



# SLOVENSKI STANDARD SIST EN 12715:2021

01-januar-2021

Nadomešča:  
SIST EN 12715:2002

---

## Izvedba posebnih geotehničnih del - Injektiranje

Execution of special geotechnical work - Grouting

Ausführung von Arbeiten im Spezialtiefbau - Injektionen

Exécution des travaux géotechniques spéciaux - Injection

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

Ta slovenski standard je istoveten z: **EN 12715:2020**

<https://standards.iteh.ai/catalog/standards/sist/1d444a9c-64cb-439e-89a5-1d7731a568a3/sist-en-12715-2021>

---

### ICS:

93.020	Zemeljska dela. Izkopavanja. Gradnja temeljev. Dela pod zemljo	Earthworks. Excavations. Foundation construction. Underground works
--------	--	---

**SIST EN 12715:2021**

**en,fr,de**

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

SIST EN 12715:2021

<https://standards.iteh.ai/catalog/standards/sist/1d444a9c-64cb-439e-89a5-1d7731a568a3/sist-en-12715-2021>

EUROPEAN STANDARD

EN 12715

NORME EUROPÉENNE

EUROPÄISCHE NORM

November 2020

ICS 93.020

Supersedes EN 12715:2000

English Version

## Execution of special geotechnical work - Grouting

Exécution des travaux géotechniques spéciaux -  
InjectionAusführung von Arbeiten im Spezialtiefbau -  
Injektionen

This European Standard was approved by CEN on 14 September 2020.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

[SIST EN 12715:2021](https://standards.iteh.ai/catalog/standards/sist/1d444a9c-64cb-439e-89a5-1d7731a568a3/sist-en-12715-2021)

<https://standards.iteh.ai/catalog/standards/sist/1d444a9c-64cb-439e-89a5-1d7731a568a3/sist-en-12715-2021>



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

<b>Contents</b>	<b>Page</b>
European foreword .....	4
Introduction .....	5
1 Scope.....	6
2 Normative references.....	7
3 Terms and definitions.....	8
4 Information needed for the execution of work.....	10
4.1 General.....	10
4.2 Specific information.....	11
5 Ground investigation.....	12
5.1 General.....	12
5.2 Specific requirements .....	12
5.3 Field grouting trials and field tests .....	13
6 Materials and products.....	13
6.1 General.....	13
6.2 Grout materials.....	13
6.2.1 Cement and hydraulic binders.....	13
6.2.2 Clay materials.....	13
6.2.3 Sands, gravels and fillers.....	14
6.2.4 Water.....	14
6.2.5 Chemical products and admixtures.....	14
6.3 Grouts.....	14
6.3.1 General.....	14
6.3.2 Suspensions .....	15
6.3.3 Solutions.....	15
6.3.4 Mortars .....	16
7 Execution design .....	16
7.1 General.....	16
7.2 Execution design basis and objectives .....	16
7.3 Grouting principles and methods .....	17
7.3.1 Grouting without ground displacement (non-displacement grouting) .....	17
7.3.2 Grouting with ground displacement (displacement grouting) .....	18
7.4 Grout.....	20
7.4.1 Type and composition.....	20
7.4.2 General considerations.....	20
7.4.3 Parameters and criteria .....	21
7.4.4 Applicability.....	21
7.5 Grout placement.....	21
7.5.1 General.....	21
7.5.2 Drilling layout and borehole design .....	22
7.5.3 Grouting sequence.....	23
7.5.4 Grouting pressure.....	23
7.6 Monitoring and control criteria.....	23
8 Execution .....	24

8.1	General .....	24
8.2	Drilling.....	24
8.3	Grout preparation .....	25
8.3.1	Storage.....	25
8.3.2	Batching and mixing.....	25
8.3.3	Pumping and delivery .....	25
8.4	Grout placement.....	26
8.4.1	General .....	26
8.4.2	Packers .....	27
8.4.3	Special conditions.....	27
8.5	Grouting sequences.....	27
9	Supervision, testing and monitoring .....	28
9.1	General .....	28
9.2	Testing.....	28
9.3	Monitoring and control .....	29
9.3.1	General .....	29
9.3.2	Environmental impact .....	29
9.3.3	Validation of the grouting works .....	29
9.3.4	Monitoring of displacement.....	30
9.3.5	Drilling.....	30
9.3.6	Grout.....	30
10	Records.....	30
10.1	General .....	30
10.2	Documents produced on site .....	31
11	Special requirements (environment, site safety) .....	32
11.1	General .....	32
11.2	Health and safety .....	32
11.3	Environmental protection .....	33
Annex A (informative) Glossary .....		34
Annex B (informative) Grout types — Processes and their characterizing.....		43
Annex C (informative) Measurement of grout parameters .....		46
Bibliography .....		51

**EN 12715:2020 (E)****European foreword**

This document (EN 12715:2020) has been prepared by Technical Committee CEN/TC 288 “Execution of special geotechnical works”, the secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by May 2021, and conflicting national standards shall be withdrawn at the latest by month year May 2021.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 12715:2000. The main changes compared to the previous edition are listed below:

- generally, the text has been checked and brought up to date;
- the Scope now includes Figure 1 to describe the various forms of grouting covered in this document;
- normative references updated and now include reference to EN 1997 for design;
- definitions updated and extended;
- “site investigation” now changed to “ground investigation” in line with EN1997;
- “design considerations” changed to “execution design” in line with EN1997;
- Table 3 moved to Annex B;
- Table 1 included in Clause 8 relating to revised grouting strategies;
- Table B.2 added to characterise grouts;
- Table 5 and A.1 replaced by Annex C with more types of testing included and standards referenced;
- Glossary reviewed and updated;
- Bibliography updated.

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

## Introduction

The general scope of TC 288 is the standardization of the execution procedures for geotechnical works (including testing and control methods) and of the required material properties. WG18 has been charged to revise EN 12715:2000, with the subject area of grouting.

The design, planning and execution of grouting call for experience and knowledge in this specialized field. The execution phase requires skilled and qualified personnel and the present document cannot replace the expertise of specialist contractor.

This document has been prepared to complement EN 1997-1, and EN 1997-2.

Until EN 1997-3<sup>1</sup> is published, the design of grouting works is not clearly defined. In particular, the boundary between design under the proposed EN 1997-3 and design as part of the execution of grouting works has not been determined. This document has therefore adopted a distinction between execution design, i.e. the design of grouting methodology and the other phases of design.

Clause 7 “Execution Design” of this document expands on design only where necessary for the execution.

This document provides coverage of the construction and supervision requirements for grouting works.

## iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 12715:2021](https://standards.iteh.ai/catalog/standards/sist/1d444a9c-64cb-439e-89a5-1d7731a568a3/sist-en-12715-2021)

<https://standards.iteh.ai/catalog/standards/sist/1d444a9c-64cb-439e-89a5-1d7731a568a3/sist-en-12715-2021>

---

<sup>1</sup> Under preparation. Stage at the time of publication: prEN 1997-3.

## EN 12715:2020 (E)

## 1 Scope


This document is applicable to the execution, testing and monitoring of geotechnical grouting work.

Grouting for geotechnical purposes (geotechnical grouting) is a process in which the remote placement of a pumpable material in the ground is indirectly controlled by adjusting its rheological characteristics and by the manipulation of the placement parameters (pressure, volume and the flow rate).

The following principles and methods of geotechnical grouting are covered by this document:

- displacement grouting (compaction and compensation grouting);
- grouting without displacement of the host material (permeation, fissure/contact grouting, bulk filling).

Figure 1 illustrates the various injection methods associated with these two principles.

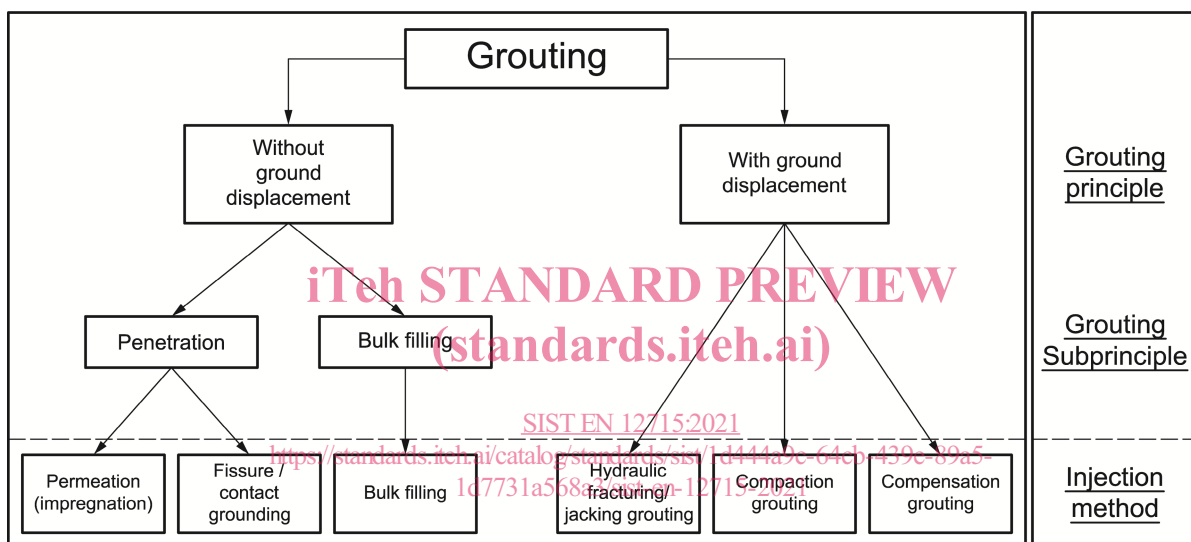

**NOTE** The term consolidation grouting is sometimes used to emphasize an improvement in the strength or deformation characteristics of a soil or rock mass, with the aim that it does not undergo any unacceptable deformation. The term compensation grouting is used when the objective of grouting is to concurrently compensate for ground loss.

**Figure 1 — Grouting principles and methods**

The principal objectives of geotechnical grouting are:

- the modification of the hydraulic/hydrogeological characteristics of the ground;
- the modification of the mechanical properties of the ground;
- the filling of natural cavities, mine workings, voids adjacent to structures;
- inducing displacement to compensate for ground loss or to stabilize and lift footings, slabs and pavements.

Specialized grouting activities, generally associated with structural and/or emergency works, are not covered by this document.

The execution, testing and monitoring of jet grouting work is not covered by this document and is covered by EN 12716.



## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 197-1, *Cement - Part 1: Composition, specifications and conformity criteria for common cements*

EN 197-2, *Cement - Part 2: Assessment and verification of constancy of performance*

EN 480-1, *Admixtures for concrete, mortar and grout - Test methods - Part 1: Reference concrete and reference mortar for testing*

EN 480-2, *Admixtures for concrete, mortar and grout - Test methods - Part 2: Determination of setting time*

EN 480-4, *Admixtures for concrete, mortar and grout - Test methods - Part 4: Determination of bleeding of concrete*

EN 480-5, *Admixtures for concrete, mortar and grout - Test methods - Part 5: Determination of capillary absorption*

EN 480-6, *Admixtures for concrete, mortar and grout - Test methods - Part 6: Infrared analysis*

EN 480-8, *Admixtures for concrete, mortar and grout - Test methods - Part 8: Determination of the conventional dry material content*

EN 480-10, *Admixtures for concrete, mortar and grout - Test methods - Part 10: Determination of water soluble chloride content*

EN 480-11, *Admixtures for concrete, mortar and grout - Test methods - Part 11: Determination of air void characteristics in hardened concrete*

EN 480-12, *Admixtures for concrete, mortar and grout - Test methods - Part 12: Determination of the alkali content of admixtures*

EN 934-1, *Admixtures for concrete, mortar and grout - Part 1: Common requirements*

EN 934-3, *Admixtures for concrete, mortar and grout - Part 3: Admixtures for masonry mortar - Definitions, requirements, conformity and marking and labelling*

EN 934-4, *Admixtures for concrete, mortar and grout - Part 4: Admixtures for grout for prestressing tendons - Definitions, requirements, conformity, marking and labelling*

EN 934-6, *Admixtures for concrete, mortar and grout - Part 6: Sampling, assessment and verification of the constancy of performance*

EN 1997-1, *Eurocode 7: Geotechnical design - Part 1: General rules*

EN 1997-2, *Eurocode 7 - Geotechnical design - Part 2: Ground investigation and testing*

EN 16228-6, *Drilling and foundation equipment - Safety - Part 6: Jetting, grouting and injection equipment*

EN ISO 22282 (series), *Geotechnical investigation and testing - Geohydraulic testing (ISO 22282 series)*

## EN 12715:2020 (E)

### 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

NOTE The definitions given in this chapter cover only the most important terms involved in geotechnical grouting. Further definitions are given in the glossary in Annex A.

#### 3.1

##### **bulk filling**

placement of grout to fill subterranean cavities

#### 3.2

##### **compaction grouting**

injection of a low slump mortar or comparatively stiff (viscous and cohesive) particulate grout into the soil to compact/densify it by expansion alone

Note 1 to entry: Expanding grouts can be used to cause compaction but may also permeate the ground.

#### 3.3

##### **contact grouting**

injection of grout into the interface between man-made structures and the ground

#### 3.4

##### **displacement grouting**

injection of grout into a host medium in such a manner as to deform, compress, or displace the ground

#### 3.5

##### **effective pressure**

pressure governing the flow in the ground, estimated from the grouting pressure considering the sum of all head losses and head gains in the injection system and the ground

#### 3.6

##### **fissure grouting**

injection of grout into fissures, joints, fractures and discontinuities in rock

#### 3.7

##### **grout**

pumpable material (suspension, solution or resins, emulsion or mortar), introduced into soil or rock, which stiffens and sets with time

#### 3.8

##### **grouting pressure**

##### **working pressure**

pressure applied during the grouting process and measured at defined locations, usually at the pump or the borehole collar

#### 3.9

##### **hydraulic fracturing**

injection of water or grout that creates a new localized fracture in the ground

**3.10****hydraulic jacking  
hydrojacking**

injection of water or grout within existing fractures in the ground to enhance the grout spread and penetrability

**3.11****penetration grouting**

grout injection of joints or fractures in rock, or pore spaces in soil, without displacing the ground

Note 1 to entry: The term includes permeation (impregnation), fissure and contact grouting.

**3.12****permeation grouting  
impregnation grouting**

replacement of interstitial water or gas of a porous medium with a grout

**3.13****non-displacement grouting**

injection of grout into a host medium in such a manner as not to deform, compress, or displace the ground

Note 1 to entry: The term includes penetration grouting and bulk filling.

**3.14****bleed**

process by which water forms a separate segregation phase from the grout under gravity or pressure

**3.15****stable suspension**

ability of a suspension to minimise bleed and segregation and retain its original properties under pressure

**3.16****field grouting trial**

trial executed in order to define or validate a grouting methodology

**3.17****hydraulic binder**

all cements and similar products used in aqueous suspensions to produce grout

**3.18****fine**

hydraulic binders or cements that are characterized by a particle size  $d_{95}$  of less than 40  $\mu\text{m}$

**3.19****microfine**

hydraulic binders or cements that are characterized by a particle size  $d_{95}$  of less than 20  $\mu\text{m}$

**3.20****ultrafine**

hydraulic binders or cements that are characterized by a particle size  $d_{95}$  of less than 10  $\mu\text{m}$

iTeh STANDARD PREVIEW  
(standards.iteh.ai)

SIST EN 12715:2021

<https://standards.iteh.ai/catalog/standards/sist/1d444a9c-64cb-439e-89a5-3c71e384d4e3/sist-12715-2021>

**EN 12715:2020 (E)****3.21****additive**

<admixture or addition> any grout ingredient other than the basic components of a grout mix (water, aggregates, or cementitious material), which is used to modify the properties of the fluid and the hardened grout

**3.22****mortars**

highly particulate grout containing sand and fine aggregates, commonly a concrete with an aggregate size of less than 4 mm

**3.23****split spacing**

procedure by which additional grout injection holes are located midway between previously grouted holes

**3.24****sleeved pipe****TAM**

injection pipe perforated at regular intervals where the perforations are covered externally by sleeves acting as non-return valves

Note 1 to entry: TAM is the abbreviation for tube á manchette.

**iTeh STANDARD PREVIEW**  
(standards.iteh.ai)

**4 Information needed for the execution of work****4.1 General**

SIST EN 12715:2021

**4.1.1** All information required to execute the works shall be provided in advance.

1d7731a568a3/sist-en-12715-2021

**4.1.2** This information should include the following, where relevant:

- any legal or statutory restrictions;
- the location of main grid lines for setting out;
- the conditions of structures, roads, services, etc. adjacent to the work, including any necessary surveys;
- a suitable quality management system, including supervision, monitoring and testing;
- the geometry of the site (boundary conditions, topography, access, slopes, headroom restrictions, etc.);
- the existing underground structures, services, known contaminations, and archaeological constraints;
- the environmental restrictions, including noise, vibration, pollution; and
- the future or ongoing activities such as dewatering, tunnelling, deep excavations on or adjacent to the worksite.

## 4.2 Specific information

4.2.1 The specific information shall cover, where relevant:

- execution specifications;
- previous use of the site;
- adjacent foundations (types, loads and geometry);
- geotechnical information and data as specified in Clause 5;
- presence of obstructions in the ground (old masonry, anchors, concrete, blocks and boulders, etc.);
- presence of headroom restrictions;
- presence of archaeological remains;
- presence of natural and/or manmade cavities (mines, etc.);
- presence of polluted ground and type, extent and degree of pollution;
- any specific requirements for the grouting works, in particular those pertaining to tolerances, quality of materials, methods and frequency of testing;
- where available, previous experience with grouting works on or adjacent to the site;
- proposed adjacent enabling or advance works that could affect the grouting works;
- functional requirements for instrumentation and monitoring of potentially affected structures;
- necessity, extent, procedure and content for any survey on the conditions of structures, roads, services, etc. adjacent to the works area.

4.2.2 Required site surveys shall be carried out and be available prior to the commencement of the works.

NOTE The results are useful to define the threshold values for any movement which affect adjacent structures by the works area construction.

4.2.3 Any additional or deviating requirements to this document shall be established and agreed with the relevant parties or authorities before the commencement of the works and the quality control system shall be suitably amended.

## EN 12715:2020 (E)

**5 Ground investigation****5.1 General**

Any ground investigation shall fulfil the requirements of EN 1997-2 and the relevant national documents.

**5.2 Specific requirements**

**5.2.1** Relevant experience of the execution of comparable grouting works under similar conditions and/or in the vicinity of the site should be taken into account when determining the extent of the ground investigation (reference to relevant experience is permitted if appropriate means of verification were taken).

**5.2.2** The ground investigation report shall be sufficient for the execution of the grouting works.

**5.2.3** If during grouting the ground conditions differ from those in the ground investigation report this shall be reported.

**5.2.4** For the execution of grouting works, the ground investigation report should contain the following specific information:

- the relevant physical and chemical characteristics of the ground and groundwater;
- the presence of any anisotropies or permeable horizons which could influence the grouting works;
- the orientation, frequency, and aperture of rock joints and the composition and nature of any infill material;
- the location and nature of filled or open cavities;
- the presence of obstructions that require special drilling and grouting methods or equipment;
- the presence and characteristics of ground that is likely to loosen, soften or become unstable, dissolve, collapse or swell as a result of drilling or grouting;
- the presence of strata with high groundwater velocities and/or permeabilities.

**5.2.5** Where relevant, the following specific drilling information should be recorded:

- location and cause of core losses;
- unstable zones and stabilization measures taken;
- water level at the beginning and end of a run, zones of water loss and gain, measurements of return water, water colour and changes in colour;
- recording of drill parameters in the case of destructive boreholes;
- rate of advance.

**5.2.6** Permeability testing shall be done in accordance with EN ISO 22282 series.

### 5.3 Field grouting trials and field tests

**5.3.1** Field grouting trials should be executed where ground investigations and local or comparable experience is insufficient to support or justify the effectiveness of the grouting project.

NOTE Some indication of *in situ* groutability can be obtained by permeating reconstituted soil samples with trial grouts, under laboratory conditions.

**5.3.2** The trials should provide information on borehole spacing, grout type, procedure and parameters.

**5.3.3** Detailed records shall be kept of each operation performed during the grouting trials.

## 6 Materials and products

### 6.1 General

**6.1.1** All grout components and grouts shall comply with the specifications for the works.

**6.1.2** The suitability of the grout constituents and their combination with the ground shall be considered and investigated if necessary.

**6.1.3** Once established, the sources of grout materials shall not be changed without prior compliance verification or testing.

### 6.2 Grout materials

(standards.iteh.ai)

#### 6.2.1 Cement and hydraulic binders

SIST EN 12715:2021

**6.2.1.1** Cements shall comply with EN 197-1 and EN 197-2. Cements that do not comply with EN 197-1 may be used if considered acceptable for the grouting purpose envisaged.

**6.2.1.2** Testing of cements and other binders shall be in accordance with their appropriate standard.

**6.2.1.3** When selecting the type of hydraulic binder for grout, its grain size distribution shall be evaluated in relation to the dimensions of the rock apertures or interstitial voids of the ground to be treated.

**6.2.1.4** Pozzolans, blast furnace slag, silica fume and fly ash from thermal power plants or any other reactive material may be used in grouts.

#### 6.2.2 Clay materials

**6.2.2.1** Natural clays, activated or modified bentonites can be added to cement-based grouts in order to reduce bleeding and/or filtration under pressure, to vary the viscosity and cohesion (yield) of the grout, or to improve the pumpability and/or penetrability of the grout.

**6.2.2.2** The mineralogy, particle size, water content, and Atterberg limits of the clay should be known.

**6.2.2.3** The effect of the clay materials on the grout properties should be evaluated if it has not been established by comparable experience.