



SLOVENSKI STANDARD
SIST EN 1452-4:2000

01-junij-2000

7 Yj b]g]ghYa]]n'dc`ja Yfb] `a Uhf]Ucj `nUcg_fVc`n`j cXc`!`BYa Y U b'dc`j]]b]_`cf]X
fDJ7!! Ł!(' "XY. JYbh]j]b'dca cÿbUcdfYa U

Plastics piping systems for water supply - Unplasticized poly(vinyl chloride) (PVC-U) -
Part 4: Valves and ancillary equipment

Kunststoff-Rohrleitungssysteme für die Wasserversorgung - Weichmacherfreies
Polyvinylchlorid (PVC-U) - Teil 4: Armaturen und Zubehör

Systemes de canalisations en plastique pour alimentation en eau - Poly(chlorure de
vinyle) non plastifié (PVC-U) - Partie 4: Robinets et équipements auxiliaires

<https://standards.iteh.ai/catalog/standards/sist/fa55f666-0bae-4f4b-8e5b-974035533313/sist-en-1452-4-2000>

Ta slovenski standard je istoveten z: EN 1452-4:1999

ICS:

23.060.01	Ventili na splošno	Valves in general
91.140.60	Sistemi za oskrbo z vodo	Water supply systems

SIST EN 1452-4:2000

en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1452-4:2000

<https://standards.iteh.ai/catalog/standards/sist/fa55f666-0bae-4f4b-8e5b-974035533313/sist-en-1452-4-2000>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 1452-4

June 1999

ICS 23.060.00

English version

**Plastics piping systems for water supply - Unplasticized
poly(vinyl chloride) (PVC-U) - Part 4: Valves and ancillary
equipment**

Systèmes de canalisations en plastique pour alimentation
en eau - Poly(chlorure de vinyle) non plastifié (PVC-U) -
Partie 4: Robinets et équipements auxiliaires

Kunststoff-Rohrleitungssysteme für die Wasserversorgung
- Weichmacherfreies Polyvinylchlorid (PVC-U) - Teil 4:
Armaturen und Zubehör

This European Standard was approved by CEN on 2 July 1998.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

<https://standards.iteh.ai/catalog/standards/sist/fa55f666-0bae-44b-8e5b-974035533313/sist-en-1452-4-2000>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Central Secretariat: rue de Stassart, 36 B-1050 Brussels

Contents

	Page
Foreword	4
Introduction	5
1 Scope	6
2 Normative references	6
3 Definitions, symbols and abbreviations	7
4 Material	7
4.1 Valve bodies and ancillaries	7
4.2 Additional components	9
5 General characteristics	9
5.1 Appearance	9
5.2 Colour	9
5.3 Opacity	9
6 Geometrical characteristics	9
6.1 Measurement of dimensions	9
6.2 Nominal diameters	10
6.3 Valves	10
6.4 Ancillary equipment: Tapping saddles	17
7 Classification and operating conditions	21
7.1 Classification	21
7.2 Determination of the allowable operating pressure PFA for water up to 45 °C	22
8 Mechanical characteristics	22
8.1 Resistance to internal pressure of valve bodies	22
8.2 Crushing test	23
8.3 Endurance properties	23
8.4 Functional properties	24
9 Physical characteristics	25
10 Chemical characteristics	26
11 Sealing rings	26
12 Adhesives	26
13 Performance requirements	26
14 Marking	26
14.1 General	26
14.2 Minimum required marking	27
14.3 Additional marking	27



For the English version :

For pipes and fittings which have conformed to the relevant national standard before 1999-06-23, as shown by the manufacturer or by a certification body, the national standard may continue to be applied until the 2001-06-30.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by 1999-12-31. Conflicting national standards shall be withdrawn at the latest by 2001-06-30.

Pour la version française :

Pour les tubes et les raccords dont la conformité à la norme nationale correspondante avant 1999-06-23 a été démontrée par le fabricant ou par un organisme certificateur, la norme nationale peut continuer à être appliquée jusqu'à 2001-06-30.

Cette norme européenne devra recevoir le statut de norme nationale, soit par publication d'un texte identique, soit par entérinement, au plus tard le 1999-12-31. Toutes les normes nationales en contradiction devront être retirées au plus tard le 2001-06-30.

Für die deutsche Fassung :

STANDARD PREVIEW
(standards.iteh.ai)

Auf Rohre und Formstücke, die vor 1999-06-23 der entsprechenden nationalen Norm entsprochen haben, wie durch den Hersteller oder eine Zertifizierungsstelle ausgewiesen, darf die nationale Norm bis 2001-06-30 weiter angewendet werden.

<https://standards.iteh.ai/catalog/standards/sist/1a551666-0bac-44fb-8e5b-974035533313/sist-en-1452-4-2000>

Diese Europäische Norm muß den Status einer nationalen Norm erhalten, entweder durch Veröffentlichung eines identischen Textes oder durch Anerkennung bis 1999-12-31. Etwaige entgegenstehende nationale Normen müssen bis 2001-06-30 zurückgezogen werden.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1452-4:2000

<https://standards.iteh.ai/catalog/standards/sist/fa55f666-0bae-4f4b-8e5b-974035533313/sist-en-1452-4-2000>

Annex A (normative) Imperial(inch)-sized valves and ancillary equipment 28
Annex B (informative) Bibliography 30

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1452-4:2000

<https://standards.iteh.ai/catalog/standards/sist/fa55f666-0bae-4f4b-8e5b-974035533313/sist-en-1452-4-2000>

Foreword

This European Standard has been prepared by Technical Committee CEN/TC 155 "Plastics piping systems and ducting systems", the secretariat of which is held by NNI. It has been prepared with the cooperation of Eureau and in liaison with CEN/TC 164 "Water supply".

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by december 1999, and conflicting national standards shall be withdrawn at the latest by June 2001.

This European Standard has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

This standard is a Part of a System Standard for plastics piping systems of a particular material for a specified application. There are a number of such System Standards.

System Standards are based on the results of the work undertaken in ISO/TC 138 "Plastics pipes, fittings and valves for the transport of fluids", which is a Technical Committee of the International Organization for Standardization (ISO).

They are supported by separate standards on test methods to which references are made throughout the System Standard.

The System Standards are consistent with general standards on functional requirements and on recommended practice for installation.

EN 1452 consists of the following Parts, under the general title *Plastics piping systems for water supply — Unplasticized poly(vinyl chloride) (PVC-U)*:

- Part 1: *General*
- Part 2: *Pipes*
- Part 3: *Fittings*
- Part 4: *Valves and ancillary equipment (this standard)*
- Part 5: *Fitness for purpose of the system*
- Part 6: *Guidance for installation (ENV)*
- Part 7: *Guidance for assessment of conformity (ENV)*

This Part of EN 1452 includes the following annexes:

- Annex A (normative): Imperial(inch)-sized valves and ancillary equipment
- Annex B (informative): Bibliography.

At the date of publication of this standard, System Standards for piping systems of other plastics materials used for the same application are the following:

NOTE All listed System Standards have reached the Enquiry stage or are under preparation.

EN 1796, *Plastics piping systems for water supply with or without pressure — Glass-reinforced thermosetting plastics (GRP) based on polyester resin (UP)*

EN 12201, *Plastics piping systems for water supply — Polyethylene (PE)*

Introduction

The System Standard, of which this is Part 4, specifies the requirements for a piping system and its components made from unplasticized poly(vinyl chloride) (PVC-U). The piping system is intended to be used for water supply.

In respect of potential adverse effects on the quality of water intended for human consumption, caused by the products covered by this standard:

- 1) this standard provides no information as to whether the product may be used without restriction in any of the Member States of the EU or EFTA;
- 2) it should be noted that, while awaiting the adoption of verifiable European criteria, existing national regulations concerning the use and/or the characteristics of this product remain in force.

For material, pipes and fittings, requirements and test methods are specified in Part 1, Part 2 and Part 3 of EN 1452. Characteristics for fitness for purpose (mainly for joints) are covered in Part 5. Guidance for installation is given in ENV 1452-6. ENV 1452-7 covers a guidance for assessment of conformity.

This Part of EN 1452 covers the characteristics of valves and ancillary equipment.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1452-4:2000

<https://standards.iteh.ai/catalog/standards/sist/fa55f666-0bae-4f4b-8e5b-974035533313/sist-en-1452-4-2000>

1 Scope

This Part of EN 1452 specifies the characteristics of valves and ancillary equipment made from unplasticized poly(vinyl chloride) (PVC-U) for piping systems in the field of water supply.

It also specifies the test parameters for the test methods referred to in this standard.

In conjunction with Parts 1, 2, 3 and 5 of EN 1452 and ENV 1452-7 it is applicable to PVC-U valves and ancillary equipment with components of PVC-U, other plastics and non-plastics materials intended to be used for the following:

- a) water mains and services buried in ground;
- b) conveyance of water above ground for both outside and inside buildings;

for the supply of water under pressure at approximately 20 °C (cold water) intended for human consumption and for general purposes.

This standard is also applicable to valves and ancillaries for the conveyance of water up to and including 45 °C. For temperatures between 25 °C and 45 °C figure A.1 of EN 1452-2:1999 applies.

This standard is applicable to tapping saddles and valves of the following types:

- valves for solvent cementing;
- valves for elastomeric ring seal joints;
- valves for flanged joints.

iTeh STANDARD PREVIEW (standards.iteh.ai)

2 Normative references

This Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies.

prEN 496, *Plastics piping and ducting systems – Plastics pipes and fittings – Measurement of dimensions and visual inspection of surfaces*

EN 578, *Plastics piping systems — Plastics pipes and fittings — Determination of the opacity*

EN 727, *Plastics piping and ducting systems — Thermoplastics pipes and fittings — Determination of Vicat softening temperature (VST)*

EN 763:1994, *Plastics piping and ducting systems — Injection-moulded thermoplastics fittings — Test method for visually assessing effects of heating*

EN 802, *Plastics piping and ducting systems — Injection-moulded thermoplastics fittings for pressure piping systems — Test method for maximum deformation by crushing*

EN 917:1997, *Plastics piping systems — Thermoplastics valves — Test methods for resistance to internal pressure and leaktightness*

EN 921, *Plastics piping systems — Thermoplastics pipes — Determination of resistance to internal pressure at constant temperature*

EN 1452-1, *Plastics piping systems for water supply — Unplasticized poly(vinyl chloride) (PVC-U) — Part 1: General*

EN 1452-2:1999, *Plastics piping systems for water supply — Unplasticized poly(vinyl chloride) (PVC-U) — Part 2: Pipes*

EN 1452-3:1999, *Plastics piping systems for water supply — Unplasticized poly(vinyl chloride) (PVC-U) — Part 3: Fittings*

- EN 1452-5, *Plastics piping systems for water supply — Unplasticized poly(vinyl chloride) (PVC-U) — Part 5: Fitness for purpose of the system*
- ENV 1452-7, *Plastics piping systems for water supply — Unplasticized poly(vinyl chloride) (PVC-U) — Part 7: Guidance for the assessment of conformity*
- EN 12107, *Plastics piping systems — Injection-moulded thermoplastics fittings, valves and ancillary equipment — Determination of the long-term hydrostatic strength of thermoplastics materials for injection-moulding of piping components*
- EN 28233, *Thermoplastics valves — Torque — Test method (ISO 8233:1988)*
- EN 28659, *Thermoplastics valves — Fatigue strength — Test method (ISO 8659:1989)*
- EN ISO 12162, *Thermoplastics materials for pipes and fittings for pressure applications — Classification and designation — Overall service (design) coefficient (ISO 12162:1995)*
- ISO 7-1, *Pipe threads where pressure-tight joints are made on the threads — Part 1: Dimensions, tolerances and designation*
- ISO/TR 9080:1992, *Thermoplastics pipes for the transport of fluids — Methods of extrapolation of hydrostatic stress rupture data to determine the long-term hydrostatic strength of thermoplastics pipe materials*
- ISO/DIS 12092:1994, *Fittings, valves and other piping system components of unplasticized poly(vinyl chloride) (PVC-U) for pipes under pressure — Resistance to internal pressure — Test method*

3 Definitions, symbols and abbreviations

For the purposes of this standard, the definitions, symbols and abbreviations given in EN 1452-1 apply.

4 Material

SIST EN 1452-4:2000

<https://standards.iteh.ai/catalog/standards/sist/fa55f666-0bae-4f4b-8e5b-974035533313/sist-en-1452-4-2000>

4.1 Valve bodies and ancillaries

4.1.1 General

The material of the valve bodies and the main components of the ancillaries which are intended to be in contact with the conveyed water shall be made from PVC-U and shall conform to EN 1452-1 and to the requirements given in 4.1.2 to 4.1.4.

4.1.2 MRS-value

The material of the valve bodies and the ancillaries shall be evaluated according to Method II of ISO/TR 9080:1992¹⁾, where a pressure test is made in accordance with EN 12107 (together with EN 921), to find the LCL. The MRS-value shall be derived from the LCL and the material shall be classified by the compound manufacturer in accordance with EN ISO 12162.

Where there is available long-term experience with the effect of a change in material/compound, it is not necessary to re-evaluate the MRS. In this case the values determined with 5 test pieces at 20 °C and 60 °C during 1000 h to 5000 h shall be located on or above the 97,5 % LCL long-term characteristic curve established prior to the material/compound change.

1) In ISO/TC 138/SC 5 a new extrapolation method is under development, which is intended to replace ISO/TR 9080.

4.1.3 Designation of injection-moulded material

The material of the valve bodies and main components of the ancillaries shall be designated as PVC-U, unless the material has an MRS of not less than 25 MPa, in which case the material shall be designated as PVC-UH.

4.1.4 Strength of injection-moulded material

When pressure tested in accordance with the procedure described in EN 12107, using injection-moulded tubular test pieces conforming to figure 1, the material shall conform to the requirements given in table 1.

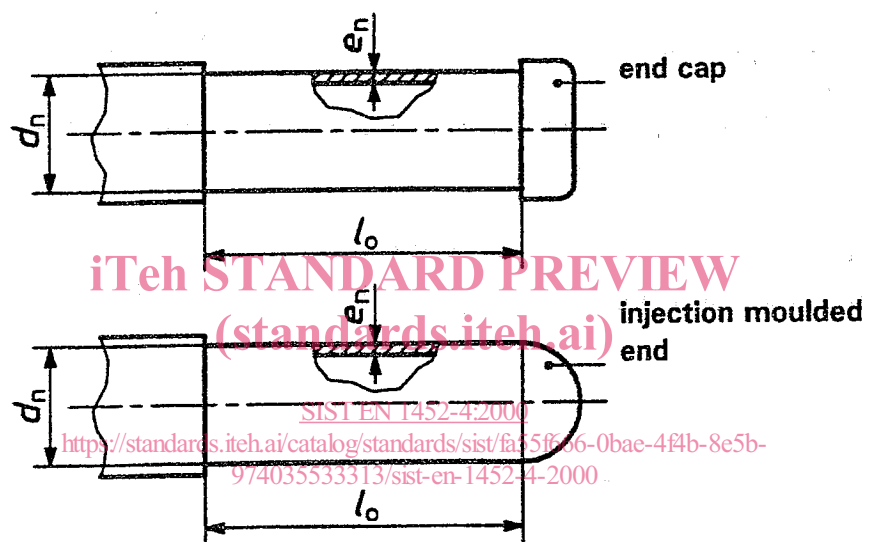


Figure 1 — Free length, l_0 , of injection-moulded test pieces