



SLOVENSKI STANDARD
SIST EN 771-4:2011+A1:2015

01-oktober-2015

Nadomešča:
SIST EN 771-4:2011

Specifikacija za zidake - 4. del: Zidaki iz avtoklaviranega celičnega betona

Specification for masonry units - Part 4: Autoclaved aerated concrete masonry units

Festlegungen für Mauersteine - Teil 4: Porenbetonsteine

iTeh STANDARD PREVIEW
Spécifications pour éléments de maçonnerie - Partie 4: Éléments de maçonnerie en
béton cellulaire autoclavé **(standards.iteh.ai)**

Ta slovenski standard je istoveten z: EN 771-4:2011+A1:2015
SIST EN 771-4:2011+A1:2015
http://www.sist.si/log/standards/771-4:2011+A1:2015-
ef4184c29662/sist-en-771-4-2011a1-2015

ICS:

91.100.30 Beton in betonski izdelki Concrete and concrete products

SIST EN 771-4:2011+A1:2015 **en,fr,de**

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 771-4:2011+A1:2015](https://standards.iteh.ai/catalog/standards/sist/05a50c8c-09f5-4292-a662-efa184c29662/sist-en-771-4-2011a1-2015)

<https://standards.iteh.ai/catalog/standards/sist/05a50c8c-09f5-4292-a662-efa184c29662/sist-en-771-4-2011a1-2015>

EUROPEAN STANDARD

EN 771-4:2011+A1

NORME EUROPÉENNE

EUROPÄISCHE NORM

August 2015

ICS 91.100.30

Supersedes EN 771-4:2011

English Version

**Specification for masonry units - Part 4: Autoclaved aerated
concrete masonry units**Spécifications pour éléments de maçonnerie - Partie 4:
Éléments de maçonnerie en béton cellulaire autoclavé

Festlegungen für Mauersteine - Teil 4: Porenbetonsteine

This European Standard was approved by CEN on 17 March 2011 and includes Amendment 1 approved by CEN on 11 January 2015.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

[SIST EN 771-4:2011+A1:2015](https://standards.iteh.ai/catalog/standards/sist/05a50c8c-09f5-4292-a662-ef184c29662/sist-en-771-4-2011a1-2015)

<https://standards.iteh.ai/catalog/standards/sist/05a50c8c-09f5-4292-a662-ef184c29662/sist-en-771-4-2011a1-2015>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

European foreword	4
1 Scope	5
2 Normative references	5
3 Terms and definitions	6
4 Materials and manufacture	8
4.1 General	8
4.2 Materials of manufacture	8
5 Requirements for AAC masonry units	8
5.1 General	8
5.2 Dimensions and tolerances	8
5.2.1 Dimensions	8
5.2.2 Tolerances	9
5.3 Configuration	10
5.4 Density	11
5.4.1 Gross dry density	11
5.4.2 Net dry density	11
5.4.3 Limit deviations	12
5.5 Compressive strength	12
5.6 Thermal properties	12
5.7 Durability	12
5.8 Moisture movement	13
5.9 Water vapour permeability	13
5.10 Water absorption	13
5.11 Reaction to fire	13
5.12 Shear bond strength	13
5.12.1 General	13
5.12.2 Declaration based on fixed values	14
5.12.3 Declaration based on tests	14
5.13 Flexural bond strength	14
5.14 Dangerous substances	14
6 Description, designation and classification of AAC masonry units	14
6.1 Description and designation	14
6.2 Classification	15
7 Marking	15
8 Assessment and verification of constancy of performance (AVCP) \square_{A1}	15
8.1 General	15
8.2 Product type determination	16
8.3 Factory production control	17
8.3.1 General	17
8.3.2 Testing and measuring equipment	17
8.3.3 Production equipment	17
8.3.4 Raw materials	17
8.3.5 Production process	17
8.3.6 Finished product testing	18
8.3.7 Statistical techniques	18
8.3.8 Marking and stock control of products	18

8.3.9	Traceability	18
8.3.10	Nonconforming products	18
Annex A	(normative) [A1] Sampling for product type determination test and for independent testing of consignments [A1]	19
A.1	General	19
A.2	Sampling procedure for an assessment of product compliance	19
A.2.1	Random sampling	19
A.2.2	Representative sampling	19
A.2.3	Dividing the sample	20
A.2.4	Number of masonry units required for testing	20
Annex B	(normative) Cutting schemes	21
B.1	Cutting scheme for producing cubes or prisms from AAC masonry units in order to determine the dry density	21
B.2	Cutting scheme for producing cubes from AAC masonry units in order to determine compressive strength	22
Annex C	(informative) Guidance on FPC frequencies	23
Annex ZA	(informative) [A1] Clauses of this European Standard addressing the provisions of the EU Construction Products Regulation [A1]	25
ZA.1	Scope and relevant characteristics	25
ZA.2	Procedure(s) for AVCP of Autoclaved Aerated Concrete masonry units	26
ZA.2.1	System(s) of AVCP	26
ZA.2.2	Declaration of performance (DoP)	28
ZA.3	CE marking and labelling	32
	Bibliography	35

EN 771-4:2011+A1:2015 (E)**European foreword**

This document (EN 771-4:2011+A1:2015) has been prepared by Technical Committee CEN/TC 125 "Masonry", the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by February 2016, and conflicting national standards shall be withdrawn at the latest by May 2017.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes A1 EN 771-4:2011 A1.

This document includes Amendment 1 approved by CEN on 2015-01-11.

The start and finish of text introduced or altered by amendment is indicated in the text by tags A1 A1.

A1 This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association and supports basic requirements for construction works of the EU Construction Products Regulation (Regulation (EU) No 305/2011).

For relationship with EU Regulation/Directive(s), see informative Annex ZA, which is an integral part of this document. A1

This European Standard also takes into account the general rules for reinforced and unreinforced masonry in Eurocode 6.

EN 771, *Specification for masonry units* consists of <https://standards.iteh.ai/catalog/standards/sist/05a50c8c-09f5-4292-a662-efa184c29662/sist-en-771-4-2011a1-2015>

- *Part 1: Clay masonry units*
- *Part 2: Calcium silicate masonry units*
- *Part 3: Aggregate concrete masonry units (Dense and light weight aggregates)*
- *Part 4: Autoclaved aerated concrete masonry units*
- *Part 5: Manufactured stone masonry units*
- *Part 6: Natural stone masonry units*

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

1 Scope

This European Standard specifies the characteristics and performance requirements of autoclaved aerated concrete (AAC) masonry units for which the main intended uses are different types of load bearing and non-load bearing applications in all forms of walling including single leaf, cavity, partitions, retaining, basement and general use below ground level, including walling for fire protection, thermal insulation, sound insulation and the fabric of chimneys (excluding chimney flue units).

A1) This European Standard includes AAC masonry units with an incorporated insulation not exposed to fire, and masonry units of an overall rectangular parallelepiped shape, specially shaped and accessory units. AAC masonry units may consist of layers of different densities where not all of the layers are loadbearing. **A1)**

A1) It provides for the assessment and verification of constancy of performance (AVCP) of the product to this European Standard.

The marking requirement for products covered by this European Standard is included. **A1)**

This European Standard does not cover the requirements for storey height panels, flue linings and masonry units with an incorporated thermal insulation material bonded to the faces of the unit susceptible to be exposed to fire. It does not specify standard sizes for autoclaved aerated concrete units nor standard work dimensions and angles of specially shaped and accessory units. It does not give permissible deviations for specially shaped and accessory units. It does not cover products intended for use as a damp proof course or the lining of a chimney.

iTeh STANDARD PREVIEW

2 Normative references (standards.iteh.ai)

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 680, *Determination of the drying shrinkage of autoclaved aerated concrete*

EN 772-1:2011, *Methods of test for masonry units — Part 1: Determination of compressive strength*

EN 772-11, *Methods of test for masonry units — Part 11: Determination of water absorption of aggregate concrete, autoclaved aerated concrete, manufactured stone and natural stone masonry units due to capillary action and the initial rate of water absorption of clay masonry units*

EN 772-13, *Methods of test for masonry units — Part 13: Determination of net and gross dry density of masonry units (except for natural stone)*

EN 772-16:2011, *Methods of test for masonry units — Part 16: Determination of dimensions*

EN 772-20, *Methods of test for masonry units — Part 20: Determination of flatness of faces of aggregate concrete, manufactured stone and natural stone masonry units*

EN 1052-2, *Methods of test for masonry — Part 2: Determination of flexural strength*

EN 1052-3, *Methods of test for masonry — Part 3: Determination of initial shear strength*

EN 1745, *Masonry and masonry products — Methods for determining thermal properties*

EN 13501-1, *Fire classification of construction products and building elements — Part 1: Classification using data from reaction to fire tests*

EN 771-4:2011+A1:2015 (E)

EN ISO 12572, *Hygrothermal performance of building materials and products — Determination of water vapour transmission properties (ISO 12572:2001)*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1**masonry unit**

prefabricated component intended for use in masonry construction

3.2**A1 autoclaved aerated concrete (AAC) masonry unit**

masonry unit manufactured from hydraulic binders such as cement and/or lime, combined with siliceous based fine material, cell generating material and water and cured with high pressure steam in autoclaves

Note 1 to entry: AAC masonry units may be provided with recesses, tongued and grooved jointing systems and other interlocking features and different hollow forms such as units with a 'U' shape or with vertical or rectangular perforation. A1

3.3**co-ordinating size**

size of the co-ordinating space allocated to a masonry unit including allowances for joints and tolerances

3.4**work size**

size of masonry unit specified for its manufacture, to which the actual size conforms within permissible deviations

3.5**actual size**

size of a masonry unit as measured

[SIST EN 771-4:2011+A1:2015
https://standards.iteh.ai/catalog/standards/sist/05a50c8c-09f5-4292-a662-efa184c29662/sist-en-771-4-2011a1-2015](https://standards.iteh.ai/catalog/standards/sist/05a50c8c-09f5-4292-a662-efa184c29662/sist-en-771-4-2011a1-2015)

3.6**regular shaped masonry unit**

masonry unit with an overall rectangular parallelepiped shape

3.7**specialty shaped masonry unit**

masonry unit which is not a rectangular parallelepiped

3.8**accessory unit**

masonry unit which is shaped to provide a particular function

3.9**interlocking features**

shaped matched projections and indentations on masonry units, e.g. tongue and groove systems

3.10**hole**

formed void which may or may not pass completely through a masonry unit

3.11**vertical perforation**

formed void which passes completely through a masonry unit perpendicular to the bed face

3.12**horizontal perforation**

formed void which passes completely through a masonry unit parallel to the bed faces

3.13**cell**

formed void which does not pass through a masonry unit

3.14**recess**

depression or indentation in one or more surfaces of a masonry unit (e.g. mortar pocket, rendering keyway)

3.15**griphole**

hole in a masonry unit to enable it to be more readily grasped and lifted by hand or by machine

3.16**declared value**

value that a manufacturer is confident of achieving, bearing in mind the precision of test and variability of the manufacturing process

3.17**Category I masonry units**

units with a declared compressive strength with a probability of failure to reach it not exceeding 5 %

NOTE

This may be determined via the mean or characteristic value.

3.18**Category II masonry units**

units not intended to comply with the level of confidence of Category I units

<https://standards.iteh.ai/catalog/standards/sist/05a50c8c-09f5-4292-a662-efa184c29662/sist-en-771-4-2011a1-2015>

3.19**normalised compressive strength of masonry units**

compressive strength of masonry units converted to the air dry compressive strength of an equivalent 100 mm wide by 100 mm high masonry unit

NOTE

See procedure given in EN 772-1:2011, Annex A.

3.20**mean compressive strength of masonry units**

arithmetic mean of the compressive strengths of masonry units

3.21**characteristic compressive strength of masonry units**

compressive strength corresponding to a 5 % fractile of the compressive strength

3.22**product group**

products from one manufacturer having common values for one or more characteristics

3.23**consignment**

shipment from the supplier

EN 771-4:2011+A1:2015 (E)**4 Materials and manufacture****4.1 General**

AAC masonry units shall be manufactured using hydraulic binders such as cement and/or lime combined with fine siliceous based material, cell-generating material and water and cured with high pressure steam in autoclaves.

[A1] NOTE The raw materials are mixed together and cast into moulds where the mix is allowed to rise and set into cakes. After this part of the process, the cake is cut into the required sizes of masonry units and cured in autoclaves. **[A1]**

4.2 Materials of manufacture

The following materials of manufacture combined with additives and agents where appropriate, may be used in the manufacturing process:

- siliceous based material;
- cement;
- lime;
- water;
- cell-generating material.

Other materials may also be included in the manufacturing process.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

5 Requirements for AAC masonry units

SIST EN 771-4:2011+A1:2015

<https://standards.iteh.ai/standards/sist/05a50c8c-09f5-4292-a662-efa184c29662/sist-en-771-4-2011a1-2015>

5.1 General

The requirements and properties specified in this standard shall be defined in terms of test methods and other procedures referred to in this European Standard.

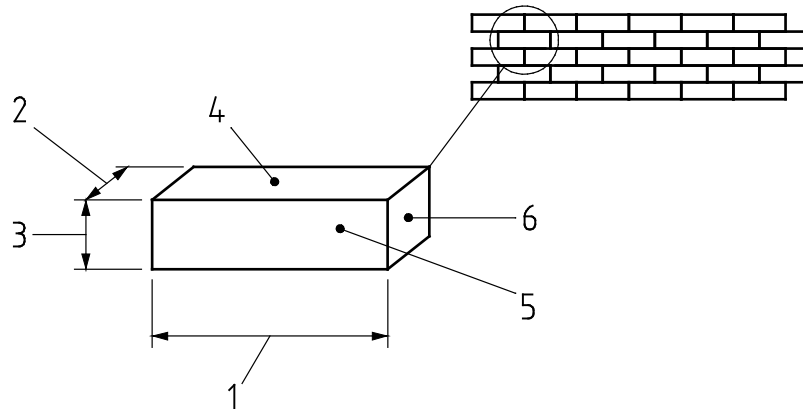
It should be noted that the test methods are not always applicable to specially shaped and accessory units (see 3.7 and 3.8).

The conformity criteria given in the following subclauses relate to **[A1]** product type determination **[A1]** (see 8.2) and, when relevant, to consignment testing (see Annex A). For the compressive strength of Category I units use a 50 % fractile ($p = 0,50$) for mean values or 5 % fractile ($p = 0,05$) for characteristic values and a confidence level of 95 %.

For production evaluation the manufacturer shall define the conformity criteria in the factory production control documentation, see 8.3.

5.2 Dimensions and tolerances**5.2.1 Dimensions**

The manufactured dimensions of an AAC masonry unit shall be declared in mm for length, width and height, in that order.

**Key**

1	Length	3	Height	5	Face
2	Width	4	Bed	6	Header

NOTE This relates to the normal use of the masonry unit in the wall.

Figure 1 — Dimensions and surfaces

They shall be given in terms of work size.

NOTE In addition the co-ordinating size may be given.

AAC masonry units shall be sampled in accordance with Annex A and tested in accordance with EN 772-16.

The deviation of the measured dimensions from the declared dimensions shall not exceed the value given in Table 2. The declared dimensions shall not exceed the value given in Table 1.

Table 1 — Maximum dimensions for AAC masonry units

	Dimensions in millimetres
Length	1 500
Width	600
Height	1 000

5.2.2 Tolerances

5.2.2.1 Permissible deviations for regular shaped units

The permissible deviations for individual masonry units shall be as given in Table 2 for mortar specified in accordance with EN 998-2.

Table 2 — Limit deviations for regular shaped units (in millimetres)

Dimensions	AAC units for erection with joints made of:		
	General purpose and lightweight mortar	Thin layer mortar	
	GPLM	TLMA	TLMB
Length	+3 -5	± 3	± 1,5
Height	+3 -5	± 2	± 1,0
Width	± 3	± 2	± 1,5
Flatness of bed faces	No requirement	No requirement	≤ 1,0
Plane parallelism of bed faces	No requirement	No requirement	≤ 1,0

NOTE Closer tolerances may be declared by the manufacturer for one or more dimensions.

5.2.2.2 Flatness of bed faces

When AAC masonry units category TLMB, intended for use with thin layer mortar, are sampled in accordance with Annex A and tested in accordance with EN 772-20, the deviation from flatness of the bed faces shall not exceed the values given in Table 2.

5.2.2.3 Plane parallelism of bed faces

When AAC masonry units category TLMB, intended for use with thin layer mortar, are sampled in accordance with Annex A and tested in accordance with EN 772-16:2011 by procedure f), the deviation from plane parallelism shall not exceed the values given in Table 2.

5.2.2.4 Permissible deviations for other shaped units

The permissible deviations for non-regular units are not specified in this standard.

5.3 Configuration

For plain regular shaped units it is not necessary to specify the shape. For other units, the geometry of the unit and the volume, direction and shape of perforation and holes shall be declared using definitions in Clause 3 or by reference to a drawing.

NOTE AAC masonry units are generally used in conjunction with general purpose, thin layer and lightweight mortars. The following are commonly employed:

- Mortar joints between plain rectangular shaped AAC masonry units;
- Tongued and grooved jointing systems using tongued and grooved AAC masonry units;
- Mortar joints between profiled AAC masonry units where the profile is designed to accommodate mortar.

When relevant to the uses for which the unit is put on the market, the configuration shall be declared.

The declaration may be made by reference to one or another of the groups defined in EN 1996-1-1 or EN 1996-1-2 and/or it may include one or more items such as those in the following list, as relevant: