



SLOVENSKI STANDARD SIST EN 13757-2:2018

01-junij-2018

Nadomešča:
SIST EN 13757-2:2005

Komunikacijski sistemi za števec - 2. del: Žične komunikacije po M-vodilu

Communication systems for meters - Part 2: Wired M-Bus communication

Kommunikationssysteme für Zähler - Teil 2: Drahtgebundene M-Bus-Kommunikation

Systèmes de communication pour compteurs - Partie 2 : Communication M-Bus filaire
(standards.iteh.ai)

Ta slovenski standard je istoveten z: **EN 13757-2:2018**

<https://standards.iteh.ai/catalog/standards/sist/36f90672-cf1a-4b57-9b26-2896a1849f18/sist-en-13757-2-2018>

ICS:

33.200	Daljinsko krmiljenje, daljinske meritve (telemetrija)	Telecontrol. Telemetry
35.100.10	Fizični sloj	Physical layer

SIST EN 13757-2:2018

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 13757-2:2018

<https://standards.iteh.ai/catalog/standards/sist/36f90672-cf1a-4b57-9b26-2896a1849f48/sist-en-13757-2-2018>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 13757-2

April 2018

ICS 33.200; 35.100.10; 35.240.99; 91.140.50

Supersedes EN 13757-2:2004

English Version

Communication systems for meters - Part 2: Wired M-Bus communication

Systèmes de communication pour compteurs - Partie 2
: Communication M-Bus filaire

Kommunikationssysteme für Zähler - Teil 2:
Drahtgebundene M-Bus-Kommunikation

This European Standard was approved by CEN on 8 February 2018.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

<https://standards.iteh.ai/catalog/standards/sist/36f90672-cfl a-4b57-9b26-2896a1849f48/sist-en-13757-2-2018>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents	Page
European foreword.....	3
Introduction	5
1 Scope	5
2 Normative references	6
3 Terms and definitions	6
4 Physical layer specifications	6
4.1 General	6
4.2 Electrical requirements slave	7
4.3 Electrical requirements master	9
4.4 Electrical requirements mini-master	12
4.5 Repeaters	12
4.6 Burst and surge requirements	13
5 Link Layer (master and slave)	13
5.1 General	13
5.2 Baud rate	13
5.3 Bit position	14
5.4 Byte format	15
5.5 Block format	15
5.6 Datagram abort on collision	15
5.7 Datagram description	16
6 Tables and figures	18
Annex A (informative) Schematic implementation of slave	23
Annex B (informative) Protection against mains voltages	24
Annex C (informative) Slave powering options	25
Annex D (informative) Slave collision detect	26
Annex E (informative) Wire installation	27
E.1 General	27
E.2 Type A: small in house installation	27
E.3 Type B: large in house installation	27
E.4 Type C: small wide area net	27
E.5 Type D: large wide area net	28
E.6 Type E: mini installation (meter cluster)	28
Annex F (informative) Protocol examples	29
F.1 Startup	29
F.2 Slave (meter) readout	29
Bibliography	30

European foreword

This document (EN 13757-2:2018) has been prepared by Technical Committee CEN/TC 294 “Communication systems for meters”, the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by October 2018, and conflicting national standards shall be withdrawn at the latest by October 2018.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 13757-2:2004.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association.

The following significant technical changes have been incorporated in the new edition of this European Standard:

- a) more precise definition of collision state under 4.3.3.8;
- b) modification of application under 5.7.3.4 from “required” to “optional”;
- c) additional explanations for usage of REQ-SKE under 5.7.3.4;
- d) addition of new datagram SND-UD2 under 5.7.3.5;
- e) alignment of Annex D with revised definition of collision state under 4.3.3.8 and
- f) editorial alignments with other parts of this standard, e.g. replacement of \$E5 with ACK.

EN 13757 is currently composed with the following parts:

- *Communication systems for meters — Part 1: Data exchange;*
- *Communication systems for meters — Part 2: Wired M-Bus communication;*
- *Communication systems for meters — Part 3: Application protocols;*
- *Communication systems for meters and remote reading of meters — Part 4: Wireless meter readout (Radio meter reading for operation in SRD bands);*
- *Communication systems for meters — Part 5: Wireless M-Bus relaying;*
- *Communication systems for meters — Part 6: Local Bus;*
- *Communication systems for meters — Part 7: Transport and security services;*
- *CEN/TR 17167, Communication systems for meters — Accompanying TR to EN 13757-2,-3 and -7, Examples and supplementary information.*

EN 13757-2:2018 (E)

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

**iTeh STANDARD PREVIEW
(standards.iteh.ai)**

SIST EN 13757-2:2018

<https://standards.iteh.ai/catalog/standards/sist/36f90672-cfl a-4b57-9b26-2896a1849f48/sist-en-13757-2-2018>

Introduction

This European Standard belongs to the EN 13757 series, which covers communication systems for meters. EN 13757-1 contains generic descriptions and a communication protocol. EN 13757-3 contains detailed description of the application protocols especially the M-Bus Protocol. EN 13757-4 describes wireless communication (often called wireless M-Bus or wM-Bus). EN 13757-5 describes the wireless network used for repeating, relaying and routing for the different modes of EN 13757-4. EN 13757-6 describes a twisted pair local bus for short distance (Lo-Bus). EN 13757-7 describes transport mechanism and security methods for data. The Technical Report CEN/TR 17167 contains informative annexes from EN 13757-2, EN 13757-3 and EN 13757-7.

An overview of communication systems for meters is given in EN 13757-1, which also contains further definitions.

The Physical and Link Layer parameters for baseband communication over twisted pairs have first been specified in EN 1434-3:1997 ("M-Bus") for heat meters. This standard is a compatible and interworking update of a part of EN 1434-3:2015 and includes also other measured media (e.g. water, gas, thermal energy, heat cost allocators), the master side of the communication and newer technical developments. It should be noted that EN 1434-3: 2015 covers also other communication techniques.

It can be used with various application layers especially the application layer of EN 13757-3.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 13757-2:2018](https://standards.iteh.ai/catalog/standards/sist/36f90672-cfl a-4b57-9b26-2896a1849f48/sist-en-13757-2-2018)

<https://standards.iteh.ai/catalog/standards/sist/36f90672-cfl a-4b57-9b26-2896a1849f48/sist-en-13757-2-2018>

EN 13757-2:2018 (E)**1 Scope**

This European Standard is applicable to the physical and link layer parameters of baseband communication over twisted pair (M Bus) for meter communication systems. It is especially applicable to thermal energy meters, heat cost allocators, water meters and gas meters.

NOTE It is usable also for other meters (like electricity meters) and for sensors and actuators. For generic descriptions concerning communication systems for meters and remote reading of meters see EN 13757-1.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 13757-1:2014, *Communication systems for meters - Part 1: Data exchange*

EN 60870-5, (all parts), *Telecontrol equipment and systems (IEC 60870-5 series)*

EN 60870-5-1, *Telecontrol equipment and systems - Part 5: Transmission protocols - Section 1: Transmission frame formats*

EN 60870-5-2:1993, *Telecontrol equipment and systems - Part 5: Transmission protocols - Section 2: Link transmission procedures*

EN 61000-4-4, *Electromagnetic compatibility (EMC) - Part 4-4: Testing and measurement techniques - Electrical fast transient/burst immunity test*

[SIST EN 13757-2:2018](https://standards.iteh.ai/catalog/standards/sist/36f90672-cfla-4b57-9b26-11e15c34-3457-2)

<https://standards.iteh.ai/catalog/standards/sist/36f90672-cfla-4b57-9b26-11e15c34-3457-2>

EN 61000-4-5, *Electromagnetic compatibility (EMC) - Part 4-5: Testing and measurement techniques - Surge immunity test*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 13757-1:2014 and the following apply.


3.1**unit load**

one unit load ($1 U_L$) is the maximum mark state current of 1,5 mA

4 Physical layer specifications**4.1 General**

Figure 1 shows the principal electrical concept of the physical layer: Information from the master to the slaves is transmitted via voltage level changes. A mark state voltage U_{Mark} (idle state, typically 36 V) and an space state voltage which is typically 12 V below U_{Mark} (but at least 12 V) is used for the data transmission. The high voltage step improves the noise immunity in the master to slave direction. The required minimum voltage supports a stable remote powering of all slaves of a segment. Signalling via a voltage change rather than by absolute voltage levels supports even large voltage drops due to wiring

resistance of the cable installation. All slaves are constant current sinks. Their mark state current of typically 1,0 mA to 1,5 mA can be used for powering the transceiver IC in the slave and optionally also the slave (meter). The active (space state) current transmit of a slave is signalled by an increase of this constant current by (11 to 20) mA. Signalling via constant current improves the immunity against induced voltages and is independent on wiring resistance. On the input of each slave transceiver a rectifier bridge makes each slave independent of the wiring polarity and reduces installation errors. Protective resistors in front of each slave transceiver simplify the implementation of overvoltage protection and safeguards, the bus against a semiconductor short circuit in a slave by limiting the current of such a defective slave to 100 mA. Annex A shows the principal function of a slave transceiver. Integrated slave transceivers which include a regulated buffered voltage output for slave (meter) powering, support of battery supply with supply switchover and power down signalling are commercially available.

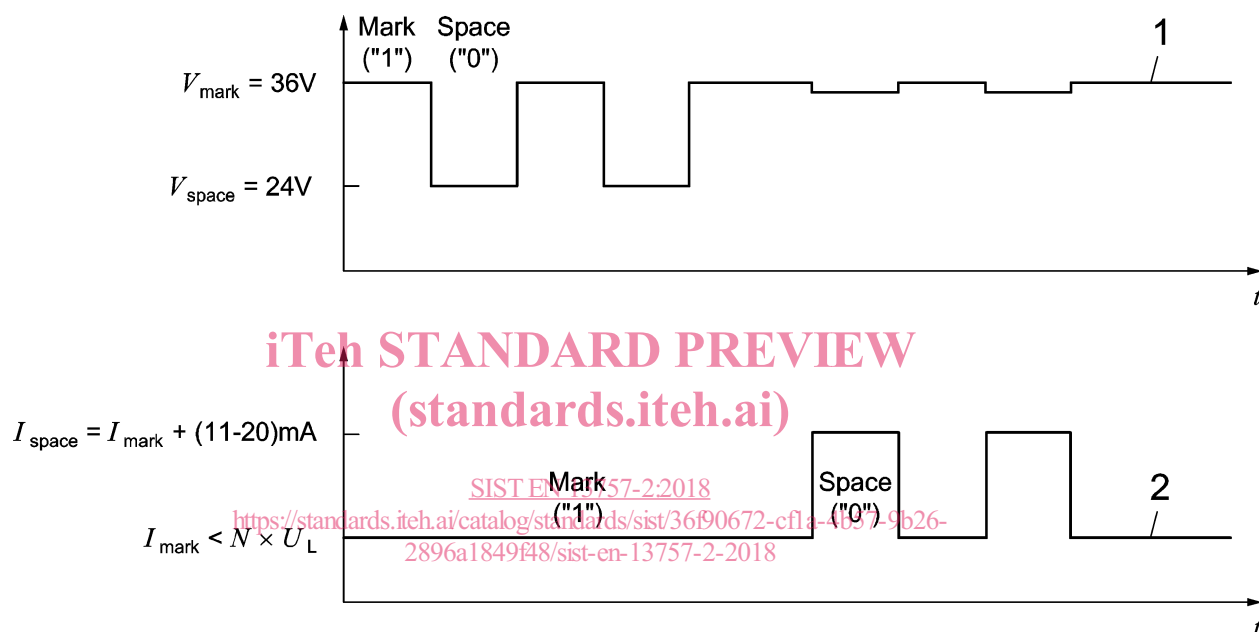

Key

- 1 Bus Voltage at Repeater, Master transmits to Slave
 - 2 Current composition of a Slave, Slave transmits to Master
- t time

Figure 1 — Representation of bits on the M-Bus

All specification requirements shall be held over the full range of temperature and operating voltage for the responsible system component.

4.2 Electrical requirements slave

4.2.1 Master to slave bus voltages

Maximum permanent voltage: - 50 V to 0 V to + 50 V (no damage).

Voltage range for meeting all specifications: \pm (12 V to 42 V).

The Bus voltage at the slave terminals in mark-(quiescent) state of master slave communication ($= U_{\text{Mark}}$) shall be \pm (21 V to 42 V).

EN 13757-2:2018 (E)

The mark voltage shall be stored by a voltage maximum detector with an asymmetric time constant. The discharge time constant shall be greater than $30 \times$ (charge constant) but less than 1 s.

The stored voltage maximum U_{Mark} may drop in 50 ms by not more than 0,2 V for all voltages between 12 V and U_{Mark} .

a) Bus voltage Mark/Space state for master slave communication:

1) Space: $U_{\text{Bus}} < U_{\text{Mark}} - 8,2 \text{ V}$;

2) Mark: $U_{\text{Bus}} \geq U_{\text{Mark}} - 5,7 \text{ V}$;

b) maximum space state time: 50 ms;

c) maximum space state duty cycle: 0,92.

4.2.2 Slave bus current and multiple unit loads**4.2.2.1 General**

A slave device may require a maximum mark state current of an integer multiple N (in the range 1 to 4) unit loads. Each terminal device shall be marked with the unit load number N (If > 1) and the device description shall contain a note on the multiple unit loads for this device.

4.2.2.2 Mark state current of a slave device

The mark state current I_{Mark} shall be $\leq N$ unit loads.

4.2.2.3 Variation of the mark state current over bus voltage

For bus voltages in the range of \pm (12 V to 42 V) a voltage variation of 1 V to 15 V shall not change the bus current by more than $N \times 3 \mu\text{A/V}$.

4.2.2.4 Short-term variation of the mark state current

At constant bus voltage the bus current shall not change by more than $\pm 1 \%$ within 10 s.

4.2.2.5 Total variation over allowed temperature and voltage range of slave device

The total variation of the mark state current of a slave device shall not vary by more than $\pm 10 \%$ over the full voltage and temperature range of the slave device.

4.2.2.6 Maximum bus current for any single semiconductor or capacitor defect

1 min after any single semiconductor or capacitor defect the maximum current of any slave device shall be less than 100 mA for any bus voltage $\leq 42 \text{ V}$.

4.2.2.7 Slow start

For any bus voltage in the range of (0 to ± 42) V the bus current shall be limited to $\leq N \times U_L$.

4.2.2.8 Fast change

After any bus voltage change the bus current shall be $\leq N \times U_L$ within 1 ms.

4.2.2.9 Space state current

The bus current for a slave space state send shall be higher by (11 to 20) mA than in the mark state for all allowed bus voltages:

$$I_{\text{Space}} = I_{\text{Mark}} + (11 \text{ to } 20) \text{ mA}$$

4.2.2.10 Input capacitance at the slave terminals: $\leq 0,5 \text{ nF}$

This capacitance shall be measured with a DC bias of (15 to 30) V.

4.2.2.11 Startup delay

In case of a bus voltage drop below 12 V for longer than 0,1 s the recovery time after applying an allowed mark state voltage until reaching full communication capabilities shall be less than 3 s.

4.2.2.12 Galvanic Isolation

The isolation resistance between any bus terminal and all metal parts accessible without violating seals shall be $> 1 \text{ M}\Omega$. Excluded are terminals for the connection of other floating or isolated external components. The test voltage is 500 V. For mains operated terminal devices the appropriate safety rules apply.

4.2.2.13 Optional reversible mains protection

The slave interface can be equipped with an optional reversible mains protection. This guarantees that even for a prolonged period (test duration: 1 min) the slave interface can withstand mains voltages of 230 V + 10 % and 50 Hz or 60 Hz and that afterwards all specifications are met again. This mains protection function is recommended for all mains operated terminal devices. For possible implementations see Annex B.

4.2.3 Dynamic requirements

Any link layer or application layer protocol of up to 38 400 Baud is acceptable if it guarantees that a mark state is reached for at least one bit time at least once in every 11 bit times and not later than after 50 ms. Note that this is applicable for any asynchronous protocol with 5 data bits to 8 data bits (with or without a parity bit) for any baud rate of at least 300 Baud, including a break signal (see 4.3.3.8). It is also applicable for many synchronous protocols with or without bit coding.

4.3 Electrical requirements master

4.3.1 Parameters

4.3.1.1 Max current (I_{Max})

A master for this physical layer is characterized by its maximum current I_{Maximum} . For all bus currents between zero and I_{Max} it shall meet all functional and parametric requirements. For example a maximally loaded segment with up to 250 slaves with 1 U_L each (375 mA) plus an allowance for one slave with a short circuit (+ 100 mA) plus the maximum space send current (+ 20 mA) an $I_{\text{max}} \geq 0,5 \text{ A}$ is required.

EN 13757-2:2018 (E)

4.3.1.2 Max allowable voltage drop (U_r)

The maximum voltage drop U_r (>0 V) is defined as the minimum space state voltage minus 12 V. U_r divided by the maximum segment resistance between the master and any terminal device (meter) gives the maximum usable bus current for a given combination of segment resistance and master.

4.3.1.3 Max baud rate (B_{Max})

Another characterization of a master is the maximum baud rate B_{Max} up to which all specifications are met. The minimum baud rate is always 300 Baud.

4.3.1.4 Application description

Each master device shall include a description about the required cable and device installation for proper functioning.

4.3.2 Function types

4.3.2.1 Simple level converter

The master function can be realized as a logically transparent level converter between the M-bus physical layer and some other (standardized) physical layer (e.g. V24). It is then bit transparent for allowable baud rates of 300 to B_{Max} . No bit time recovery is possible. Hence a simple level converter cannot be used as a repeater.

iTech STANDARD PREVIEW

4.3.2.2 Intelligent level converter (standards.iteh.ai)

An intelligent level converter can perform space bit time recovery for any asynchronous byte protocol at its maximum baud rate B_{Max} . Other baud rates B_{Max}/L ($L = 2$ to L_{Max}) are allowed, but bit time recovery cannot be guaranteed for these other baud rates. Such a level converter can be used as a physical layer repeater for its maximum baud rate.

4.3.2.3 Bridge

The master function can be integrated with a link layer unit thus forming a (link layer) bridge. If this bridge can support the required physical and link layer management functions it can support also multiple baud rates.

4.3.2.4 Gateway

The master function can be integrated into the application layer of a gateway or it can be fully integrated into an application.

4.3.3 Requirements

4.3.3.1 Mark state voltage

For currents between:

$$0 \dots I_{max} : U_{Mark} = (24 V + U_r) \dots 42 V$$

4.3.3.2 Space state voltage

$$U_{Space} < U_{Mark} - 12 V, \text{ and } U_{Space} \geq 12 V + U_r$$