

ISO/TC 30/SC 2

Secretariat: BSI

Voting begins on:  
2015-10-29

Voting terminates on:  
2015-12-29

---

---

# Measurement of fluid flow by means of pressure differential devices inserted in circular cross-section conduits running full —

## Part 5: Cone meters

*Mesure de débit des fluides au moyen d'appareils déprimogènes insérés dans des conduites en charge de section circulaire —*

*Partie 5: Cônes de mesure*

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.

Please see the administrative notes on page iii



Reference number  
ISO/FDIS 5167-5:2015(E)

## ISO/CEN PARALLEL PROCESSING

This final draft has been developed within the International Organization for Standardization (ISO), and processed under the **ISO-lead** mode of collaboration as defined in the Vienna Agreement. The final draft was established on the basis of comments received during a parallel enquiry on the draft.

This final draft is hereby submitted to the ISO member bodies and to the CEN member bodies for a parallel two-month approval vote in ISO and formal vote in CEN.

**Positive votes shall not be accompanied by comments.**

**Negative votes shall be accompanied by the relevant technical reasons.**

**iTeh STANDARD PREVIEW**  
(standards.iteh.ai)  
Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/68aa963b-3cb1-4306-a4ff-9b0c0601125f/iso-5167-5-2016>



### **COPYRIGHT PROTECTED DOCUMENT**

© ISO 2015, Published in Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Ch. de Blandonnet 8 • CP 401  
CH-1214 Vernier, Geneva, Switzerland  
Tel. +41 22 749 01 11  
Fax +41 22 749 09 47  
copyright@iso.org  
www.iso.org

# Contents

	Page
<b>Foreword</b> .....	<b>iv</b>
<b>Introduction</b> .....	<b>v</b>
<b>1 Scope</b> .....	<b>1</b>
<b>2 Normative references</b> .....	<b>1</b>
<b>3 Terms and definitions</b> .....	<b>1</b>
<b>4 Principles of the method of measurement and computation</b> .....	<b>2</b>
<b>5 Cone meters</b> .....	<b>3</b>
5.1 Field of application.....	3
5.2 General shape.....	3
5.3 Material and manufacture.....	7
5.4 Pressure tappings.....	8
5.5 Discharge coefficient, $C$ .....	8
5.5.1 Limits of use.....	8
5.5.2 Discharge coefficient of the cone meter.....	8
5.6 Expansibility (expansion) factor, $\epsilon$ .....	9
5.7 Uncertainty of the discharge coefficient, $C$ .....	9
5.8 Uncertainty of the expansibility (expansion) factor, $\epsilon$ .....	9
5.9 Pressure loss.....	9
<b>6 Installation requirements</b> .....	<b>10</b>
6.1 General.....	10
6.2 Minimum upstream and downstream straight lengths for installations between various fittings and the cone meter.....	10
6.2.1 General.....	10
6.2.2 Single 90° bend.....	11
6.2.3 Two 90° bends in perpendicular planes.....	11
6.2.4 Concentric expander.....	11
6.2.5 Partially closed valves.....	11
6.3 Additional specific installation requirements for cone meters.....	11
6.3.1 Circularity and cylindricity of the pipe.....	11
6.3.2 Roughness of the upstream and downstream pipe.....	11
6.3.3 Positioning of a thermowell.....	11
<b>7 Flow calibration of cone meters</b> .....	<b>12</b>
7.1 General.....	12
7.2 Test facility.....	12
7.3 Meter installation.....	12
7.4 Design of the test programme.....	12
7.5 Reporting the calibration results.....	13
7.6 Uncertainty analysis of the calibration.....	13
7.6.1 General.....	13
7.6.2 Uncertainty of the test facility.....	13
7.6.3 Uncertainty of the cone meter.....	13
<b>Annex A (informative) Table of expansibility (expansion) factor</b> .....	<b>14</b>
<b>Bibliography</b> .....	<b>15</b>

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see [www.iso.org/directives](http://www.iso.org/directives)).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see [www.iso.org/patents](http://www.iso.org/patents)).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT) see the following URL: [Foreword - Supplementary information](#)

The committee responsible for this document is ISO/TC 30, *Measurement of fluid flow in closed conduits*, Subcommittee SC 2, *Pressure differential devices*.

The first edition of ISO 5167-5 is complementary to ISO 5167-1, ISO 5167-2, ISO 5167-3, and ISO 5167-4.

ISO 5167 consists of the following parts, under the general title *Measurement of fluid flow by means of pressure differential devices inserted in circular cross-section conduits running full*:

- *Part 1: General principles and requirements*
- *Part 2: Orifice plates*
- *Part 3: Nozzles and Venturi nozzles*
- *Part 4: Venturi tubes*
- *Part 5: Cone meters*

## Introduction

This International Standard, divided into five parts, covers the geometry and method of use (installation and operating conditions) of orifice plates, nozzles, Venturi tubes, and cone meters when they are inserted in a conduit running full to determine the flow rate of the fluid in the conduit. It also gives necessary information for calculating the flow rate and its associated uncertainty.

This International Standard is applicable only to pressure differential devices in which the flow remains subsonic throughout the measuring section and where the fluid can be considered as single-phase, but it is not applicable to the measurement of pulsating flow. Furthermore, each of these devices can only be used within specified limits of pipe size and Reynolds number.

This International Standard deals with devices for which direct calibration experiments have been made sufficient in number, spread, and quality to enable coherent systems of application to be based on their results and coefficients to be given with certain predictable limits of uncertainty. However, for cone meters calibrated in accordance with [Clause 7](#), a wider range of pipe size,  $\beta$ , and Reynolds number may be considered.

The devices introduced into the pipe are called “primary devices”. The term primary device also includes the pressure tapplings. All other instruments or devices required for the measurement are known as “secondary devices”. This International Standard covers primary devices; secondary devices<sup>[1][5]</sup> will be mentioned only occasionally.

This International Standard is divided into the following five parts:

- a) ISO 5167-1 gives general terms and definitions, symbols, principles, and requirements as well as methods of measurement and uncertainty that are to be used in conjunction with ISO 5167-1, ISO 5167-2, ISO 5167-3, ISO 5167-4, and ISO 5167-5.
- b) ISO 5167-2 specifies requirements for orifice plates, which can be used with corner pressure tapplings,  $D$  and  $D/2$  pressure tapplings<sup>1)</sup>, and flange pressure tapplings.
- c) ISO 5167-3 specifies requirements for ISA 1932 nozzles<sup>2)</sup>, long radius nozzles, and Venturi nozzles, which differ in shape and in the position of the pressure tapplings.
- d) ISO 5167-4 specifies requirements for classical Venturi tubes<sup>3)</sup>.
- e) This part of ISO 5167 specifies requirements for cone meters and includes a section on calibration.

Aspects of safety are not dealt with in ISO 5167 (all parts). It is the responsibility of the user to ensure that the system meets applicable safety regulations.

---

1) Orifice plates with ‘vena contracta’ pressure tapplings are not considered in ISO 5167 (all parts).

2) ISA is the abbreviation for the International Federation of the National Standardizing Associations, which was succeeded by ISO in 1946.

3) In the USA, the classical Venturi tube is sometimes called the Herschel Venturi tube.

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/68aa963b-3cb1-4306-a4ff-9b0c0601125f/iso-5167-5-2016>

# Measurement of fluid flow by means of pressure differential devices inserted in circular cross-section conduits running full —

## Part 5: Cone meters

### 1 Scope

This part of ISO 5167 specifies the geometry and method of use (installation and operating conditions) of cone meters when they are inserted in a conduit running full to determine the flow rate of the fluid flowing in the conduit.

As the uncertainty of an uncalibrated cone meter might be too large for a particular application, it might be deemed essential to calibrate the flow meter in accordance with [Clause 7](#).

This part of ISO 5167 also provides background information for calculating the flow rate and is applicable in conjunction with the requirements given in ISO 5167-1.

This part of ISO 5167 is applicable only to cone meters in which the flow remains subsonic throughout the measuring section and where the fluid can be considered as single-phase. Uncalibrated cone meters can only be used within specified limits of pipe size, roughness,  $\beta$ , and Reynolds number. This part of ISO 5167 is not applicable to the measurement of pulsating flow. It does not cover the use of uncalibrated cone meters in pipes sized less than 50 mm or more than 500 mm, or where the pipe Reynolds numbers are below  $8 \times 10^4$  or greater than  $1,2 \times 10^7$ .

A cone meter is a primary device which consists of a cone-shaped restriction held concentrically in the centre of the pipe with the nose of the cone upstream. The design of cone meter defined in this part of ISO 5167 has one or more upstream pressure tappings in the wall, and a downstream pressure tapping positioned in the back face of the cone with the connection to a differential pressure transmitter being a hole through the cone to the support bar, and then up through the support bar.

Alternative designs of cone meters are available; however, at the time of writing, there is insufficient data to fully characterize these devices, and therefore, these meters shall be calibrated in accordance with [Clause 7](#).

### 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 4006, *Measurement of fluid flow in closed conduits — Vocabulary and symbols*

ISO 5167-1:2003, *Measurement of fluid flow by means of pressure differential devices inserted in circular cross-section conduits running full — Part 1: General principles and requirements*

### 3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 4006, ISO 5167-1, and the following apply.

3.1

**beta edge**

maximum circumference of the cone

**4 Principles of the method of measurement and computation**

The principle of the method of measurement is based on the installation of the cone meter into a pipeline in which a fluid is running full. Flow through a cone meter produces a differential pressure between the upstream and downstream tappings.


The mass flow rate can be determined by Formulae (1) and (2):

$$q_m = \frac{C}{\sqrt{1 - \beta^4}} \varepsilon \frac{\pi}{4} (D\beta)^2 \sqrt{2\Delta p \rho_1} \tag{1}$$

and

$$\beta = \sqrt{1 - \frac{d_c^2}{D^2}} \tag{2}$$

where  $d_c$  is the diameter of the cone in the plane of the beta edge. This assumes that the diameter of the pipe at the upstream tapping,  $D_{TAP}$ , is equal to the diameter of the pipe at the beta edge,  $D$ . [Figure 1](#) shows that as the cone diameter increases,  $\beta$  decreases.

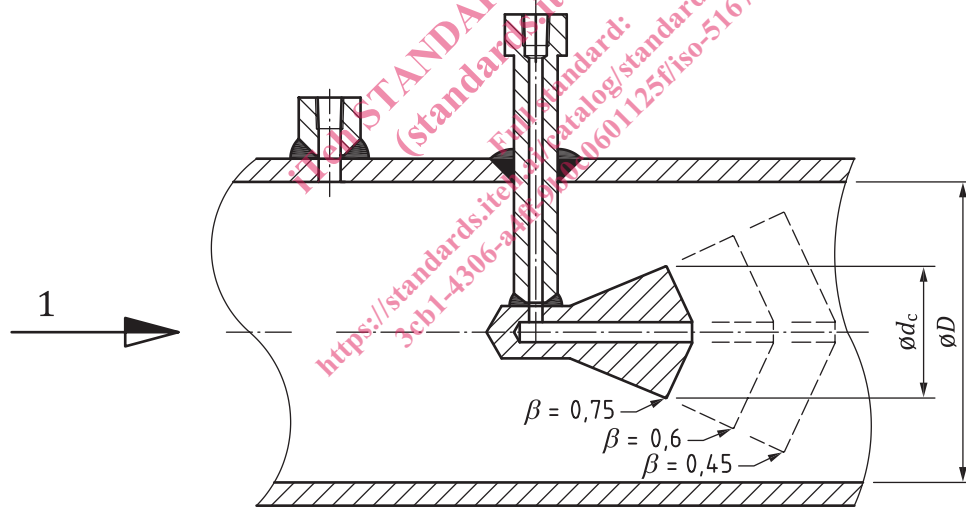

**Key**

1 flow

**Figure 1 — Cone meter showing different values of  $\beta$**



The uncertainty limits can be calculated using the procedure given in ISO 5167-1:2003, Clause 8, except that Formula (3) should be used instead of ISO 5167-1:2003, Formula (3)

$$\frac{\delta q_m}{q_m} = \left(\frac{\delta C}{C}\right)^2 + \left(\frac{\delta \varepsilon}{\varepsilon}\right)^2 + \left(\frac{2(1 + \beta^2 + \beta^4)}{\beta^2(1 + \beta^2)}\right)^2 \left(\frac{\delta D}{D}\right)^2 + \left(\frac{2}{\beta^2(1 + \beta^2)}\right)^2 \left(\frac{\delta d_c}{d_c}\right)^2 + \frac{1}{4} \left(\frac{\delta p}{p}\right)^2 + \frac{1}{4} \left(\frac{\delta \rho_1}{\rho_1}\right)^2 \quad (3)$$

Similarly, the value of the volume flow rate can be calculated since

$$q_V = \frac{q_m}{\rho} \quad (4)$$

where  $\rho$  is the fluid density at the temperature and pressure for which the volume is stated.

Computation of the flow rate, which is a purely arithmetic process, is performed by replacing the different items on the right-hand side of Formula (1) by their numerical values. Formula (5) in 5.6 (or the computed values in Table A.1) gives cone meter expansibility factors ( $\varepsilon$ ). The values in Table A.1 are not intended for precise interpolation. Extrapolation is not permitted. However, the coefficient of discharge,  $C$ , is generally dependent on the Reynolds number,  $Re$ , which is itself dependent on  $q_m$ , and has to be obtained by iteration (see ISO 5167-1:2003, Annex A for guidance regarding the choice of iteration procedure and initial estimates).

The diameters,  $d_c$  and  $D$ , mentioned in Formulae (1) and (2) are the values of the diameters at working conditions. Measurements taken at any other conditions should be corrected for any possible expansion or contraction of the primary device and the pipe due to the values of the temperature and pressure of the fluid during the measurement.

As the cone meter flow rate calculation is particularly sensitive to the pipe and cone diameter values used, the user shall ensure that these are correctly entered into the flow computation calculations. For example, care shall be taken to use the measured internal diameter rather than a nominal value.

It is necessary to know the density and the viscosity of the fluid at working conditions. In the case of a compressible fluid, it is also necessary to know the isentropic exponent of the fluid at working conditions.

NOTE The turndown of all differential pressure flow meters is dependent upon the differential pressure range. Typically, a 10:1 turndown in flow rate (equivalent to 100:1 turndown in differential pressure) can be achieved.

## 5 Cone meters

### 5.1 Field of application

Uncalibrated cone meters can be used in pipes with diameters between 50 mm and 500 mm and with  $0,45 \leq \beta \leq 0,75$ . Cone meters with  $\beta > 0,75$  shall be calibrated. Cone meters with values of  $\beta < 0,45$  are not normally manufactured.


There are limits to the roughness and Reynolds number which shall be addressed.

### 5.2 General shape

5.2.1 Figure 2 shows a section through the centreline of a cone meter. Figure 4 shows other sections through the meter to aid in the metrology of the cone meter. The letters used in the text refer to those shown in Figure 2 and Figure 4.

The cone meter is made up of a pipe section of diameter,  $D$ , which houses the cone assembly with cone diameter,  $d_c$ , the support structure for the cone, and the tapplings for differential pressure measurement.

The cone assembly is installed such that the cone centreline is concentric to the centreline of the pipe section, as per 5.2.13.

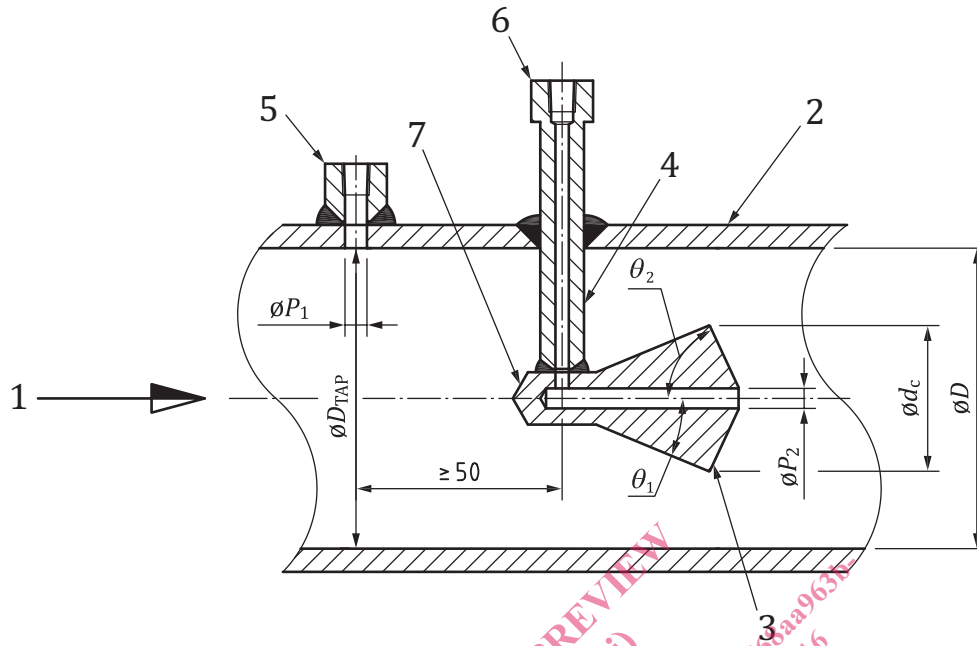

**Key**

- 1 flow
- 2 body pipe
- 3 cone element
- 4 support strut
- 5 high pressure tapping
- 6 low pressure tapping
- 7 cone nose

NOTE  $50 \text{ mm} \leq L \leq 2D$ , as defined in 5.4.7.

**Figure 2 — Geometric profile of cone meter**