



Designation: D7383 – 08

Standard Test Methods for Axial Compressive Force Pulse (Rapid) Testing of Deep Foundations¹

This standard is issued under the fixed designation D7383; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 These test methods cover procedures for testing an individual vertical or inclined deep foundation to determine the displacement response to an axial compressive force pulse applied at its top. These test methods apply to all deep foundation units, referred to herein as “piles,” that function in a manner similar to driven or cast-in-place piles, regardless of their method of installation.

1.2 Two alternative procedures are provided:

1.2.1 Procedure A uses a combustion gas pressure apparatus to produce the required axial compressive force pulse.

1.2.2 Procedure B uses a cushioned drop mass apparatus to produce the required axial compressive force pulse.

1.3 This standard provides minimum requirements for testing deep foundations under an axial compressive force pulse. Plans, specifications, provisions (or combinations thereof) prepared by a qualified engineer, may provide additional requirements and procedures as needed to satisfy the objectives of a particular deep foundation test program. The engineer in responsible charge of the foundation design, referred to herein as the “Engineer”, shall approve any deviations, deletions, or additions to the requirements of this standard.

1.4 The proper conduct and evaluation of force pulse testing requires special knowledge and experience. A qualified engineer should directly supervise the acquisition of field data and the interpretation of the test results so as to predict the actual performance and adequacy of deep foundations used in the constructed foundation. A qualified engineer shall approve the apparatus used for applying the force pulse, rigging and hoisting equipment, support frames, templates, and test procedures.

1.5 The text of this standard references notes and footnotes which provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the standard. The word “shall” indicates a mandatory provision, and the word “should” indicates a recommended or advisory provision. Imperative sentences indicate mandatory provisions.

1.6 The values stated in SI units are to be regarded as standard. No other units of measurement are included in this standard.

1.7 All observed and calculated values shall conform to the guidelines for significant digits and rounding established in Practice D6026.

1.8 The method used to specify how data are collected, calculated or recorded in this standard is not directly related to the accuracy to which the data can be applied in the design or other uses, or both. How one uses the results obtained using this standard is beyond its scope.

1.9 ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

1.10 *This standard may involve hazardous materials, operations, and equipment. This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.* Section 7 provides a partial list of specific hazards and precautions.

2. Referenced Documents

2.1 *ASTM Standards*:²

D653 Terminology Relating to Soil, Rock, and Contained Fluids

D1143 Test Method for Piles Under Static Axial Compressive Load³

D3689 Test Methods for Deep Foundations Under Static Axial Tensile Load

D3740 Practice for Minimum Requirements for Agencies Engaged in Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction

¹ These test methods are under the jurisdiction of ASTM Committee D18 on Soil and Rock and is the direct responsibility of Subcommittee D18.11 on Deep Foundations.

Current edition approved Oct. 1, 2008. Published October 2008. DOI: 10.1520/D7383-08.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard’s Document Summary page on the ASTM website.

³ Withdrawn. The last approved version of this historical standard is referenced on www.astm.org.

D5882 Test Method for Low Strain Impact Integrity Testing of Deep Foundations

D6026 Practice for Using Significant Digits in Geotechnical Data

D6760 Test Method for Integrity Testing of Concrete Deep Foundations by Ultrasonic Crosshole Testing

peak force and then decrease smoothly and continuously. Typical force pulse durations range from 90 to 250 ms.

NOTE 1—A force pulse duration of less than $12L/c$ may be acceptable to the Engineer when using supplemental transducers as described in 5.4.

3.2.5 *pre-load, n*—the load applied to the pile head due to the static weight of the test apparatus prior to the test, possibly negligible depending on the design of the test apparatus.

3.2.6 *target peak force, n*—a pre-determined target value for the desired amplitude of the force pulse as defined by the project requirements. This value should typically exceed the sum of the required ultimate axial compressive static capacity plus the dynamic resistance of the pile by an amount determined by the Engineer based on factors including, but not limited to, pile type, soil type, structural strength of the pile, type of structural load, physical restrictions, or other project requirements (see Section 4).

3.2.7 *wave speed, c, n*—the speed with which a strain wave propagates through a pile. It is a property of the pile composition and is represented herein by c . For one-dimensional wave propagation, c is equal to the square root of Elastic Modulus divided by mass density: $c = (E/\rho)^{1/2}$. Typical values of c are 4000 m/s for concrete piles and 5100 m/s for steel piles.

3. Terminology

3.1 Definitions:

3.1.1 For common definitions of terms used in this standard, see Terminology D653.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *cast-in-place pile, n*—a deep foundation unit made of cement grout or concrete and constructed in its final location, for example, drilled shafts, bored piles, caissons, augercast piles, pressure-injected footings, etc.

3.2.2 *deep foundation, n*—a relatively slender structural element (length greater than width) that transmits some or all of the load it supports to soil or rock well below the ground surface. It may be a driven pile, a cast-in-place pile, or an alternate structural element having a similar function.

3.2.3 *driven pile, n*—a deep foundation unit made of pre-formed material with a predetermined shape and size and typically installed by impact hammering, vibrating, or pushing.

3.2.4 *force pulse, n*—for the purposes of this standard, a “force pulse” shall result in a force-time event similar to Fig. 1, typically reaching a target peak force. The applied force shall exceed the pre-load for a duration time of at least twelve times the test pile length (L) divided by the strain wave speed (c), or $12L/c$. The applied force shall also exceed 50 % of the actual peak force for a minimum duration time of four times L/c . The force pulse shall increase smoothly and continuously to the

4. Significance and Use

4.1 Based on the measurements of force and displacement at the pile top, possibly combined with those from acceleration or strain transducers located further down the pile, these test methods measure the pile top deflection in response to an axial compressive force pulse. The relatively long duration of the force pulse compared to the natural period of the test pile

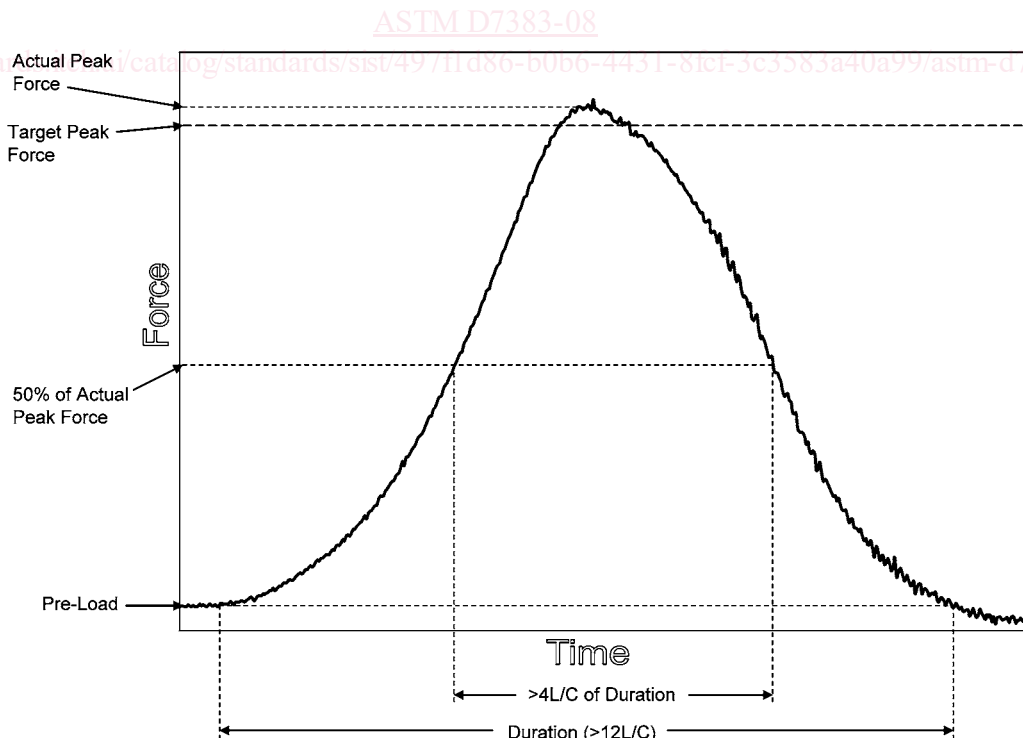


FIG. 1 Typical Axial Compressive Force Pulse

causes the pile to compress and translate approximately as a unit during a portion of the pulse, simultaneously mobilizing compressive axial static capacity and dynamic resistance at all points along the length of the pile for that portion of the test. The Engineer may analyze the acquired data using engineering principles and judgment to evaluate the performance of the force pulse apparatus, and the characteristics of the pile's response to the force pulse loading.

4.2 If significant permanent axial movement occurs during the axial force pulse event, the Engineer may analyze the results of the test to estimate, after assessing inertial effects and the dynamic soil and rock response along the side and bottom of the pile, the ultimate axial static compression capacity (see **Note 2**). The scope of this standard does not include analysis for either ultimate or design foundation capacity. Factors that may affect the axial static capacity estimated from force pulse tests include, but are not limited to, the: (1) pile installation equipment and procedures, (2) elapsed time since initial installation, (3) pile material properties and dimensions, (4) type, density, strength, stratification, and saturation of the soil, or rock, or both adjacent to and beneath the pile, (5) quality of force pulse test data, (6) foundation settlement, (7) analysis method, and (8) engineering judgment and experience. If the Engineer does not have adequate previous experience with these factors, and with the analysis of force pulse test data, then a static load test carried out according to Test Method **D1143** should be used to verify estimates of static capacity and its distribution along the pile length. Test Method **D1143** provides a direct and more reliable measurement of static capacity.

NOTE 2—If a force pulse test produces insufficient axial movement, subsequent analysis may overestimate the static capacity because of difficulty in separating the static and dynamic components of the response. The analysis of a force pulse test to estimate static capacity also typically includes a reduction factor to account for the additional load resistance that occurs as a result of a faster rate of loading than used during a static test. Force pulse test results from cohesive soils generally require a greater reduction factor due to the rate of loading effect, chosen conservatively to produce a lower static capacity estimate. The Engineer should determine how the type, size, and shape of the pile, and the properties of the soil or rock beneath and adjacent to the pile, affect the rate-of-loading reduction factors and the amount of movement required to mobilize and accurately assess the static capacity. Correlations between actual measurements and force pulse estimates of the ultimate axial static compression capacity generally improve when using additional transducers embedded in the pile. Static capacity may also change over time after the pile installation, especially for driven piles. Both static and force pulse tests represent the capacity at the time of the respective test, and correlation attempts should provide results for a similar time of testing after pile installation or include analysis to account for changes in the soil strength during the time between the two tests.

4.3 When used in conjunction with additional transducers embedded in the pile, these test methods may also be used to measure the pile response to the axial force pulse along the pile length. When combined with an appropriate method of analysis, the Engineer may use data from these optional transducers to estimate the relative contribution of side shear and end bearing to the mobilized axial static compressive capacity of the pile, or to infer the relative contribution of certain soil layers to the overall axial compressive capacity of the pile.

NOTE 3—When used in conjunction with additional transducers embed-

ded in the pile the force pulse test analysis may provide an estimate of the pile's tension (uplift) capacity. Users of this standard are cautioned to interpret the estimated side resistance conservatively. If the Engineer does not have adequate previous experience for the specific site and pile type with the analysis of force pulse test data for tension capacity, then a static load test carried out according to Test Method **D3689** should be used to verify tension capacity estimates. Test Method **D3689** provides a direct and more reliable measurement of static tension capacity.

NOTE 4—The quality of the result produced by these test methods is dependent on the competence of the personnel performing it, and the suitability of the equipment and facilities used. Agencies that meet the criteria of Practice **D3740** are generally considered capable of competent and objective testing and inspection. Users of these test methods are cautioned that compliance with Practice **D3740** does not in itself assure reliable results. Reliable results depend on many factors; Practice **D3740** provides a means of evaluating some of those factors.

5. Apparatus

5.1 *General*—Any apparatus capable of applying a force pulse to a pile foundation that is in accordance with Section 3 shall be considered acceptable. The apparatus selected shall be capable of applying a target peak force in accordance with the project requirements. This section describes two specific types of equipment used to generate an axial compressive force pulse: a combustion gas pressure apparatus as shown in **Fig. 2** and a cushioned drop-mass apparatus as shown in **Fig. 3**.

5.2 *Combustion Gas Pressure Apparatus (for Procedure A):*

5.2.1 Piston and cylinder jack capable of confining the operating pressure, and capable of centering the force pulse application to the pile.

5.2.2 Fuel and ignition mechanism to create gas pressure in the combustion chamber.

5.2.3 Reaction beam, supported by cylinder portion of jack to transfer the combustion force to the inertial or other reaction system.

5.2.4 Reaction mass or other means to resist the combustion forces. A reaction mass system will typically weigh between 5 and 15 % of the target peak force and will be comprised of concrete, steel or contained water.

5.2.5 Accumulator or plenum to receive the combustion gas.

5.2.6 Venting apparatus for the release of combustion gas from the plenum.

5.2.7 Silencer apparatus to muffle the noise of the venting combustion gas.

5.2.8 Means or mechanism to protect the pile from damage caused by the fall of the reaction mass system (this will typically consist of a gravel-filled enclosure or a mechanism for arresting the reaction mass such as a hydraulic or mechanical system).

5.2.9 Means or mechanism such as a rupture valve or disk to release the combustion gas in the event of an accidental increase in system pressure or malfunction of the system.

5.3 *Cushioned Drop Mass Apparatus (for Procedure B):*

5.3.1 A drop mass comprised of concrete, steel or another material, typically weighing between 5 and 15 % of the target peak force.

5.3.2 A cylinder jack, crane, or winch, capable of lifting the drop mass to the required height.

5.3.3 Release mechanism for the drop mass.

5.3.4 A guiding system for the fall of the drop mass to properly center the force pulse application to the pile.

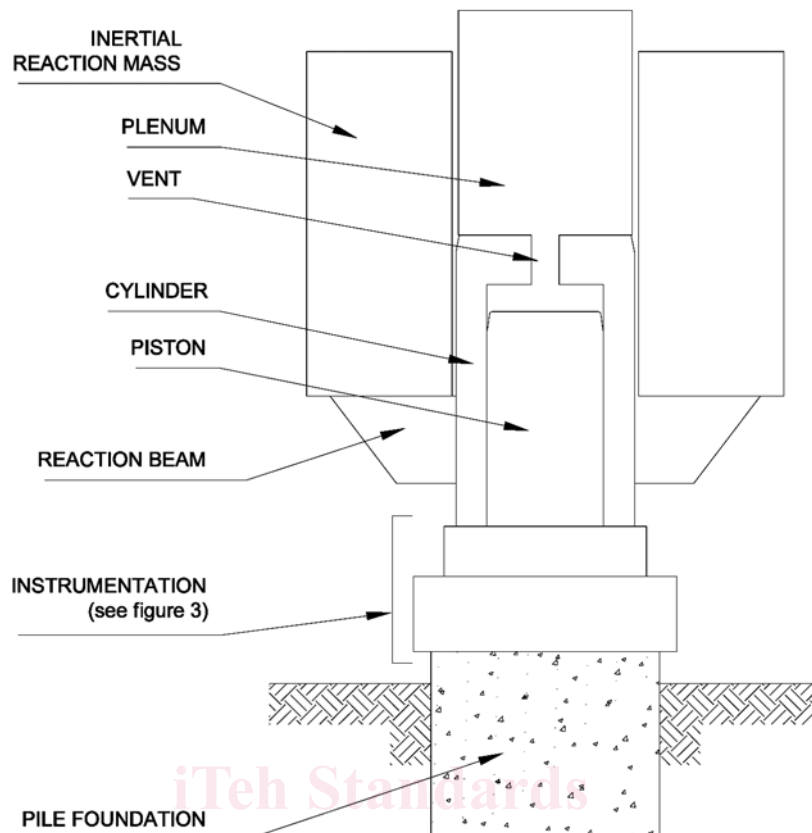


FIG. 2 Schematic of a Combustion Gas Pressure Test Apparatus

5.3.5 Springs or cushion material of sufficient strength and stiffness to transfer a force pulse to the test pile.

5.3.6 Optional secondary springs or cushion material to further cushion the force pulse at the beginning and end of the force pulse application.

5.3.7 Optional clamping or catching mechanism on the drop mass, guide system, or lift cylinder to catch the rebounding drop mass after the application of the force pulse, preventing the application of additional force and improving the verification of the permanent pile head displacement by means of an elevation check as described in 6.4.4. This clamping or catching mechanism is preferred but not required.

5.3.8 Accessibility for the measurement of the drop height.

5.3.9 Accumulator or plenum to receive the hydraulic fluids used to raise and to catch the drop mass.

5.4 Force and Displacement Measurements:

5.4.1 The apparatus for measuring the force pulse applied to the pile shall consist of a calibrated force transducer mounted directly between the test apparatus and the pile head and in alignment with the central longitudinal axis of the test pile. The force transducer shall have a rated service capacity at least 10 % greater than the target peak force and shall be calibrated to a minimum of the target peak force plus 10 %. The force transducer shall be calibrated to an accuracy of 2 % throughout the applicable measurement range. Calibration of the force transducer shall demonstrate linearity to within 2 %. Hysteresis shall not exceed 2 %. The force transducer shall have a response time of less than 0.1 ms.

5.4.2 The primary apparatus for measuring the axial displacement at the pile head shall consist of a calibrated displacement transducer(s). The device shall be capable of measuring displacements directly and continuously over a range of not less than the larger of: (a) 50 mm plus the theoretical elastic shortening of the pile; or (b) $D/20$ plus the theoretical elastic shortening of the pile, where D is the pile diameter. The transducer shall have a precision of at least 0.25 mm and a response time of less than 0.1 ms. The transducer shall be calibrated to an accuracy of 2 % throughout the applicable measurement range. The displacement transducer shall be positioned at and parallel to the central longitudinal axis of the pile. If a single transducer cannot be located at the central axis, then position two or more transducers parallel to and at symmetrical locations with respect to the central longitudinal axis so that the average of their measurements cancels the rotational movement of the pile head. The displacement shall be measured using a stationary reference, such as shown in Fig. 4. Position the displacement reference at a sufficient distance from the test pile such that the measurements are not influenced by test-induced disturbances (typically 20 to 30 m), considering the expected force pulse duration and wave speed in the surrounding soil and surface material.

5.4.3 A secondary apparatus for measuring axial pile head displacement is required, and shall consist of accelerometers, redundant displacement transducers, or other apparatus as approved by the Engineer. Accelerometers indicate pile head