



SLOVENSKI STANDARD
SIST-TS CEN/TS 1555-7:2022

01-februar-2022

Nadomešča:

SIST-TS CEN/TS 1555-7:2013

Cevni sistemi iz polimernih materialov za oskrbo s plinastimi gorivi - Polietilen (PE) - 7. del: Smernice za ugotavljanje skladnosti

Plastics piping systems for the supply of gaseous fuels - Polyethylene (PE) - Part 7: Guidance for the assessment of conformity

Kunststoff-Rohrleitungssysteme für die Gasversorgung - Polyethylen (PE) - Teil 7: Empfehlungen für die Beurteilung der Konformität

Systèmes de canalisations en plastique pour la distribution de combustibles gazeux — Polyéthylène (PE) — Teil 7: Guide pour l'évaluation de la conformité

[SIST-TS CEN/TS 1555-7:2022](https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-342f-426c-b11d-1025-7-2022)

[https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-](https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-342f-426c-b11d-1025-7-2022)

Ta slovenski standard je istoveten z CEN/TS 1555-7:2021
2022

ICS:

83.140.30	Polimerne cevi in fittingi za snovi, ki niso tekočine	Plastics pipes and fittings for non fluid use
91.140.40	Sistemi za oskrbo s plinom	Gas supply systems

SIST-TS CEN/TS 1555-7:2022

en,fr,de

**iTeh STANDARD
PREVIEW
(standards.iteh.ai)**

SIST-TS CEN/TS 1555-7:2022

<https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-13ba-4437-817d-e3f42fcacfd1/sist-ts-cen-ts-1555-7-2022>

TECHNICAL SPECIFICATION
SPÉCIFICATION TECHNIQUE
TECHNISCHE SPEZIFIKATION

CEN/TS 1555-7

December 2021

ICS 23.040.01; 91.140.40

Supersedes CEN/TS 1555-7:2013

English Version

Plastics piping systems for the supply of gaseous fuels -
Polyethylene (PE) - Part 7: Guidance for the assessment of
conformity

Systèmes de canalisations en plastique pour la
distribution de combustibles gazeux - Polyéthylène
(PE) - Teil 7: Guide pour l'évaluation de la conformité

Kunststoff-Rohrleitungssysteme für die Gasversorgung
- Polyethylen (PE) - Teil 7: Empfehlungen für die
Beurteilung der Konformität

This Technical Specification (CEN/TS) was approved by CEN on 17 October 2021 for provisional application.

The period of validity of this CEN/TS is limited initially to three years. After two years the members of CEN will be requested to submit their comments, particularly on the question whether the CEN/TS can be converted into a European Standard.

CEN members are required to announce the existence of this CEN/TS in the same way as for an EN and to make the CEN/TS available promptly at national level in an appropriate form. It is permissible to keep conflicting national standards in force (in parallel to the CEN/TS) until the final decision about the possible conversion of the CEN/TS into an EN is reached.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

[SIST-TS CEN/TS 1555-7:2022](https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-13ba-4437-817d-e3f42fcacfd1/sist-ts-cen-ts-1555-7-2022)

<https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-13ba-4437-817d-e3f42fcacfd1/sist-ts-cen-ts-1555-7-2022>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents	Page
European foreword.....	3
Introduction	4
1 Scope.....	6
2 Normative references.....	6
3 Terms and definitions	7
4 Abbreviated terms.....	10
5 General.....	11
6 Testing and inspection.....	11
6.1 Grouping.....	11
6.1.1 General.....	11
6.1.2 Size groups.....	11
6.1.3 Fitting groups	11
6.1.4 Fitting types.....	11
6.2 Type testing.....	12
6.3 Batch release tests	22
6.4 Process verification tests	26
6.5 Audit tests.....	30
6.6 Indirect tests.....	35
6.7 One-off products and products produced in very low quantity	36
6.8 Large diameter products.....	36
6.9 Documentation.....	36
6.9.1 6.9.1 Type test results.....	36
6.9.2 Test records	36
6.9.3 Technical file for certification purposes.....	36
Annex A (normative) Change of compound.....	37
A.1 General.....	37
A.2 Change.....	37
A.2.1 Change of base polymer	37
A.2.2 Change of grade.....	37
A.2.3 Change of pigment	37
A.2.4 Change of additives other than pigments.....	37
A.3 Type testing required for re-evaluation	37
A.3.1 Changes A.2.1 and A.2.3.1.....	37
A.3.2 Changes A.2.2.1, A.2.2.2, A.2.2.3, A.2.3.2, A.2.4.1, A.2.4.2 and A.2.4.3	38
Annex B (informative) Basic test matrix for PE compounds and piping products.....	39
Bibliography.....	43

European foreword

This document (CEN/TS 1555-7:2021) has been prepared by Technical Committee CEN/TC 155 “Plastics piping systems and ducting systems”, the secretariat of which is held by NEN.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes CEN/TS 1555-7:2013.

EN 1555 is composed of the following parts:

- EN 1555-1, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 1: General*;
- EN 1555-2, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 2: Pipes*;
- EN 1555-3, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 3: Fittings*;
- EN 1555-4, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 4: Valves*;
- EN 1555-5, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 5: Fitness for purpose of the system*;
- CEN/TS 1555-7, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 7: Guidance for the assessment of conformity* (the present Technical Specification).

This issue of CEN/TS 1555-7 takes into account the technical changes made in the revision of EN 1555-1, -2, -3, -4 and -5, published in 2021. Guidance for the assessment of conformity given in this document has been revised to reflect the changes made to test methods and requirements given in EN 1555-1, -2, -3, -4 and -5.

The revision of this System Standard has been carried out to add the PE 100-RC type materials with enhanced resistance to slow crack growth. The size range has been increased to 800 mm diameter, test methods have been updated, and new test methods have been added for PE 100-RC materials.

Any feedback and questions on this document should be directed to the users’ national standards body. A complete listing of these bodies can be found on the CEN website.

According to the CEN/CENELEC Internal Regulations, the national standards organisations of the following countries are bound to announce this Technical Specification: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Introduction

Figures 1 and 2 are intended to provide general information on the concept of testing and organization of those tests used for the purpose of the assessment of conformity. For each type of test, i.e. type testing (TT), batch release test (BRT), process verification test (PVT), and audit test (AT), this part of EN 1555 details the applicable characteristics to be assessed as well as the frequency and sampling of testing.

A typical scheme for the assessment of conformity of compounds, pipes, fittings, valves, joints or assemblies by manufacturers is given in Figure 1.

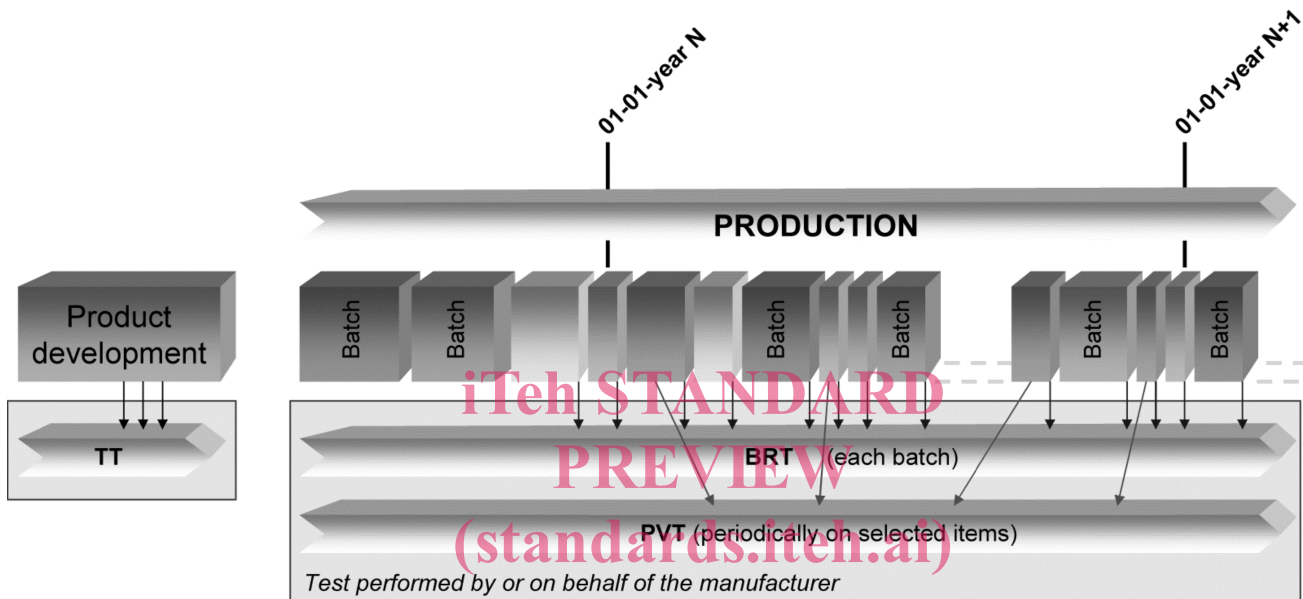


Figure 1 — Typical scheme for the assessment of conformity by a manufacturer

SIST-TS CEN/TS 1555-7:2022
<https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-13ba-4437-817d-e3f42fcacfd1/sist-ts-cen-ts-1555-7-2022>

A typical scheme for the assessment of conformity of compounds, pipes, fittings, valves, joints or assemblies by manufacturers, including certification, is given in Figure 2.

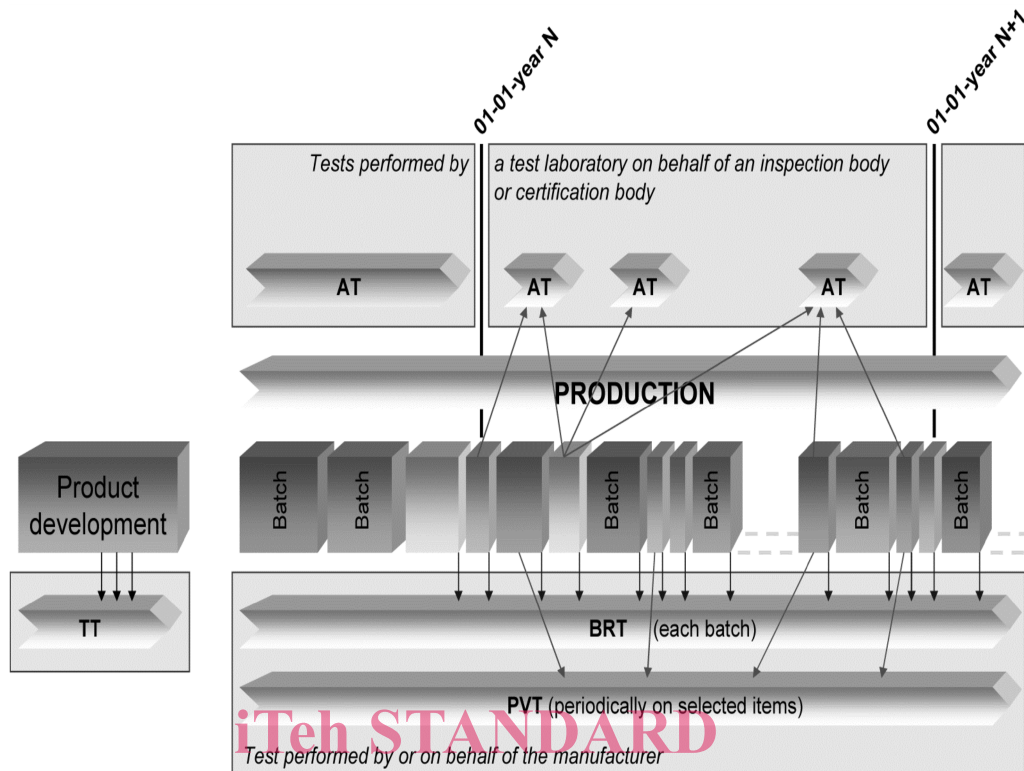


Figure 2 — Typical scheme for the assessment of conformity by a manufacturer, including certification
(standards.iteh.ai)

[SIST-TS CEN/TS 1555-7:2022](https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-13ba-4437-817d-e3f42fcacfd1/sist-ts-cen-ts-1555-7-2022)

<https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-13ba-4437-817d-e3f42fcacfd1/sist-ts-cen-ts-1555-7-2022>

CEN/TS 1555-7:2021 (E)**1 Scope**

This document gives guidance for the assessment of conformity of compounds, products, joints and assemblies in accordance with the applicable part(s) of EN 1555 intended to be included in the manufacturer's quality plan as part of the quality management system and for the establishment of certification procedures.

This document gives recommendations that the quality management system conforms to or is no less stringent than the relevant requirements to EN ISO 9001 [1].

NOTE 1 If certification is involved, the certification and inspection body is preferably compliant with EN ISO/IEC 17065 [2], EN ISO/IEC 17021 [3] or EN ISO/IEC 17020 [4], as applicable.

In conjunction with Parts 1 to 5 of EN 1555 (see Foreword), this document is applicable to polyethylene (PE) plastics piping systems for the supply of gaseous fuels. It is applicable to PE pipes, fittings, and valves, their joints and to joints with components of other materials intended to be used under the following conditions:

- a) a maximum operating pressure, MOP, up to and including 10 bar¹;
- b) an operating temperature of 20 °C as reference temperature.

NOTE 2 For other operating temperatures, derating coefficients can be used; see EN 1555-5.

For mechanical fittings conforming to ISO 17885, guidance for assessment of conformity is not given in this part of EN 1555. When requested, a quality plan based on the tests mentioned should be set up in agreement between user and manufacturer.

EN 1555 covers a range of maximum operating pressures and gives requirements concerning colours.

NOTE 3 It is the responsibility of the purchaser or specifier to make the appropriate selections from these aspects, taking into account their particular requirements and any relevant national regulations and installation practices or codes.

<https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-13ba-4437-817d-e3f42fcacfd1/sist-ts-cen-ts-1555-7-2022>

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 1555-1:2021, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 1: General*

EN 1555-2:2021, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 2: Pipes*

EN 1555-3:2021, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 3: Fittings*

EN 1555-4:2021, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 4: Valves*

EN 1555-5:2021, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 5: Fitness for purpose of the system*

¹ 1 bar = 0,1 MPa. = 10⁵ Pa; 1 MPa = 1 N/mm²

3 Terms and definitions

For the purposes of this document, the following terms and definitions given in EN 1555-1:2021, EN 1555-2:2021, EN 1555-3:2021, EN 1555-4:2021 and EN 1555-5:2021 and the following apply.

3.1

certification body

impartial body, governmental or non-governmental, possessing the necessary competence and responsibility to carry out certification of conformity according to given rules of procedure and management

Note 1 to entry: A certification body is preferably compliant with EN ISO/IEC 17065 [2].

3.2

inspection body

organization or part of an organization that performs inspection

Note 1 to entry: An inspection body is accredited to EN ISO/IEC 17020 [4].

3.3

testing laboratory

laboratory which measures, tests, calibrates or otherwise determines the characteristics of the performance of materials and products

Note 1 to entry: In the context of this part of EN 1555, the materials and products can be subjected to type testing, batch release testing, process verification testing, audit testing, and witness testing, as applicable.

Note 2 to entry: A testing laboratory is preferably compliant with EN ISO/IEC 17025[5].

3.4

quality management system

management system to direct and control an organisation with regard to quality

Note 1 to entry: Requirements for quality management systems are given in EN ISO 9001 [1].

3.5

quality plan

document setting out the specific quality practices, resources and sequence of activities relevant to a particular product or range of products

3.6

type testing

TT

testing performed to prove that the material, product, joint or assembly is capable of conforming to the requirements given in the relevant standard

Note 1 to entry: The type test results remain valid until there is a change in the material or product or assembly provided that the process verification tests are done regularly.

3.7

batch release test

BRT

test performed by or on behalf of the manufacturer on a batch of compound or products, which needs to be satisfactorily completed before the batch can be released

CEN/TS 1555-7:2021 (E)**3.8****process verification test****PVT**

test performed by or on behalf of the manufacturer on compound or products or joints or assemblies at specific intervals to confirm that type tests originally performed on the compound or products or joints or assemblies continue to be valid and the process continues to be capable of producing products which conform to the requirements given in the relevant standard

Note 1 to entry: Such tests are carried out as a measure of process control and are not related to release of batches of compound or products.

3.9**audit test****AT**

test performed by a test laboratory on behalf of an inspection body or certification body to confirm that the compound, product, joint or assembly continues to conform to the requirements given in the relevant standard and to provide information to assess the effectiveness of the quality management system

3.10**indirect test****IT**

test performed by or on behalf of the manufacturer, different from that specified test for that particular characteristic, having previously verified its correlation with the specified test

3.11**witness test****WT**

test accepted by an inspection or a certification body for type testing and/or audit testing, which is carried out by or on behalf of the manufacturer and supervised by a representative of the inspection or certification body, qualified in testing

3.12**material**

composition grouped by families, expressed by generic names, e.g. polypropylene, stainless steel, brass or EPDM

Note 1 to entry: Definition from European Commission, Directorate-General for Enterprise and Industry, Sub-group on Product Testing Procedures (EC, DG ENT and IND, SG PTP).

3.13**compound**

clearly defined homogenous mixture of base polymer with additives, i.e. antioxidants, pigments, stabilisers and others, at a dosage level necessary for the processing and the intended use of the final product

Note 1 to entry: Annex A gives the testing requirements for changes made to the compound.

3.14**material batch**

clearly identified quantity of a given homogeneous compound manufactured continuously under uniform conditions and defined and identified by the compound manufacturer

3.15**product**

pipe, fitting, or valve of a clearly identified type intended to be a part of a piping system which the manufacturer puts on the market

3.16**product batch**

clearly identified collection of products, manufactured consecutively or continuously under the same conditions, using the same compound conforming to the same specification

Note 1 to entry: The product batch is defined and identified by the product manufacturer.

3.17**lot**

clearly identifiable sub-division of a batch for inspection purposes

3.18**sample**

one or more products drawn from the same production batch or lot, selected at random without regard to their quality

Note 1 to entry: The number of products in the sample is the sample size.

Note 2 to entry: The number of test pieces required for each test are taken from the sample. This information is given in this document, in the product standard, or in the relevant test method standard.

3.19**group**

collection of similar products from which samples are selected for testing purposes

3.20**component**

product manufactured out of a specific composition or compound, brought to the market as part of another product or as a spare part

Note 1 to entry: Components are considered as products and are individually approved (e.g. o-rings and gaskets), or they are tested as integral part of a finished product (e.g. in a valve).

3.21**joint**

connection between two or more products

3.22**assembled product**

assembled final product using two or more single parts

3.23**assembly**

unit of two or more products assembled for testing purposes

3.24**sampling plan**

specification of the type of sampling to be used combined with the operational specification of the entities or increments to be taken, the samples to be constituted and the measurements to be made

CEN/TS 1555-7:2021 (E)

EXAMPLE A specific plan which indicates the type of test, the number of units of products or assemblies to be inspected.

3.25**product type**

generic description of a product

EXAMPLE A pipe or fitting or valve or their main parts, of the same design.

3.26**body type**

generic description of a body

EXAMPLE A valve body of a particular design, which can have different end connections.

3.27**cavity**

space within a mould to be filled to form the moulded product

EXAMPLE That part of an injection mould which gives the form to the injection-moulded product.

4 Abbreviated terms

To avoid misunderstanding, the abbreviations in this Clause are defined as being the same in each language. For the same reason, the terms are given in the three languages, English, French and German.

AT EN: audit test

FR: essai d'audit

DE: Überwachungsprüfung [SIST-TS CEN/TS 1555-7:2022](https://standards.iteh.ai/catalog/standards/sist/5a9f16ea-13ba-4437-817d-e3f42fcacfd1/sist-ts-cen-ts-1555-7-2022)

BRT EN: batch release test

FR: essai de libération de campagne de fabrication

DE: Freigabepfung einer Charge

IT EN: indirect test

FR: essai indirect

DE: indirekte Prüfung

PVT EN: process verification test

FR: essai de vérification du procédé de fabrication

DE: Prozessüberprüfung

TT EN: type test

FR: essai de type

DE: Typprüfung

WT EN: witness test

FR: essai témoin

DE: Prüfung unter Aufsicht

5 General

5.1 Compounds, products, joints and assemblies shall conform to the requirements given in EN 1555-1:2021, EN 1555-2:2021, EN 1555-3:2021, EN 1555-4:2021, and EN 1555-5:2021.

5.2 Products and assemblies shall be produced by the manufacturer under a quality management system which includes a quality plan.

6 Testing and inspection

6.1 Grouping

6.1.1 General

For the purposes of this Technical Specification, the groups specified in 6.1.2 and 6.1.3 apply.

6.1.2 Size groups

Four size groups are defined for pipes and fittings, as given in Table 1. For testing purposes, one individual nominal diameter, d_n , shall be selected from each group.

Table 1 — Size groups

Size group	Nominal diameter, d_n mm
1	$d_n < 75$
2	$75 \leq d_n < 250$
3	$250 \leq d_n < 710$
4	$710 \leq d_n \leq 800$

6.1.3 Fitting groups

Three groups of fittings each having a similar design are defined, as given in Table 2.

For testing purposes, one individual fitting shall be selected from each group.

Table 2 — Fitting groups

Fitting groups	Fitting type
(A)	Electrofusion socket fitting
(B)	Electrofusion saddle fitting
(C)	Spigot end fitting

6.1.4 Fitting types

Fitting groups are divided in fitting types.

Fitting group (A) includes the following fitting types: Electrofusion couplers, electrofusion 45° elbows, electrofusion 90° elbows, electrofusion tees, electrofusion reducers, electrofusion end caps, etc.

Fitting group (B) includes the following fitting types: Electrofusion tapping saddles, electrofusion branch saddles, etc.

Fitting group (C) includes the following fitting types: 45° elbows, 90° elbows, tees, reducers, end caps, etc.