



SLOVENSKI STANDARD

SIST EN 17255-2:2020

01-julij-2020

Emisije nepremičnih virov - Sistemi za zajem in vrednotenje podatkov (DAHS) - 2. del: Specifikacija zahtev za sisteme za zajem in vrednotenje podatkov

Stationary source emissions - Data acquisition and handling systems - Part 2: Specification of requirements on data acquisition and handling systems

Emissionen aus stationären Quellen - Datenerfassungs- und Auswerteeinrichtungen - Teil 2: Festlegung von Anforderungen an Datenerfassungs- und Auswerteeinrichtungen

Émissions de sources fixes - Systèmes d'acquisition et de traitement de données - Partie 2 : Spécification des exigences relatives aux systèmes d'acquisition et de traitement de données

<https://standards.iteh.ai/catalog/standards/sist/615d3adb-3d97-4eea-b312-f0dae377c887/sist-en-17255-2-2020>

Ta slovenski standard je istoveten z: EN 17255-2:2020

ICS:

13.040.40 Emisije nepremičnih virov Stationary source emissions

SIST EN 17255-2:2020

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 17255-2:2020

<https://standards.iteh.ai/catalog/standards/sist/615d3adb-3d97-4eea-b312-f0dae377c887/sist-en-17255-2-2020>

EUROPEAN STANDARD

EN 17255-2

NORME EUROPÉENNE

EUROPÄISCHE NORM

April 2020

ICS 13.040.40

English Version

Stationary source emissions - Data acquisition and handling systems - Part 2: Specification of requirements on data acquisition and handling systems

Émissions de sources fixes - Systèmes d'acquisition et de traitement de données - Partie 2 : Spécification des exigences relatives aux systèmes d'acquisition et de traitement de données

Emissionen aus stationären Quellen - Datenerfassungs- und Auswerteeinrichtungen - Teil 2: Festlegung von Anforderungen an Datenerfassungs- und Auswerteeinrichtungen

This European Standard was approved by CEN on 7 March 2020.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents

	Page
European foreword.....	4
Introduction	5
1 Scope.....	6
2 Normative references.....	6
3 Terms and definitions	6
4 Symbols and abbreviations	8
5 Principles	8
6 Performance requirements.....	9
6.1 General.....	9
6.2 Data acquisition.....	10
6.2.1 Overview	10
6.2.2 Interfaces	10
6.2.3 Manual data input.....	11
6.2.4 Remote data logger unit	11
6.3 Input data processing.....	11
6.3.1 Validity of input data.....	11
6.3.2 First level data (FLD)	12
6.4 Reported data.....	12
6.4.1 General.....	12
6.4.2 Warnings, alarms and violations.....	12
6.5 Reports.....	12
6.5.1 General.....	12
6.5.2 Emission reports	13
6.5.3 System reports	13
6.6 Data storage	13
6.6.1 General.....	13
6.6.2 Time stamping.....	13
6.6.3 Storage of FLD.....	13
6.6.4 Storage of STA.....	13
6.6.5 Storage of standardized STA (SSTA).....	14
6.6.6 Storage of validated STA (VSTA).....	14
6.6.7 Storage of QAL3 data.....	14
6.6.8 Storage of warnings, alarms and violations	14
6.6.9 Storage of the event-log and configuration parameters	14
6.7 System functions	14
6.7.1 Event log	14
6.7.2 Configuration.....	14
6.7.3 Export of data	14
6.7.4 Test mode.....	15
6.8 Data integrity.....	15
6.8.1 DAHS availability.....	15
6.8.2 Tamper-proof data transfer and handling.....	15
6.8.3 Preventing loss of data.....	15
6.8.4 Data back-up.....	15
6.8.5 DAHS identification	16

6.8.6	Time management.....	16
6.9	Documentation	16
	Annex A (informative) Example list of configuration parameters.....	17
A.1	Measurement channel configuration	17
A.2	Data processing configuration.....	18
A.3	Data storage configuration.....	19
A.4	Report configuration.....	19
	Bibliography	20

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 17255-2:2020

<https://standards.iteh.ai/catalog/standards/sist/615d3adb-3d97-4eea-b312-f0dae377c887/sist-en-17255-2-2020>

EN 17255-2:2020 (E)**European foreword**

This document (EN 17255-2:2020) has been prepared by Technical Committee CEN/TC 264 “Air Quality”, the secretariat of which is held by DIN.

This document shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by October 2020, and conflicting national standards shall be withdrawn at the latest by October 2020.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document is Part 2 of the EN 17255 series.

The EN 17255 series, published under the general title Stationary source emissions — Data acquisition and handling systems, specifies:

- requirements for the handling and reporting of data;
- requirements on data acquisition and handling systems;
- requirements for the performance test of data acquisition and handling systems;
- requirements for the installation and on-going quality assurance and quality control of data acquisition and handling systems.

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this document: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Introduction

This document forms part of a series of standards which, between them, govern the process for the quality assurance of data received by a data acquisition and handling system (DAHS) from automated measuring systems (AMS), being used for monitoring emissions from stationary sources and quality ensured to EN 14181.

The input data can be either in analogue representation or in digital form directly from an AMS or via a digital bus system. Inputs can include the data from the AMS, peripheral data needed for calculation of the reported values and information on plant conditions needed to apply data selection criteria.

The data acquisition and handling system (DAHS) receives the raw data, as they are measured, averaged and presented by the AMS, and converts, averages, stores and reports data as required by legislation.

This series of standards suggests that the process of data handling is best performed in a dedicated DAHS. It does not preclude the use of other options for all or part of the process provided that it can be shown to meet all of the requirements of the standard, particularly in relation to speed, accuracy, access, security and validation.

This series of standards applies to all DAHS installed after the date of implementation of this document.

EN 17255-2 specifies the implementation of the calculations laid down in EN 17255-1 and the specific requirements on functionality of the DAHS.

iTeh STANDARD PREVIEW (standards.iteh.ai)

SIST EN 17255-2:2020

<https://standards.iteh.ai/catalog/standards/sist/615d3adb-3d97-4eea-b312-f0dae377c887/sist-en-17255-2-2020>

EN 17255-2:2020 (E)**1 Scope**

This document specifies the performance requirements on data acquisition and handling systems (DAHS) regarding implementation of the procedures defined in EN 17255-1 including

- data acquisition;
- data processing;
- data storage;
- data output;
- generation of reports;
- system functions;
- data integrity;
- documentation.

This document supports the requirements of EN 14181 and legislation such as the IED and E-PRTR. It does not preclude the use of additional features and functions provided the minimum requirements of this document are met and that these features do not adversely affect data quality, clarity or access.

2 Normative references

(standards.iteh.ai)

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 14181:2014, *Stationary source emissions - Quality assurance of automated measuring systems*

EN 17255-1, *Stationary source emissions - Data acquisition and handling systems - Part 1: Specification of requirements for the handling and reporting of data*

IEEE 754, *Floating-point arithmetic*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 17255-1 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

3.1**warning signal**

binary value or enumerated value signifying the need for action

Note 1 to entry: Warnings can be derived from measurement values or conditions, which are still within the specified limits, but where the value is close to the specified limit. Warnings are for the benefit of the plant operator.

Note 2 to entry: Warnings can be conditions communicated to the plant operator as requiring attention. Instrument conditions like operation exceeding the upper limit of the valid calibration range are also considered as warnings.

3.2

alarm signal

binary value or enumerated value indicating an alarm state

Note 1 to entry: Examples of alarm signals are incidents where an ELV is exceeded,

Note 2 to entry: Examples of alarm signals from instruments include conditions such as out of operation, and operation conditions like measurements outside the measurement range.

Note 3 to entry: A condition, which leads to an alarm, can lead to a violation, if it persists too long according to directives, local permits or other standards.

Note 4 to entry: Alarms are conditions communicated to the plant operator indicating that the plant if it continues in this state could enter into a condition where it is not any longer fulfilling the relevant directive conditions.

3.3

violation signal

binary value or enumerated value indicating presence of a condition where requirements of directives, operating permits or other standards are exceeded

Note 1 to entry: Measured values above ELV at a duration exceeding the limit in the directives can cause a violation signal.

Note 2 to entry: Instrument conditions like too many hours out of operation, and operation conditions like exceeding the valid calibration range for too many time periods related to the short-term average can cause violation signals.

<https://standards.iteh.ai/catalog/standards/sist/615d3adb-3d97-4eea-b312-f0dae377c887/sist-en-17255-2-2020>

3.4

data storage

electronic memory capacity to hold data for processing or documentation

Note 1 to entry: This document does not prescribe storage technology. It is always the responsibility of the plant operator that the capacity and reliability of the chosen storage is sufficient.

3.5

permanent data storage

non-volatile data storage with the capacity to hold data for a period equal to or exceeding a required minimum time period

3.6

event

occurrence that could affect the performance or processing of the DAHS

Note 1 to entry: Events can be caused by an operator, e.g. by adding or changing configuration data, peripheral data, limit values, QAL2 data or basic information, or by the system itself, e.g. for watchdog restart, change to or from DST, recovery from power cut, performing automatic backup, reporting lack of communication with AMS or external data loggers, or generating reports.

EN 17255-2:2020 (E)

4 Symbols and abbreviations

AMS	automated measuring system
DAHS	data acquisition and handling system
DST	daylight saving time
ELV	emission limit value
E-PRTR	European pollutant release and transfer register
FLD	first level data
IED	industrial emissions directive
LTA	long-term average
OPC	open platform communication
QAL2	second quality assurance level
QAL3	third quality assurance level
SRM	standard reference method
SSTA	standardized short-term average
STA	short-term average
UTC	coordinated universal time
VSTA	validated short-term average

Full STANDARD PREVIEW
(standards.iteh.ai)

5 Principles

SIST EN 17255-2:2020

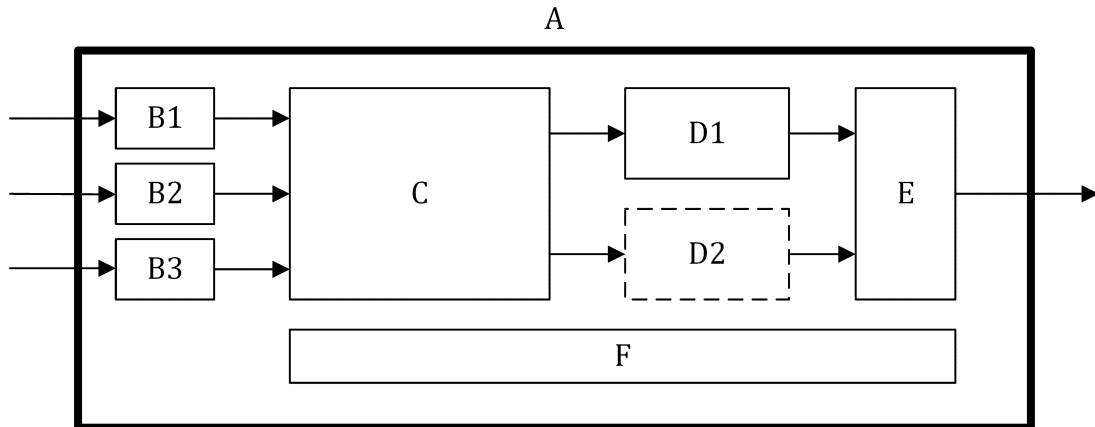
<https://standards.iteh.ai/catalog/standards/sist/615d3adb-3d97-4eea-b312->

This document specifies minimum requirements for the performance and functional capabilities of DAHS.

The minimum functional capabilities specified in this document are considered to be necessary to meet the requirements of the relevant regulations (e.g. EU Directives) in terms of the provision of emissions data for reporting. These functional capabilities also cover the traceability, security and ability to audit reported data.

The DAHS provides the time stamp for input data.

Figure 1 shows the elements of the DAHS defined in this document.

**Key**

- A DAHS
- B1 AMS data interface
- B2 peripheral data interface
- B3 plant data interface
- C input processing and production of FLD
- D1 calculation of reported data
- D2 optional calculation of additional reported data, e.g. to meet additional reporting requirements
- E report generation
- F data storage

iTech STANDARD PREVIEW

(standards.itech.ai)

Figure 1 — DAHS elements

SIST EN 17255-2:2020

6 Performance requirements

<https://www.itech.ai/catalog/standards/sist/615d3adb-3d97-4eea-b312-f0dae377c887/sist-en-17255-2-2020>

6.1 General

The DAHS shall meet the performance requirements for

- data acquisition (see 6.2);
- input data processing (see 6.3);
- reported data (see 6.4);
- reports (see 6.5);
- data storage (see 6.6);
- system functions (see 6.7);
- data integrity (see 6.8);
- documentation (see 6.9).