

SLOVENSKI STANDARD

SIST EN 15698-2:2020

01-januar-2020

Nadomešča:

SIST EN 15698-2:2015

Cevi za daljinsko ogrevanje - Poviti dvocevni sistemi za neposredno vkopana vročevodna omrežja - 2. del: Tovarniško izdelan sestav fittingov in ventilov iz jeklene cevi, poliuretanske toplotne izolacije in zunanjega polietilenskega plašča

District heating pipes - Bonded twin pipe systems for directly buried hot water networks - Part 2: Factory made fitting and valve assemblies of steel service pipes, polyurethane thermal insulation and one casing of polyethylene

Fernwärmerohre - Verbundmanteldoppelrohre für direkt erdverlegte Fernwärmenetze - Teil 2: Werkmäßig hergestelltes Verbundformstück und vorgedämmte Absperrarmatur, bestehend aus Stahl-Mediumrohr, Polyurethan-Wärmedämmung und einem Mantel aus Polyethylen

<https://standards.iteh.ai/catalog/standards/sist/aaf2e5c-be0d-4348-a3b8-9fb56f198d71/sist-en-15698-2-2020>

Tuyaux de chauffage urbain - Systèmes bloqués de bitubes pour les réseaux d'eau chaude enterrés directement - Partie 2 : Assemblages de raccords et d'appareils de robinetterie manufacturés pour tubes de service en acier, isolation thermique en polyuréthane et protection extérieure unique en polyéthylène

Ta slovenski standard je istoveten z: EN 15698-2:2019

ICS:

23.040.07	Cevovodi za daljinsko ogrevanje in njihovi deli	Pipeline and its parts for district heat
23.040.10	Železne in jeklene cevi	Iron and steel pipes
91.140.10	Sistemi centralnega ogrevanja	Central heating systems

SIST EN 15698-2:2020

en,fr,de

iTeh STANDARD PREVIEW (standards.iteh.ai)

SIST EN 15698-2:2020

<https://standards.iteh.ai/catalog/standards/sist/aaf2e5c-be0d-4348-a3b8-9fb56f198d71/sist-en-15698-2-2020>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 15698-2

October 2019

ICS 23.040.07

Supersedes EN 15698-2:2015

English Version

**District heating pipes - Bonded twin pipe systems for
directly buried hot water networks - Part 2: Factory made
fitting and valve assemblies of steel service pipes,
polyurethane thermal insulation and one casing of
polyethylene**

Tuyaux de chauffage urbain - Systèmes bloqués de
bitubes pour les réseaux d'eau chaude enterrés
directement - Partie 2 : Assemblages de raccords et
d'appareils de robinetterie manufacturés pour tubes de
service en acier, isolation thermique en polyuréthane
et protection extérieure unique en polyéthylène

Fernwärmerohre - Verbundmanteldoppelrohre für
direkt erdverlegte Fernwärmenetze - Teil 2:
Werkmäßig hergestelltes Verbundformstück und
vorgeämmte Absperrarmatur, bestehend aus Stahl-
Mediumrohr, Polyurethan-Wärmedämmung und
einem Mantel aus Polyethylen

iTeh STANDARD PREVIEW
(standards.iteh.ai)

This European Standard was approved by CEN on 12 August 2019.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

<https://standards.iteh.ai/catalog/standards/sist/aal1f2e5c-be0d-4348-a3b8-9fb56f198d71/sist-en-15698-2-2020>

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents	Page
European foreword	3
Introduction	4
1 Scope	5
2 Normative references	5
3 Terms and definitions	6
4 Requirements	6
5 Test methods	8
6 Marking	8
Annex A (normative) Waste treatment and recycling	9
Annex B (informative) Examples of twin pipe fitting assemblies	10
Bibliography	13

iTeh STANDARD PREVIEW (standards.iteh.ai)

SIST EN 15698-2:2020

<https://standards.iteh.ai/catalog/standards/sist/aa1f2e5c-be0d-4348-a3b8-9fb56f198d71/sist-en-15698-2-2020>

European foreword

This document (EN 15698-2:2019) has been prepared by Technical Committee CEN/TC 107 “Prefabricated district heating and district cooling pipe system”, the secretariat of which is held by DS.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by April 2020, and conflicting national standards shall be withdrawn at the latest by April 2020.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 15698-2:2015.

In comparison with the previous edition, the main changes in EN 15698-2 are:

- editorial changes to the new structure of standards prepared by the Technical Committee CEN/TC 107.

EN 15698 is currently composed with the following parts:

- *District heating pipes — Bonded twin pipe systems for directly buried hot water networks — Part 1: Factory made twin pipe assembly of steel service pipes, polyurethane thermal insulation and one casing of polyethylene* [new edition currently at Formal Vote];
- *District heating pipes — Bonded twin pipe systems for directly buried hot water networks — Part 2: Factory made fitting and valve assemblies of steel service pipes, polyurethane thermal insulation and one casing of polyethylene* [the present Formal Vote draft].

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Introduction

EN 15698-2 is Part 2 of the EN15698 series.

This standard has been elaborated as a complement to the standards for bonded pipe systems for buried hot water networks using steel service pipe and polyurethane foam thermal insulation and one casing of polyethylene.

These standards are:

- EN 253, *District heating pipes — Bonded single pipe systems for directly buried hot water networks — Factory made pipe assembly of steel service pipe, polyurethane thermal insulation and a casing of polyethylene;*
- EN 448, *District heating pipes — Bonded single pipe systems for directly buried hot water networks — Factory made fitting assemblies of steel service pipes, polyurethane thermal insulation and a casing of polyethylene;*
- EN 488, *District heating pipes — Bonded single pipe systems for directly buried hot water networks — Factory made steel valve assembly for steel service pipes, polyurethane thermal insulation and a casing of polyethylene;*
- EN 489-1, *District heating pipes — Bonded single and twin pipe systems for buried hot water networks — Part 1: Joint casing assemblies and thermal insulation for hot water networks in accordance with EN 13941-1;*
- EN 13941-1, *District heating pipes — Design and installation of thermal insulated bonded single and twin pipe systems for directly buried hot water networks — Part 1: Design;*
- EN 13941-2, *District heating pipes — Design and installation of thermal insulated bonded single and twin pipe systems for directly buried hot water networks — Part 2: Installation;*
- EN 14419, *District heating pipes — Bonded single and twin pipe systems for directly buried hot water networks — Surveillance systems;*
- EN 15632 (all parts), *District heating pipe — Pre-insulated flexible pipe systems;*
- EN 15698-1, *District heating pipes — Bonded twin pipe systems for directly buried hot water networks — Part 1: Factory made twin pipe assembly of steel service pipe, polyurethane thermal insulation and one casing of polyethylene;*
- EN 17248, *District heating and district cooling pipe systems — Terms and definitions.*

Waste management and recycling of materials is dealt with in Annex A.

1 Scope

This document specifies requirements and test methods for fittings of factory made thermally insulated bonded twin pipe assemblies for hot water networks in accordance with EN 13941-1, comprising two steel service fittings and/or valves, polyurethane foam thermal insulation and one casing of polyethylene.

The pipe assembly can also include the following additional elements: measuring wires, spacers and diffusion barriers.

This document covers the following assemblies:

- fittings: bends, T-pieces and reducers;
- valve construction.

This document applies to fitting and valve assemblies with a minimum design pressure of 1,6 MPa (overpressure).

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 253, *District heating pipes — Bonded single pipe systems for directly buried hot water networks — Factory made pipe assembly of steel service pipe, polyurethane thermal insulation and a casing of polyethylene*

EN 448, *District heating pipes — Bonded single pipe systems for directly buried hot water networks — Factory made fitting assemblies of steel service pipes, polyurethane thermal insulation and a casing of polyethylene*

EN 488, *District heating pipes — Bonded single pipe systems for directly buried hot water networks — Factory made steel valve assembly for steel service pipes, polyurethane thermal insulation and a casing of polyethylene*

EN 10204, *Metallic products — Types of inspection documents*

EN 13941-1, *District heating pipes — Design and installation of thermal insulated bonded single and twin pipe systems for directly buried hot water networks — Part 1: Design*

EN 14419, *District heating pipes — Bonded single and twin pipe systems for directly buried hot water networks — Surveillance systems*

EN 15698-1, *District heating pipes — Bonded twin pipe systems for directly buried hot water networks — Part 1: Factory made twin pipe assembly of steel service pipe, polyurethane thermal insulation and one casing of polyethylene*

EN 17248, *District heating and district cooling pipe systems — Terms and definitions*

3 Terms and definitions

For the purpose of this document, the terms and definitions given in EN 17248 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

4 Requirements

4.1 General

The material of the fitting and valve steel parts shall be certified, in accordance with EN 10204. If traceability on materials is required by the end user, it shall be specified at the time of ordering. Corresponding material certificates shall be delivered to the end user if specified at the time of ordering.

All components shall be designed in accordance with EN 13941-1, for the actions and stresses that normally occur during a system's entire service life.

4.2 Steel parts

The quality of service pipe material used for the assembly of fittings and valves shall be in accordance with EN 13941-1. The dimensions of the steel parts, such as wall thickness and diameter and components shall be in accordance with EN 448.

4.3 Welding of steel parts

4.3.1 Welding of steel pipes and elements

[SIST EN 15698-2:2020](https://standards.iteh.ai/catalog/standards/sist/aa1f2e5c-be0d-4348-a3b8-9fb56f198d71/sist-en-15698-2-2020)

[https://standards.iteh.ai/catalog/standards/sist/aa1f2e5c-be0d-4348-a3b8-](https://standards.iteh.ai/catalog/standards/sist/aa1f2e5c-be0d-4348-a3b8-9fb56f198d71/sist-en-15698-2-2020)

[9fb56f198d71/sist-en-15698-2-2020](https://standards.iteh.ai/catalog/standards/sist/aa1f2e5c-be0d-4348-a3b8-9fb56f198d71/sist-en-15698-2-2020)

Fusion welding between the steel parts in different fitting and valve assemblies shall be in accordance with EN 448.

The quality of the steel ends of the fittings shall match with the steel service pipes.

4.3.2 Welding of fixing bars

The fixing bars shall be welded to the pipes according to the requirements of EN 13941-1.

4.3.3 Placing of the fixing bars

Fixing bars shall be welded to the straight part of the twin pipe fittings at:

- transition assembly at the twin pipe part of fitting assemblies;
- horizontal and vertical bends from both sides of bended area;
- reducers at the largest pipe diameter;
- tees at branch pipes;
- valve assemblies from both sides of the valve;
- venting and draining fitting assemblies at the main pipe from both sides of the fitting assembly.

4.4 Casing

The casing material, casing properties and dimensions shall be in accordance with EN 253. Casing shall be tested according to the requirements of EN 253.

4.5 Polyurethane (PUR) rigid foam thermal insulation


Material and thermal insulation properties shall be specified and tested as specified in EN 253.

4.6 Fitting and valve assemblies

At the joint end, the insulation thickness shall meet the requirements of EN 15698-1. The insulation thickness inside the fitting and valve assemblies can vary, depending on the construction and shall at any point have a minimum insulation thickness of 15 mm, between service pipe and casing

Valve assemblies shall meet the requirements of EN 488. The centre line and angular deviation shall be according to EN 15698-1. Fitting assemblies shall meet the requirements of EN 448. The centre line and angular deviation shall be according to EN 15698-1. Centre line deviation and out of roundness are measured as 3×2 linear measurements (see A, B and C in Figure 1).

Limits at joint end for all three measurements shall be $(\text{max.} - \text{min.}) \leq 2 \times (\text{max. centre line deviation, EN 253})$.

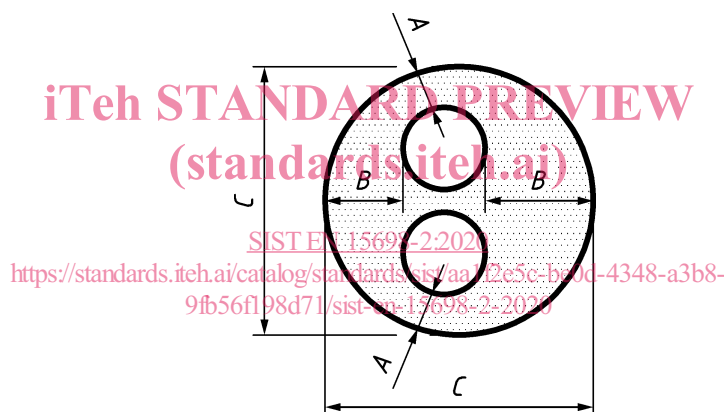

Key

- A the 2 smallest distances from service pipe to casing surface expressed in millimetres (mm)
- B the 2 long distances from service pipe casing surface expressed in millimetres (mm)
- C diameter expressed in millimetres (mm)

Figure 1 — Centre line deviations

The distance between the flow and return steel service pipes, at the joint ends, shall be in accordance with EN 15698-1.

The distance inside the fitting- and valve assemblies can vary on the condition that welding is still possible.

4.7 Requirements for effective operation and maintenance

Effective operation and maintenance shall meet the requirements of EN 488.

4.8 Surveillance system

If a surveillance system is installed, it shall comply with EN 14419.