



SLOVENSKI STANDARD

oSIST prEN 1366-3:2018

01-april-2018

Preskusi požarne odpornosti servisnih inštalacij - 3. del: Tesnitve prebojev

Fire resistance tests for service installations - Part 3: Penetration seals

Feuerwiderstandsprüfungen für Installationen - Teil 3: Abschottungen

Essais de résistance au feu des installations techniques - Partie 3 : Calfeutrements de trémie

(standards.iteh.ai)

Ta slovenski standard je istoveten z: prEN 1366-3

<https://standards.iteh.ai/catalog/standards/sist/db9ed8ab-2fd9-4949-aa11-089889ae05d3/osist-pren-1366-3-2018>

ICS:

13.220.50	Požarna odpornost gradbenih materialov in elementov	Fire-resistance of building materials and elements
-----------	---	--

oSIST prEN 1366-3:2018

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[oSIST prEN 1366-3:2018](#)

<https://standards.iteh.ai/catalog/standards/sist/db9ed8ab-2fd9-4949-aa11-089889ae05d3/osist-pren-1366-3-2018>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

DRAFT
prEN 1366-3

February 2018

ICS 13.220.50

Will supersede EN 1366-3:2009

English Version

Fire resistance tests for service installations - Part 3: Penetration seals

Essais de résistance au feu des installations techniques
- Partie 3 : Calfeutrements de trémie

Feuerwiderstandsprüfungen für Installationen - Teil 3:
Abschottungen

This draft European Standard is submitted to CEN members for enquiry. It has been drawn up by the Technical Committee CEN/TC 127.

If this draft becomes a European Standard, CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CEN in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

Warning : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents

Page

European foreword.....	8
Introduction.....	9
1 Scope	10
2 Normative references	10
3 Terms and definitions, symbols, units and abbreviations	12
3.1 Terms and definitions.....	12
3.2 Symbols, units and abbreviations	22
3.2.1 Symbols.....	22
3.2.2 Units	22
3.2.3 Abbreviations	22
4 Test equipment	23
5 Test conditions.....	23
5.1 Heating conditions.....	23
5.2 Pressure conditions.....	23
6 Test specimen	24
6.1 Size and distances	24
6.2 Number.....	25
6.3 Design	26
6.3.1 General.....	26
6.3.2 Advice for designing test specimen(s) without standard configuration.....	27
6.4 Construction.....	27
6.5 Verification	27
7 Installation of test specimen	27
7.1 General.....	27
7.2 Installation of the supporting construction including penetration(s)	28
7.2.1 General.....	28
7.2.2 Standard supporting constructions.....	28
7.3 Installation of service(s).....	29
7.3.1 General.....	29
7.3.2 Support conditions for penetrating services.....	29
7.3.3 Ballast weights on cable carriers in standard configurations	30
7.3.4 Pipe end configuration	36
7.3.5 Capping of conduits	37
7.3.6 Cable / waveguide / bus bar end configuration	37
7.3.7 Subsequent addition/removal of services	37
7.4 Installation of the penetration seal.....	37
8 Conditioning.....	37
9 Application of instrumentation.....	37
9.1 Thermocouples	37
9.1.1 Furnace thermocouples (plate thermometers).....	37
9.1.2 Unexposed face thermocouples	38
9.1.3 Roving thermocouple.....	44
9.2 Pressure	44

10	Test procedure.....	44
10.1	General.....	44
10.2	Integrity.....	44
10.3	Other observations.....	45
11	Performance criteria.....	45
11.1	Integrity.....	45
11.2	Insulation.....	45
11.3	Multiple and mixed penetration seals.....	45
11.4	Multiple penetrations.....	46
12	Test report.....	46
13	Field of direct application of test results.....	46
13.1	General.....	46
13.2	Orientation.....	46
13.3	Supporting construction.....	46
13.3.1	Rigid floor and wall constructions.....	46
13.3.2	Flexible wall constructions.....	47
13.4	Services.....	48
13.5	Service support construction.....	49
13.6	Penetration seal size.....	49
13.7	Distances.....	49
Annex A	(normative) Configuration and field of direct application for “cable penetration seals – large”.....	50
A.1	Purpose of Annex A.....	50
A.2	Overview of options for test set up and the resulting field of direct application.....	50
A.2.1	Standard configuration.....	50
A.2.2	Non-standard configuration.....	50
A.3	Designing the standard configuration test specimens.....	50
A.3.1	Specimen size.....	50
A.3.2	Services.....	50
A.3.3	Service options.....	50
A.3.4	Location of the services.....	51
A.3.5	Installation of the services / test equipment.....	53
A.4	Field of direct application.....	57
A.4.1	General.....	57
A.4.2	Cable type (construction characteristics).....	57
A.4.3	Cable size.....	57
A.4.4	Cable carriers.....	57
A.4.5	Distances.....	58
A.4.6	Cable support.....	58
Annex B	(normative) Configuration and field of direct application for “cable penetration seals — small”, modular systems and steel framed cable boxes.....	59

prEN 1366-3:2018 (E)

B.1	Configuration and field of direct application for “cable penetration seals — small”	59
B.1.1	Purpose of B.1	59
B.1.2	Overview of options for test set up and the resulting field of direct application	59
B.1.3	Designing the standard configuration test specimens	59
B.1.4	Field of direct application	64
B.2	Configuration and field of direct application for modular systems	66
B.2.1	Purpose of B.2	66
B.2.2	Overview of options for test set up and the resulting field of direct application	67
B.2.3	Designing the standard configuration test specimens	68
B.2.4	Field of direct application	69
B.3	Configuration and field of direct application for steel framed cable boxes	72
B.3.1	Purpose of B.3	72
B.3.2	Overview of options for test set up and the resulting field of direct application	72
B.3.3	Designing the standard configuration test specimens	72
B.3.4	Field of direct application for steel framed cable boxes	74
Annex C (normative)	Test configuration and field of direct application for conduits and trunkings for cables	76
C.1	Conduits	76
C.1.1	General	76
C.1.2	Standard conduit configuration	77
C.1.3	Field of direct application	83
C.2	Trunkings	86
C.2.1	General	86
C.2.2	Standard trunking configuration	86
C.2.3	Field of direct application	87
Annex D (normative)	Specimen design and field of direct application for bus bars / bus bar trunking units	88
D.1	Purpose of Annex D	88
D.2	Test specimen	88
D.3	Field of direct application	88
Annex E (normative)	Test specimen design, test procedure and field of direct application for pipe penetration seals	92
E.1	Purpose of Annex E	92
E.2	Selection of pipes to be included in the test	92
E.2.1	Metal pipes (hmp) in accordance with 3.1.37	92
E.2.2	Metal pipes (lmp) in accordance with 3.1.38	93
E.2.3	Coated metal pipes (hmp) in accordance with 3.1.39	93

E.2.4	Coated metal pipes (lmp) in accordance with 3.1.40	93
E.2.5	Single layer plastic pipes	93
E.2.6	Multilayer plastic pipes in accordance with 3.1.42	97
E.2.7	Composite pipes in accordance with 3.1.43	97
E.2.8	MLC pipes in accordance with 3.1.44	97
E.2.9	Pipes with the risk of fracture in accordance with 3.1.45	97
E.2.10	Small tubes	97
E.2.11	Pipe-in-pipe systems.....	98
E.2.12	Special installations	98
E.3	Designing the test specimen.....	98
E.3.1	Single arrangement (distance between pipes ≥ 100 mm).....	98
E.3.2	Linear arrangement or cluster arrangement (distance between pipes < 100 mm)	99
E.4	Field of direct application	102
E.4.1	General rules.....	102
E.4.2	Metal pipes (hmp) in accordance with 3.1.37	104
E.4.3	Metal pipes (lmp) in accordance with 3.1.38	113
E.4.4	Coated metal pipes (hmp) in accordance with 3.1.39	113
E.4.5	Coated metal pipes (lmp) in accordance with 3.1.40	113
E.4.6	Single layer plastic pipes.....	113
E.4.7	Multilayer plastic pipes in accordance with 3.1.42	122
E.4.8	Composite pipes in accordance with 3.1.43	123
E.4.9	MLC pipes in accordance with 3.1.44	123
E.4.10	Pipes with the risk of fracture in accordance 3.1.45	124
E.4.11	Small tubes	124
E.4.12	Pipe-in-pipe-systems	124
E.5	Floor penetrations ending at floor level (e.g. floor drain)	124
Annex F (normative)	Test specimen design, test procedure and field of direct application for mixed penetration seals.....	126
F.1	Purpose of Annex F.....	126
F.2	Mixed penetration seals containing pipes of different pipe material groups.....	126
F.2.1	Single arrangement (distance between pipes ≥ 100 mm).....	126
F.2.2	Linear arrangement or cluster arrangement (distance between pipes < 100 mm)	128
F.3	Mixed penetration seals containing cables and other services.....	133
F.3.1	General.....	133
F.3.2	Intended mixed penetration seal size ≥ 600 mm x 600 mm.....	133
F.3.3	Intended mixed penetration seal size ≥ 300 mm x 300 mm but < 600 mm x 600 mm	138

prEN 1366-3:2018 (E)

F.3.4	Intended mixed penetration seal size < 300 mm x 300 mm.....	141
F.4	Mixed penetration seals containing pipes and other services.....	144
F.5	Mixed penetration seals containing different services other than cables and pipes.....	144
F.6	Selection of previous test results (if available) for designing the test specimen.....	144
F.7	Field of direct application	144
F.7.1	General.....	144
F.7.2	Services	144
F.7.3	Distances.....	145
Annex G	(normative) Critical service approach	146
G.1	General.....	146
G.2	Criteria to identify the critical services.....	146
G.3	Identification and selection of the most critical services	147
G.3.1	Metal pipes (hmp) in accordance with 3.1.37	147
G.3.2	Metal pipes (lmp) in accordance with 3.1.38	147
G.3.3	Single layer Plastic pipes in accordance with 3.1.41	148
G.3.4	Multilayer plastic pipes in accordance with 3.1.42.....	148
G.3.5	Metal conduits (hmp) in accordance with 3.1.33.....	148
G.3.6	Metal conduits (lmp) in accordance with 3.1.34.....	148
G.3.7	Plastic conduits in accordance with 3.1.35.....	148
G.3.8	Metal trunkings (hmp) in accordance with 3.1.50.....	149
G.3.9	Metal trunkings (lmp) in accordance with 3.1.51	149
G.3.10	Plastic trunkings in accordance with 3.1.52.....	149
G.3.11	Composite pipes in accordance with 3.1.43.....	149
G.3.12	MLC pipes in accordance with 3.1.44	149
G.3.13	Bus bars and bus bar trunking units	149
G.3.14	Waveguides.....	150
G.3.15	Coaxial cables.....	150
Annex H	(informative) Explanatory notes.....	151
H.1	General.....	151
H.2	Notes on the scope and application of test results	151
H.2.1	General.....	151
H.3	Notes on test conditions.....	152
H.3.1	Size of furnace.....	152
H.3.2	Furnace pressure.....	152
H.4	Notes on test construction	152
H.4.1	Services	152

H.4.2	Pipe end configuration.....	158
H.4.3	Service support.....	160
H.4.4	Supporting construction.....	161
H.4.5	Distance between penetration seals.....	161
H.4.6	Non-standard cable configuration.....	161
H.4.7	Pipe penetration seals.....	162
H.4.8	Small penetration seals.....	164
H.4.9	Modular systems.....	164
H.4.10	Cable boxes.....	165
H.4.11	Mixed penetration seals.....	165
H.4.12	Fire exposure from the upper side.....	165
H.5	Notes on instrumentation.....	166
H.5.1	Thermocouple pad.....	166
H.5.2	Thermocouples A.....	166
H.6	Notes on test procedure.....	166
H.6.1	General.....	166
H.6.2	Blank penetration seal.....	166
H.6.3	Pipe penetration seals.....	166
H.6.4	Mixed penetration seals.....	168
H.6.5	Critical service approach.....	169
H.7	Notes on test criteria.....	169
H.8	Notes on validity of test results (field of application).....	169
H.8.1	Rigid wall or floor constructions.....	169
H.8.2	Flexible wall constructions.....	169
H.8.3	Cables.....	170
H.8.4	Conduits.....	170
H.8.5	Trunkings.....	171
H.8.6	Restriction of field of direct application in case of different test results for single services in multiple or mixed penetration seals.....	171
H.8.7	Penetration seal size.....	172
H.9	Notes on test report.....	173
	Bibliography.....	174

ITeH STANDARD PREVIEW
(standards.iteh.ai)

<https://standards.iteh.ai/catalog/standards/sist/db9ed8ab-2fd9-4949-aa11-089889ae05d3/osist-pren-1366-3-2018>

<https://standards.iteh.ai/catalog/standards/sist/db9ed8ab-2fd9-4949-aa11-089889ae05d3/osist-pren-1366-3-2018>

prEN 1366-3:2018 (E)**European foreword**

This document (prEN 1366-3:2018) has been prepared by Technical Committee CEN/TC 127 “*Fire Safety in Buildings*”, the secretariat of which is held by BSI.

This document is currently submitted to the CEN Enquiry.

This document will supersede EN 1366-3:2009.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association.

Annexes A to G are normative. Annex H is informative.

EN 1366 ‘*Fire resistance tests for service installations*’ consists of the following:

- Part 1: *Ducts*
- Part 2: *Fire dampers*
- Part 3: *Penetration seals*
- Part 4: *Linear joint seals*
- Part 5: *Service ducts and shafts*
- Part 6: *Raised access floors and hollow floors*
- Part 7: *Closures for conveyors and trackbound transportation systems*
- Part 8: *Smoke extraction ducts*
- Part 9: *Single compartment smoke extraction ducts*
- Part 10: *Smoke control dampers*
- Part 11: *Fire Protection system for essential services (in course of preparation)*
- Part 12: *Non-mechanical fire barrier for ventilation ductwork*
- Part 13: *1-, 2-, 3-sided ventilation ducts (in course of preparation)*
- Part 14: *Kitchen extraction ducts*
- Part 15: *Combined penetration seals (in course of preparation)*

Introduction

This part of the EN 1366 series has been prepared to provide a method of test for assessing the contribution of a penetration seal to the fire resistance of separating elements when they have been penetrated by a service or services.

Caution

The attention of all persons concerned with managing and carrying out fire resistance testing is drawn to the fact that fire testing can be hazardous and that there is a possibility that toxic and/or harmful smoke and gases will be emitted during the test. Mechanical and operational hazards might also arise during the construction of the test elements or structures, their testing and disposal of test residues.

An assessment of all potential hazards and risks to health should be made and safety precautions should be identified and provided. Written safety instructions should be issued. Appropriate training should be given to relevant personnel. Laboratory personnel should ensure that they follow written safety instructions at all times.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN 1366-3:2018](https://standards.iteh.ai/catalog/standards/sist/db9ed8ab-2fd9-4949-aa11-089889ae05d3/osist-pren-1366-3-2018)

<https://standards.iteh.ai/catalog/standards/sist/db9ed8ab-2fd9-4949-aa11-089889ae05d3/osist-pren-1366-3-2018>

prEN 1366-3:2018 (E)**1 Scope**

This part of the EN 1366 series specifies a method of test and criteria for the evaluation (including field of direct application rules) of the ability of a penetration seal to maintain the fire resistance of a separating element at the position at which it has been penetrated by a service or services. Penetration seals used to seal gaps around chimneys, air ventilation systems, fire rated ventilation ducts, fire rated service ducts, shafts and smoke extraction ducts as well as combined penetration seals are excluded from this part of the EN 1366 series. Supporting constructions are used in this part of the EN 1366 series to represent separating elements such as walls or floors. These simulate the interaction between the test specimen and the separating element into which the sealing system is to be installed in practice.

This part of the EN 1366 series is intended to be used in conjunction with EN 1363-1.

The purpose of a test described in this part of the EN 1366 series is to assess the integrity and insulation performance of the penetration seal, of the penetrating service or services and of the separating element in the surrounding area of the penetration seal.

No information can be implied by the test concerning the influence of the inclusion of such penetrations and penetration seals on the loadbearing capacity of the separating element.

It is assumed that in each case the lintel above a penetration seal in the wall is designed in hot and cold state in a way that it does not apply any additional vertical load on the penetration seal.

It is not the intention of this test to provide quantitative information on the rate of leakage of smoke and/or hot gases or on the transmission or generation of fumes. Such phenomena are only to be noted in the test report in describing the general behaviour of test specimens during the test.

Tests in accordance with this part of the EN 1366 series are not intended to supply any information on the ability of the penetration seal to withstand stress caused by movements or displacements of the penetrating services.

The risk of spread of fire downwards caused by burning material, which drips through a pipe downwards to floors below, cannot be assessed with this test.

Tests in accordance with this part of the EN 1366 series do not address any risks associated with leakage of dangerous liquids or gases caused by failure of the pipe(s) in case of fire.

Tests in accordance with this part of the EN 1366 series of pipe penetration seals for pipes of pneumatic dispatch systems, pressurized air systems etc. simulate a situation where the systems are shut off in case of fire.

Explanatory notes to this test method are given in Annex H.

All values given without tolerances in this Standard are nominal ones unless otherwise specified.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 520, *Gypsum plasterboards – Definitions, requirements and test methods*

EN 1329-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure - Unplasticized poly(vinyl chloride) (PVC-U) - Part 1: Specifications for pipes, fittings and the system*

EN 1363-1, *Fire resistance tests - Part 1: General Requirements*

EN 1363-2, *Fire resistance tests - Part 2: Alternative and additional procedures*

EN 1451-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure - Polypropylene (PP) - Part 1: Specifications for pipes, fittings and the system*

EN 1453-1, *Plastics piping systems with structured-wall pipes for soil and waste discharge (low and high temperature) inside buildings - Unplasticized poly(vinyl chloride) (PVC-U) - Part 1: Specifications for pipes and the system*

EN 1455-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure - Acrylonitrile-butadiene-styrene (ABS) - Part 1: Requirements for pipes, fittings and the system*

EN 1519 (all parts), *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure - Polyethylene (PE)*

EN 1565-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure - Styrene copolymer blends (SAN+PVC) - Part 1: Specifications for pipes, fittings and the system*

EN 1566-1, *Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure - Chlorinated poly(vinyl chloride) (PVC-C) - Part 1: Specifications for pipes, fittings and the system*

EN 10305-4, *Steel tubes for precision applications - Technical delivery conditions - Part 4: Seamless cold drawn tubes for hydraulic and pneumatic power systems*

<https://standards.iteh.ai/catalog/standards/sist/db9ed8ab-2fd9-4949-aa11->

EN 10305-6, *Steel tubes for precision applications - Technical delivery conditions - Part 6: Welded cold drawn tubes for hydraulic and pneumatic power systems*

EN 12201-2, *Plastics piping systems for water supply, and for drainage and sewerage under pressure - Polyethylene (PE) - Part 2: Pipes*

EN 12449, *Copper and copper alloys - Seamless, round tubes for general purposes*

EN 12666-1, *Plastics piping systems for non-pressure underground drainage and sewerage - Polyethylene (PE) - Part 1: Specifications for pipes, fittings and the system*

EN 13501-1, *Fire classification of construction products and building elements - Part 1: Classification using test data from reaction to fire tests*

EN 13501-2, *Fire classification of construction products and building elements - Part 2: Classification using data from fire resistance tests, excluding ventilation services*

EN 13600, *Copper and copper alloys - Seamless copper tubes for electrical purposes*

EN 61386-21, *Conduit systems for cable management - Part 21: Particular requirements - Rigid conduit systems (IEC 61386-21)*

EN ISO 1452-2, *Plastics piping systems for water supply and for buried and above-ground drainage and sewerage under pressure - Unplasticized poly(vinyl chloride) (PVC-U) - Part 2: Pipes (ISO 1452-2)*

prEN 1366-3:2018 (E)

EN ISO 13943, *Fire safety - Vocabulary (ISO 13943)*

EN ISO 15493, *Plastics piping systems for industrial applications - Acrylonitrile-butadiene-styrene (ABS), unplasticized poly(vinyl chloride) (PVC-U) and chlorinated poly(vinyl chloride) (PVC-C) - Specifications for components and the system - Metric series (ISO 15493)*

HD 21.3, *Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V – Part 3: Non-sheathed cables for fixed wiring*

HD 603 S1, *Distribution cables of rated voltage 0,6/1 kV*

HD 604 S1, *0,6/1 kV and 1,9/3,3 kV power cables with special fire performance for use in power stations*

3 Terms and definitions, symbols, units and abbreviations**3.1 Terms and definitions**

For the purposes of this document, the terms and definitions given in EN 1363-1 and EN ISO 13943 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1.1**penetration**

aperture in a separating element with one or more services passing through

3.1.2**penetration seal**

system used to maintain the fire resistance of a separating element at the position where one or more services pass through or where there is provision for services to pass through a separating element (for the latter see blank penetration seal)

3.1.3**blank penetration seal**

aperture in the separating element without services passing through which is sealed or closed by the specified seal

Note 1 to entry: A blank penetration seal is used in the test setup to simulate penetrations with only a few services (low infill rate)

3.1.4**single service penetration seal**

penetration seal intended for penetrations with only one service passing through

3.1.5**multiple penetration seal**

penetration seal intended for penetrations where more than one service of the same type (e.g. cables or pipes) pass through

3.1.6**mixed penetration seal**

penetration seal intended for penetrations where more than one type of services (e.g. cables and plastic and/or metal pipes, but no ducts or fire dampers) pass through

3.1.7**combined penetration seal**

mixed penetration seal with fire ducts or fire dampers passing through

3.1.8**cable penetration seal - large**

cable penetration seal intended for a penetration larger than or equal to 300 mm x 300 mm or 430 mm in diameter

3.1.9**cable penetration seal - small**

cable penetration seal intended for a penetration smaller than 300 mm x 300 mm or 430 mm in diameter

3.1.10**primary part of the penetration seal**

part of the penetration seal used to fill the penetration

Note 1 to entry: See Figure 1.

Note 2 to entry: Parts of the penetration seal filling the space created by a beading or extending over the penetration on the separating element (e.g. a coating of a slab) are also taken as part of the primary part of the penetration seal

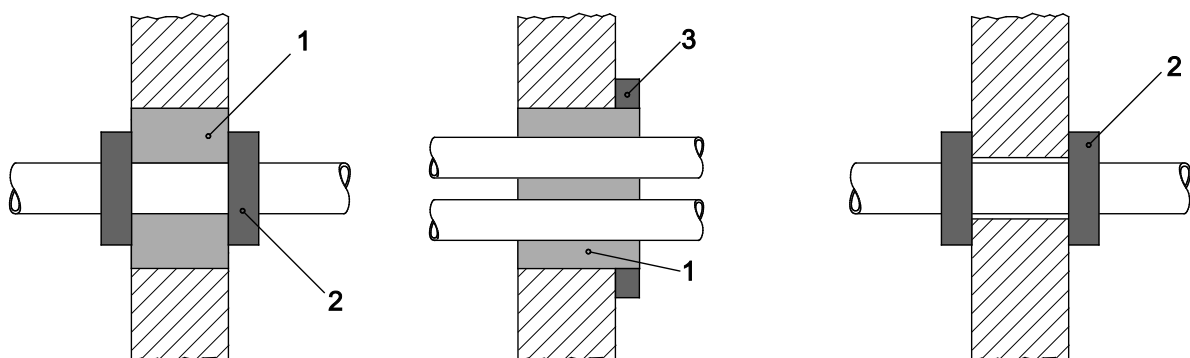
oSIST prEN 1366-3:2018

<https://standards.iteh.ai/catalog/standards/sist/db9ed8ab-2fd9-4949-aa11-089889ae05d3/osist-pren-1366-3-2018>

3.1.11**secondary part of the penetration seal**

part of the penetration seal in addition to the *primary part of the penetration seal* that is related to a service

EXAMPLE *Insulation material on pipes, intumescent coatings on cables and/or pipe closure devices on plastic pipes; see Figure 1.*

**Key**

- 1 primary part of the penetration seal (e.g. mortar, foam)
- 2 secondary part(s) of the penetration seal (as an example pipe collars are shown)
- 3 framing or beading

Figure 1 — Primary and secondary part of the penetration seal