
Carbon dioxide capture —
Part 1:
Performance evaluation methods
for post-combustion CO₂ capture
integrated with a power plant

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Captage du dioxyde de carbone —

Partie 1: Méthodes d'évaluation des performances pour le captage du
CO₂ post-combustion intégré à une centrale thermique

ISO 27919-1:2018

<https://standards.iteh.ai/catalog/standards/sist/ce84d809-48cc-4dfe-9647-9a914ea62dc0/iso-27919-1-2018>



iTeh STANDARD PREVIEW (standards.iteh.ai)

ISO 27919-1:2018

<https://standards.iteh.ai/catalog/standards/sist/ce84d809-48cc-4dfe-9647-9a914ea62dc0/iso-27919-1-2018>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2018

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

Page

Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	2
3 Terms, definitions and symbols	2
4 Defining the system boundary	10
4.1 PCC plant integrated with a host power plant	10
4.2 Boundary of the PCC plant, host power plant and utilities	10
5 Definition of basic PCC plant performance	21
5.1 General	21
5.2 Input and output streams	21
5.3 Capture efficiency of the absorber	21
5.4 Flow rate of the product CO ₂ stream from a PCC plant	22
5.5 Properties of product CO ₂ stream at CO ₂ compression system outlet	23
5.5.1 General	23
5.5.2 Compositions of product CO ₂ stream	23
5.5.3 CO ₂ stream compressor system outlet pressure	23
5.5.4 Others	24
6 Definition of utilities and consumption calculation	24
6.1 General	24
6.2 Low-pressure – medium-pressure steam	24
6.2.1 Definition of utility	24
6.2.2 Consumption calculation	26
6.3 Cooling water	26
6.3.1 Definition of CW	26
6.3.2 Consumption calculation	28
6.4 Electrical energy	28
6.4.1 Definition of electrical energy consumption evaluation	28
6.5 Demineralized water and industrial water	30
6.6 Absorbent and chemical	30
7 Guiding principles — Basis for PCC plant performance assessment	30
7.1 General	30
7.2 Guiding principle of the performance test	31
7.2.1 General	31
7.2.2 Power plant and capture unit conditions	31
8 Instruments and measurement methods	32
8.1 General requirement	32
8.1.1 Introduction	32
8.1.2 Instrument classification	32
8.1.3 Measurement uncertainty	33
8.1.4 Calibration of instrument	33
8.1.5 Permanent plant instrument	33
8.1.6 Redundant instrument	33
8.2 Measurement method	34
8.2.1 Flue gas	34
8.2.2 Product CO ₂ stream at the CO ₂ compressor outlet	34
8.2.3 Steam and steam condensate	35
8.2.4 Cooling water	35
8.2.5 Electric power measurement	35
8.2.6 Measurement of pressure and temperature	35
8.2.7 Data collection and handling	36

9	Evaluation of key performance indicators	36
9.1	Introduction	36
9.2	Specific thermal energy consumption (STEC)	36
9.3	Specific electrical energy consumption (SEC)	37
9.4	Specific equivalent electrical energy consumption (SEEC)	37
9.5	Specific reduction in CO ₂ emissions (SRCE)	38
9.6	Specific absorbent consumption and specific chemical consumption (SAC and SCC)	38
Annex A	(informative) Summary of streams and equipment nomenclature	40
Annex B	(informative) Test principles and guidelines	44
Annex C	(informative) Instruments and measurement methods	48
Annex D	(informative) Additional approaches of performance evaluation for a PCC plant integrated with a power plant	56
Annex E	(informative) Reference conditions	59
Annex F	(informative) Check list for performance evaluation	61
Bibliography		62

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 27919-1:2018

<https://standards.iteh.ai/catalog/standards/sist/ce84d809-48cc-4dfe-9647-9a914ea62dc0/iso-27919-1-2018>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2. www.iso.org/directives

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received. www.iso.org/patents

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT) see the following URL: Foreword - Supplementary information

This document was prepared by Technical Committee ISO/TC 265, *Carbon dioxide capture, transportation and geological storage*.

A list of all the parts in the ISO 27919 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

It is very important to reduce atmospheric carbon dioxide (CO₂) emissions in order to meet climate change mitigation targets. Inclusion of carbon dioxide capture and storage (CCS) among the variety of available emission reduction approaches enhances the probability of meeting these targets at the lowest cost to the global economy. CCS captures CO₂ from industrial and energy-related sources and stores it underground in geological formations. It can capture emissions from carbonaceous fuel-based combustion processes, including power generation, and is the only technology capable of dealing directly with emissions from several industrial sectors, such as cement manufacture and fertilizer production.

This document is the first in a series of standards for CO₂ capture. It is limited to evaluation of key performance indicators (KPIs) for post-combustion CO₂ capture (PCC) from a power plant using a liquid-based chemical absorption process. New or revised standards focused on other capture technologies and approaches will be developed at a later date.

PCC is applicable to all combustion-based thermal power plants. A simplified block diagram illustrating the PCC is shown in [Figure 1](#).

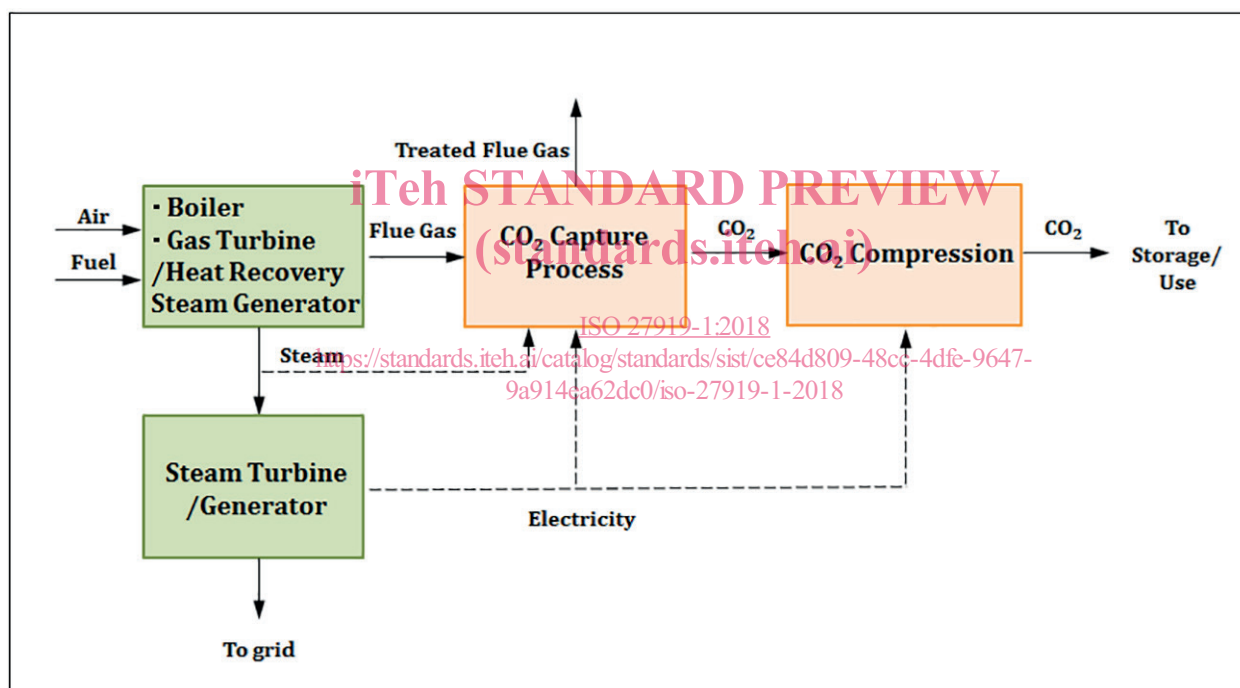


Figure 1 — Simplified block diagram for PCC

In a typical power generation facility, carbonaceous fuel (e.g. coal, oil, gas, biomass) is combusted with air in a boiler to raise steam that drives a turbine/generator to produce power. In a gas turbine combined cycle system, the combustion occurs in the gas turbine to drive power generation, and steam generated through a heat recovery steam generator (HRSG) contributes to additional power generation. Flue gas from the boiler or gas turbine consists mostly of N₂, CO₂, H₂O and O₂ with smaller amounts of other compounds depending on the fuel used. The CO₂ capture process is located downstream of conventional pollutant controls. Chemical absorption-based PCC usually requires the extraction of steam from the power plant's steam cycle or, depending on the absorption liquid/process employed, the use of lower grade heat sources for absorption liquid regeneration.

The intended readership for this document includes power plant owners and operators, project developers, technology developers and vendors, regulators, and other stakeholders. The document will provide several benefits, as outlined in the clauses below. In brief, it provides a common basis to estimate, measure, evaluate and report on the performance of a PCC plant integrated with a power

plant. It can help various stakeholders to identify potential efficiency improvements among different plant components. It can help to guide the selection of measurement methodologies, and serve as a resource in development of regulations. Finally, it provides the basis for future standards development.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 27919-1:2018

<https://standards.iteh.ai/catalog/standards/sist/ce84d809-48cc-4dfe-9647-9a914ea62dc0/iso-27919-1-2018>

iTeh STANDARD PREVIEW **(standards.iteh.ai)**

ISO 27919-1:2018

<https://standards.iteh.ai/catalog/standards/sist/ce84d809-48cc-4dfe-9647-9a914ea62dc0/iso-27919-1-2018>

Carbon dioxide capture —

Part 1:

Performance evaluation methods for post-combustion CO₂ capture integrated with a power plant

1 Scope

This document specifies methods for measuring, evaluating and reporting the performance of post-combustion CO₂ capture (PCC) integrated with a power plant, and which separates CO₂ from the power plant flue gas in preparation for subsequent transportation and geological storage. In particular, it provides a common methodology to calculate specific key performance indicators for the PCC plant, requiring the definition of the boundaries of a typical system and the measurements needed to determine the KPIs.

This document covers thermal power plants burning carbonaceous fuels, such as coal, oil, natural gas and biomass-derived fuels, which are producing CO₂ from boilers or gas turbines, and are integrated with CO₂ capture.

The PCC technologies covered by this document are those based on chemical absorption using reactive liquids, such as aqueous amine solutions, potassium carbonate solutions, and aqueous ammonia. Other PCC concepts based on different principles (e.g. adsorption, membranes, cryogenic) are not covered. The PCC plant can be installed for treatment of the full volume of flue gas from the power plant or a fraction of the total (i.e. a slip stream). Captured CO₂ is processed in a compression or liquefaction step as determined by the conditions for transportation and storage.

The KPIs considered in this document are the following:

- a) Specific thermal energy consumption (STEC);
- b) Specific electrical energy consumption (SEC);
- c) Specific equivalent electrical energy consumption (SEEC);
- d) Specific reduction in CO₂ emissions (SRCE);
- e) Specific absorbent consumption (SAC) and specific chemical consumption (SCC).

The calculations are based on measurements at the boundaries of the considered system, particularly of energy and utilities consumption. The integrated system includes the definition of interfaces between the PCC plant and the power plant.

This document includes the following items:

- The system boundary which defines the boundaries of the PCC plant and identifies which streams of energy and mass are crossing these boundaries to help power plant operators identify the key streams that are applicable for their particular case.
- Basic PCC plant performance which defines the parameters that describe the basic performance of the PCC plant.
- Definition of utilities and consumption calculation which lists the utility measurements required and provides guidance on how to convert utility measurements into the values required for the KPIs.

- Guiding principles - Basis for PCC plant performance assessment which describes all guidelines to prepare, set-up and conduct the tests.
- Instruments and measurement methods which lists the standards available for the relevant measurements and considerations to take into account when applying measurement methods to PCC plants.
- Evaluation of key performance indicators which specifies the set of KPIs to be determined and their calculation methods to provide a common way of reporting them.

This document does not provide guidelines for benchmarking, comparing or assessing KPIs of different technologies or different PCC projects.

NOTE For the purposes of this document, thermal energy and electric energy are expressed by the unit of “J” (Joule) and “Wh” (Watt hour) respectively unless otherwise noted, with a prefix of International System of Units (SI) if necessary. (1 J = 1 W·s, 1 Wh = 1 W·h = 3 600 J).

2 Normative references

There are no normative references in this document.

3 Terms, definitions and symbols

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>
<https://standards.iteh.ai/catalog/standards/sist/ce84d809-48cc-4dfe-9647-9a914ea62dc0/iso-27919-1-2018>

3.1 Terms and definitions

3.1.1

absorbent

substance able to absorb liquid or gas

[SOURCE: ISO/TR 27912:2016, definition 3.1]

3.1.2

measurement accuracy

accuracy of measurement

accuracy

closeness of agreement between a measured quantity value and a true quantity value of a measurand

[SOURCE: ISO/IEC Guide 99:2007, definition 2.13]

3.1.3

auxiliary unit

unit providing heat, power and/or other utilities for the PCC plant

3.1.4

boiler feed water

water consisting of the condensate and the make-up water that is sent to the boiler

3.1.5**carbon dioxide capture and storage****CCS**

process consisting of the separation of CO₂ from industrial and energy-related sources, transportation and injection into a geological formation, resulting in long term isolation from the atmosphere

Note 1 to entry: CCS is often referred to as Carbon Capture and Storage. This terminology is not encouraged because it is inaccurate: the objective is the capture of carbon dioxide and not the capture of carbon. Tree plantation is another form of carbon capture that does not describe precisely the physical process of removing CO₂ from industrial emission sources.

Note 2 to entry: The term "sequestration" is also used alternatively to "storage". The term "storage" is preferred since "sequestration" is more generic and can also refer to biological processes (absorption of carbon by living organisms).

Note 3 to entry: Long term means the minimum period necessary for CO₂ geological storage to be considered an effective and environmentally safe climate-change-mitigation-option.

Note 4 to entry: The term carbon dioxide capture, utilization (or use) and storage (CCUS) includes the concept that isolation from the atmosphere could be associated with a beneficial outcome. CCUS is embodied within the definition of CCS to the extent that long term isolation of the CO₂ occurs through storage within geological formations. CCU is Carbon Capture and utilization (or use) without storage within geological formations.

Note 5 to entry: CCS should also ensure long term isolation of CO₂ from oceans, lakes, potable water supplies and other natural resources.

[SOURCE: ISO 27917:2017, definition 3.1.1]

3.1.6**carbonaceous fuels**

any solid, liquid or gaseous fuels containing carbon atoms

3.1.7**capture plant**

process and associated equipment that produces a CO₂ stream

3.1.8**chemical absorption**

process in which CO₂ is absorbed by chemical reaction

3.1.9**CO₂ capture efficiency****capture efficiency**

CO₂ removal efficiency of the capture plant calculated as the amount of CO₂ captured divided by the total amount of CO₂ contained in the flue gas at the inlet of the capture plant

Note 1 to entry: The CO₂ capture efficiency is expressed as a percentage.

3.1.10**CO₂ captured**

absolute amount of pure CO₂ captured by the capture plant

3.1.11**CO₂ stream**

stream consisting overwhelmingly of carbon dioxide

[SOURCE: ISO 27917:2017, definition 3.1.1, modified — The Note was deleted.]

3.1.12**condensate**

water produced by condensation of steam, e.g. a boiler of PCC return to the steam cycle and/or auxiliary boiler

3.1.13

**deep flue gas desulfurization
deep FGD**

SO₂ removal unit placed downstream of the main flue gas desulfurization process intended to lower the SO₂ content to the level required by the CO₂ capture plant

Note 1 to entry: Also called a “polishing” FGD.

Note 2 to entry: In the case where no FGD is required by local regulations, and FGD is installed for the purposes of CCS, the new unit will be considered as deep FGD.

3.1.14

dehydrator

moisture removal system and/or equipment

3.1.15

demineralized water

water from which the mineral matter or salts have been removed

[SOURCE: ISO/TR 27912:2016, definition 3.24, modified — The second term “demin water” was removed and in the definition the word “of” was replaced by “from”.]

3.1.16

DeNO_x

process or equipment used to remove NO_x from the flue gas

3.1.17

effluent

liquid discharged to the environment

iTeh STANDARD PREVIEW
(standards.iteh.ai)

3.1.18

fuel specific emission

amount of component generated from complete combustion per unit of heat energy released

<https://standards.iteh.ai/catalog/standards/sist/ce84d809-48cc-4dfe-9647-9a514ca02d00/iso-27919-1-2018>

3.1.19

host power plant

power plant from which flue gas is sent to the PCC plant

3.1.20

impurities

non-CO₂ substances that are part of the CO₂ stream that may be derived from the source materials or the capture process, or added as a result of commingling for transportation, or released or formed as a result of sub-surface storage and/or leakage of CO₂

[SOURCE: ISO 27917:2017, definition 3.2.12, modified — Notes 1 and 2 were deleted.]

3.1.21

interface

mechanical, thermal, electrical, or operational common boundary between two elements of a system

[SOURCE: ISO 10795:2011, definition 1.120, modified — The abbreviation “I/F” was deleted.]

3.1.22

key performance indicator

measure of performance relevant to the PCC plant integrated with a power plant

3.1.23**measurement uncertainty**

uncertainty of measurement

uncertainty

non-negative parameter characterizing the dispersion of the quantity values being attributed to a measurand, based on the information used

Note 1 to entry: Measurement uncertainty includes components arising from systematic effects, such as components associated with corrections and the assigned quantity values of physical properties, as well as the definitional uncertainty. Sometimes estimated systematic effects are not corrected for; associated measurement uncertainty components are incorporated instead.

Note 2 to entry: The parameter may be, for example, a standard deviation called standard measurement uncertainty (or a specified multiple of it), or the half-width of an interval, having a stated coverage probability.

Note 3 to entry: Measurement uncertainty comprises, in general, many components. Some of these may be evaluated by Type A evaluation of measurement uncertainty from the statistical distribution of the quantity values from a series of measurements and can be characterized by standard deviations. The other components, which may be evaluated by Type B evaluation of measurement uncertainty, can also be characterized by standard deviations, evaluated from probability density functions based on experience or other information.

Note 4 to entry: In general, for a given set of information, it is understood that the measurement uncertainty is associated with a stated quantity value attributed to the measurand. A modification of this value results in a modification of the associated uncertainty.

Note 5 to entry: "Type A evaluation of measurement uncertainty" is defined as an evaluation of a component of measurement uncertainty by a statistical analysis of measured quantity values obtained under defined measurement conditions. "Type B evaluation of measurement uncertainty" is defined as an evaluation of a component of measurement uncertainty determined by means other than a Type A evaluation of measurement uncertainty".

[SOURCE: ISO/IEC Guide 99:2007, definition 2.26, modified — "measurement standards" in Note 1 was changed to "physical properties", and a Note 5 was added.]

3.1.24**PM**

particulate matter including PM_{2,5}, PM₁₀, and/or total suspended particulate matter

[SOURCE: ISO 25597:2013, definition 3.21]

3.1.25**particulate removal**

action to remove particulate matter from the flue gas stream

3.1.26**PCC plant**

process and associated equipment that produces a CO₂ stream from combustion gases

3.1.27**permanent plant instrument**

instrument installed in the power plant and capture plant for control and monitoring

3.1.28**post-combustion CO₂ capture**

capture of carbon dioxide from flue gas stream produced by carbonaceous fuel combustion

[SOURCE: ISO/TR 27912:2016, definition 3.51, modified — In the term, "CO₂" was added and "fuel air combustion" was modified to "carbonaceous fuel combustion" in the definition.]

3.1.29**product CO₂ stream**

stream produced by a CO₂ capture and compression/liquefaction process

3.1.30

reclaiming system

system used to recover CO₂ absorbents for use in the PCC plant to remove the heat stable salts produced by the reaction of organic and inorganic acids with the amine(s) in the absorbents

3.1.31

redundant instrument

duplicate instrument necessary to plant functioning in case of failure of similar instruments for measurement of the same parameters

3.1.32

reference power plant

power plant that is considered to be representative of power generation without CO₂ capture

Note 1 to entry: The power plant is either real or hypothetical.

3.1.33

regeneration

process to regenerate an activity of absorbent after use to its operationally effective state

3.1.34

rejected heat

heat dissipated to the environment by cooling equipment

3.1.35

specific absorbent consumption

amount of CO₂ absorbent consumed to capture and compress/liquefy a tonne of CO₂

3.1.36

specific reduction in CO₂ emissions

calculated net decrease of the CO₂ emissions per unit output of a reference power plant by implementing the PCC process to the host power plant

Note 1 to entry: This measure of emission reduction is normalised with respect to the output of the power plant.

[SOURCE: ISO 27917:2017, definition 3.2.8, modified — “baseline scenario and the CCS project output” has been replaced by “per unit output of a reference power plant by implementing the PCC process to the host power plant”.]

3.1.37

specific chemical consumption

amount of chemical consumed to capture and compress/liquefy a tonne of CO₂

3.1.38

specific equivalent electrical energy consumption

overall electrical energy consumption attributed to capture and compression/liquefaction of a tonne of CO₂

3.1.39

specific electrical energy consumption

electrical energy consumed to capture and compress/liquefy a tonne of CO₂

3.1.40

specific thermal energy consumption

thermal energy consumed to capture and compress/liquefy a tonne of CO₂

3.1.41**reference conditions**

conditions for a reference point where results of performance evaluation could be adjusted for the purpose of comparability in the reporting of the results and benchmarking

Note 1 to entry: See Annex E which presents standard reference conditions used as a reference point to adjust the results of performance evaluation.

3.1.42**thermal power plant**

power plant that converts heat e.g. released by the combustion of carbonaceous fuels into electricity

3.1.43**tie-in point**

point of connection between the utility supply and the PCC plant

Note 1 to entry: This point sits at the PCC plant boundary.

3.1.44**treated flue gas**

flue gas of which the CO₂ concentration has been reduced after passing through a PCC plant

3.1.45**utilities**

ancillary services needed in the operation of a process, such as steam, electricity, cooling water (CW), demineralised water, compressed air, refrigeration and effluent disposal

3.1.46**vent gases**

gases other than flue gases or treated flue gases that are intentionally emitted to the atmosphere

3.1.47**waste heat**

heat generated by a process that would normally be dissipated to the environment if special measures for its utilization were not implemented

3.1.48**waste water**

excess water allowed to run to waste from the water circuit

[SOURCE: ISO 1213-1:1993, definition 5.1.18]

3.1.49**wet-basis**

condition in which a solid, such as a fuel or a gas, such as flue gas, contains moisture

3.2 Abbreviations

CCS	carbon dioxide capture and storage
CW	cooling water
DP	differential pressure
FGD	flue gas desulfurization
FSE	fuel specific emission
GTCC	gas turbine combined cycle
HP	high pressure
HRSG	heat recovery steam generator
IP	intermediate pressure