



**SLOVENSKI STANDARD**  
**SIST-TP CEN/TR 17801:2022**

**01-maj-2022**

---

**Smernice za zasnovno načrta vodne varnosti v stavbah**

Guidelines for water safety plan concept in buildings

Leitfaden für die Umsetzung des Water Safety Plan Konzeptes in Gebäuden

Lignes directrices pour concevoir des plan de sécurité pour l'eau dans les bâtiments

**Ta slovenski standard je istoveten z: CEN/TR 17801:2022**

---

[SIST-TP CEN/TR 17801:2022](https://standards.iteh.ai/catalog/standards/sist/8f8a2912-a18b-40d2-a2ea-175b0c629477/sist-tp-cen-tr-17801-2022)

**ICS:**

91.140.60

Sistemi za oskrbo z vodo

Water supply systems

**SIST-TP CEN/TR 17801:2022**

**en,fr,de**

**iTeh STANDARD  
PREVIEW  
(standards.iteh.ai)**

SIST-TP CEN/TR 17801:2022

<https://standards.iteh.ai/catalog/standards/sist/8f8a2912-a18b-40d2-a2ea-175b0c629477/sist-tp-cen-tr-17801-2022>

TECHNICAL REPORT

CEN/TR 17801

RAPPORT TECHNIQUE

TECHNISCHER BERICHT

February 2022

ICS 13.060.20; 91.140.60

English Version

## Guidelines for water safety plan concept in buildings

Lignes directrices relatives au plan de gestion de la  
sécurité sanitaire de l'eau dans les bâtiments

Leitfaden für die Umsetzung des Water Safety Plan  
Konzeptes in Gebäuden

This Technical Report was approved by CEN on 24 January 2022. It has been drawn up by the Technical Committee CEN/TC 164.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

**iTeh STANDARD  
PREVIEW  
(standards.iteh.ai)**

[SIST-TP CEN/TR 17801:2022](https://standards.iteh.ai/catalog/standards/sist/8f8a2912-a18b-40d2-a2ea-175b0c629477/sist-tp-cen-tr-17801-2022)

<https://standards.iteh.ai/catalog/standards/sist/8f8a2912-a18b-40d2-a2ea-175b0c629477/sist-tp-cen-tr-17801-2022>



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

<b>Contents</b>	<b>Page</b>
European foreword .....	3
Introduction .....	4
1 Scope.....	5
2 Normative references.....	5
3 Terms and definitions .....	5
4 Symbols and abbreviations .....	7
5 Modules and process of the WSP.....	8
5.1 Flowchart and elements of the Water Safety Plan .....	8
5.2 Assembling WSP-Team .....	9
5.3 System description .....	9
5.3.1 Technical description.....	9
5.3.2 Preliminary talk .....	10
5.3.3 Inventory documentation .....	11
5.4 System assessment.....	12
5.4.1 Identify Hazards and hazardous events .....	12
5.4.2 Assess and prioritize risks .....	13
5.4.3 Results of the risk assessment .....	15
5.5 Controlling risks.....	15
5.5.1 Determination of measures .....	15
5.5.2 Monitoring of measures .....	15
5.5.3 Define corrective actions .....	16
5.5.4 Validation of measures .....	16
6 Verification.....	17
7 Revision.....	17
Annex A (informative) Supplement to the inventory documentation .....	18
Bibliography .....	19

## European foreword

This document (CEN/TR 17801:2022) has been prepared by Technical Committee CEN/TC 164 “Water supply”, the secretariat of which is held by AFNOR.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

Any feedback and questions on this document should be directed to the users’ national standards body. A complete listing of these bodies can be found on the CEN website.

# iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST-TP CEN/TR 17801:2022](https://standards.iteh.ai/catalog/standards/sist/8f8a2912-a18b-40d2-a2ea-175b0c629477/sist-tp-cen-tr-17801-2022)

<https://standards.iteh.ai/catalog/standards/sist/8f8a2912-a18b-40d2-a2ea-175b0c629477/sist-tp-cen-tr-17801-2022>

## Introduction

This document describes the elements and the procedure of the Water Safety Plan for potable water installations inside buildings and, for certain purposes, outside buildings but within the premises. The Water Safety Plan is a risk-based management approach, which aims to provide safe potable water at the point of consumption of the potable water installation. In order to achieve this goal, the Water Safety Plan includes a method for the analysis, evaluation and control of risks, which are described in this document as a combination of likelihood and severity of impact of hazard and hazardous events and which are present or may arise in the context of the use of potable water installations.

The Water Safety Plan described in this document is based on the principles of process-oriented risk management outlined in EN 15975-2 for potable water supply systems and it supports the European Union Recast Drinking Water Directive 2020/2184/EU [1].

# iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST-TP CEN/TR 17801:2022](https://standards.iteh.ai/catalog/standards/sist/8f8a2912-a18b-40d2-a2ea-175b0c629477/sist-tp-cen-tr-17801-2022)

<https://standards.iteh.ai/catalog/standards/sist/8f8a2912-a18b-40d2-a2ea-175b0c629477/sist-tp-cen-tr-17801-2022>

## 1 Scope

This document describes a method for the analysis, evaluation and management of risks that exist or may arise from the use of potable water installations within buildings and, for certain purposes, outside buildings but within the premises. Water Safety Plans for potable water supply systems are excluded from the scope of this document.

The document is addressed to all organisations and other stakeholders which are responsible for providing potable water within a safe potable water installation inside buildings according to EN 806, EN 1717 and national regulations.

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 806-1, *Specifications for installations inside buildings conveying water for human consumption - Part 1: General*

## 3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 806-1 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <https://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

### 3.1

**Water Safety Plan** <https://standards.iteh.ai/catalog/standards/sist/8f8a2912-a186-49d2-a2ca-17580c62947/sist-tp-cen-tr-17801-2022>  
 approach to ensure the safety of potable water through the use of a comprehensive risk assessment and risk management that encompasses all steps in water supply from catchment to consumer. For the purpose of this technical report, WSP is limited to potable water installations within buildings and, for certain purposes, outside buildings but within the premises

[SOURCE: EN 806-1, definition Figure 1]

### 3.2

#### **likelihood of occurrence**

chance of a hazardous event happening, whether defined, measured or determined objectively or subjectively, qualitatively or quantitatively, and described using general or mathematical terms (such as a probability or a frequency over a given time period)

### 3.3

#### **building**

structure that includes rooms, can be entered and serves the stay and residence of people, animals or the storage of things. It includes also structures intended for commercial and industrial uses

### 3.4

#### **hazard**

biological, chemical, physical or radiological agents in water, or condition (aerosol, steam, etc.) of water, with the potential to cause harm to public health

Note 1 to entry: Condition includes quantity.

## CEN/TR 17801:2022 (E)

**3.5****hazard analysis**

systematic identification of hazards to human health and of events or situations that may lead to the occurrence of a hazard to human health from a potable water installation, taking into account:

- The description of the potable water installation;
- The observations made during the site visit;
- The identified deviations from the legal and normative requirements;
- The other knowledge about the water quality, the potable water installation and its use;
- The laboratory results and their local correlation

**3.6****hazardous event**

event that introduces hazards to potable water installations, or fails to remove them from the potable water installation

**3.7****corrective action**

action to eliminate the cause of a non-conformity (non-fulfilment of a nominal condition<sup>1</sup>) and to prevent recurrence

**3.8****risk control measure**

Any action and activity that can be used to prevent or eliminate a hazard or reduce it to an acceptable level

**3.9****risk**

combination of the likelihood of occurrence of a hazardous event and the severity of impact if the hazard occurs

**3.10****severity of impact<sup>2</sup>**

level of extent or severity of the impact on human health and/or safety of supply from the potable water installation

**3.11****potable water**

water suitable for human consumption

Note 1 to entry: The water may also be used for washing, cooking and sanitary purposes.

Note 2 to entry: Additionally conforming to the relevant regulations based on EU directives.

<sup>1</sup> See EN 15975-2, 4.6.5.

<sup>2</sup> See EN 15975-2, Table A.2.



**3.12****potable water installation**

pipework, fittings and appliances which are installed between the taps that are normally used for water intended for human consumption in both public and private premises and the distribution network, but only if they are not in the responsibility of the water supplier, in its capacity as a water supplier, under the relevant national law

**3.13****validation**

obtain evidence, assessment and approval of the capability of the current or proposed control measures

**3.14****verification**

routine confirmation, through the provision of objective evidence, that the potable water supply system is delivering water in accordance with the set objectives and that the risk management approach is effective

**3.15****inventory documentation**

existing technical documentation of the potable water installation

**3.16****pipng scheme**

summary technical presentation/drawing of the potable water installation

**4 Symbols and abbreviations****Table 1 — Abbreviation**

Abbreviation	Meaning
PWC	Potable water cold
PWH	Potable water hot
PWH-C	Potable water hot – Circulation
WSP	Water Safety Plan

## 5 Modules and process of the WSP

### 5.1 Flowchart and elements of the Water Safety Plan

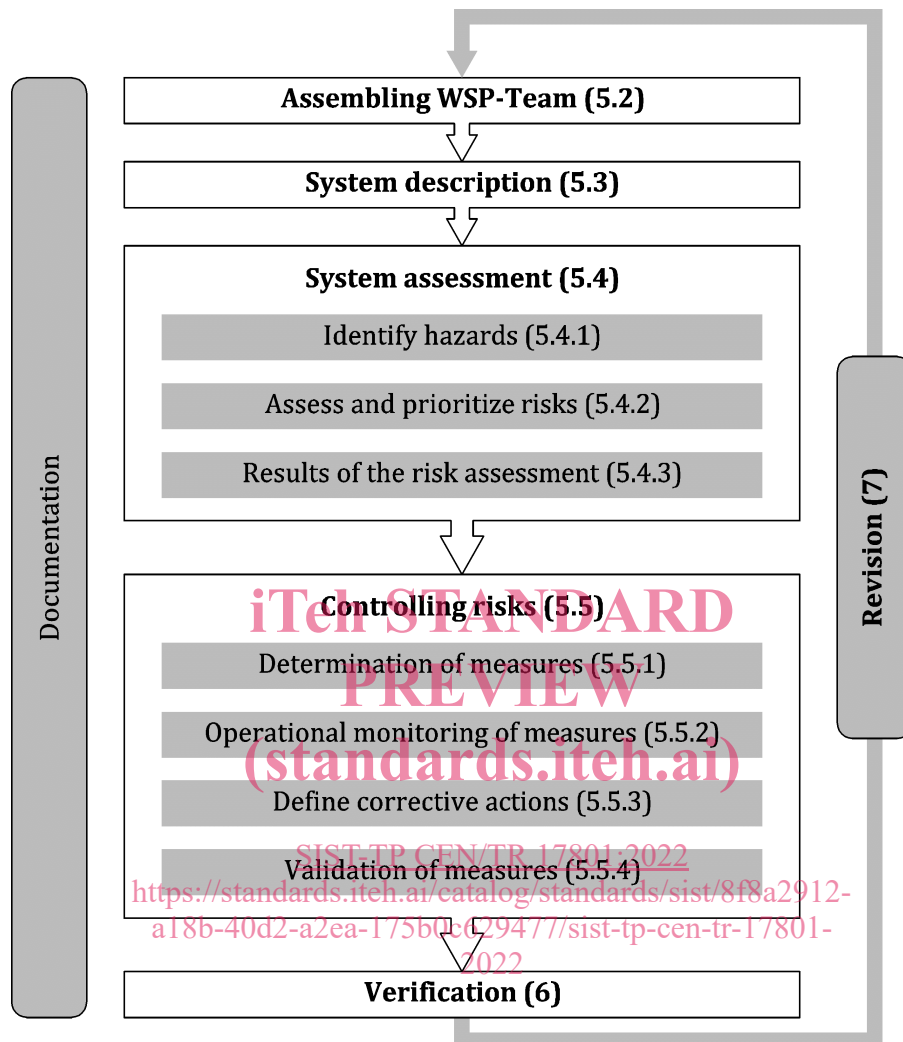


Figure 1 — Overview of modules of the WSP approach

## 5.2 Assembling WSP-Team

The first step in the Water Safety Plan approach is to assemble a Water Safety Plan Team (WSP-Team).

The WSP team should have a team leader who coordinates the team and its tasks. Any party involved in the water system shall be invited to join the WSP team. Depending on building members can be e.g.:

- Planner, designer;
- Installer, contractor;
- Operator;
- Maintainer;
- Building administrator;
- Facility manager;
- Safety manager;
- Owner, investor;
- The person with responsibility for hygiene in the building;
- Representatives of the responsible health authorities.

The interdisciplinary team should have adequate knowledge of the building's potable water installation, appropriate technical and hygienic expertise and be responsible for the development and implementation of the WSP steps.

## 5.3 System description

### 5.3.1 Technical description

An essential element of the system description is a technical description of the entire potable water installation including the actual operating conditions since commissioning. This can be done by a combination of preliminary talks, inspection of the inventory documentation and site inspection with an assessment of the structural conditions and operating modes. This makes it possible to identify hazards and hazardous events.