
**Condition monitoring and
diagnostics of machine systems —
Thermography —**

**Part 2:
Image interpretation and diagnostics**

*Surveillance et diagnostic de l'état des systèmes de machines —
Thermographie —*

Partie 2: Interprétation d'image et diagnostic

Document Preview

[ISO 18434-2:2019](https://standards.iteh.ai/catalog/standards/iso/113b3f92-b550-4a98-9251-b2c21a7cfe38/iso-18434-2-2019)

<https://standards.iteh.ai/catalog/standards/iso/113b3f92-b550-4a98-9251-b2c21a7cfe38/iso-18434-2-2019>



iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[ISO 18434-2:2019](https://standards.iteh.ai/catalog/standards/iso/113b3f92-b550-4a98-9251-b2c21a7cfe38/iso-18434-2-2019)

<https://standards.iteh.ai/catalog/standards/iso/113b3f92-b550-4a98-9251-b2c21a7cfe38/iso-18434-2-2019>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2019

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

Page

Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Thermal condition monitoring	2
4.1 Application of thermal imaging within condition monitoring programmes.....	2
4.2 Correlation with other technologies.....	2
4.3 Performance monitoring.....	2
5 Equipment choice	2
5.1 Lens choice.....	2
5.2 Infrared windows and sight glasses.....	2
5.3 IR camera characteristics.....	3
5.3.1 General.....	3
5.3.2 Image capture speed.....	3
5.3.3 Wavelength choice.....	3
5.3.4 Camera lens filters.....	3
6 Data collection	3
6.1 Thermogram and photograph content.....	3
6.2 Error sources, accuracy and repeatability.....	4
6.2.1 IR camera location.....	4
6.2.2 Emissivity.....	5
6.2.3 Focus, range and distance.....	5
6.2.4 Machine operating conditions.....	5
6.2.5 Environmental conditions.....	5
6.2.6 Calibration.....	5
7 Machine bearing location identification convention	5
8 Severity criteria	5
8.1 Baseline measurements.....	5
8.2 Typical guidelines.....	5
9 Image interpretation guidelines	6
10 Diagnosing thermodynamic problems	6
10.1 General principles.....	6
10.2 Heat generation.....	7
10.2.1 General.....	7
10.2.2 Surface friction.....	7
10.2.3 Fluid friction.....	7
10.2.4 Electrostatic discharge heating.....	7
10.2.5 Electrical (induced current) discharge heating.....	7
10.2.6 Exothermic reaction heating.....	8
10.2.7 Electromagnetic heating.....	8
10.2.8 Compression heating.....	8
10.2.9 Material cyclic deformation heating.....	8
10.2.10 Electrical resistance heating.....	8
10.3 Abnormal heat distribution.....	8
10.4 Applied heat.....	8
10.5 Heat loss.....	9
10.6 Heat transfer.....	9
Annex A (informative) Case examples	10

iTeh Standards
(<https://standards.itih.ai>)
Document Preview

[ISO 18434-2:2019](https://standards.itih.ai/catalog/standards/iso/113b3f92-b550-4a98-9251-b2c21a7cfe38/iso-18434-2-2019)

<https://standards.itih.ai/catalog/standards/iso/113b3f92-b550-4a98-9251-b2c21a7cfe38/iso-18434-2-2019>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 108, *Mechanical vibration, shock and condition monitoring*, Subcommittee SC 5, *Condition monitoring and diagnostics of machine systems*.

A list of all parts in the ISO 18434 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

This document provides specific guidance on the interpretation of infrared thermograms as part of a programme for condition monitoring and diagnostics of machines. Thermography can be used to identify and document anomalies for the purposes of condition monitoring of machines. These anomalies are usually caused by such mechanisms as operation, improper lubrication, misalignment, worn components or mechanical loading anomalies.

Infrared thermography is based on measuring the distribution of radiant thermal energy (heat) emitted from a target surface, and converting this to a map of radiation intensity differences (surface temperature map) or thermogram. The thermographer therefore requires an understanding of heat, temperature and the various types of heat transfer as essential prerequisites when undertaking an IR programme. Thermal energy is present with the operation of all machines. It can be in the form of friction or energy losses, as a property of the process media, produced by the actual process itself or any combination thereof. As a result, temperature can be a key parameter for monitoring the performance of machines, the condition of machines and the diagnostics of machine problems. Infrared thermography is an ideal technology to do this temperature monitoring because it provides complete thermal images of a machine, or a machine component, with no physical attachments (non-intrusive), requires little set-up and provides the results in a very short period of time.

Although extremely useful, IRT has a limitation in that radiometric sensing is susceptible to unacceptable error when used on most low emissivity surfaces.

iTeh Standards (<https://standards.iteh.ai>) Document Preview

[ISO 18434-2:2019](https://standards.iteh.ai/catalog/standards/iso/113b3f92-b550-4a98-9251-b2c21a7cfe38/iso-18434-2-2019)

<https://standards.iteh.ai/catalog/standards/iso/113b3f92-b550-4a98-9251-b2c21a7cfe38/iso-18434-2-2019>

Condition monitoring and diagnostics of machine systems — Thermography —

Part 2: Image interpretation and diagnostics

1 Scope

This document provides specific guidance on the interpretation of infrared thermograms as part of a programme for condition monitoring and diagnostics of machine systems.

In addition, IR applications pertaining to machinery performance are addressed.

This document is intended to:

- provide guidance on establishing severity assessment criteria for anomalies identified by IRT;
- outline methods and requirements for carrying out thermography of machine systems, including safety recommendations;
- provide information on image interpretation, assessment criteria and reporting requirements.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 13372, *Condition monitoring and diagnostics of machines — Vocabulary*

ISO 13373-1, *Condition monitoring and diagnostics of machines — Vibration condition monitoring — Part 1: General procedures*

ISO 13379-1, *Condition monitoring and diagnostics of machines — Data interpretation and diagnostics techniques — Part 1: General guidelines*

ISO 17359, *Condition monitoring and diagnostics of machines — General guidelines*

ISO 18434-1, *Condition monitoring and diagnostics of machines — Thermography — Part 1: General procedures*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 13372 and ISO 18434-1 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

4 Thermal condition monitoring

4.1 Application of thermal imaging within condition monitoring programmes

Within typical condition monitoring programmes, thermal imaging of mechanical components of a machine system is not typically used as a primary monitoring technique. The exceptions to this are when heat generation or transfer characteristics are a primary indicator of impending failure or performance deterioration or where rapid scanning using thermal imaging is more economical and efficient. Another exception is when applied heat is a primary cause of failure.

4.2 Correlation with other technologies

Typically, thermal imaging is used in a condition monitoring programme to detect thermal characteristics of failure modes previously identified by another technology. In this scenario, thermal imaging can be used both to confirm the presence of a failure mode and to validate its severity. Exceptions to this occur when the primary symptom of failure is heat generation or heat loss such as bypassing reciprocating compressor valves, leaking or blocked heat exchangers, insulation failure, refrigerant leaks or electrical faults.

4.3 Performance monitoring

Thermal imaging is also applicable in the field of performance monitoring of a process and the machine at the machine/product interface. Typically, such application also involves the use of thermal imaging in a product quality assurance and/or control role whereby machine failure is identified via deterioration in product quality.

Examples of this are when the production process involves exothermic reactions such as foam manufacturing or high temperature applications such as plastic extrusion.

5 Equipment choice

5.1 Lens choice

Infrared (IR) cameras with fixed lenses can have limitations with respect to resolution and field of view and might not be suitable for all applications. For IR cameras where different lenses can be used, there is normally a choice of lenses including standard, wide angle, telephoto and macro.

For machine condition monitoring, wide angle lenses are particularly useful for gaining images containing the maximum machine surface area for comparison of apparent temperature. If wide-angle lenses are not available then IR cameras with a larger field of view (FOV) are more suitable. This allows the comparison of multiple components in a single image. This lens type is also useful in confined space areas where the standoff distance can be very small.

Telephoto lenses are useful for remote component locations such as elevated conveyors and equipment, vessels and outdoor substations. They may also be used for small items.

IR camera FOV, instantaneous field of view (IFOV) and detector characteristics should be considered in conjunction with lens characteristics to ensure thermal resolution is appropriate.

Macro lenses are not typically used for machine condition monitoring but can be used for product quality monitoring. An example is monitoring the quality of glass fibre optics.

5.2 Infrared windows and sight glasses

Infrared windows or sight glasses can be used for internal inspection of electrical cabinets, some mechanical equipment, high temperature applications such as boilers and furnaces, or where access through doors and panels is required.

5.3 IR camera characteristics

5.3.1 General

When selecting an IR camera, the condition monitoring application shall be considered to ensure the suitability of the equipment. Smaller, less expensive IR cameras might not be suitable for many applications due to their thermal, optical and image processing limitations.

Thermal sensitivity, spatial resolution, temperature range and time response should be carefully considered with respect to the intended applications.

5.3.2 Image capture speed

For applications that involve video capture, high surface speeds and/or rapid changes in apparent temperature, the use of a high speed IR camera can be required.

5.3.3 Wavelength choice

For most machine condition monitoring applications, both long-wave (approximately 8 μm to 14 μm) and mid-wave (approximately 3 μm to 5 μm) IR cameras are suitable.

In some specific applications, such as monitoring thin film plastic extrusion equipment, a short-wave (approximately 0,8 μm to 3 μm) or a mid-wave IR camera with specific filters can be required. Such IR cameras are also useful for internal inspections of boilers and furnaces and gas leak detection. Short-wave cameras are particularly necessary for material testing at very high temperatures (>1 000 °C). For gas leak detection, the wavelength required depends on the gas.

5.3.4 Camera lens filters

For some specific failure modes, lens filters can be required. Examples include monitoring of thin plastic films, boilers and furnaces, and gas leaks.

6 Data collection

6.1 Thermogram and photograph content

For condition monitoring applications, it is typical that many component locations are required in a single image in order to facilitate rapid comparison of multiple component temperatures. This means that it is advisable to acquire as much of the machines surface as possible in a single image.

Such image acquisition often requires

- large standoff distances,
- image acquisition at angles to the machine normally at the corners,
- elevated viewing locations.

Examples of good images with sufficient machine surface coverage are given in [Figure 1](#).

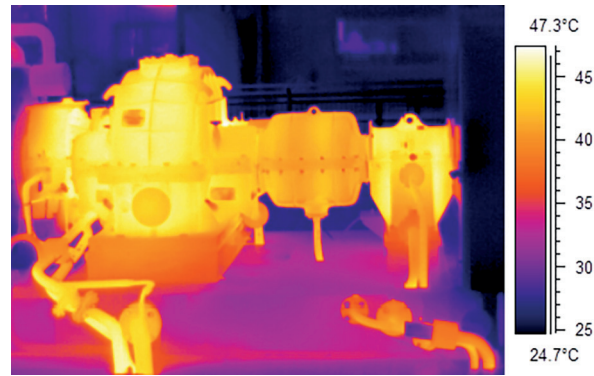


Figure 1 — Single drive train thermogram

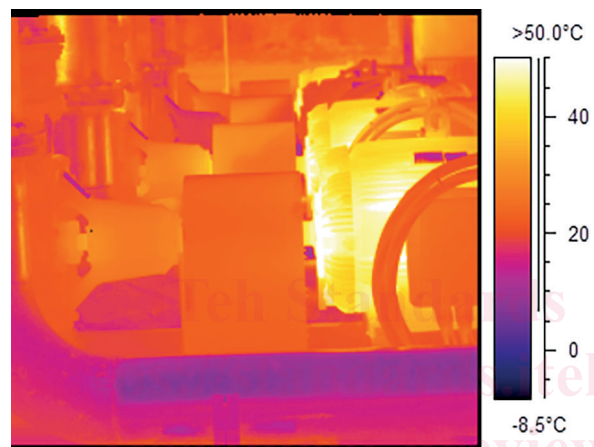


Figure 2 — Multiple machines (pump sets) comparison thermogram

Some systems also have the capability of image montage allowing the production of a single large image from many smaller ones, which can be advantageous when analysing large machine trains.

It can also be useful to include within the same image an adjacent identical machine in order to determine if any variation between them can reveal the presence of a failure mode (Figure 2). If a difference exists, further investigation can be undertaken and additional comparison of the machines operating conditions, behaviour and history can prove useful for diagnostics.

To aid with image identification and interpretation, photographs should be acquired from exactly the same location, orientation and subject content as the thermal image.

6.2 Error sources, accuracy and repeatability

6.2.1 IR camera location

Images should be acquired from locations that minimize errors caused by other sources, such as background reflections and solar reflections. For condition monitoring of machines, the image location should include as much of the machine as possible to allow for comparison and pattern analysis in a single image (Figure 1). Typically, such positions can include the acquisition of multiple machine faces in a single thermogram from a 45° angle to the corner. Determination of reflected apparent temperatures shall be in accordance with ISO 18434-1.

6.2.2 Emissivity

Where temperature alarm criteria are used, all the emissivity of any anomalies shall be correctly determined in order to ensure the accuracy of the temperatures displayed, the derived severities and the subsequent recommendations. Determination of correct emissivity shall be in accordance with ISO 18434-1.

6.2.3 Focus, range and distance

All images shall be in focus. Appropriate IR camera and image settings, i.e. range, level, span, contrast and sensitivity, shall be selected for the application. These settings may differ between that necessary for the determination of component load zone and thermal patterns as opposed to those necessary for accurate temperature determination. The standoff distance shall be appropriately selected to ensure adequate thermal and spatial measurement resolution of the anomaly.

For condition monitoring of machine systems, the most appropriate stand-off distance may be extremely large to include the entire machine train in a single image to allow for comparison and pattern analysis. Correction for stand-off distance shall be in accordance with ISO 18434-1.

6.2.4 Machine operating conditions

When routine assessment is carried out, the machine should be operating under steady state conditions representative of normal operating conditions and after thermal equilibrium has been achieved. The conditions at the time of assessment shall be recorded.

6.2.5 Environmental conditions

In many instances, field measurements of reflected apparent temperature and emissivity need to be carried out in order to obtain correct temperatures. These measurements shall be carried out in accordance with ISO 18434-1 as well as established industry standards and practices, relevant International Standards and manufacturers' guidelines.

6.2.6 Calibration

IR cameras shall be in calibration at the time of inspection and a calibration check shall be carried out prior to image acquisition. Such requirements are stated in ISO 18434-1.

7 Machine bearing location identification convention

All machine bearing locations shall be identified in accordance with ISO 13373-1.

8 Severity criteria

8.1 Baseline measurements

Baseline temperatures and assessment criteria should be based on historical or statistically derived temperatures established from the specific item, or machine groups, when in the "ideal" condition. Establishment of severity criteria shall be in accordance with ISO 17359 and ISO 13379-1. Assessment criteria should be based on temperatures specified by manufacturers of similar items or groups of equipment. These measurements shall be carried out in accordance with ISO 18434-1 as well as established industry standards and practices, relevant International Standards and manufacturers' guidelines.

8.2 Typical guidelines

When applying infrared thermography to the condition monitoring and diagnostics of machines, and their related components, it is strongly recommended that severity assessment criteria be established.