



**SLOVENSKI STANDARD**  
**SIST EN 61850-7-1:2012/A1:2020**

**01-december-2020**

---

**Komunikacijska omrežja in sistemi za avtomatizacijo porabe (električne) energije -  
7-1. del: Osnovna komunikacijska struktura - Načela in modeli - Dopolnilo A1**

Communication networks and systems for power utility automation - Part 7-1: Basic communication structure - Principles and models

Kommunikationsnetze und -systeme für die Automatisierung in der elektrischen Energieversorgung - Teil 7-1: Grundlegende Kommunikationsstruktur - Grundsätze und Modelle

**(standards.iteh.ai)**

Réseaux et systèmes de communication pour l'automatisation des systèmes électriques - Partie 7-1: Structure de communication de base - Principes et modèles

SIST EN 61850-7-1:2012/A1:2020  
<https://standards.iteh.ai/catalog/standards/sist/51836b38-bc32-4213-b4fc-58563fad53f3/sist-en-61850-7-1-2012-a1-2020>

**Ta slovenski standard je istoveten z: EN 61850-7-1:2011/A1:2020**

---

**ICS:**

29.240.30	Krmilna oprema za elektroenergetske sisteme	Control equipment for electric power systems
33.200	Daljinsko krmiljenje, daljinske meritve (telemetrija)	Telecontrol. Telemetry

**SIST EN 61850-7-1:2012/A1:2020** en

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

SIST EN 61850-7-1:2012/A1:2020

<https://standards.iteh.ai/catalog/standards/sist/51836f38-bc32-4213-b4fc-58563fad53f3/sist-en-61850-7-1-2012-a1-2020>

EUROPEAN STANDARD

**EN 61850-7-1:2011/A1**

NORME EUROPÉENNE

EUROPÄISCHE NORM

October 2020

ICS 33.200

English Version

Communication networks and systems for power utility  
automation - Part 7-1: Basic communication structure -  
Principles and models  
(IEC 61850-7-1:2011/A1:2020)

Réseaux et systèmes de communication pour  
l'automatisation des systèmes électriques - Partie 7-1:  
Structure de communication de base - Principes et modèles  
(IEC 61850-7-1:2011/A1:2020)

Kommunikationsnetze und -systeme für die  
Automatisierung in der elektrischen Energieversorgung -  
Teil 7-1: Grundlegende Kommunikationsstruktur -  
Grundsätze und Modelle  
(IEC 61850-7-1:2011/A1:2020)

This amendment A1 modifies the European Standard EN 61850-7-1:2011; it was approved by CENELEC on 2020-10-05. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this amendment the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This amendment exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

**EN 61850-7-1:2011/A1:2020 (E)****European foreword**

The text of document 57/2201/FDIS, future IEC 61850-7-1/A1, prepared by IEC/TC 57 "Power systems management and associated information exchange" was submitted to the IEC-CENELEC parallel vote and approved by CENELEC as EN 61850-7-1:2011/A1:2020.

The following dates are fixed:

- latest date by which the document has to be implemented at national (dop) 2021-07-05 level by publication of an identical national standard or by endorsement
- latest date by which the national standards conflicting with the (dow) 2023-10-05 document have to be withdrawn

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a mandate given to CENELEC by the European Commission and the European Free Trade Association.

**Endorsement notice****iTeh STANDARD PREVIEW**

The text of the International Standard IEC 61850-7-1:2011/A1:2020 was approved by CENELEC as a European Standard without any modification. (standards.iteh.ai)

Remove the following reference:

IEC 61400 series **NOTE Harmonized in EN 61400 series.**  
<https://standards.iteh.ai/catalog/standards/sist/en-61850-7-1-2012-a1-2020>  
 58563fad53f3/sist-en-61850-7-1-2012-a1-2020



IEC 61850-7-1

Edition 2.0 2020-08

# INTERNATIONAL STANDARD

# NORME INTERNATIONALE



AMENDMENT 1  
AMENDEMENT 1

**Communication networks and systems for power utility automation –  
Part 7-1: Basic communication structure – Principles and models**

**Réseaux et systèmes de communication pour l'automatisation des systèmes  
électriques –** <https://standards.iteh.ai/catalog/standards/sist/51836f38-bc32-4213-b4fc-58562645301e/sist-61850-7-1:2012-a1:2020>  
**Partie 7-1: Structure de communication de base – Principes et modèles**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

COMMISSION  
ELECTROTECHNIQUE  
INTERNATIONALE

ICS 33.200

ISBN 978-2-8322-8481-0

**Warning! Make sure that you obtained this publication from an authorized distributor.  
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

## FOREWORD

This amendment has been prepared by IEC technical committee 57: Power systems management and associated information exchange.

The text of this amendment is based on the following documents:

FDIS	Report on voting
57/2201/FDIS	57/2221/RVD

Full information on the voting for the approval of this amendment can be found in the report on voting indicated in the above table.

The committee has decided that the contents of this amendment and the base publication will remain unchanged until the stability date indicated on the IEC website under "http://webstore.iec.ch" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**iTeh STANDARD PREVIEW**  
(standards.iteh.ai)

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

#### 4 Abbreviated terms

*Add the following new terms to the list of abbreviated terms:*

MICS	Model implementation conformance statement
PICS	Protocol implementation conformance statement
SICS	SCL implementation conformance statement

#### 5 Overview of the IEC 61850 series concepts

##### 5.3 The information models of substation automation systems


*Add, at the end of the third paragraph below Figure 3, the following new footnote:*

There is one exception: the proxy/gateway application. For details, refer to 8.2.3 Gateways and proxies.

## 5.4 Applications modelled by logical nodes defined in IEC 61850-7-4

### Figure 4 – Logical node information categories

Replace existing Figure 4 with the following new figure:

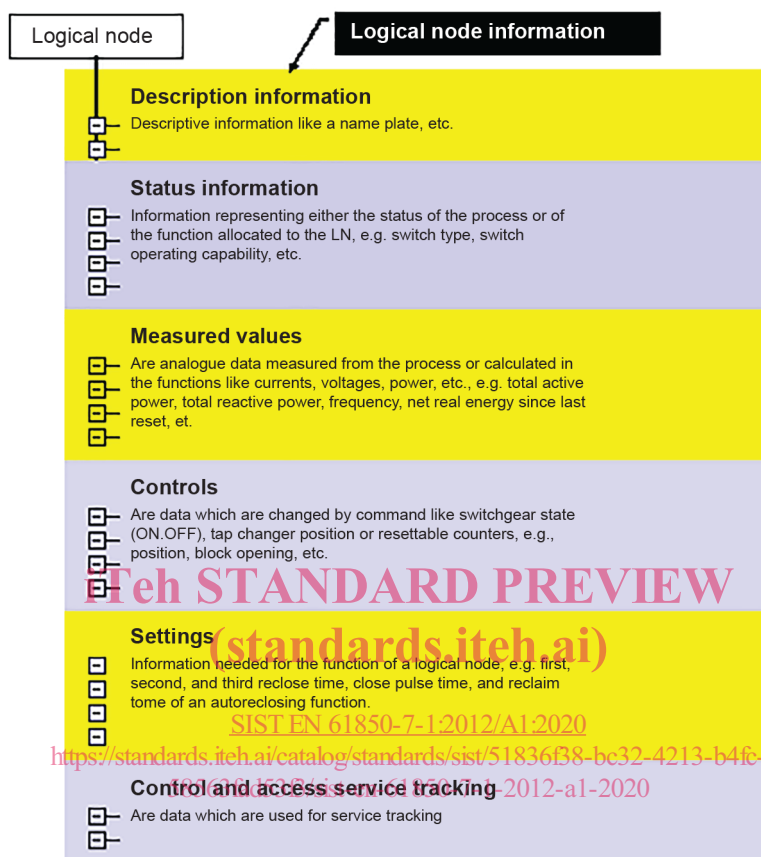


IEC

## 5.5 The semantic is attached to data

### Figure 6 – Position information depicted as a tree (conceptual)

Replace existing Figure 6 with the following new figure:

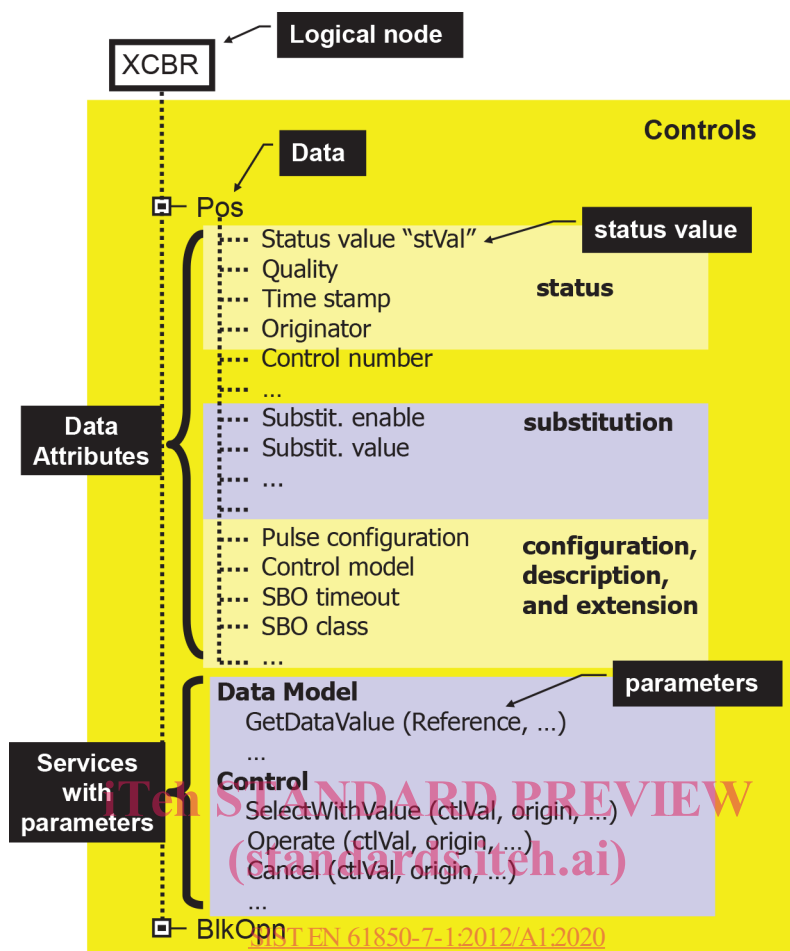

<https://standards.iteh.ai/catalog/standards/sist/51836f38-bc32-4213-b4fc-58563fad53f3/sist-en-61850-7-1-2012-a1-2020> IEC

Replace the first table of Subclause 5.5 with the following new table:

Attribute name	Attribute type	FC	TrgOp	(Value/value range) Description	PresCond
stVal	DpStatusKind	ST	dchg	Status value of the controllable data object.	M
ctlModel	CtlModelKind	CF	dchg	Control model as defined in IEC 61850-7-2 that reflects the behaviour of the controllable data object.	M

Below this table, replace the last item of the dashed list with the following new item:

- the presence conditions, e.g. mandatory (M) or optional (O). These conditions specify presence of elements in a given context (one LN, or one CDC, or one data attribute type, or one data object for dataNs) and are specified in IEC 61850-7-2.

After the dashed list, replace the first paragraph and the following table with the following new paragraph:

The data attribute names are standardised (i.e., they are reserved) names that have a specific semantic in the context of the IEC 61850 series. The semantic of all data attribute names is defined in IEC 61850-7-3.



## 6 Modelling approach of the IEC 61850 series

### 6.2 Creating information models by stepwise composition

**Table 2 – Logical node class XCBR (conceptual)**

Replace existing Table 2 with the following new table:

<b>Descriptions</b>
External equipment name plate
Name plate of the logical node
<b>Controls</b>
<b>Switch position (see below for details)</b>
Block opening
Block closing
Charger motor enabled
Control authority at station level. Switches between station and higher level.
...
<b>Status information</b>
Mode
Behaviour
Health
External equipment health
Operation counter
Local operation (Indicates the switchover between local and remote operation; local =TRUE, remote =FALSE)
Circuit breaker operating capability
Point on wave switching capability
Circuit breaker operating capability when fully charged
...

Replace the existing table below Figure 11 with the following new table:

Data object name	Explanation
...	...
<b>Pos</b>	(controllable) Circuit breaker/switch position.
...	...

#### 6.4.2 Output model

##### 6.4.2.1 Control model concept

**Figure 14 – Output model (step 1) (conceptual)**

Replace existing Figure 14 with the following new figure:

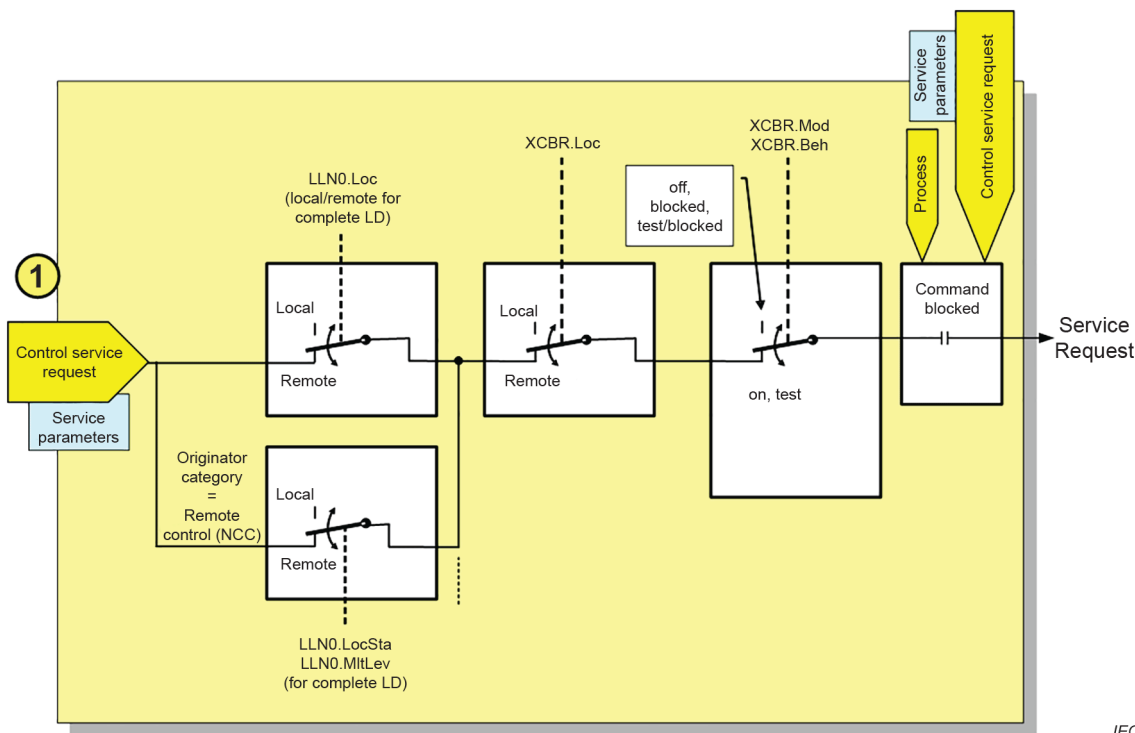


Figure 14 – Output model (step 1) (conceptual)

(standards.iteh.ai)

6.4.2.2 GSE and SMV model concept

Add the following new text after the paragraph below Figure 16:

<https://standards.iteh.ai/catalog/standards/sist/51836f38-bc32-4213-b4fc-3321c0772212-2020>

The act of receiving GOOSE and SMV messages by an IED is called subscription. How to define subscriptions by means of configuration tools is given in the normative Annex H.

6.4.2.4 Setting data and setting group control block

Table 3 – Excerpt of integer status setting

Replace existing Table 3 by the following new table:

ING class					
Attribute name	Attribute type	FC	TrgOp	Value/value range	PresCond
<b>DataAttribute for configuration, description and extension</b>					
<i>setting</i>					
setVal	INT32	SP	dchg	The value of the status setting.	AtMostOne
setVal	INT32	SG, SE		The value of the status setting.	AtMostOne
<i>configuration, description and extension</i>					
minVal	INT32	CF	dchg	Minimum setting for 'setVal'.	O
maxVal	INT32	CF	dchg	Maximum setting for 'setVal'.	O
stepSize	INT32U	CF	dchg	(range=[1...(maxVal-minVal)]) Step between the individual values of 'setVal'.	O
units	Unit	CF	dchg	Unit for 'setVal', 'minVal', 'maxVal', 'stepSize'.	O
d	VISIBLE STRING255	DC		Textual description of the data. In case it is used within the CDC LPL, the description refers to the logical node.	O
...	...	...			...


### 6.4.3 Input model

#### 6.4.3.2 Data attribute value processing, monitoring and event detection

Replace the last sentence of the second paragraph with the following new sentence:

The value of mag shall be updated to the current value of instMag when the value has changed according to the value of the configuration parameters db and dbRef of this data.


Replace Figure 19 and the subsequent paragraph with the following new figure and text:

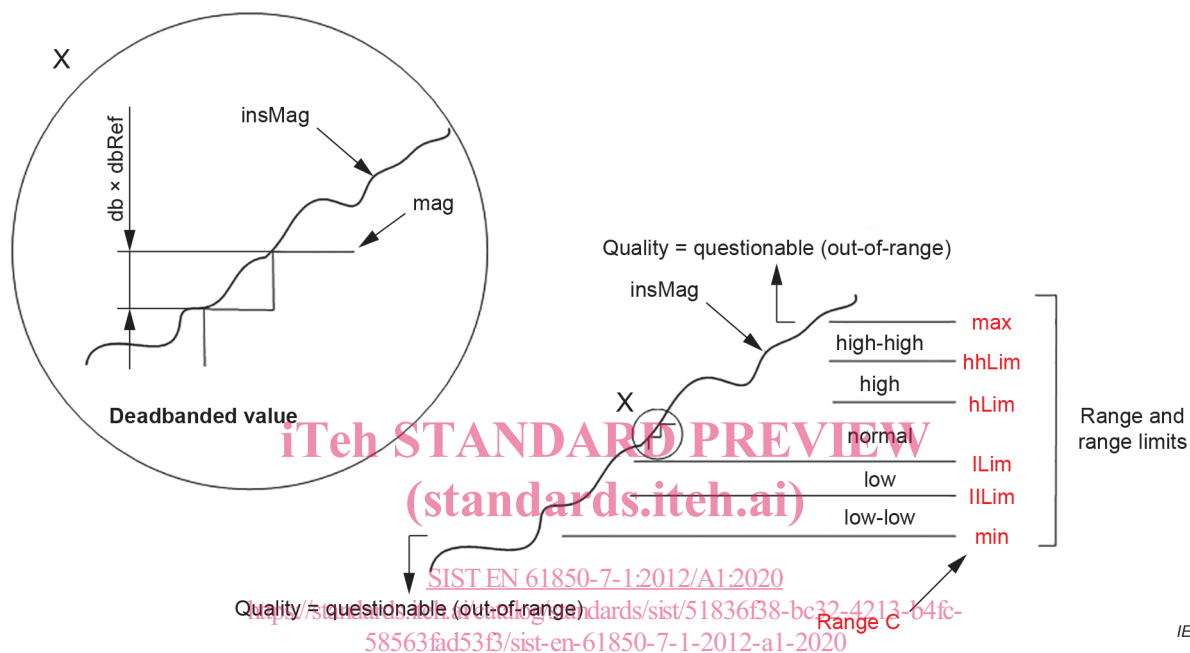

The value of the deadband configuration db shall represent the percentage of the deadband reference dbRef in units of 0,001 % (fixed deadband). A value of dbRef of 0 means that the value db shall represent the percentage of the last transmitted values in units of 0,001 %. This allows for a deadband calculation that is related to the last refreshed value (variable deadband).

#### Figure 20 – Input model for analogue values (step 2) (conceptual)

Replace existing Figure 20 with the following new figure:

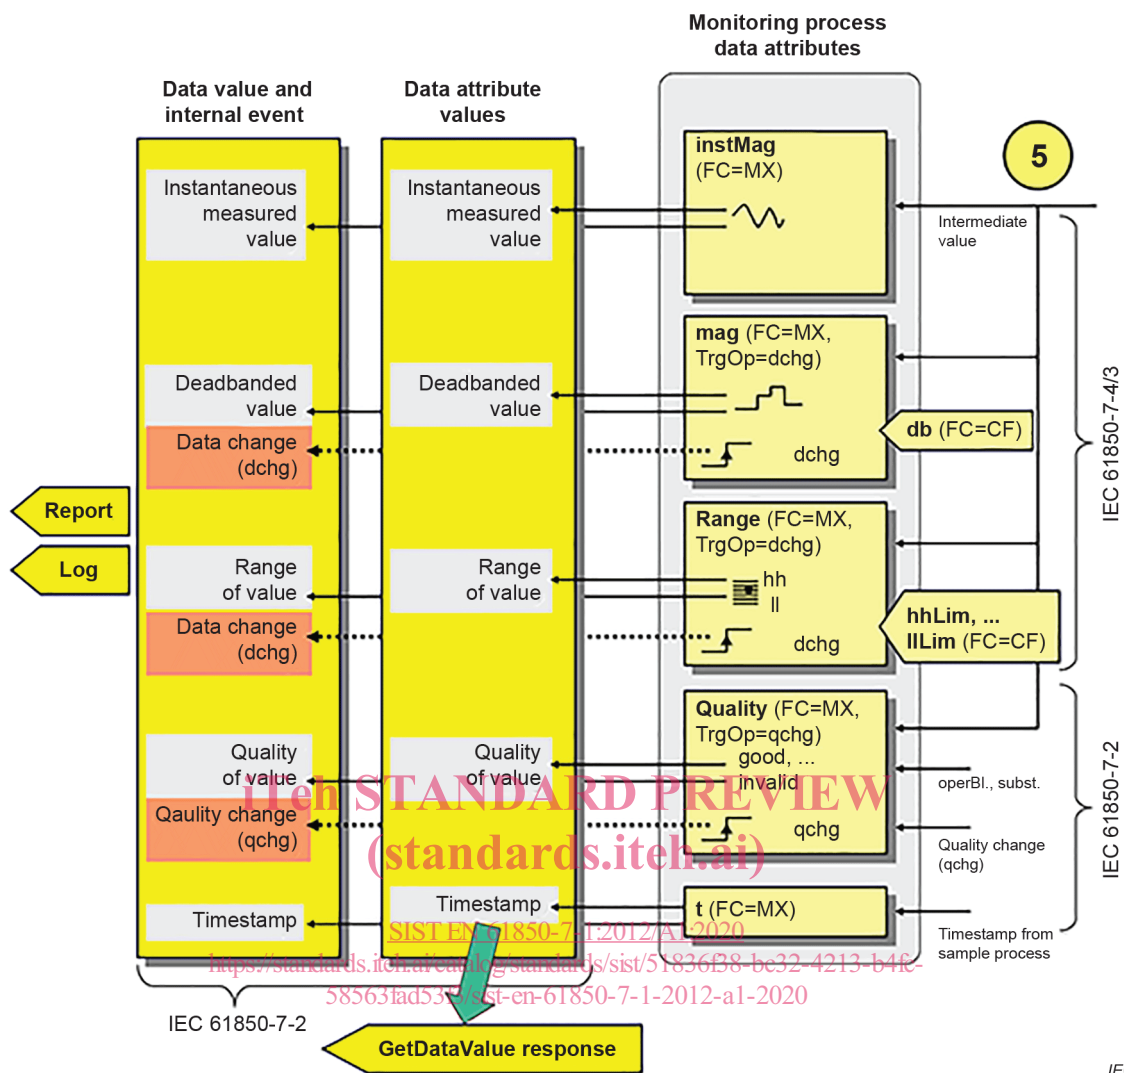

Remove the fourth paragraph below Figure 20.

### 6.4.3.3.2 Data reporting

Replace existing Table 4 with the following new table:

**Table 4 – Comparison of the data access methods**

Retrieval method	Time-critical information exchange	Can lose changes (of sequence)	Multiple clients to receive information	Last change of data stored by	Typical client (but not exclusive)
Polling (GetDataValues)	NO	YES	YES	-	Browser
Unbuffered Reporting	YES	YES	NO	-	Real-time GUI
Buffered Reporting	YES	NO	NO	Server	Data concentrator
Log (used for SOE logging)	NO	NO	YES	Server	Engineering stations

Replace the existing paragraph before Figure 23 with the following new text:

The basic buffered reporting mechanism is shown in Figure 23. The buffered and unbuffered reporting starts with the reservation of the report control block by the client, followed by configuration of the report control block, including the verification that the report control block parameters are meeting the needs of the client. The reporting to the client starts with setting the enable buffer attribute to TRUE; setting to FALSE stops the reporting to the client.

*Before the last sentence of the first paragraph below Figure 23 add the following new sentence.*

The buffering is independent from the reporting being enabled or not.

#### **6.4.3.4 Peer-to-peer data value publishing**

*Replace the last paragraph of 6.4.3.4 by the new following new text:*

Which event triggers the publishing of values as well as how often and how fast the values are to be published is a matter of the requirements of the function being implemented.

#### **6.4.4 Model for statistical and historical statistical data**


##### **Figure 28 – Conceptual model of statistical and historical statistical data (1)**

*Replace existing Figure 28 with the following new figure:*

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[SIST EN 61850-7-1:2012/A1:2020](https://standards.iteh.ai/catalog/standards/sist/51836f38-bc32-4213-b4fc-58563fad53f3/sist-en-61850-7-1-2012-a1-2020)

<https://standards.iteh.ai/catalog/standards/sist/51836f38-bc32-4213-b4fc-58563fad53f3/sist-en-61850-7-1-2012-a1-2020>

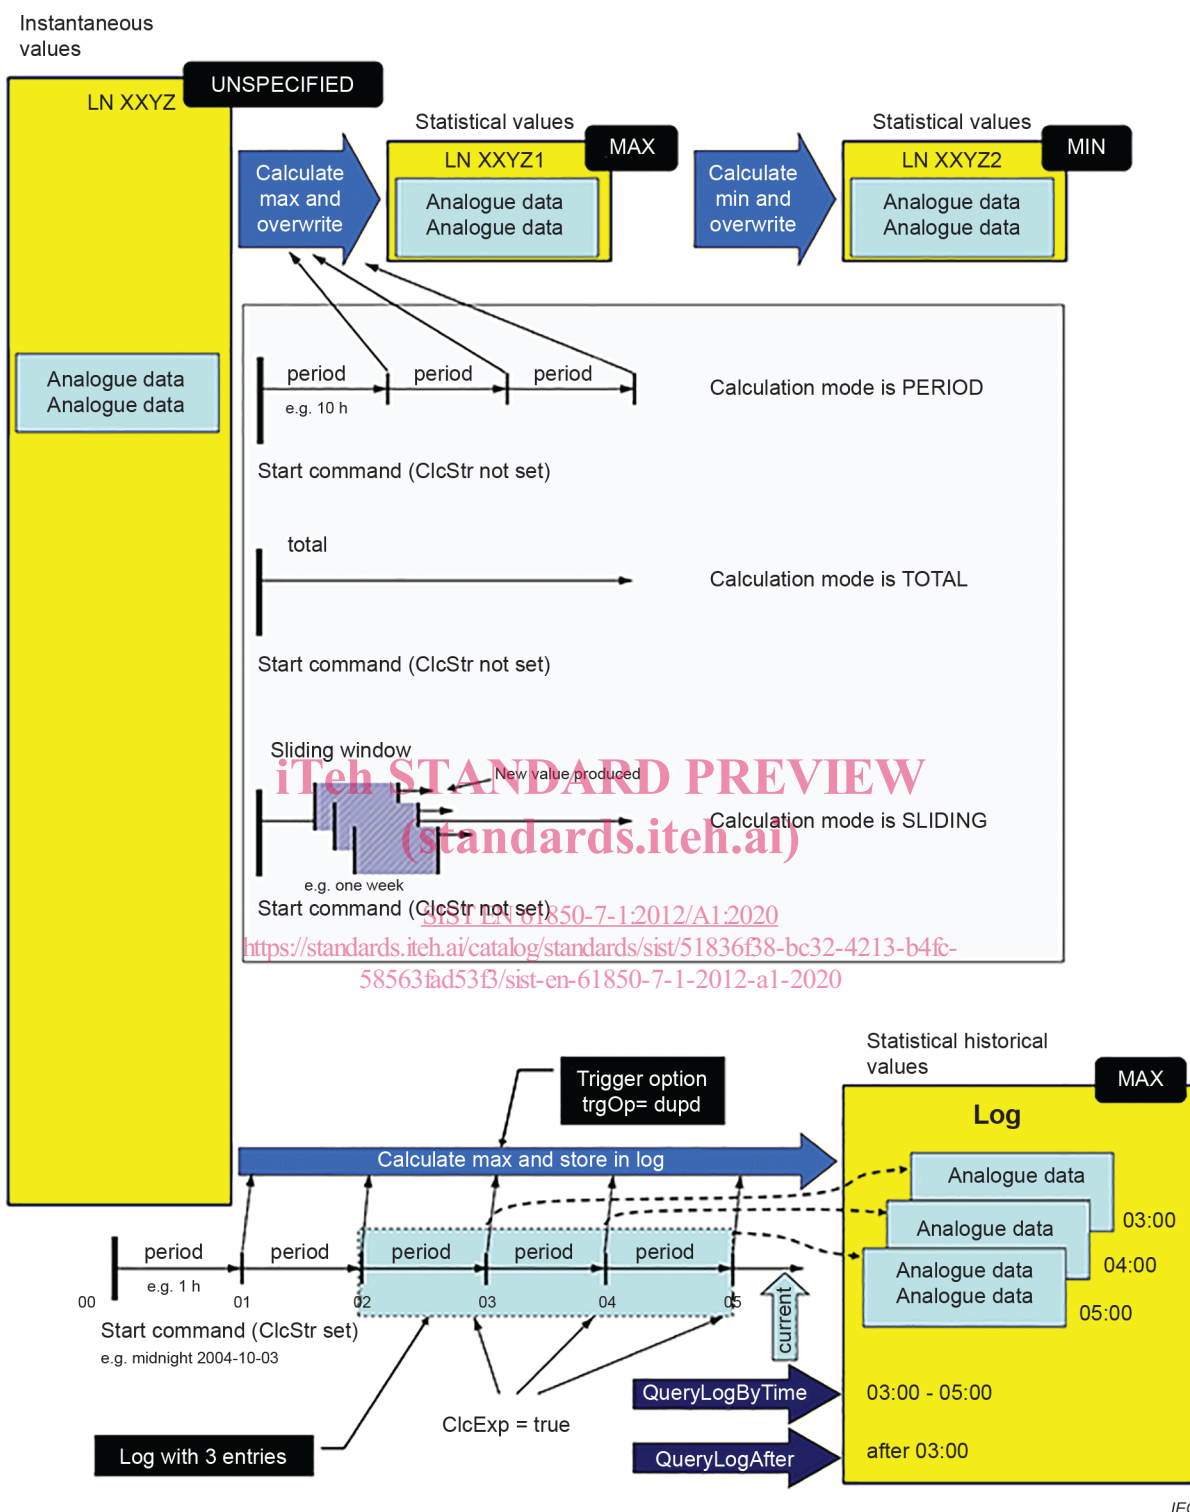

Replace the penultimate paragraph before Figure 29 with the following new text:

The lower part of the figure shows the conceptual model of the historical statistical data. In this model, the values are calculated periodically (in this case the maximum values with calculation mode set to PERIOD) and are stored in sequence in a log. The calculation in the example starts at midnight of 2004-10-03. The interval is 1 h. After the first hour, the first log entry is written. After the second hour, the second entry contains the value of the second hour. After 5 h, the log contains the values of the last three hours (intervals 02-03, 03-04, 04-05). The expiration of the statistical calculation is indicated by the "event" ClcExp set to TRUE and at this moment the statistical values that have the trigger option dupd are logged even if

the values have not changed. The same concept can be applied to the reporting of statistical data.

Remove the last paragraph of Subclause 6.4.4.

## 6.4.5 Model for system functions

### 6.4.5.1 General

Remove the last two sentences of Subclause 6.4.5.1.

### 6.4.5.5 GOOSE and SMV supervision

Add the following new text at the end of Subclause 6.4.5.5:

The normative Annex G describes the configuration flow with regards to these supervision logical nodes.

## 7 Application view


### 7.3 Mode and behaviour of a logical node

Replace “on-blocked” by “blocked” in the first paragraph below Figure 37.

### 7.7 Data used for logical node inputs/outputs blocking (operational blocking)

#### Figure 39 – Data used for logical node inputs/outputs blocking (IEC 61850-7-4)

Replace existing Figure 39 by the following new figure.

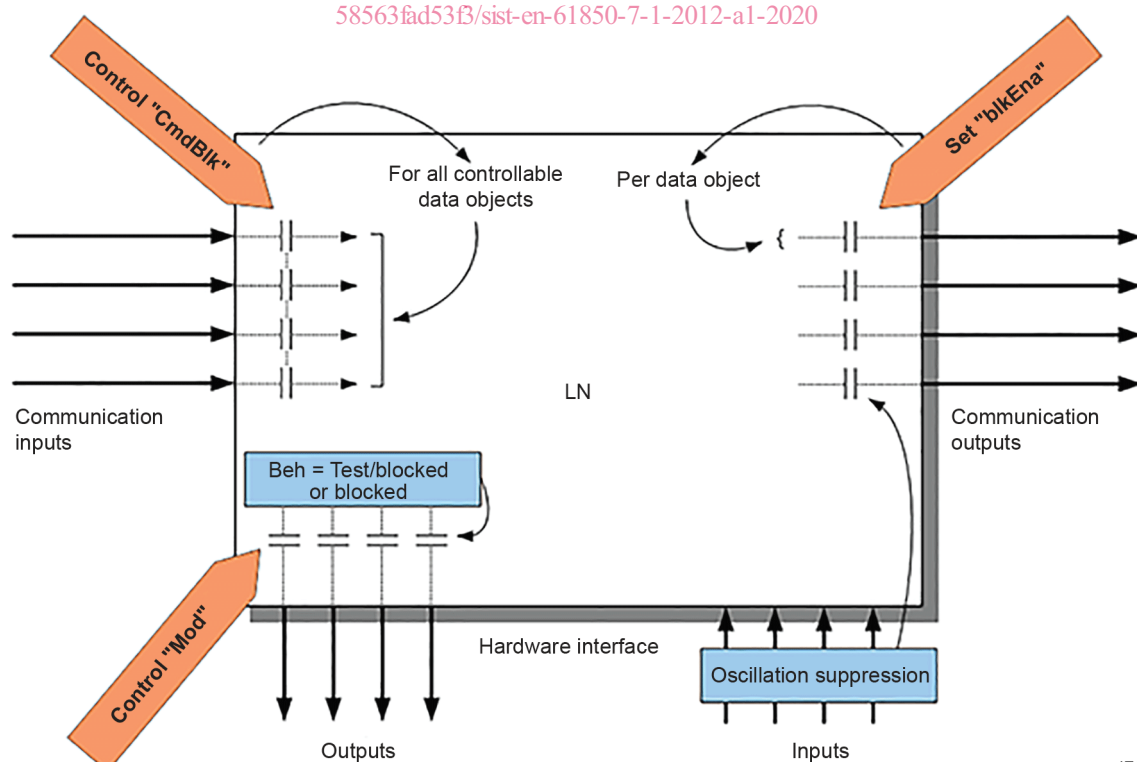

### 7.7.2 Blocking incoming commands

Add, at the end of the last paragraph of Subclause 7.7.2, the following new text: