



# SLOVENSKI STANDARD

## oSIST prEN 12504-4:2019

01-november-2019

---

### Preskušanje betona - 4. del: Določevanje hitrosti prehoda ultrazvoka

Testing concrete in structures - Part 4: Determination of ultrasonic pulse

Prüfung von Beton in Bauwerken - Teil 4: Bestimmung der Ultraschallgeschwindigkeit

Essais pour béton dans les structures - Partie 4 : Détermination de la vitesse de propagation des ultrasons

(standards.iteh.ai)

Ta slovenski standard je istoveten z: **prEN 12504-4**

[oSIST prEN 12504-4:2019](https://standards.iteh.ai/catalog/standards/sist/f04dc5de-f4f1-434c-a5c4-e1716a9b5a49/osist-pren-12504-4-2019)

<https://standards.iteh.ai/catalog/standards/sist/f04dc5de-f4f1-434c-a5c4-e1716a9b5a49/osist-pren-12504-4-2019>

#### ICS:

|           |                           |                                |
|-----------|---------------------------|--------------------------------|
| 91.100.30 | Beton in betonski izdelki | Concrete and concrete products |
|-----------|---------------------------|--------------------------------|

**oSIST prEN 12504-4:2019**

**en,fr,de**

## **iTeh STANDARD PREVIEW (standards.iteh.ai)**

[oSIST prEN 12504-4:2019](https://standards.iteh.ai/catalog/standards/sist/f04dc5de-f4f1-434c-a5c4-e1716a9b5a49/osist-pren-12504-4-2019)

<https://standards.iteh.ai/catalog/standards/sist/f04dc5de-f4f1-434c-a5c4-e1716a9b5a49/osist-pren-12504-4-2019>

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

**DRAFT**  
**prEN 12504-4**

September 2019

ICS 91.100.30

Will supersede EN 12504-4:2004

English Version

## Testing concrete in structures - Part 4: Determination of ultrasonic pulse

Essais pour béton dans les structures - Partie 4:  
Détermination de la vitesse de propagation du son

Prüfung von Beton in Bauwerken - Teil 4: Bestimmung  
der Ultraschallgeschwindigkeit

This draft European Standard is submitted to CEN members for enquiry. It has been drawn up by the Technical Committee CEN/TC 104.

If this draft becomes a European Standard, CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CEN in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

<https://standards.iteh.ai/catalog/standards/sist/f04dc5de-f4f1-434c-a5c4-1716a9b5a49/osist-pr-en-12504-4-2019>

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

**Warning** : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

| <b>Contents</b>  | <b>Page</b> |
|--|-------------|
| <b>European foreword.....</b>  | <b>3</b>    |
| <b>1 Scope .....</b>   | <b>4</b>    |
| <b>2 Normative references .....</b>  | <b>4</b>    |
| <b>3 Terms and definitions .....</b>   | <b>4</b>    |
| <b>4 Principle .....</b>   | <b>4</b>    |
| <b>5 Apparatus.....</b>  | <b>5</b>    |
| 5.1 General.....   | 5           |
| 5.2 Performance requirements.....  | 5           |
| 5.3 Transducers .....  | 5           |
| 5.4 Apparatus for determination of arrival time of the pulse.....                          | 5           |
| <b>6 Procedures.....</b>   | <b>6</b>    |
| 6.1 Determination of Pulse Velocity .....  | 6           |
| 6.1.1 Factors influencing pulse velocity measurements.....                                 | 6           |
| 6.1.2 Transducer arrangement.....  | 6           |
| 6.1.3 Path length measurement.....   | 7           |
| 6.1.4 Coupling the transducer onto the concrete .....                                      | 8           |
| 6.1.5 Measurement of transit time .....  | 8           |
| 7 Expression of result.....  | 8           |
| 8 Test report.....   | 8           |
| 9 Precision.....   | 9           |
| <b>Annex A (informative) Determination of pulse velocity - indirect transmission .....</b> | <b>10</b>   |
| <b>Annex B (informative) Factors influencing pulse velocity measurements .....</b>         | <b>12</b>   |
| B.1 General.....   | 12          |
| B.2 Moisture content .....   | 12          |
| B.3 Temperature of the concrete .....  | 12          |
| B.4 Path length.....   | 12          |
| B.5 Shape and size of specimen .....   | 13          |
| B.6 Effect of reinforcing bars .....   | 13          |
| B.7 Cracks and voids.....  | 13          |
| <b>Annex C (informative) Correlation of pulse velocity and strength .....</b>              | <b>15</b>   |
| C.1 General.....   | 15          |
| C.2 Correlation using moulded specimens.....   | 15          |
| C.3 Correlation by tests on cores .....  | 15          |
| C.4 Correlation with the strength of precast units.....                                    | 16          |
| <b>Bibliography.....</b>   | <b>17</b>   |

## European foreword

This document (prEN 12504-4:2019) has been prepared by Technical Committee CEN/TC 104 “Concrete and related products”, the secretariat of which is held by SN.

This document is currently submitted to the CEN Enquiry.

This document will supersede EN 12504-4:2004.

This standard is one of a series on testing concrete.

EN 12504, *Testing concrete in structures*, consists of the following parts:

- Part 1: *Cored specimens — Taking, examining and testing in compression;*
- Part 2: *Non-destructive testing — Determination of rebound number;*
- Part 3: *Determination of pull-out force;*
- Part 4: *Determination of ultrasonic pulse velocity.*

This document is based on the International Standard ISO 1920-7, *Testing of concrete — Part 7: Non-destructive tests on hardened concrete*. It is recognized that the ultrasonic pulse velocity determined using this document is a convention in as much that the path length over which the pulse travels is not always strictly known.

The measurement of pulse velocity can be used for the determination of the uniformity of concrete, the presence of cracks or voids, changes in properties with time and in the determination of dynamic physical properties. These subjects were considered to be outside the scope of this document, but some information is given in Annex B and more information can be found in the technical literature. The measurement can also be used to estimate the strength of *in situ* concrete elements or specimens given in EN 13791, *Assessment of in situ compressive strength in structures and precast concrete components*. However, it is not intended as an alternative to the direct measurement of the compressive strength of concrete.

The following amendments have been made to the former edition:

- option to use equipment utilizing transverse waves.

## 1 Scope

This document specifies a method for the determination of the velocity of propagation of pulses of ultrasonic longitudinal waves or ultrasonic transverse waves in hardened concrete, which is used for a number of applications.

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 206, *Concrete — Specification, performance, production and conformity*

## 3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 206 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

### 3.1 transit time

time taken for an ultrasonic pulse to travel from the transmitting transducer to the receiving transducer, passing through the interposed concrete

### 3.2 onset

leading edge of the pulse detected by the measuring apparatus

### 3.3 rise time

time for the leading edge of the first pulse to rise from 10% to 90% of its maximum amplitude

## 4 Principle

A pulse of longitudinal or transverse vibrations is produced by an electro-acoustical transducer held in contact with one surface of the concrete under test. After traversing a known path length in the concrete, the pulse of vibrations is converted into an electrical signal by a second transducer and electronic timing circuits enable the transit time of the pulse to be measured.

## 5 Apparatus

### 5.1 General

The apparatus consists of an electrical pulse generator, a pair of transducers, an amplifier and an electronic timing device for measuring the time interval elapsing between the onset of a pulse generated at the transmitting transducer and the onset of its arrival at the receiving transducer. A reference bar or prism is used to zero the instrument or to provide a datum for the velocity measurement.

NOTE 1 This is typically necessary when the user changes the length of the cables being used.

Three forms of the electronic timing apparatus are available:

- a) an oscilloscope on which the first front of the pulse is displayed in relation to a suitable time scale;
- b) an interval timer with a direct reading digital display;
- c) an A-scan display built directly into the instrument.

NOTE 2 An oscilloscope or integrated A-scan display provides the facility for monitoring the wave form of the pulse, which can be advantageous in complex testing situations or in automatic system measurements.

### 5.2 Performance requirements

The apparatus shall conform to the following performance requirements:

- It shall be capable of measuring transit times in the reference bar or prism to a limit deviation of  $\pm 0,1 \mu\text{s}$  and an accuracy of 2 %.
- The electronic excitation pulse applied to the transmitting transducer shall have a rise time of not greater than one quarter of its natural period. This is to ensure a sharp pulse onset.
- The pulse repetition frequency shall be low enough to ensure that the onset of the received signal is free from interference by reverberations.

The apparatus shall be used within the operating conditions stated by the manufacturer.

### 5.3 Transducers

The natural frequency of the transducers should normally be within the range 20 kHz to 150 kHz.

NOTE For longitudinal waves, frequencies as low as 10 kHz and as high as 200 kHz can sometimes be used. High frequency pulses have a well defined onset, but, as they pass through the concrete, they become attenuated more rapidly than pulses of lower frequency. It is, therefore, preferable to use high frequency transducers (60 kHz to 200 kHz) for short path lengths (down to 50 mm) and low frequency transducers (10 kHz to 40 kHz) for long path lengths (up to a maximum of 15 m). Transducers with a frequency of 40 kHz to 60 kHz are found to be useful for most applications. For ultrasonic pulse echo measurements using transverse waves the transducer frequency of 40 kHz to 60 kHz is also typical, but in this case the path length is limited to a maximum of approximately 2,5 m.

### 5.4 Apparatus for determination of arrival time of the pulse

The apparatus shall be capable of determining the time of arrival of the first front of the pulse with the lowest possible threshold, even though this may be of small amplitude compared with that of the first half wave of the pulse.

## 6 Procedures

### 6.1 Determination of Pulse Velocity

#### 6.1.1 Factors influencing pulse velocity measurements

In order to provide a measurement of pulse velocity, which is reproducible, it is necessary to take into account various factors which can influence the measurements. These are set out in Annex B.

#### 6.1.2 Transducer arrangement

Although the direction in which the maximum energy is propagated is at right angles to the face of the transmitting transducer, it is possible to detect pulses which have travelled through the concrete in some other direction. It is therefore possible to make measurements of pulse velocity by placing the two transducers on opposite faces (direct transmission), or on adjacent faces (semi-direct transmission), or the same face (indirect or surface transmission; pulse echo transmission) (see Figure 1) of a concrete structure or specimen. In the case of pulse echo transmission, the receiver detects pulses which have travelled through the concrete to the opposite face and have been reflected back to the first face.

Where it is necessary to place the transducers on opposite faces but not directly opposite each other such arrangement shall be regarded as a semi-direct transmission (see Figure 1.b).


NOTE 1 The indirect transmission arrangement is the least sensitive and is used when only one face of the concrete is accessible or when the quality of the surface concrete relative to the overall quality is of interest.

NOTE 2 The semi-direct transmission arrangement is used when the direct arrangement cannot be used, for example at the corners of structures.

NOTE 3 Pulse echo transmission is an alternative to indirect transmission when only one face of the concrete is accessible. The sensitivity is comparable with direct transmission.

<https://standards.iteh.ai/catalog/standards/sist/f04dc5de-f4f1-434c-a5c4-e1716a9b5a49/osist-pren-12504-4-2019>



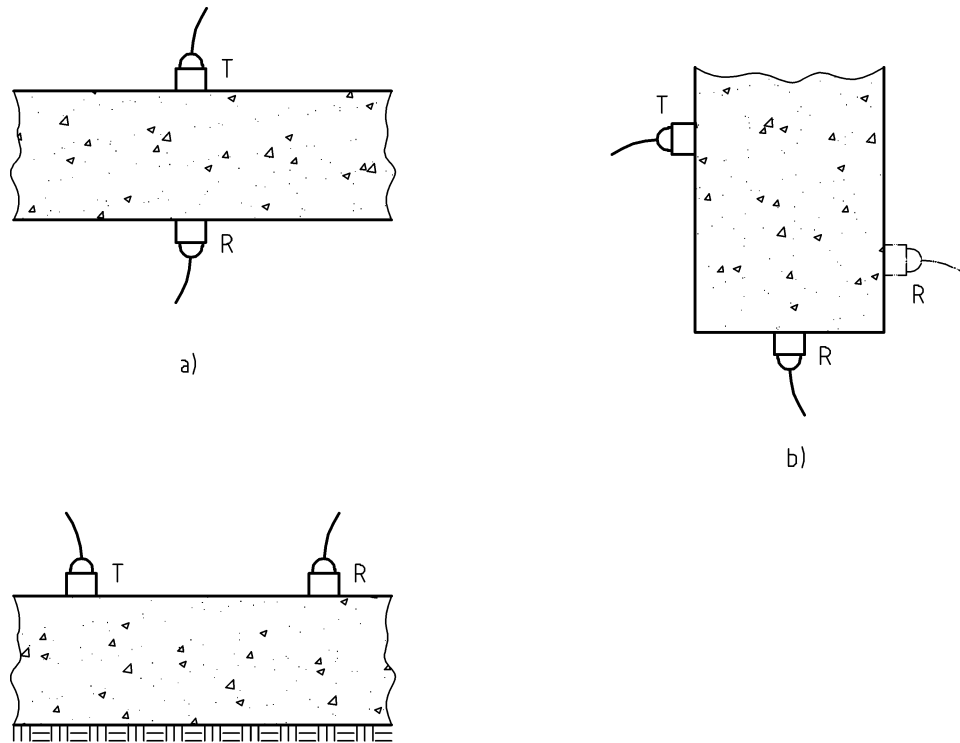

## iTeh STANDARD PREVIEW (standards.iteh.ai)

### Key

R is the receiver transducer

T is the transmitter transducer

oSIST prEN 12504-4:2019

<https://standards.iteh.ai/catalog/standards/sist/f04dc5de-f4f1-434c-a5c4-e7b54969531a/pr-en-12504-4-2019>

Figure 1 — Transducer positioning

### 6.1.3 Path length measurement

For direct transmission, the path length is the shortest distance between the transducers. The accuracy of measurement of the path length shall be recorded to an accuracy of  $\pm 1\%$ .

For semi-direct transmission, it is generally found to be sufficiently accurate to take the path length as the distance measured from centre to centre of the transducer faces. The accuracy of path length is dependent upon the size of the transducer compared with the centre to centre distance.

With indirect transmission, the path length is not measured, but a series of measurements is made with the transducers at different distances apart (see Annex A).

For pulse echo transmission, the path length is two times the distance from the face where the transducer is placed and the opposite face. The path length shall be recorded as for direct transmission.