



SLOVENSKI STANDARD

oSIST prEN 12390-1:2019

01-november-2019

Preskušanje strjenega betona - 1. del: Oblika, mere in druge zahteve za vzorce in kalupe

Testing hardened concrete - Part 1: Shape, dimensions and other requirements for specimens and moulds

Prüfung von Festbeton - Teil 1: Form, Maße und andere Anforderungen für Probekörper und Formen

Essais pour béton durci - Partie 1 : Forme, dimensions et autres exigences relatives aux éprouvettes et aux moules

iTeh STANDARD PREVIEW
(standards.iteh.ai)
<https://standards.iteh.ai/catalog/standards/sist/56edad04-50de-4dae-8fdc-b6826476e5/ksist-pr-en-12390-1-2021>

Ta slovenski standard je istoveten z: prEN 12390-1

ICS:

91.100.30	Beton in betonski izdelki	Concrete and concrete products
-----------	---------------------------	--------------------------------

oSIST prEN 12390-1:2019

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[kSIST FprEN 12390-1:2021](#)

<https://standards.iteh.ai/catalog/standards/sist/56edad04-50de-4dae-8fdc-b6fa36476ee5/ksist-fpren-12390-1-2021>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

DRAFT
prEN 12390-1

September 2019

ICS 91.100.30

Will supersede EN 12390-1:2012

English Version

Testing hardened concrete - Part 1: Shape, dimensions and other requirements for specimens and moulds

Essais pour béton durci - Partie 1 : Forme, dimensions et autres exigences relatives aux éprouvettes et aux moules

Prüfung von Festbeton - Teil 1: Form, Maße und andere Anforderungen für Probekörper und Formen

This draft European Standard is submitted to CEN members for enquiry. It has been drawn up by the Technical Committee CEN/TC 104.

If this draft becomes a European Standard, CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CEN in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

Warning : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents	Page
European foreword.....	3
1 Scope	5
2 Normative references	5
3 Terms and definitions	5
4 Shape, dimensions and tolerances of specimens	5
4.1 General	5
4.2 Cubes	6
4.2.1 Nominal sizes	6
4.2.2 Designated sizes	6
4.2.3 Tolerances	6
4.3 Cylinders	6
4.3.1 Nominal sizes	6
4.3.2 Designated sizes	7
4.3.3 Tolerances	7
4.3.4 Applicability of tolerances	7
4.4 Prisms	7
4.4.1 Nominal sizes	7
4.4.2 Designated sizes	7
4.4.3 Tolerances	7
4.5 Measurement of dimensions and shape of specimens	8
5 Moulds	8
5.1 General	8
5.2 Calibrated moulds	8
Annex A (normative) Application of EN ISO 1101 to concrete test specimens and moulds	10
A.1 General	10
A.2 Flatness	10
A.3 Perpendicularity	10
A.4 Straightness	11
Annex B (normative) Assessment of flatness of specimens and moulds	12

iTeH STANDARD PREVIEW
(standards.iteh.ai)

kSIST PrEN 12390-1:2021
<https://standards.iteh.ai/catalog/standards/sist/56edad04-50de-4dae-8fdc-60a56476cc9/kSIST-prEN-12390-1-2021>

European foreword

This document (prEN 12390-1:2019) has been prepared by Technical Committee CEN/TC 104 “Concrete and related products”, the secretariat of which is held by SN.

This document is currently submitted to the CEN Enquiry.

This document will supersede EN 12390-1:2012.

This document is one of a series on testing concrete.

EN 12390, *Testing hardened concrete*, consists of the following parts:

- Part 1: *Shape, dimensions and other requirements for specimens and moulds;*
- Part 2: *Making and curing specimens for strength tests;*
- Part 3: *Compressive strength of test specimens;*
- Part 4: *Compressive strength – Specification for testing machines;*
- Part 5: *Flexural strength of test specimens;*
- Part 6: *Tensile splitting strength of test specimens;*
- Part 7: *Density of hardened concrete;*
- Part 8: *Depth of penetration of water under pressure;*
- Part 10: *Determination of the carbonation resistance of concrete at atmospheric levels of carbon dioxide;*
- Part 11: *Determination of the chloride resistance of concrete, unidirectional diffusion;*
- Part 12: *Determination of the potential carbonation resistance of concrete: Accelerated carbonation method (in preparation);*
- Part 13: *Determination of secant modulus of elasticity in compression;*
- Part 14: *Semi-adiabatic method for the determination of heat released by concrete during its hardening process;*
- Part 15: *Adiabatic method for the determination of heat released by concrete during its hardening process;*
- Part 16: *Determination of shrinkage of concrete (in preparation);*
- Part 17: *Determination of creep of concrete in compression (in preparation).*

ITEH STANDARD PREVIEW
(standards.iteh.ai)

https://standards.iteh.ai/catalog/standards/sist/56edad04-50de-4dae-8fdc-

936d7b-fd10-470e-9100-120000000000

prEN 12390-1:2019

prEN 12390-1:2019 (E)

The following amendments have been made to the former edition:

- editorial revision;
- increases in the allowable tolerances for flatness of moulds and the dimensions of the specimens which reflect current industry practice.

This document recognizes alternative approaches towards obtaining test specimens of the correct sizes and shapes. The first is to use moulds whose life is limited and to measure the specimens to ensure conformity. The second is to cast specimens in calibrated metal moulds which meet tighter tolerances than for specimens. The use of calibrated moulds allows relaxation on the requirement for measuring the specimens.

Annex A gives the application of EN ISO 1101 to measuring the shapes of concrete test specimens and moulds.

Annex B gives a method to measure the flatness of specimens and moulds.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[kSIST FprEN 12390-1:2021](https://standards.iteh.ai/catalog/standards/sist/56edad04-50de-4dae-8fdc-b6fa36476ee5/ksist-fpren-12390-1-2021)

<https://standards.iteh.ai/catalog/standards/sist/56edad04-50de-4dae-8fdc-b6fa36476ee5/ksist-fpren-12390-1-2021>

1 Scope

This document specifies the shape, dimensions and tolerances of cast concrete test specimens in the form of cubes, cylinders and prisms, and of the moulds required to produce them.

NOTE The tolerances specified in this document are based on the needs of strength testing, but they can be applicable to tests for other properties.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN ISO 1101, *Geometrical product specifications (GPS) — Geometrical tolerancing — Tolerances of form, orientation, location and run-out (ISO 1101:2017)*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN ISO 1101 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

— IEC Electropedia: available at <http://www.electropedia.org/>

— ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1

nominal size

commonly used description of specimen size

3.2

designated size

specimen size in millimetres, selected and declared by the user of this standard from amongst the allowed range of nominal sizes

4 Shape, dimensions and tolerances of specimens

4.1 General

For application of EN ISO 1101 to the measurement of concrete test specimens and moulds in respect to flatness, perpendicularity and straightness, see Annex A.

For each shape of test specimen, cube, cylinder and prism, the nominal size d (Figures 1, 2 and 3) should be chosen to be at least three and a half times the maximum aggregate size (D_{\max} according to EN 206) in the concrete.

prEN 12390-1:2019 (E)

4.2 Cubes

4.2.1 Nominal sizes

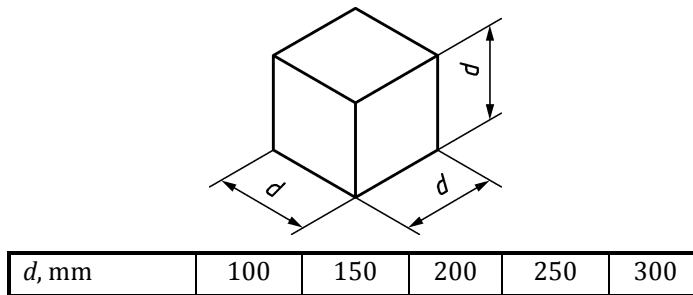


Figure 1 — Cube - nominal sizes

4.2.2 Designated sizes

Designated sizes may be selected within $\pm 10\%$ of the nominal size.

4.2.3 Tolerances

4.2.3.1 Between moulded surfaces the tolerance on the designated size (d) is 1,0%.

4.2.3.2 Between the top trowelled face and the moulded bottom face the tolerance on the designated size is 1,5%.


4.2.3.3 The tolerance on the flatness of the potential load bearing surfaces is $0,0006d$ mm (see Annex B).

<https://standards.iteh.ai/catalog/standards/sist/56edad04-50de-4dae-8fdc-100000000000/sist-56edad04-50de-4dae-8fdc-100000000000>

4.2.3.4 The tolerance on the perpendicularity of the sides of the cube, with reference to the base, as cast, is 0,5 mm.

4.3 Cylinders

4.3.1 Nominal sizes

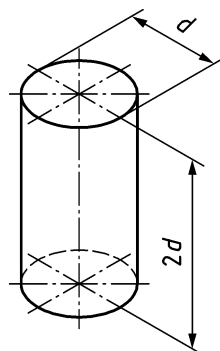

d, mm	100	113 a	150	200	250	300
a This has a load-bearing area of 10 000 mm ² .						

Figure 2 — Cylinder - nominal size

4.3.2 Designated sizes

Designated sizes may be selected within $\pm 10\%$ of the nominal size.

4.3.3 Tolerances

4.3.3.1 The tolerance on the designated diameter (d) is 1,0%.

4.3.3.2 The tolerance on the flatness of the load-bearing surface is $0,0006d$ mm (see Annex B).

4.3.3.3 The tolerance on the perpendicularity of the side, with reference to the end faces, is $0,007d$ mm.

4.3.3.4 The tolerance on the height ($2d$) is 5%.

4.3.3.5 For specimens to be used for the tensile splitting strength test, the straightness tolerance on the generating line of the cylinder is 0,2 mm.

4.3.4 Applicability of tolerances

4.3.4.1 Specimens with moulded end faces, or with end faces adjusted by grinding, shall conform to 4.3.3.

4.3.4.2 Specimens with end faces adjusted using sulfur capping, high alumina cement capping, or similar capping shall conform to 4.3.3.1 before capping and to 4.3.3.2, 4.3.3.3 and 4.3.3.4 after capping.

4.3.4.3 Specimens with end faces adjusted using the sandbox method or similar methods shall conform to 4.3.3.1 and 4.3.3.4 before capping and to 4.3.3.3 after fixing the box(es).

4.4 Prisms

<https://standards.iteh.ai/catalog/standards/sist/56edad04-50de-4dae-8fdc-b6fa36476ee5/ksist-fpren-12390-1-2021>

4.4.1 Nominal sizes

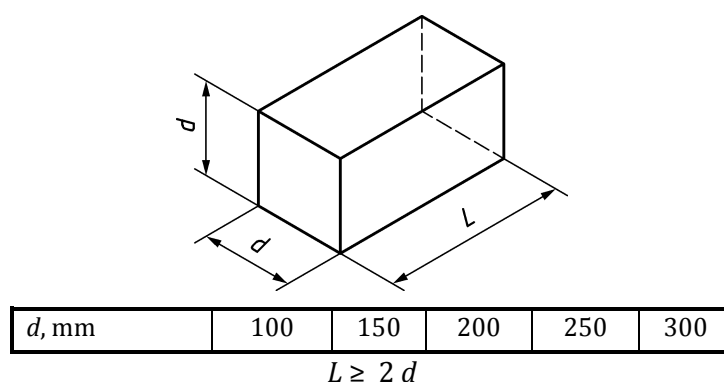


Figure 3 — Prism - nominal sizes

4.4.2 Designated sizes

Designated sizes (d) may be selected within $\pm 10\%$ of the nominal sizes.

4.4.3 Tolerances

4.4.3.1 Between moulded surfaces, the tolerance on the designated size (d) is 1,0%.

prEN 12390-1:2019 (E)

4.4.3.2 Between the top trowelled face and the bottom moulded face, the tolerance on the designated size is 1,5%.

4.4.3.3 The tolerance on the perpendicularity of the sides of the prism with reference to the base, as cast, is 0,5 mm.

4.4.3.4 The tolerances on the straightness of the surface to be in contact with the rollers in the flexural strength test is 0,2 mm.

4.4.3.5 For specimens to be used for the tensile splitting strength test, the straightness tolerance on the load bearing surface is 0,2 mm.

4.5 Measurement of dimensions and shape of specimens

4.5.1 Unless specimens have documentation to show that they had been made in calibrated moulds, they shall be measured or checked for conformity to 4.2, 4.3 or 4.4 as appropriate.

NOTE Go/no-go gauges or other suitable method can be used to check dimensions.

4.5.2 If specimens have documentation to show that they have been made in calibrated moulds, only the requirements of 4.2.3.1 and 4.2.3.2 or 4.3.3.1, 4.3.3.2 and 4.3.3.4 or 4.4.3.1, 4.4.3.2, for cubes, cylinder or prisms, respectively, shall be checked.

NOTE 1 Go/no-go gauges or other suitable method can be used to check dimensions.

NOTE 2 If a surface, calibrated with respect to flatness, is used to form the load bearing surface of cylinders, 4.3.3.2, need not be performed.

NOTE 3 Guidance on the measurement of flatness of load-bearing surfaces is given in Annex B.

<https://standards.iteh.ai/catalog/standards/sist/56edad04-50de-4dae-8fdc-b6fa36476ee5/ksist-fpren-12390-1-2021>

5 Moulds**5.1 General**

5.1.1 Moulds shall be watertight and non-absorbent.

NOTE The joints of moulds can be coated with wax, oil or grease to achieve water-tightness.

5.1.2 Moulds, other than calibrated moulds in accordance with 5.2, may be made from any material which is suitable for producing concrete specimens.

5.2 Calibrated moulds

5.2.1 Calibrated moulds shall be made of steel or cast-iron, which shall be the reference materials. If moulds are manufactured from other materials, in-use performance test data shall be available which demonstrates long-term equivalence with steel or cast-iron calibrated moulds.

5.2.2 All parts of calibrated moulds shall be sufficiently robust to prevent distortion on assembly and in use.

5.2.3 The components of the mould, with the possible exception of the base plate, shall have identification marks.

5.2.4 Calibrated moulds for cubical specimens