

---

**Načrtovanje okolja v stavbah - Vgrajeni hladilni in ogrevalni sistemi - 2. del:  
Določanje načrtovane grelne in hladilne moči (ISO/DIS 11855-2:2020)**

Building environment design - Embedded radiant heating and cooling systems - Part 2:  
Determination of the design heating and cooling capacity (ISO/DIS 11855-2:2020)

Umweltgerechte Gebäudeplanung - Flächenintegrierte Strahlheizungs- und -  
kühlssysteme - Teil 2: Bestimmung der Auslegungs-Heiz- bzw. Kühlleistung (ISO/DIS  
11855-2:2020)

**(standards.iteh.ai)**

Conception de l'environnement des bâtiments - Systèmes intégrés de chauffage et de  
refroidissement par rayonnement - Partie 2: Détermination de la puissance calorifique et  
frigorigue à la conception (ISO/DIS 11855-2:2020)

**Ta slovenski standard je istoveten z: prEN ISO 11855-2**

---

**ICS:**

91.140.10	Sistemi centralnega ogrevanja	Central heating systems
91.140.30	Prezračevalni in klimatski sistemi	Ventilation and air-conditioning systems

**oSIST prEN ISO 11855-2:2020**

**en,fr,de**

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[oSIST prEN ISO 11855-2:2020](https://standards.iteh.ai/catalog/standards/sist/b2d94664-f1a6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020)

<https://standards.iteh.ai/catalog/standards/sist/b2d94664-f1a6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020>

# DRAFT INTERNATIONAL STANDARD

## ISO/DIS 11855-2

ISO/TC 205

Secretariat: ANSI

Voting begins on:  
2020-03-16Voting terminates on:  
2020-06-08

---

---

## Building environment design — Embedded radiant heating and cooling systems —

Part 2:

### Determination of the design heating and cooling capacity

*Conception de l'environnement des bâtiments — Systèmes intégrés de chauffage et de refroidissement par rayonnement —*

*Partie 2: Détermination de la puissance calorifique et frigorifique à la conception*

ICS: 91.040.01

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[oSIST prEN ISO 11855-2:2020](https://standards.iteh.ai/catalog/standards/sist/b2d94664-fla6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020)

<https://standards.iteh.ai/catalog/standards/sist/b2d94664-fla6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020>

THIS DOCUMENT IS A DRAFT CIRCULATED FOR COMMENT AND APPROVAL. IT IS THEREFORE SUBJECT TO CHANGE AND MAY NOT BE REFERRED TO AS AN INTERNATIONAL STANDARD UNTIL PUBLISHED AS SUCH.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

This document is circulated as received from the committee secretariat.

**ISO/CEN PARALLEL PROCESSING**



Reference number  
ISO/DIS 11855-2:2020(E)

© ISO 2020

## iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN ISO 11855-2:2020](https://standards.iteh.ai/catalog/standards/sist/b2d94664-f1a6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020)

<https://standards.iteh.ai/catalog/standards/sist/b2d94664-f1a6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020>



### **COPYRIGHT PROTECTED DOCUMENT**

© ISO 2020

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
CP 401 • Ch. de Blandonnet 8  
CH-1214 Vernier, Geneva  
Phone: +41 22 749 01 11  
Fax: +41 22 749 09 47  
Email: [copyright@iso.org](mailto:copyright@iso.org)  
Website: [www.iso.org](http://www.iso.org)

Published in Switzerland

# Contents

	Page
Foreword.....	iv
Introduction.....	v
<b>1 Scope.....</b>	<b>1</b>
<b>2 Normative references.....</b>	<b>1</b>
<b>3 Terms and definitions.....</b>	<b>1</b>
<b>4 Symbols and abbreviations.....</b>	<b>1</b>
<b>5 Concept of the method to determine the heating and cooling capacity.....</b>	<b>3</b>
<b>6 Heat exchange coefficient between surface and space.....</b>	<b>4</b>
<b>7 Simplified calculation methods for determining heating and cooling capacity or surface temperature.....</b>	<b>5</b>
7.1 Universal single power function.....	6
7.2 Thermal resistance methods.....	9
<b>8 Use of basic calculation programmes.....</b>	<b>11</b>
8.1 Basic calculation programmes.....	11
8.2 Items to be included in a complete computation documentation.....	12
<b>9 Calculation of the heating and cooling capacity.....</b>	<b>12</b>
<b>Annex A (normative) Calculation of the heat flux.....</b>	<b>13</b>
<b>Annex B (normative) General resistance method.....</b>	<b>34</b>
<b>Annex C (normative) Pipes embedded in wooden construction.....</b>	<b>40</b>
<b>Annex D (normative) Method for verification of FEM and FDM calculation programmes.....</b>	<b>48</b>
<b>Annex E (normative) Values for heat conductivity of materials and air layers.....</b>	<b>52</b>
<b>Bibliography.....</b>	<b>54</b>

## ISO/DIS 11855-2:2020(E)

### Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 11855-2 was prepared by Technical Committee ISO/TC 205, *Building environment design*.

ISO 11855 consists of the following parts, under the general title *Building environment design — Design, dimensioning, installation, control and input parameters for the energy calculation of embedded radiant heating and cooling systems*:

- *Part 1: Definition, symbols, and comfort criteria*
- *Part 2: Determination of the design and heating and cooling capacity*
- *Part 3: Design and dimensioning*
- *Part 4: Dimensioning and calculation of the dynamic heating and cooling capacity of Thermo Active Building Systems (TABS)*
- *Part 5: Installation*
- *Part 6: Control*
- *Part 7: Input parameters for the energy calculation*

Part 1 specifies the comfort criteria which should be considered in designing embedded radiant heating and

cooling systems, since the main objective of the radiant heating and cooling system is to satisfy thermal comfort of the occupants. Part 2 provides steady-state calculation methods for determination of the heating and cooling capacity. Part 3 specifies design and dimensioning methods of radiant heating and cooling systems to ensure the heating and cooling capacity. Part 4 provides a dimensioning and calculation method to design Thermo Active Building Systems (TABS) for energy-saving purposes, since radiant heating and cooling systems can reduce energy consumption and heat source size by using renewable energy. Part 5 addresses the installation process for the system to operate as intended. Part 6 shows a proper control method of the radiant heating and cooling systems to ensure the maximum performance which was intended in the design stage when the system is actually being operated in a building. Part 7 presents a calculation method for input parameters to ISO 52031.

## Introduction

The radiant heating and cooling system consists of heat emitting/absorbing, heat supply, distribution, and control systems. The ISO 11855 series deals with the embedded surface heating and cooling system that directly controls heat exchange within the space. It does not include the system equipment itself, such as heat source, distribution system and controller.

The ISO 11855 series addresses an embedded system that is integrated with the building structure. Therefore, the panel system with open air gap, which is not integrated with the building structure, is not covered by this series.

The ISO 11855 series shall be applied to systems using not only water but also other fluids or electricity as a heating or cooling medium.

The object of the ISO 11855 series is to provide criteria to effectively design embedded systems. To do this, it presents comfort criteria for the space served by embedded systems, heat output calculation, dimensioning, dynamic analysis, installation, control method of embedded systems, and input parameters for the energy calculations.

## iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN ISO 11855-2:2020](https://standards.iteh.ai/catalog/standards/sist/b2d94664-f1a6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020)

<https://standards.iteh.ai/catalog/standards/sist/b2d94664-f1a6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020>

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[oSIST prEN ISO 11855-2:2020](https://standards.iteh.ai/catalog/standards/sist/b2d94664-f1a6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020)

<https://standards.iteh.ai/catalog/standards/sist/b2d94664-f1a6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020>



# Building environment design — Embedded radiant heating and cooling systems —

## Part 2:

## Determination of the design heating and cooling capacity

### 1 Scope

This part of ISO 11855 specifies procedures and conditions to enable the heat flow in water based surface heating and cooling systems to be determined relative to the medium differential temperature for systems. The determination of thermal performance of water based surface heating and cooling systems and their conformity to this part of ISO 11855 is carried out by calculation in accordance with design documents and a model. This should enable a uniform assessment and calculation of water based surface heating and cooling systems.

The surface temperature and the temperature uniformity of the heated/cooled surface, nominal heat flux between water and space, the associated nominal medium differential temperature, and the field of characteristic curves for the relationship between heat flux and the determining variables are given as the result.

This part of ISO 11855 includes a general method based on Finite Difference or Finite Element Methods and simplified calculation methods depending on position of pipes and type of building structure.

The ISO 11855 series is applicable to water based embedded surface heating and cooling systems in residential, commercial and industrial buildings. The methods apply to systems integrated into the wall, floor or ceiling construction without any open air gaps. It does not apply to panel systems with open air gaps which are not integrated into the building structure.

The ISO 11855 series also applies, as appropriate, to the use of fluids other than water as a heating or cooling medium. The ISO 11855 series is not applicable for testing of systems. The methods do not apply to heated or chilled ceiling panels or beams.

### 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 11855-1, *Building environment design — Design, dimensioning, installation, control and input parameters for the energy calculation of embedded radiant heating and cooling systems — Part 1: Vocabulary, symbols, and comfort criteria*

EN 1264, *Water based surface embedded heating and cooling systems (2012)*

### 3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 11855-1 apply.

### 4 Symbols and abbreviations

For the purposes of this document, the symbols and abbreviations in [Table 1](#) apply.

Table 1 — Symbols and abbreviations

Symbol	Unit	Quantity
$\alpha_i$	—	Parameter factors for calculation of characteristic curves
$A_A$	m <sup>2</sup>	Surface of the occupied area
$A_F$	m <sup>2</sup>	Surface of the heating/cooling surface area
$A_R$	m <sup>2</sup>	Surface of the peripheral area
$b_u$	—	Calculation factor depending on the pipe spacing
$B, B_G, B_0$	W/(m <sup>2</sup> ·K)	Coefficients depending on the system
$D$	m	External diameter of the pipe, including sheathing where used
$d_a$	m	External diameter of the pipe
$d_i$	m	Internal diameter of the pipe
$d_M$	m	External diameter of sheathing
$c_W$	kJ/(kg·K)	Specific heat capacity of water
$h_t$	W/(m <sup>2</sup> ·K)	Total heat transfer coefficient (convection + radiation) between surface and space
$K_H$	W/(m <sup>2</sup> ·K)	Equivalent heat transmission coefficient
$K_{WL}$	—	Parameter for heat conducting devices
$k_{CL}$	—	Parameter for heat conducting layer
$L_{WL}$	m	Width of heat conducting devices
$L_{fin}$	m	Width of fin (horizontal part of heat conducting device seen as a heating fin)
$L_R$	m	Length of installed pipes
$m$	—	Exponents for determination of characteristic curves
$m_D$	—	Exponents for determination of characteristic curves
$m_u$	—	Exponents for determination of characteristic curves
$m_T$	—	Exponents for determination of characteristic curves
$m_H$	kg/s	Design heating/cooling medium flow rate
$n, n_G$	—	Exponents
$q$	W/m <sup>2</sup>	Heat flux at the surface
$q_A$	W/m <sup>2</sup>	Heat flux in the occupied area
$q_{des}$	W/m <sup>2</sup>	Design heat flux
$q_G$	W/m <sup>2</sup>	Limit heat flux
$q_N$	W/m <sup>2</sup>	Nominal heat flux
$q_R$	W/m <sup>2</sup>	Heat flux in the peripheral area
$q_u$	W/m <sup>2</sup>	Outward heat flux
$R_o$	m <sup>2</sup> ·K/W	Partial inwards heat transmission resistance of surface structure
$R_u$	m <sup>2</sup> ·K/W	Partial outwards heat transmission resistance of surface structure
$R_{\lambda,B}$	m <sup>2</sup> ·K/W	Thermal resistance of surface covering
$R_{\lambda,ins}$	m <sup>2</sup> ·K/W	Thermal resistance of thermal insulation
$s_h$	m	In Type B systems, thickness of thermal insulation from the outward edge of the insulation to the inward edge of the pipes (see <a href="#">Figure 2</a> )
$s_l$	m	In Type B systems, thickness of thermal insulation from the outward edge of the insulation to the outward edge of the pipes (see <a href="#">Figure 2</a> )
$s_{ins}$	m	Thickness of thermal insulation
$s_R$	m	Pipe wall thickness
$s_u$	m	Thickness of the layer above the pipe
$s_{WL}$	m	Thickness of heat conducting device
$S$	m	Thickness of the screed (excluding the pipes in type A systems)

Table 1 (continued)

Symbol	Unit	Quantity
$W$	m	Pipe spacing
$h$	$W/(m^2 \cdot K)$	Heat exchange coefficient
$\lambda_{WL}$	$W/(m \cdot K)$	Heat conductivity of the heat diffusion device material
$\theta_{s,max}$	$^{\circ}C$	Maximum surface temperature
$\theta_{s,min}$	$^{\circ}C$	Minimum surface temperature
$\theta_i$	$^{\circ}C$	Design indoor temperature
$\theta_m$	$^{\circ}C$	Temperature of the heating/cooling medium
$\theta_{s,m}$	$^{\circ}C$	average surface temperature
$\theta_R$	$^{\circ}C$	Return temperature of heating/cooling medium
$\theta_V$	$^{\circ}C$	Supply temperature of heating/cooling medium
$\theta_u$	$^{\circ}C$	Indoor temperature in an adjacent space
$\Delta\theta_H$	K	Heating/cooling medium differential temperature
$\Delta\theta_{H,des}$	K	Design heating/cooling medium differential temperature
$\Delta\theta_{H,G}$	K	Limit of heating/cooling medium differential temperature
$\Delta\theta_N$	K	Nominal heating/cooling medium differential temperature
$\Delta\theta_V$	K	Heating/cooling medium differential supply temperature
$\Delta\theta_{V,des}$	K	Design heating/cooling medium differential supply temperature
$\lambda$	$W/(m \cdot K)$	Thermal conductivity
$\sigma$	K	Temperature drop $\theta_V - \theta_R$
$\varphi$	—	Conversion factor for temperatures
$\psi$	—	Volume ratio of the attachment studs in the screed

<https://standards.iteh.ai/catalog/standards/sist/b2d94664-fla6-4be1-8d81-1b9c75206f11/osist-pre-iso-11855-2-2020>

## 5 Concept of the method to determine the heating and cooling capacity

A given type of surface (floor, wall, ceiling) delivers, at a given average surface temperature and indoor temperature (operative temperature  $\theta_i$ ), the same heat flux in any space independent of the type of embedded system. It is therefore possible to establish a basic formula or characteristic curve for cooling and a basic formula or characteristic curve for heating, for each of the type of surfaces (floor, wall, ceiling), independent of the type of embedded system, which is applicable to all heating and cooling surfaces (see [Clause 6](#)).

Two methods are included in this part of ISO 11855:

- simplified calculation methods depending on the type of system (see [Clause 7](#));
- Finite Element Method and Finite Difference Method (see [Clause 8](#)).

Different simplified calculation methods are included in [Clause 7](#) for calculation of the surface temperature (average, maximum and minimum temperature) depending on the system construction (type of pipe, pipe diameter, pipe distance, mounting of pipe, heat conducting devices, distribution layer) and construction of the floor/wall/ceiling (covering, insulation layer, trapped air layer, etc.). The simplified calculation methods are specific for the given type of system, and the boundary conditions listed in [Clause 7](#) shall be met. In the calculation report, it shall be clearly stated which calculation method has been applied.

In case a simplified calculation method is not available for a given type of system, either a basic calculation using two or three dimensional finite element or finite difference method can be applied (see [Clause 8](#) and [Annex D](#)).


NOTE In addition, laboratory testing (for example EN 1264:2012) may be applied.

## ISO/DIS 11855-2:2020(E)

Based on the calculated average surface temperature at given combinations of medium (water) temperature and space temperature, it is possible to determine the steady state heating and cooling capacity (see [Clause 9](#)).

## 6 Heat exchange coefficient between surface and space

The relationship between the heat flux and mean differential surface temperature [see [Figure 1](#) and [Equations \(1\)](#) to (4)] depends on the type of surface (floor, wall, ceiling) and whether the temperature of the surface is lower (cooling) or higher (heating) than the space temperature.

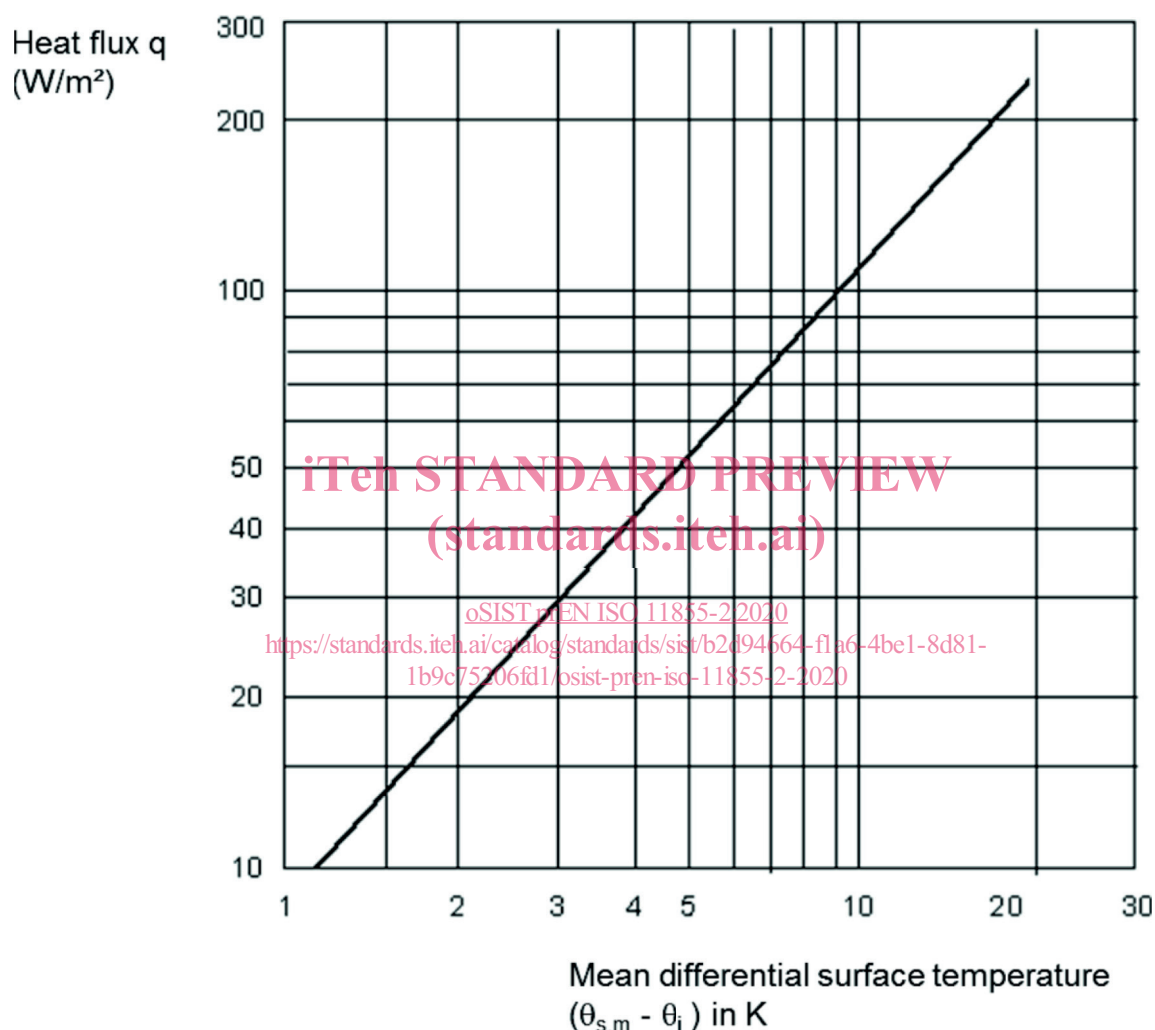

**Figure 1 — Basic characteristic curve for floor heating and ceiling cooling**

For floor heating and ceiling cooling in [Figure 1](#), the heat flux  $q$  is given by:

$$q = 8,92 (\theta_{s,m} - \theta_i)^{1,1} \text{ (W/m}^2\text{)} \quad (1)$$

where

$\theta_{s,m}$  is the average surface temperature in °C;

$\theta_i$  is the nominal indoor operative temperature in °C.

For other types of surface heating and cooling systems, the heat flux  $q$  is given by:

Wall heating and wall cooling:  $q = 8 (|\theta_{s,m} - \theta_i|) \text{ (W/m}^2\text{)} \quad (2)$

$$\text{Ceiling heating: } q = 6 (|\theta_{s,m} - \theta_i|) \text{ (W/m}^2\text{)} \quad (3)$$

$$\text{Floor cooling: } q = 7 (|\theta_{s,m} - \theta_i|) \text{ (W/m}^2\text{)} \quad (4)$$

The heat transfer coefficient is combined convection and radiation.

**NOTE** In many building system simulations using dynamic computer models, the heat transfer is often split up in a convective part (between heated/cooled surface and space air) and a radiant part (between heated/cooled surface and the surrounding surfaces or sources). The radiant heat transfer coefficient may in the normal temperature range 15-30 °C be fixed to 5,5 W/m<sup>2</sup>K. The convective heat transfer coefficient depends on type of surface, heating or cooling, air velocity (forced convection) or temperature difference between surface and air (natural convection).

For using the simplified calculation method in [Annex A](#) the characteristic curves present the heat flux as a function of the difference between the heating/cooling medium temperature and the indoor temperature. For the user of [Annex A](#), this means not to do any calculations by directly using values of heat transfer coefficients. Consequently, [Annex A](#) does not include values for such an application or special details or equations concerning heat transfer coefficients on heating or cooling surfaces.

Thus, the values  $\alpha$  of [Table A.12](#) of [Annex A](#) are not intended to calculate the heat flux directly. In fact, they are provided exclusively for the conversion of characteristic curves in accordance with [Equation \(A.32\)](#) in [Clause A.3](#). For simplifications these calculations are based on the same heat transfer coefficient for floor cooling and ceiling heating, 6,5 W/m<sup>2</sup>K.

For every surface heating and cooling system, there is a maximum allowable heat flux, the limit heat flux  $q_G$ . This is determined for a selected design indoor room temperature of  $\theta_i$  (for heating, often 20 °C and for cooling, often 26 °C) at the maximum or minimum surface temperature  $\theta_{F,max}$  and a temperature drop  $\sigma = 0$  K.

(standards.iteh.ai)

For the calculations, the centre of the heating or cooling surface area, regardless of the type of system, is used as a reference point for  $\theta_{S,max}$ .

The average surface temperature,  $\theta_{S,m}$ , which determines the heat flux (refer to the basic characteristic curve) is linked with the maximum or minimum surface temperature:  $\theta_{S,m} < \theta_{S,max}$  and  $\theta_{S,m} > \theta_{S,min}$  always applies.

The attainable value,  $\theta_{S,m}$ , depends not only on the type of system, but also on the operating conditions (temperature drop  $\sigma = \theta_V - \theta_R$ , outward heat flow  $q_u$  and heat resistance of the covering  $R_{\lambda,B}$ ).

The following assumptions form the basis for calculation of the heat flux:

- heat transfer between the heated or cooled surface and the space occurs in accordance with the basic characteristic curve;
- the temperature drop  $\sigma = 0$ . The dependence of the characteristic curve on the temperature drop is determined by using the logarithmically determined mean differential heating medium temperature  $\Delta\theta_H$  [see [Equation \(1\)](#)];
- turbulent flow in pipe:  $\frac{m_H}{d_i} > 4000 \frac{kg}{h \cdot m}$ ;
- no lateral heat flow.

## 7 Simplified calculation methods for determining heating and cooling capacity or surface temperature

Two types of simplified calculation methods can be applied according to this part of ISO 11855:

- one method is based on a single power function product of all relevant parameters developed from the finite element method (FEM);

## ISO/DIS 11855-2:2020(E)

- another method is based on calculation of equivalent thermal resistance between the temperature of the heating or cooling medium and the surface temperature (or room temperature).

A given system construction can only be calculated with one of the simplified methods. The correct method to apply depends on the type of system, A to G (position of pipes, concrete or wooden construction) and the boundary conditions listed in [Table 2](#).

**Table 2 — Criteria for selection of simplified calculation method**

Pipe position	Type of system	Figure	Boundary conditions	Reference to method
In screed Thermally decoupled from the structural base of the building by thermal insulation	A, C	2 a)	$W \geq 0,050 \text{ m}$ $s_u \geq 0,01 \text{ m}$ $0,008 \text{ m} \leq d \leq 0,03 \text{ m}$ $s_u/\lambda_e \geq 0,01$	<a href="#">7.1</a> <a href="#">A.2.2</a>
In insulation, conductive devices Not wooden constructions except for weight bearing and thermal diffusion layer	B	2 b)	$0,05 \text{ m} \leq W \leq 0,45 \text{ m}$ $0,014 \text{ m} \leq d \leq 0,022 \text{ m}$ $0,01 \text{ m} \leq s_u/\lambda_e \leq 0,18$	<a href="#">7.1</a> <a href="#">A.2.3</a>
Plane section system	D	2 c)		<a href="#">7.1</a> , <a href="#">A.2.4</a>
In concrete slab	E	4	$S_T/W \geq 0,3$	<a href="#">7.2</a> , <a href="#">B.1</a>
Capillar tubes in concrete surface	F	5	$d_a/W \leq 0,2$	<a href="#">7.2</a> , <a href="#">B.2</a>
Wooden constructions, pipes in sub floor or under sub floor, conductive devices	G	6	$\lambda_{wl} \geq 10 \lambda_{\text{surroundingmaterial}}$ $S_{WL} \lambda \geq 0,01$	<a href="#">7.2</a> , <a href="#">Annex C</a>

oSIST prEN ISO 11855-2:2020

## 7.1 Universal single power function

The heat flux between embedded pipes (temperature of heating or cooling medium) and the space is calculated by the general equation:

$$q = B \cdot \prod_i (a_i^{m_i}) \cdot \theta_H \quad (\text{W/m}^2) \quad (5)$$

where

$B$  is a system-dependent coefficient in  $\text{W}/(\text{m}^2 \cdot \text{K})$ . This depends on the type of system;

$\prod_i (a_i^{m_i})$  is the power product, which links the parameters of the structure (surface covering, pipe spacing, pipe diameter and pipe covering).


This calculation method is given in [Annex A](#) for the following four types of systems:

- Type A with pipes embedded in the screed or concrete (see [Figure 2](#) and [A.2.2](#));
- Type B with pipes embedded outside the screed (see [Figure 2](#) and [A.2.3](#));
- Type C with pipes embedded in the screed (see [Figure 2](#) and [A.2.2](#));
- Type D plane section systems (see [A.2.4](#)).

[Figure 2](#) shows the types as embedded in the floor, but the methods can also be applied for wall and ceiling systems with a corresponding position of the pipes.

This method shall only be used for system configurations meeting the boundary conditions listed for the different types of systems in [Annex A](#).



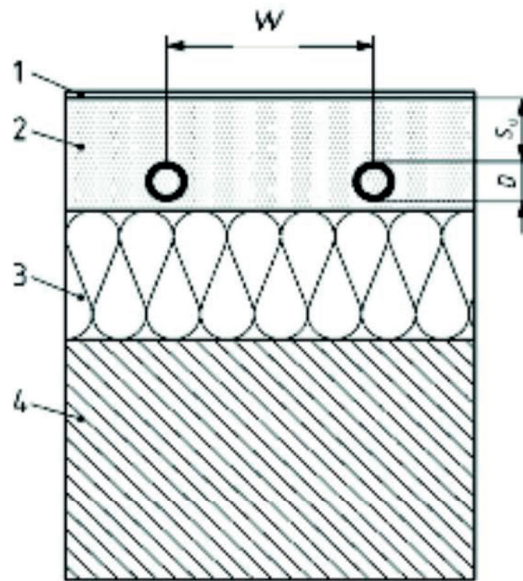

a) Type A and C

**Key**

- 1 floor covering
- 2 weight bearing and thermal diffusion layer (cement screed, anhydrite screed, asphalt screed)
- 3 thermal insulation
- 4 structural bearing

iTeh STANDARD PREVIEW  
 (standards.iteh.ai)  
 oSIST prEN ISO 11855-2:2020  
<https://standards.iteh.ai/catalog/standards/sist/b2d94664-fl a6-4be1-8d81-1b9c75206fd1/osist-pren-iso-11855-2-2020>