



Designation: ~~C1201-91 (Reapproved 2003)~~ Designation: C 1201/C 1201M - 09

## Standard Test Method for Structural Performance of Exterior Dimension Stone Cladding Systems by Uniform Static Air Pressure Difference<sup>1</sup>

This standard is issued under the fixed designation C 1201/C 1201M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

### 1. Scope

1.1 This test method covers the determination of the structural performance of dimension stone cladding systems under positive and negative uniform static air pressure differences, using a test chamber.

1.2 The proper use of this test method requires a knowledge of the principles of pressure and deflection measurement.

1.3 This test method describes the apparatus and the procedure to be used for applying either specific test loads or unknown ultimate values of uniformity distributed test loads to a specimen.

1.3.1 Procedure A (see 11.2) shall be used when deflections at maximum load only are required.

1.3.2 Procedure B (see 11.3) shall be used when a load-deflection curve is required.

~~1.4 The values stated in SI units are to be regarded as the standard. The values given in parentheses are for information only.~~

1.4 Units—The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.* For specific hazard statements, see Section 7.

### 2. Referenced Documents

2.1 *ANSI Standard:*

ANSI A58.1 Building Code Requirements for Minimum Design Loads in Buildings and Other Structures<sup>2</sup>

2.2 *AAMA Standard:*

AAMA TIR-A2 Design Wind Loads for Aluminum Curtain Walls<sup>3</sup>

### 3. Terminology

3.1 ~~Descriptions~~ Definitions of Terms Specific to This Standard:

3.1.1 *permanent deformation*—the permanent displacement from an original position that remains after an applied load has been removed.

3.1.2 *specimen*—the entire assembled unit submitted for test as described in Section 8.

3.1.3 *test load*—the specified difference in static air pressure (positive or negative) for which the specimen is to be tested, expressed in ~~pascals (pounds-force/pounds-force per square foot)-foot [Pascals]~~.

3.1.4 *ultimate load*—the difference in static air pressure (positive or negative) at which failure of the specimen occurs, expressed in ~~pascals (pounds-force/pounds-force per square foot)-foot [Pascals]~~.

### 4. Summary of Test Method

4.1 This test method consists of sealing the test specimen into or against one face of a test chamber; supplying air to, or exhausting air from, the chamber at the rate required to maintain the test-pressure difference across the specimen; and observing,

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee ~~E-18~~ C18 on Dimension Stone and is the direct responsibility of Subcommittee ~~C18.01~~ C18.01 on Test Methods. Current edition approved May 10, 2003. Published June 2003. Originally approved in 1991. Last previous edition approved in 1996 as C 1201-91 (1996). Current edition approved April 1, 2009. Published April 2009. Originally approved in 1991. Last previous edition approved in 2003 as C 1201-91(2003).

<sup>2</sup> Available from American National Standards Institute, 11 West 42nd Street, 13th Floor, New York, NY 10036.

<sup>3</sup> Available from American National Standards Institute (ANSI), 25 W. 43rd St., 4th Floor, New York, NY 10036, <http://www.ansi.org>.

<sup>4</sup> Available from American Architectural Manufacturers Association, 2700 River Road, Suite 118, Des Plaines, IL 60018.

<sup>5</sup> Available from American Architectural Manufacturers Association (AAMA), 1827 Walden Office Square, Suite 550, Schaumburg, IL 60173-4268.

measuring, and recording the deflection, deformations, and nature of any failures.<sup>4,5</sup>

## 5. Significance and Use

5.1 This test method gives a standard procedure for determining structural performance under uniform static air pressure difference. This typically is intended to represent the effects of wind loads on exterior building surface elements. The actual loading on building surfaces is quite complex, varying with wind direction, time, height above ground, building shape, terrain, surrounding structures, and other factors. These factors are discussed in the literature in 2.1 and 2.2 and Footnotes 4 and 5.

NOTE 1—In applying the results of tests by this test method, it should be borne in mind that the performance of a cladding system may be a function of fabrication, installation, and adjustment, and that the specimen may or may not truly represent the actual structure. In service, the performance will also depend on the rigidity of supporting construction and on the resistance of components to deterioration by various causes, to vibration, to thermal expansion and contraction, etc.

## 6. Apparatus

6.1 The description of apparatus is general in nature; any equipment capable of performing the test procedure within the allowable tolerances is permitted.

6.2 *Major Components* (see Fig. 1):

6.2.1 *Test Chamber*—A test chamber or box with an opening, a removable mounting panel, or one open side in which, or against which, the specimen is installed. Care should be taken when designing the chamber-to-specimen seal, to avoid edge conditions not representative of the cladding system being tested. At least one static pressure tap shall be provided to measure the chamber pressure and shall be so located that the reading is unaffected by the velocity of the air supply to or from the chamber, or any other air movement. The air supply opening into the chamber shall be arranged so that the air does not impinge directly on the test specimen. A means of access into the chamber may be provided to facilitate adjustments and observations after the specimen has been installed.

NOTE 2—The test chamber and the specimen mounting frame must not deflect under the test load in such a manner that the performance of the specimen will be affected.

6.2.2 *Air System*—A controllable blower, a compressed-air supply, an exhaust system, or reversible controllable blower designed to provide the required maximum air-pressure difference across the specimen. The system shall provide an essentially constant air-pressure difference for the required test period.

NOTE 3—It is convenient to use a reversible blower or a separate pressure and exhaust system to provide the required air-pressure difference so that the test specimen can be tested for the effect of positive pressure and for the effect of negative pressure without removing, reversing, and reinstalling the test specimen. If an adequate air supply is available, a completely airtight seal need not be provided around the perimeter of the test specimen and the mounting panel, although it is preferable. However, substantial air leakage will require an air supply of much greater capacity to maintain the required pressure differences.

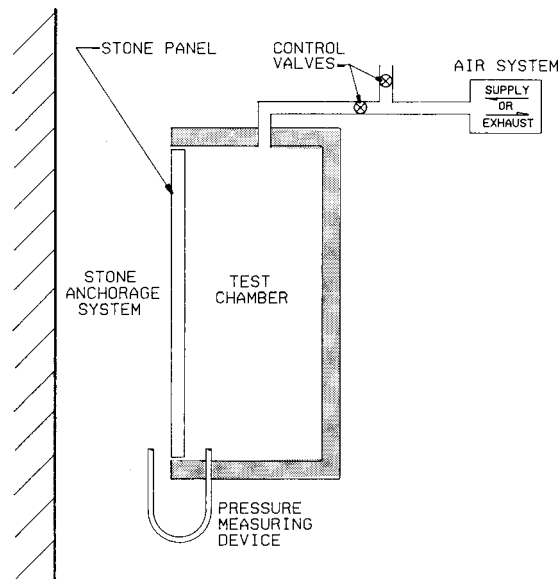


FIG. 1 General Arrangement of Testing Apparatus

<sup>4</sup> ASHRAE *Handbook of Fundamentals*, American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc., Chapter 26, 1977.

<sup>5</sup> "Wind Forces on Structures," *Transactions of the American Society of Civil Engineer*, Vol 126, Part II, Paper 3269, 1961, pp. 1124–1198.