

# **SLOVENSKI STANDARD**

## **SIST EN 50090-5-1:2020**

**01-junij-2020**

**Nadomešča:**

**SIST EN 50090-5-1:2005**

---

**Stanovanjski in stavbni elektronski sistemi (HBES) - 5-1. del: Mediji in nivoji, odvisni od medijev - Napajalni vod za HBES razreda 1**

Home and Building Electronic Systems (HBES) - Part 5-1: Media and media dependent layers - Power line for HBES Class 1

Elektrische Systemtechnik für Heim und Gebäude (ESHG) Teil 5-1: Medien und medienabhängige Schichten - Signalübertragung auf elektrischen Niederspannungsnetzen für ESHG Klasse 1

Systèmes électroniques pour les foyers domestiques et les bâtiments (HBES) - Partie 5-1: Medias et couches dépendantes des medias - Courants porteurs pour HBES Classe 1

**Ta slovenski standard je istoveten z: EN 50090-5-1:2020**

---

**ICS:**

35.240.67	Uporabniške rešitve IT v gradbeništvu	IT applications in building and construction industry
97.120	Avtomatske krmilne naprave za dom	Automatic controls for household use

**SIST EN 50090-5-1:2020**

**en**

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

SIST EN 50090-5-1:2020

<https://standards.iteh.ai/catalog/standards/sist/8b3e068d-8a29-4686-b550-6968189b5f9e/sist-en-50090-5-1-2020>

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

**EN 50090-5-1**

April 2020

ICS 35.100.10; 35.100.20; 97.120

Supersedes EN 50090-5-1:2005 and all of its  
amendments and corrigenda (if any)

English Version

**Home and Building Electronic Systems (HBES) - Part 5-1: Media  
and media dependent layers - Power line for HBES Class 1**

Systèmes électroniques pour les foyers domestiques et les  
bâtiments (HBES) - Partie 5-1: Médias et couches  
dépendantes des médias - Courants porteurs pour HBES  
Classe 1

Elektrische Systemtechnik für Heim und Gebäude (ESHG) -  
Teil 5-1: Medien und medienabhängige Schichten -  
Signalübertragung auf elektrischen Niederspannungsnetzen  
für ESHG Klasse 1

This European Standard was approved by CENELEC on 2020-01-09. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

<https://standards.iteh.ai/catalog/standards/sist/8b3e068d-8a29-4686-b550-6968189b5f9e/sist-en-50090-5-1-2020>



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

## Contents

## Page

European foreword .....	3
1 Scope .....	4
2 Normative references .....	4
3 Terms, definitions and symbols .....	4
3.1 Terms and definitions .....	4
3.2 Abbreviations .....	5
4 Requirements for HBES Class 1, power line PL110 .....	5
4.1 Physical layer PL110 .....	5
4.1.1 General .....	5
4.1.2 Transmission medium .....	7
4.1.3 Medium attachment unit (MAU) .....	8
4.1.4 Installation topology .....	10
4.1.5 Installation requirements .....	10
4.1.6 Surge protection .....	11
4.1.7 Services at the data link layer / physical layer interface .....	11
4.1.8 Features of PL110-physical layer .....	12
4.1.9 PL110 character overview .....	12
4.2 Data link layer type PL110 .....	16
4.2.1 General .....	16
4.2.2 Domain Address/Individual Address/Group Address .....	16
4.2.3 Frame formats .....	17
4.2.4 Medium access control .....	21
4.2.5 Data link layer services .....	25
4.2.6 Parameters of layer-2 .....	27
4.2.7 Data link layer protocol .....	27
4.2.8 The layer-2 of a repeater .....	28
Bibliography .....	29

## European foreword

This document (EN 50090-5-1:2020) has been prepared by CLC/TC 205, “Home and Building Electronic Systems (HBES)”<sup>1</sup>

The following dates are fixed:

- latest date by which this document has (dop) 2020-10-24  
to be implemented at national level by  
publication of an identical national  
standard or by endorsement
- latest date by which the national (dow) 2023-04-24  
standards conflicting with this document  
have to be withdrawn

This document will supersede EN 50090-5-1 and all of its amendments and corrigenda (if any).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

EN 50090-5-1 is part of the EN 50090 series of European Standards, which comprises the following parts:

- Part 1: Standardization structure
- Part 3: Aspects of application
- Part 4: Media independent layers [SIST EN 50090-5-1:2020](https://standards.iteh.ai/catalog/standards/sist/8b3e068d-8a29-4686-b550-6968189b589e/sist-en-50090-5-1-2020)
- Part 5: Media and media dependent layers
- Part 6: Interfaces
- Part 7: System management

NOTE Part 2 has been withdrawn.

---

<sup>1</sup> This document was prepared with the help of CENELEC co-operation partner KNX Association, De Kleetlaan 5, B-1831 Diegem.

**EN 50090-5-1:2020 (E)****1 Scope**

This document defines the mandatory and optional requirements for the medium specific physical and data link layer of power line Class 1 PL110.

Data link layer interface and general definitions, which are medium independent, are given in EN 50090-4-1.

**2 Normative references**

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50090-1, *Home and Building Electronic Systems (HBES) - Part 1: Standardization structure*

EN 50090-4-2, *Home and Building Electronic Systems (HBES) - Part 4-2: Media independent layers - Transport layer, network layer and general parts of data link layer for HBES Class 1*

EN 50090-5-2, *Home and Building Electronic Systems (HBES) - Part 5-2: Media and media dependent layers - Network based on HBES Class 1, Twisted Pair*

EN 50065-1, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5 kHz - Part 1: General requirements, frequency bands and electromagnetic disturbances*

EN 50065-7, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5 kHz - Part 7: Equipment impedance*

EN 50160, *Voltage characteristics of electricity supplied by public electricity networks*

EN 55016-1-2, *Specification for radio disturbance and immunity measuring apparatus and methods - Part 1-2: Radio disturbance and immunity measuring apparatus - Coupling devices for conducted disturbance measurements (CISPR-16-1-2)*

EN 61643-11, *Low-voltage surge protective devices - Part 11: Surge protective devices connected to low-voltage power systems - Requirements and test methods (IEC 61643-11)*

**3 Terms, definitions and symbols****3.1 Terms and definitions**

For the purposes of this document, the terms and definitions given in EN 50090-1 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

**3.1.1****differential mode**

PL signals that are injected between phase and neutral

**3.1.2****router**

connects one sub-network with another sub-network

**3.1.3****PL110**

power line signal operating in the frequency band 95 kHz to 125 kHz according to EN 50065-1

**3.2 Abbreviations**

HBES Class 1	refers to simple control and command
HBES Class 2	refers to Class 1 plus simple voice and stable picture transmission
HBES Class 3	refers to Class 2 plus complex video transfers
ACK	Acknowledgement
NRZ	Non Return to Zero
SPD	Surge Protection Devices
LPDU	Link layer Protocol Data Unit
CS	Check Sequence
TPDU	Transport layer Protocol Data Unit
APDU	Application layer Protocol Data Unit
NACK	Not acknowledge
DAF	Destination Address Flag
FSK	Frequency Shift Keying
SFSK	Spread Frequency Shift Keying
MSK	Minimum Shift Keying
FEC	Forward Error Correction
FCS	Frame Check Sequence
CTRL	Control field
MAU	Medium Attachment Unit
NPCI	Network Protocol Control Information
CSMA	Carrier Sense Multiple Access protocol
DOA	Domain Address

**4 Requirements for HBES Class 1, power line PL110****4.1 Physical layer PL110****4.1.1 General**

This clause describes the physical layer characteristics of the PL110 power line signalling which operates in the frequency band 95 kHz to 125 kHz band as described in EN 50065-1 and having a nominal centre frequency of 110 kHz.

The main characteristics of the PL110 physical layer are:

- a spread frequency shift keying signalling;
- asynchronous transmission of data packets;
- symbols globally synchronized to the mains frequency;
- half duplex bi-directional communication.

## EN 50090-5-1:2020 (E)

Electrical wiring in the building/home should be in compliance with the current national regulations. Power line communication is described in EN 50065-1 (general requirements, frequency allocation and electromagnetic disturbances).

The electric power distribution network normally determines the physical topology of the power line network. The structure of this network may be 1 or 3-phase. The rated voltage between one phase and the neutral shall be 230 V. PL110 signals are injected between phase and neutral.

General requirements for the physical layer type PL110 are given in Table 1.

**Table 1 — General requirements for physical layer PL110**


Characteristic	Description
Medium	electrical power distribution network
Topology	installation dependant (e.g. linear, star, tree)
Bit rate	1 200 bps
Mains frequency	50 Hz (according to EN 50160)
Number of Domain Addresses	255
Number of Individual Addresses	32 767
Modulation type	spread frequency shift keying (SFSK)
Frequency for logical "0"	105,6 kHz $\pm$ 100 ppm
Frequency for logical "1"	115,2 kHz $\pm$ 100 ppm
Bit duration	833,33 $\mu$ s
Maximum output level	122 dB $\mu$ V <sup>a</sup>
Input sensitivity	$\leq$ 60 dB $\mu$ V <sup>b</sup>
Device class	Class 122 <sup>c</sup>
Compliance to standards	EN 50065-1
<p><sup>a</sup> Measurement according to EN 50065-1.</p> <p><sup>b</sup> With artificial network according to EN 55016-1-2 [(50 <math>\mu</math>H + 5 <math>\Omega</math>) / 50 <math>\Omega</math>].</p> <p><sup>c</sup> Equipment manufactured to Class 116 according to EN 50065-1 will now meet the requirements of Class 122 and may be marked Class 116 provided that its output complies with the previous standard.</p>	

The logical structure of the physical layer PL110 entity is shown in Figure 1. Each PL110-device includes one.

The PL110 entity shall consist of three blocks:

- connector;
- medium attachment unit (MAU);
- error correction.



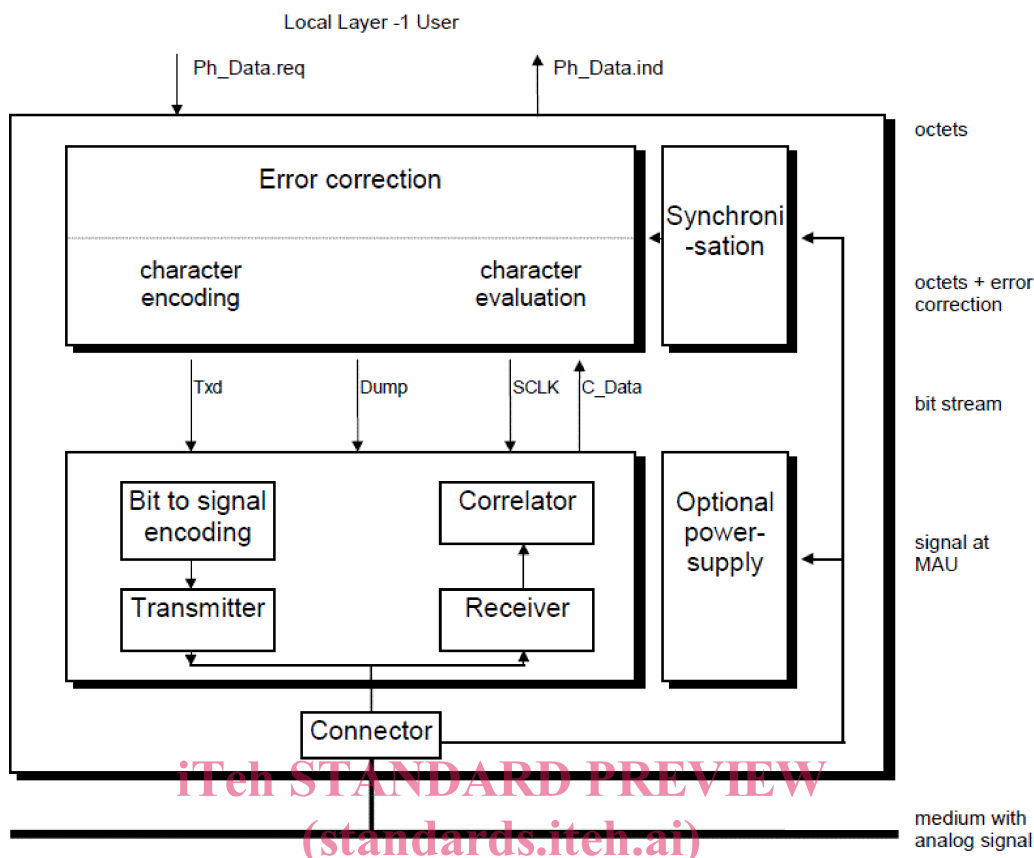

SIST EN 50090-5-1:2020  
<https://standards.iteh.ai/catalog/standards/sist/8b3e068d-8a29-4686-b550-6968189b519e/sist-en-50090-5-1-2020>  
**Figure 1 — Structure of the MAU (example)**

#### 4.1.2 Transmission medium

##### 4.1.2.1 Requirements for protection against electrical shocks and connectors

The PL110 devices are connected to the 230 V installation network. The requirements for protection against electrical shocks for human beings (and animals) and connectors shall be considered within the complete device and are not subject to the physical layer description.

These requirements are fixed in the installation and equipment standards (safety standards).

##### 4.1.2.2 Power line cables

Insofar as installation wires are used as power line cables, national regulations apply. Normally the type of cable, the connected loads and the topology of the network is not known. Some widespread cables are listed in Table 2. In contrast to the theoretical values, the impedance at one network access point is determined more by the load than by the cabling.

Typical cables for fixed electrical installation are “thermoplastic-insulated and sheathed cable”, “PVC-insulated flat cable, overall covering vulcanized rubber” or “sheathed metal-clad wiring cable with PVC-insulated cores sheet-zinc cover with additional PVC-jacket”.

Table 2 — Example of typical cable characteristics

Feature	Description
Cross-section	1,5 mm <sup>2</sup> up to 4 mm <sup>2</sup>
Used wires	Phase and Neutral
Resistance	25 µΩ/m to 50 mΩ/m
Capacity	15 pF/m to 100 pF/m
Inductance	1,2 µH/m to 1,5 µH/m

NOTE The use of shielded cables and cables with cross sections greater than 35 mm<sup>2</sup> can influence PL110 signalling significantly.

### 4.1.3 Medium attachment unit (MAU)

#### 4.1.3.1 General

The medium attachment unit converts the frequency-coded signals into values representing logical ones and zeros and vice versa. In parallel, a power supply circuit may be connected to the medium. Signal converter and power supply shall be independent from each other. The power supply shall meet the following requirements in Table 3:

Power supply	Nominal values
Receiving mode	5 V at 30 mA / 24 V at 1 mA <a href="https://standards.iteh.ai/catalog/standards/sist/8b3e068d-8a29-4686-b550-6968189b550e/sist-en-50090-5-1-2020">SIST EN 50090-5-1:2020</a>
Transmitting mode	5 V at 30 mA / 24 V at 10 mA - 50 mA (dependent on impedance)

Compliance is checked by measurement.

The power supply of the MAU may be internal or external.

#### 4.1.3.2 Signal encoding

A signal of 105,6 kHz for a period of  $833.\overline{3}$  µs shall correspond to a logical "0", a signal of 115,2 kHz for a period of  $833.\overline{3}$  µs to a logical "1". See Figure 2.

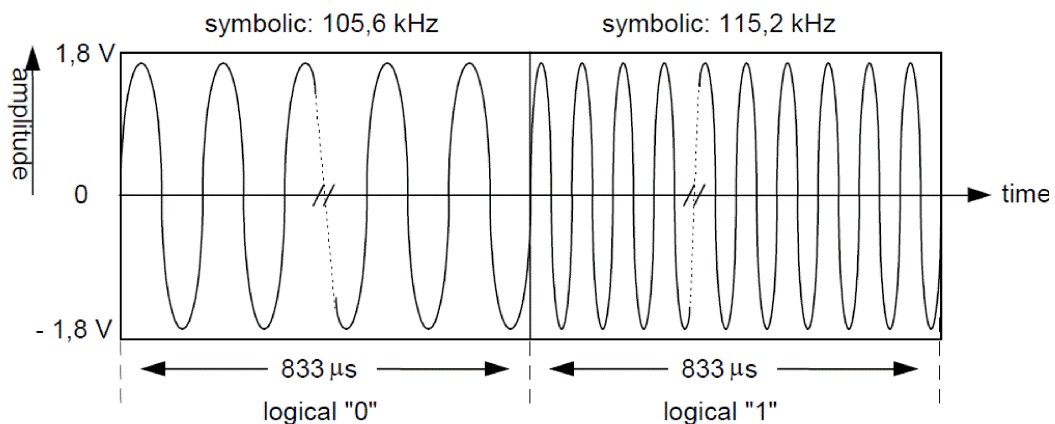


Figure 2 — Signal encoding

These NRZ-signals are superimposed on the 230 V/50 Hz mains AC-voltage. The maximum amplitude of the signal shall be limited to 122 dB $\mu$ V, measured with EN 55016-1-2 artificial mains network according EN 50065-1. The sensitivity of the receiver shall be better than 60 dB $\mu$ V.

For lowest disturbances, the change between adjacent symbols shall be phase continuous.

Compliance is checked by measurement.

#### 4.1.3.3 Overlapping of logical “0” or “1” resulting in fade-in / fade-out effects

Overlapping of logical “0” or “1”-symbols, e.g. the simultaneous transmission of equal information at the same time from several MAU's (e.g. common ACK), results in fade-in / fade-out effects. Due to slight frequency deviations between several MAU's the signal fades periodically with the difference of the MAU-frequencies. In PL110 power line communication this case can be avoided by setting a unique group response flag to each assigned Group Address.

#### 4.1.3.4 Overlapping of logical “0” and “1”

Overlapping of logical “0” and “1”-symbols, e.g. the simultaneous transmission of different information at the same time from several MAU's, results in a collision. While there is no indication of collision for any MAU, the probability of this state is minimized by special bus access mechanism.

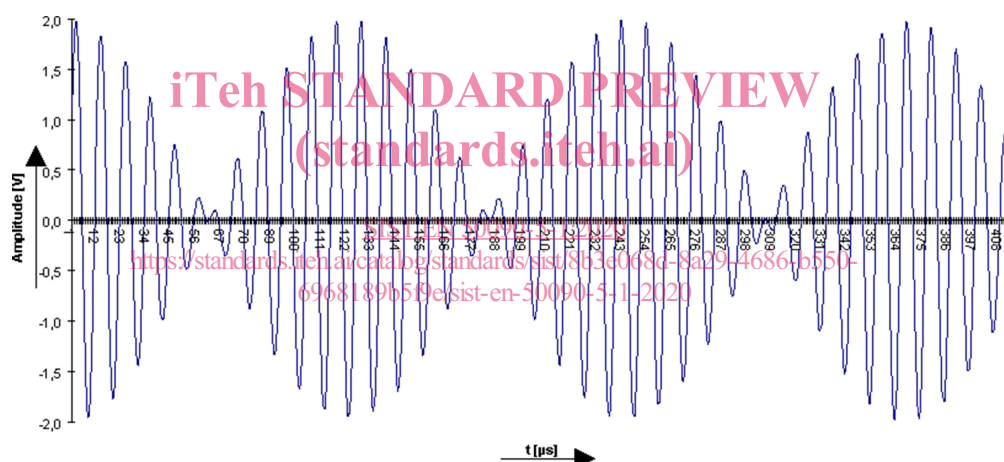


Figure 3 — Idealized overlapping of 105,6 kHz and 115,2 kHz

Figure 3 shows the ideal overlapping of 105,6 kHz and 115,2 kHz.


#### 4.1.3.5 Impedance of the MAU

To limit the influence of connected MAU's on the characteristic of the power line bus the impedance in receiving mode shall be high. For signal injection with minimum losses, the impedance in transmitting mode shall be low. When tested according to EN 50065-7, the limits for PL110 shall be as in Table 4:

Table 4 — Requirements for the impedance of the MAU

Impedance on	Requirements
Receiving mode	$ Z_{in}  \geq 80 \, \Omega$ at 100 kHz to 125 kHz
Transmitting mode	$ Z_{out}  \leq 20 \, \Omega$ at 100 kHz to 125 kHz

#### 4.1.3.6 PL bus coupling

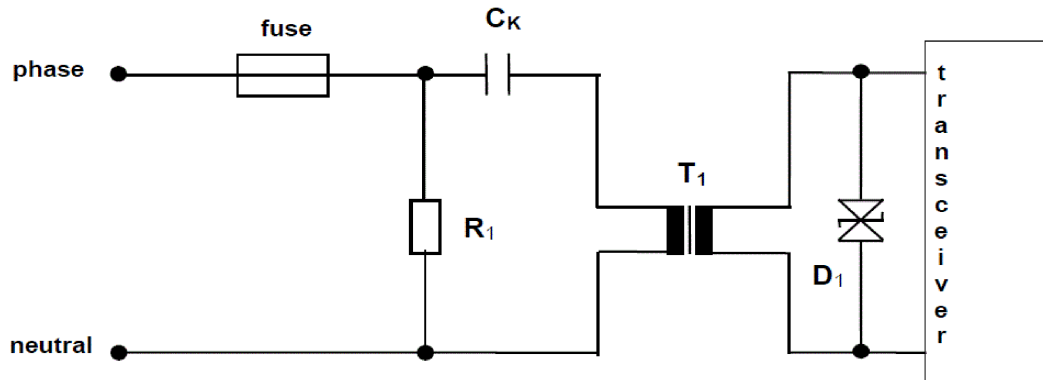

#### Key

- $C_k$  coupling capacitor, X2-type
- $T_1$  coupling transformer
- $D_1$  transient voltage protection diode
- $R_1$  resistor for discharging  $C_k$  (optional)

**Figure 4 — Example of a PL inductive coupling circuit**


Electrical coupling of signals to the power line is done by special circuits. In general, capacitive or inductive coupling may be used. Inductive coupling may be combined with electrical insulation or not. For example, see Figure 4.

#### 4.1.4 Installation topology

SIST EN 50090-5-1:2020

<https://standards.iteh.ai/catalog/standards/sist/8b3e068d-8a29-4686-b550-6963189b550e/sist-en-50090-5-1-2020>

The structure of an electrical installation may be linear, star, ring, tree or any combination, for example see Figure 5. Referring to the electrical distribution board as the centre, the topology normally has a star structure. Each branch of the electrical distribution network may have its own different structure.

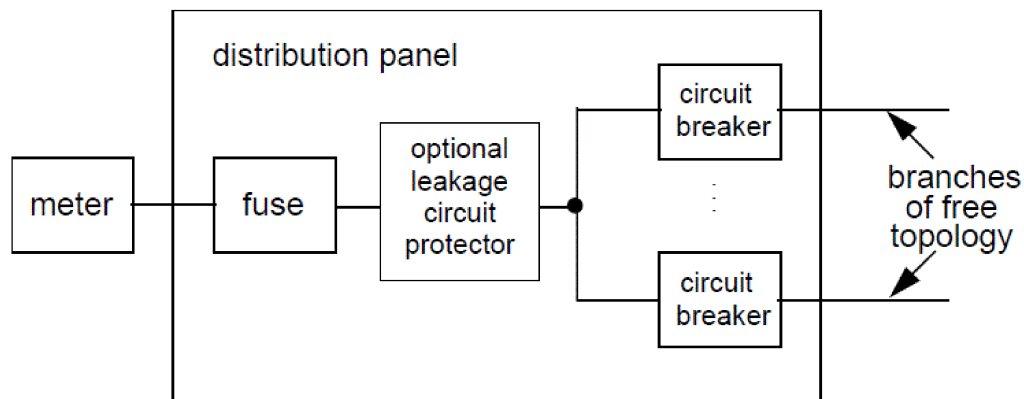

**Figure 5 — Example of a typical PL topology**

#### 4.1.5 Installation requirements

When installing power line networks, national and international regulations as well as standards apply. Additional instructions about the communication aspects of the network may be given in the manufacturers instruction sheet.