
Cevni sistemi iz polimernih materialov za odvodnjavanje ali kanalizacijo in oskrbo z vodo, s tlakom in brez njega - S steklenimi vlakni ojačeni duromerni materiali (GRP) na osnovi nenasičene poliestrske smole (UP) (ISO/DIS 23856:2019)

Plastics piping systems for pressure and non-pressure water supply, drainage or sewerage - Glass-reinforced thermosetting plastics (GRP) systems based on unsaturated polyester (UP) resin (ISO/DIS 23856:2019)

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Systèmes de canalisation en matières plastiques pour les branchements et les collecteurs d'assainissement avec ou sans pression - Systèmes en plastiques thermodurcissables renforcés de verre (PRV) à base de résine de polyester non saturé (UP) (ISO/DIS 23856:2019)

Ta slovenski standard je istoveten z: prEN ISO 23856

ICS:

23.040.05	Cevovodi za zunanje sisteme za odpadno vodo in njihovi deli	Pipeline and its parts for external sewage systems
83.120	Ojačani polimeri	Reinforced plastics
91.140.80	Drenažni sistemi	Drainage systems
93.030	Zunanji sistemi za odpadno vodo	External sewage systems

oSIST prEN ISO 23856:2019

en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[oSIST prEN ISO 23856:2019](https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019)

<https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019>

DRAFT INTERNATIONAL STANDARD

ISO/DIS 23856

ISO/TC 138/SC 6

Secretariat: ASI

Voting begins on:
2019-06-13Voting terminates on:
2019-09-05

Plastics piping systems for pressure and non-pressure water supply, drainage or sewerage — Glass-reinforced thermosetting plastics (GRP) systems based on unsaturated polyester (UP) resin

ICS: 23.040.20; 91.140.80; 93.030

iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN ISO 23856:2019](https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019)<https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019>

THIS DOCUMENT IS A DRAFT CIRCULATED FOR COMMENT AND APPROVAL. IT IS THEREFORE SUBJECT TO CHANGE AND MAY NOT BE REFERRED TO AS AN INTERNATIONAL STANDARD UNTIL PUBLISHED AS SUCH.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

This document is circulated as received from the committee secretariat.

ISO/CEN PARALLEL PROCESSING



Reference number
ISO/DIS 23856:2019(E)

© ISO 2019

iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN ISO 23856:2019
https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019](https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019)



COPYRIGHT PROTECTED DOCUMENT

© ISO 2019

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	2
3 Terms and definitions	3
4 General	12
4.1 Classification.....	12
4.1.1 Categories.....	12
4.1.2 Nominal size.....	12
4.1.3 Nominal stiffness.....	12
4.1.4 Nominal pressure.....	13
4.2 Materials.....	13
4.2.1 General.....	13
4.2.2 Reinforcement.....	14
4.2.3 Resin.....	14
4.2.4 Aggregates and fillers.....	14
4.2.5 Thermoplastics liners.....	14
4.2.6 Elastomers.....	14
4.2.7 Metals.....	14
4.3 Wall construction.....	15
4.3.1 Inner layer.....	15
4.3.2 Structural layer.....	15
4.3.3 Outer layer.....	15
4.4 Appearance.....	15
4.5 Reference conditions for testing.....	15
4.5.1 Temperature.....	15
4.5.2 Properties of water for testing.....	15
4.5.3 Loading conditions.....	16
4.5.4 Conditioning.....	16
4.5.5 Measurement of dimensions.....	16
4.6 Elapsed time, x, for determination of long-term properties.....	16
4.7 Joints.....	16
4.7.1 General.....	16
4.7.2 Types of joint.....	16
4.7.3 Flexibility of the joint.....	16
4.7.4 Sealing ring.....	17
4.7.5 Adhesives.....	17
4.8 Effect on water quality.....	17
4.9 Assessment of conformity.....	17
5 Pipes	17
5.1 Type of pipes.....	17
5.2 Geometrical characteristics.....	18
5.2.1 Diameter.....	18
5.2.2 Wall thickness.....	23
5.2.3 Length.....	23
5.3 Mechanical characteristics.....	24
5.3.1 Initial specific ring stiffness.....	24
5.3.2 Long-term specific ring stiffness under wet conditions.....	24
5.3.3 Initial resistance to failure in a deflected condition.....	25
5.3.4 Ultimate long-term resistance to failure in a deflected condition.....	27
5.3.5 Initial specific longitudinal tensile strength.....	28
5.3.6 Initial design and failure pressures for pressure pipes.....	30

ISO/DIS 23856:2019(E)

5.3.7	Long-term failure pressure.....	32
5.4	Resistance to strain corrosion.....	33
5.4.1	General.....	33
5.4.2	Procedure using failure points.....	33
5.4.3	Procedure using specified levels of strain.....	34
5.4.4	Test piece length.....	35
5.4.5	Test solution.....	35
5.5	Marking.....	35
6	Fittings.....	36
6.1	All types.....	36
6.1.1	General.....	36
6.1.2	Diameter series.....	36
6.1.3	Nominal pressure (PN).....	36
6.1.4	Nominal stiffness (SN).....	36
6.1.5	Fitting type.....	36
6.1.6	Mechanical characteristics of fittings.....	36
6.1.7	Installed leaktightness of fittings.....	37
6.1.8	Dimensions.....	37
6.2	Bends.....	37
6.2.1	Classification of bends.....	37
6.2.2	Dimensions and tolerances of bends.....	38
6.3	Branches.....	41
6.3.1	Classification of branches.....	41
6.3.2	Dimensions and tolerances of branches.....	41
6.4	Reducers.....	44
6.4.1	Classification of reducers.....	44
6.4.2	Dimensions and tolerances of reducers.....	44
6.5	Non pressure saddles.....	46
6.5.1	Classification of saddles.....	46
6.5.2	Dimensions of saddles and associated tolerances.....	47
6.6	Flanges.....	47
6.6.1	Classification of flanges.....	47
6.6.2	Dimensions and tolerances for adaptors.....	48
6.7	Marking.....	50
7	Joint performance.....	50
7.1	General.....	50
7.1.1	Interchangeability.....	50
7.1.2	Requirements.....	50
7.1.3	Test temperature.....	51
7.1.4	Non-pressure piping and joints.....	51
7.1.5	Dimensions.....	51
7.2	Flexible joints.....	51
7.2.1	General.....	51
7.2.2	Maximum allowable draw.....	51
7.2.3	Maximum allowable angular deflection.....	51
7.2.4	Flexible non-end-load-bearing joints with elastomeric sealing rings.....	51
7.2.5	Flexible end-load-bearing joints with elastomeric sealing rings.....	52
7.3	Rigid joints.....	52
7.3.1	Wrapped or cemented.....	52
7.3.2	Bolted flange joints.....	53
7.4	Marking.....	53
	Annex A (normative) Principles used to establish the design requirements based on regression testing and consideration of the variability of the product.....	55
	Bibliography.....	60

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see the following URL: www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 6, *Reinforced plastics pipes and fittings for all applications*.

oSIST prEN ISO 23856:2019
<https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-1d43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019>

ISO/DIS 23856:2019(E)**Introduction**

This system standard is a result of merging ISO 10639, ISO 10467 as well as EN 1796 and EN 14364. As these standards were almost identical, except for the requirement on chemical resistance of sewer pipes, it was decided that it would be beneficial for the user and make his work easier to refer only to one document.

**iTeh STANDARD PREVIEW
(standards.iteh.ai)**

[oSIST prEN ISO 23856:2019
https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019](https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019)

Plastics piping systems for pressure and non-pressure water supply, drainage or sewerage — Glass-reinforced thermosetting plastics (GRP) systems based on unsaturated polyester (UP) resin

1 Scope

This document specifies the properties of piping system components made from glass-reinforced thermosetting plastics (GRP) based on unsaturated polyester resin (UP). It is suited for all types of water supply, drainage and sewerage with or without pressure. Types of water supply include, but are not limited to, raw water, irrigation, cooling water, potable water, salt water, sea water, penstocks in power plants, processing plants and other water-based applications. This document is applicable to GRP UP piping systems, with flexible or rigid joints with or without end thrust load-bearing capability, primarily intended for use in direct buried installations.

NOTE 1 For the purpose of this document, the term polyester resin (UP) also includes vinyl-ester resins (VE).

NOTE 2 Piping systems conforming to this document can also be used for non-buried applications, provided the influence of the environment and the supports are considered in the design of the pipes, fittings and joints.

NOTE 3 This document can also apply for other installations, such as slip-lining rehabilitation of existing pipes.

NOTE 4 This document is also referenced in ISO 25780, which specifies requirements for GRP-pipes used for jacking installation.

The requirements for the hydrostatic pressure design of pipes referring to this document meet the requirements of ISO/TS 20656-1 and the general principle for the reliability of structures detailed in ISO 2394 and in EN 1990. These International Standards provide procedures for the harmonization of design practices and address the probability of failure, as well as possible consequences of failures. The design practices are based on a partial safety factor concept, as well as on risk management engineering.

This document is applicable to pipes, fittings and their joints of nominal sizes from DN 50 to DN 4000 which are intended to be used for the conveyance of water at temperatures up to 50 °C, with or without pressure. In a pipework system, pipes and fittings of different nominal pressure and stiffness ratings may be used together. [Clause 4](#) specifies the general aspects of GRP UP piping systems intended to be used in the field of drainage or sewerage with or without pressure.

[Clause 5](#) specifies the characteristics of pipes made from GRP UP with or without aggregates and/or fillers. The pipes may have a thermoplastics or thermosetting resin liner. [Clause 5](#) also specifies the test parameters for the test methods referred to in this document.

[Clause 6](#) specifies the characteristics of fittings made from GRP UP, with or without a thermoplastics or thermosetting resin liner, intended to be used in the field of drainage and sewerage. [Clause 6](#) specifies the dimensional and performance requirements for bends, branches, reducers, saddles and flanged adaptors. [Clause 6](#) covers requirements to prove the structural design of fittings. It is applicable to fittings made using any of the following techniques:

- fabrication from straight pipes;
- moulding by
 - 1) filament winding,
 - 2) tape winding,
 - 3) contact moulding, and

ISO/DIS 23856:2019(E)

- 4) hot or cold compression moulding.

[Clause 7](#) is applicable to the joints to be used in GRP UP piping systems to be used for the conveyance of surface water and sewerage, both buried and non-buried. It covers requirements to prove the design of the joint. [Clause 7](#) specifies type test performance requirements for the following joints as a function of the declared nominal pressure rating of the pipeline or system:

- a) socket-and-spigot (including double-socket) joints or mechanical joints;
- b) locked socket-and-spigot joints;
- c) cemented or wrapped joints;
- d) bolted flange joints.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 75-2:2013, *Plastics — Determination of temperature of deflection under load — Part 2: Plastics and ebonite*

ISO 161-1, *Thermoplastics pipes for the conveyance of fluids — Nominal outside diameters and nominal pressures — Part 1: Metric series*

ISO 527-4, *Plastics — Determination of tensile properties — Part 4: Test conditions for isotropic and orthotropic fibre-reinforced plastic composites*

ISO 527-5, *Plastics — Determination of tensile properties — Part 5: Test conditions for unidirectional fibre-reinforced plastic composites*

ISO 1452-3, *Plastics piping systems for water supply and for buried and above-ground drainage and sewerage under pressure — Unplasticized poly(vinyl chloride) (PVC-U) — Part 3: Fittings*

ISO 2394:2015, *General principles on reliability for structures*

ISO 2531, *Ductile iron pipes, fittings, accessories and their joints for water applications*

ISO 3126, *Plastics piping systems — Plastics components — Determination of dimensions*

ISO 4200, *Plain end steel tubes, welded and seamless — General tables of dimensions and masses per unit length*

ISO 4633, *Rubber seals — Joint rings for water supply, drainage and sewerage pipelines — Specification for materials*

ISO 7432, *Glass-reinforced thermosetting plastics (GRP) pipes and fittings — Test methods to prove the design of locked socket-and-spigot joints, including double-socket joints, with elastomeric seals*

ISO 7509, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Determination of time to failure under sustained internal pressure*

ISO 7685, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Determination of initial specific ring stiffness*

ISO 8483, *Glass-reinforced thermosetting plastics (GRP) pipes and fittings — Test methods to prove the design of bolted flange joints*

ISO 8513:2016, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Test methods for the determination of the initial longitudinal tensile strength*

ISO 8521:2009, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Test methods for the determination of the apparent initial circumferential tensile strength*

ISO 8533, *Plastics piping systems for pressure and non-pressure drainage and sewerage — Glass-reinforced thermosetting plastics (GRP) systems based on unsaturated polyester (UP) resin — Test methods to prove the design of cemented or wrapped joints*

ISO 8639, *Glass-reinforced thermosetting plastics (GRP) pipes and fittings — Test methods for leaktightness and proof of structural design of flexible joints*

ISO 10466, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Test method to prove the resistance to initial ring deflection*

ISO 10468, *Glass-reinforced thermosetting plastics (GRP) pipes — Determination of the ring creep properties under wet or dry conditions*

ISO 10471, *Glass-reinforced thermosetting plastics (GRP) pipes — Determination of the long-term ultimate bending strain and the long-term ultimate relative ring deflection under wet conditions*

ISO 10928:2016, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes and fittings — Methods for regression analysis and their use*

ISO 10952, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes and fittings — Determination of the resistance to chemical attack for the inside of a section in a deflected condition*

ISO 11922-1, *Thermoplastics pipes for the conveyance of fluids — Dimensions and tolerances — Part 1: Metric series*

ISO 18851, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes and fittings — Test method to prove the structural design of fittings*

ISO/TS 20656-1, *Plastics piping systems — General rules for structural design of glass-reinforced thermosetting plastics (GRP) pipes — Part 1: Buried pipes*

CEN/TS 14632, *Plastics piping systems for drainage, sewerage and water supply, pressure and non-pressure. Glass-reinforced thermosetting plastics (GRP) based on unsaturated polyester resin (UP). Guidance for the assessment of conformity*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1

break

condition where the test piece can no longer carry the load to which it is being subjected

3.2

coefficient of variation

V

ratio of the *standard deviation* (3.18) to the absolute value of the arithmetic mean, given by the following formula:

$$V = \text{standard deviation of the population} / \text{mean of the population}$$

Note 1 to entry: In this document, it is expressed as a percentage.

ISO/DIS 23856:2019(E)

3.3 Diameter

3.3.1

declared diameter

diameter which a manufacturer states to be the internal or external diameter produced in respect of a particular *nominal size* (DN) (3.6)

3.3.2

mean diameter

d_m
diameter of the circle corresponding to the middle of the pipe wall cross-section and given, in metres (m), by either of the following formulae:

$$d_m = d_i + e$$

$$d_m = d_e - e$$

where

d_i is the internal diameter, in m;

d_e is the external diameter, in m;

e is the wall thickness of the pipe, in m

3.4

laying length

total length (3.20) of a pipe minus, where applicable, the manufacturer's recommended insertion depth of the spigot(s) in the socket

iTech STANDARD PREVIEW
(standards.itech.ai)
oSIST prEN ISO 23856:2019
<https://standards.itech.ai/catalog/standards/sist/ed5c0afb-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019>

3.5 Joint movement

3.5.1

angular deflection

δ

angle between the axes of two consecutive pipes

Note 1 to entry: It is expressed in degrees (°).

Note 2 to entry: See [Figure 1](#).

3.5.2

deformation

M

pipe deformation in the coupling as a result of a vertical force of 20 N/mm of the *nominal size* (3.6), in millimetres (mm) on the pipe and a supported coupling causing a step between the two pipe spigots at the loading position in millimetres (mm)

Note 1 to entry: See [Figure 1](#).

3.5.3

draw

D

longitudinal movement of a joint

Note 1 to entry: It is expressed in millimetres (mm).

Note 2 to entry: See [Figure 1](#).

3.5.4 flexible joint

joint which allows relative movement between the components being joined

Note 1 to entry: Flexible joints which have resistance to axial loading are classified as end-load-bearing. Examples of this type of joint are:



- socket-and-spigot joints with an elastomeric sealing element (including double-socket designs);
- locked socket-and-spigot joints with an elastomeric sealing element (including double-socket designs);
- mechanically clamped joints, e.g. bolted couplings including components made of materials other than GRP.

3.5.5 rigid joint


joint which does not allow relative movement between the components being joined

Note 1 to entry: Rigid joints which do not have resistance to axial loading are classified as non-end-load-bearing. Examples of this type of joint are:

- flanged joints including integral or loose flanges;
- wrapped or cemented joints.

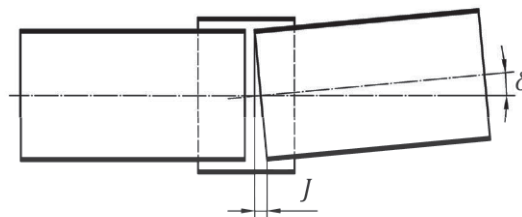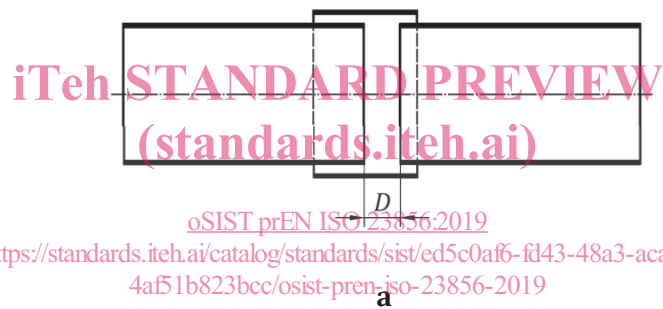

b

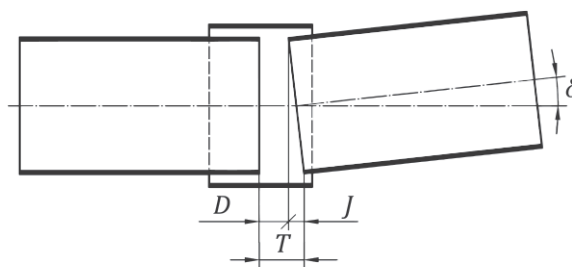

c

ISO/DIS 23856:2019(E)

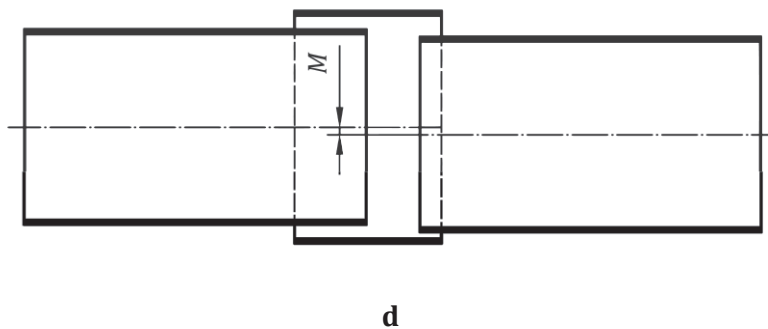
**Key** D draw J longitudinal movement arising from angular deflection of the joint δ angular deflection of the joint T total draw M deformation

Figure 1 — Joint movements
 iTeh STANDARD PREVIEW
 (standards.iteh.ai)

3.5.6**total draw** T

sum of the *draw*, D (3.5.3), and the additional longitudinal movement, J , of joint components due to the presence of *angular deflection* (3.5.1)

Note 1 to entry: It is expressed in millimetres (mm).

Note 2 to entry: See [Figure 1](#).

3.6**nominal size****DN**

alphanumeric designation of size, which is common to all components in a piping system, which is a convenient round number for reference purposes and is related to the internal diameter in millimetres (mm)

Note 1 to entry: The designation for reference or marking purposes consists of the letters DN plus a number.

3.7**nominal length**

numerical designation of pipe length which is equal to the *laying length* (3.4), in metres (m), rounded to the nearest whole number

3.8**nominal stiffness****SN**

alphanumeric designation of stiffness classification purposes, which has the same numerical value as the minimum initial value required, when expressed in newtons per square metre (N/m²)

Note 1 to entry: See [4.1.3](#).

Note 2 to entry: The designation for reference or marking purposes consists of the letters SN plus a number.

3.9**non-pressure pipe or fitting**

pipe or fitting subjected to an internal pressure not greater than 1 bar

3.10**normal service conditions**

conveyance of water or sewage in the temperature range 2 °C to 50 °C, with or without pressure, for 50 years

Note 1 to entry: At temperatures above 35 °C, it may be necessary to rerate the pipe.

3.11 Pipeline**3.11.1****buried pipeline**

pipeline which is subjected to the external pressure transmitted from soil loading, including traffic and superimposed loads and possibly the pressure of a head of water

3.11.2**non-buried pipeline**

pipeline which is subjected to negative and positive pressure, forces resulting from its supports and environmental conditions

Note 1 to entry: Examples of environmental conditions are snow, wind and temperature.

3.11.3**sub-aqueous pipeline**

pipeline which is subjected to an external pressure arising from a head of water and conditions such as drag and lift caused by current and wave action

3.12 Pressure

<https://standards.iteh.ai/catalog/standards/sist/ed5c0af6-fd43-48a3-aca5-4af51b823bcc/osist-pren-iso-23856-2019>

3.12.1**initial failure pressure**

p_0

mean pressure at which failure occurs with specimens subjected to short-term tests performed in accordance with ISO 8521

3.12.2**nominal pressure**

PN

alphanumeric designation for a pressure, which is the maximum sustained hydraulic internal pressure for which a pipe is designed in the absence of other loading conditions than internal pressure, this means that the nominal pressure shall be equal to or greater than the *working pressure* (3.12.13)

Note 1 to entry: The designation for reference or marking purposes consists of the letters PN plus a number.

Note 2 to entry: The definition for the PN has been changed from the previous version of this document. The definition is more specific and related to internal pressure load exclusively.

3.12.3**minimum initial failure pressure**

$p_{0,QC}$

initial failure pressure (3.12.1), determined in accordance with ISO 8521, which 95 % of products are required to exceed