



SLOVENSKI STANDARD

SIST EN 13384-2:2015+A1:2019

01-september-2019

Nadomešča:
SIST EN 13384-2:2015

Dimniki - Računske metode termodinamike in dinamike fluidov - 2. del: Dimniki za več kot eno ogrevalno napravo

Chimneys - Thermal and fluid dynamic calculation methods - Part 2: Chimneys serving more than one heating appliance

Abgasanlagen - Wärme- und strömungstechnische Berechnungsverfahren - Teil 2: Abgasanlagen mit mehreren Feuerstätten

Conduits de fumée - Méthodes de calcul thermo-aéraulique - Partie 2: Conduits de fumée desservant plus d'un appareil de chauffage

Ta slovenski standard je istoveten z: EN 13384-2:2015+A1:2019

ICS:

91.060.40 Dimniki, jaški, kanali Chimneys, shafts, ducts

SIST EN 13384-2:2015+A1:2019 en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 13384-2:2015+A1:2019](https://standards.iteh.ai/catalog/standards/sist/94e9a529-9efd-420f-934a-d50d880e13b1/sist-en-13384-2-2015a1-2019)

<https://standards.iteh.ai/catalog/standards/sist/94e9a529-9efd-420f-934a-d50d880e13b1/sist-en-13384-2-2015a1-2019>

EUROPEAN STANDARD
 NORME EUROPÉENNE
 EUROPÄISCHE NORM

EN 13384-2:2015+A1

July 2019

ICS 91.060.40

Supersedes EN 13384-2:2015

English Version

Chimneys - Thermal and fluid dynamic calculation methods - Part 2: Chimneys serving more than one heating appliance

Conduits de fumée - Méthodes de calcul thermo-
 aéraulique - Partie 2: Conduits de fumée desservant
 plus d'un appareil de chauffage

Abgasanlagen - Wärme- und strömungstechnische
 Berechnungsverfahren - Teil 2: Abgasanlagen mit
 mehreren Feuerstätten

This European Standard was approved by CEN on 24 January 2015 and includes Amendment 1 approved by CEN on 27 April 2019.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
 COMITÉ EUROPÉEN DE NORMALISATION
 EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents

Page

European foreword.....	5
Introduction	7
1 Scope	8
2 Normative references	8
3 Terms and definitions	9
4 General symbols and abbreviations.....	10
5 Calculation method.....	10
5.1 General principles.....	10
5.2 Pressure equilibrium condition	12
5.2.1 Negative pressure chimneys	12
5.2.2 Positive pressure chimneys.....	13
5.3 Mass flow requirement	14
5.4 Pressure requirements.....	14
5.4.1 Negative pressure chimneys.....	14
5.4.2 Positive pressure chimneys.....	15
5.5 Temperature requirement	16
5.6 Calculation procedure	17
6 Flue gas data characterising the combustion appliance.....	19
7 Data for chimney and connecting flue pipes.....	21
8 Basic data for the calculation.....	21
8.1 General.....	21
8.2 Air temperatures.....	21
8.2.1 External air temperature (T_L).....	21
8.2.2 Ambient air temperature (T_u)	21
8.3 External air pressure (p_L)	21
8.4 Gas constant	21
8.4.1 Gas constant of the air (R_L)	21
8.4.2 Gas constant of flue gas (R).....	21
8.5 Density of air (ρ_L).....	21
8.6 Specific heat capacity of the flue gas (c_p).....	21
8.7 Water vapour content ($\sigma(\text{H}_2\text{O})_{,j}$) and condensing temperature (T_{sp})	22
8.8 Correction factor for temperature instability (S_H).....	22
8.9 Flow safety coefficient (S_E).....	22
8.10 External coefficient of heat transfer.....	22
9 Determination of temperatures.....	22
10 Mixing calculations.....	24
10.1 General.....	24
10.2 Flue gas mass flow (\dot{m}_j)	24
10.3 Flue gas temperature at the inlet of the chimney segment ($T_{e,j}$).....	24
10.4 CO ₂ -content of the flue gas in the chimney segment ($\sigma(\text{CO}_2)_{,j}$)	25
10.5 H ₂ O-content of the flue gas ($\sigma(\text{H}_2\text{O})_{,j}$).....	25

10.6	Gas constant of the flue gas (R_j)	25
10.7	Flue gas data	25
10.7.1	Specific heat capacity ($c_{pV,j}$), ($c_{p,j}$)	25
10.7.2	Thermal conductivity of the flue gas ($\lambda_{AV,j}$), ($\lambda_{A,j}$)	26
10.7.3	Dynamic viscosity ($\eta_{AV,j}$), ($\eta_{A,j}$)	26
10.7.4	Condensing temperature (T_{SP})	27
11	Density and velocity of the flue gas	27
12	Determination of the pressures	28
12.1	Pressures at each inlet of the chimney segments	28
12.1.1	Draught	28
12.1.2	Positive pressure	28
12.1.3	Draught due to chimney effect in the chimney segment ($P_{H,j}$)	28
12.1.4	Pressure resistance in the chimney segment ($P_{R,j}$)	28
12.2	Minimum draught required at the flue gas inlet into the chimney and maximum allowed draught (P_{Ze} and P_{Zemax}) and maximum and minimum differential pressure at the flue gas inlet into the chimney (P_{ZOe} and P_{ZOemin})	31
12.2.1	Minimum required and maximum allowed draught	31
12.2.2	Maximum available and minimum allowed differential pressure	31
12.2.3	Calculated pressure resistance of the connecting flue pipe ($P_{V,j}$)	31
12.2.4	Calculated pressure resistance of the air supply ($P_{Bc,j}$)	33
13	Inner wall temperature	34
14	Cascade installations	35
14.1	Principle of the calculation method	35
14.2	Pressure equilibrium condition	35
14.2.1	Negative pressure cascade installation	35
14.2.2	Positive pressure cascade installation	36
14.3	Mass flow requirement	37
14.4	Pressure requirements	37
14.4.1	Negative pressure chimneys	37
14.4.2	Positive pressure chimneys	38
14.5	Temperature requirement	39
14.6	Calculation procedure	39
14.7	Pressures at the outlet of the connecting flue pipe and pressures at the inlet of the collector segment	40
14.7.1	Pressure at the flue gas inlet into the collector segment ($P_{ZC,j,l}$ or $P_{ZOC,j,l}$)	40
14.7.2	Pressures required or available at the outlet of the connecting flue pipe ($P_{Zec,j,l}$, $P_{ZOec,j,l}$)	43
14.8	Inner wall temperature ($T_{iobC,j,l}$)	45
15	Balanced flue chimney	45
15.1	Principle of the calculation method	45
15.2	Pressure equilibrium condition	46
15.3	Mass flow requirement	46
15.4	Pressure requirements	46
15.4.1	Negative pressure chimneys	46
15.4.2	Positive pressure chimneys	47
15.5	Temperature requirements	48
15.6	Calculation procedure for balanced flue chimneys	48
15.7	Mass flow of the \square_{A1} combustion \square_{A1} air	50
15.8	Determination of the temperatures in balanced flue chimneys	51
15.8.1	Separate ducts	51
15.8.2	Concentric ducts	51

15.8.3	Concentric connection pipes.....	59
15.9	Pressures of the air supply ducts	65
15.9.1	Draught due to chimney effect of the air supply duct of chimney segment j.....	65
15.9.2	Draught due to chimney effect of the air supply duct of connection pipes	65
15.9.3	Pressure resistance of the air supply duct of the chimney segment j ($P_{RB,j}$).....	66
15.9.4	Pressure resistance of the air supply duct of the connection pipe j ($P_{RBV,j}$)	67
15.10	Density and velocity of the \square_{A1} combustion \square_{A1} air	69
15.10.1	Density and velocity of the \square_{A1} combustion \square_{A1} air in the air supply duct averaged over the length of the chimney segment	69
15.10.2	Density and velocity of the \square_{A1} combustion \square_{A1} air averaged over the length of the connection pipes.....	70
16	Consideration of chimney fans.....	70
16.1	General.....	70
16.2	Inline fans	71
16.3	Exhaust fans	72
Annex A (informative) Recommendations.....		74
A.1	General.....	74
A.2	Recommendations for the chimney and \square_{A1} combustion \square_{A1} appliances.....	74
A.3	Recommendations for connecting flue pipes.....	74
Annex B (informative) Characteristics for the \square_{A1} combustion \square_{A1} appliance		75

iTech STANDARD PREVIEW
(standards.itech.ai)

[SIST EN 13384-2:2015+A1:2019](https://standards.itech.ai/catalog/standards/sist/94e9a529-9efd-420f-934a-d50d880e13b1/sist-en-13384-2-2015a1-2019)

<https://standards.itech.ai/catalog/standards/sist/94e9a529-9efd-420f-934a-d50d880e13b1/sist-en-13384-2-2015a1-2019>

European foreword

This document (EN 13384-2:2015+A1:2019) has been prepared by Technical Committee CEN/TC 166 “Chimneys”, the secretariat of which is held by ASI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2020, and conflicting national standards shall be withdrawn at the latest by January 2020.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes $\boxed{A1}$ EN 13384-2:2015 $\boxed{A1}$.

This document includes Amendment 1 approved by CEN on 26 June 2019.

According to EN 13384-2:2003+A1:2009 and EN 13384-2:2015+A1:2019 the following fundamental changes are given:

- editorial mistakes have been corrected;
- mistakes in formulas have been corrected;
- characteristic values for $\boxed{A1}$ combustion $\boxed{A1}$ appliances for solid fuel and for liquid fuels in Annex B have been adapted to actual data;
- for the mixture of fuels a clarification about the rise of the dew point has been added;
- for non-concentric ducts the calculation of the mean temperature of the air supply has been amended;
- the process for iteration for appliances with low impact of the pressure to the flue gas mass flow (e.g. CHP with combustion engine) has been simplified;
- for chimney fans a calculation procedure has been added;
- “heating appliance” replaced by “combustion appliance”;
- “Supply air” replaced by “combustion air”;
- New table for specification for gas-fired heating boilers Type C₍₁₀₎.

This standard is one of a series of standards prepared by CEN/TC 166 comprising product standards and execution standards for chimneys.

National installation rules are not regarded in the standard.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association.

The start and finish of text introduced or altered by amendment is indicated in the text by tags $\boxed{A1}$ $\boxed{A1}$.

EN 13384-2:2015+A1:2019 (E)

This European Standard “Chimneys — Thermal and fluid dynamic calculation methods” consists of three Parts:

- Part 1: Chimneys serving one combustion appliance
- Part 2: Chimneys serving more than one combustion appliance
- Part 3: Methods for the development of diagrams and tables for chimneys serving one heating appliance

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



iTeh STANDARD PREVIEW
(standards.iteh.ai)



[SIST EN 13384-2:2015+A1:2019](https://standards.iteh.ai/catalog/standards/sist/94e9a529-9efd-420f-934a-d50d880e13b1/sist-en-13384-2-2015a1-2019)

<https://standards.iteh.ai/catalog/standards/sist/94e9a529-9efd-420f-934a-d50d880e13b1/sist-en-13384-2-2015a1-2019>

Introduction

The calculation described in this standard is complex and is intended to be solved by using a computer programme. The general principles of this calculation method of EN 13384-1 also apply to this standard.

This standard is in support of the execution standards for a chimney installation serving more than one  combustion  appliance.

The execution standard identifies limitations and safety considerations associated with the design, installation, commissioning and maintenance of a chimney serving more than one  combustion  appliance (not dealt within the calculation method).

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 13384-2:2015+A1:2019](https://standards.iteh.ai/catalog/standards/sist/94e9a529-9efd-420f-934a-d50d880e13b1/sist-en-13384-2-2015a1-2019)

<https://standards.iteh.ai/catalog/standards/sist/94e9a529-9efd-420f-934a-d50d880e13b1/sist-en-13384-2-2015a1-2019>

EN 13384-2:2015+A1:2019 (E)

1 Scope

This part of EN 13384 specifies methods for calculation of the thermal and fluid dynamic characteristics of chimneys serving more than one $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance.

This part of EN 13384 covers both the cases, either

- a) where the chimney is connected with more than one connecting flue pipe from individual or several appliances in a multi-inlet arrangement; or
- b) where the chimney is connected with an individual connecting flue pipe connecting more than one appliance in a cascade arrangement.

The case of multiple inlet cascade arrangement is covered by the case a).

This part of EN 13384 deals with chimneys operating under negative pressure conditions (there can be positive pressure condition in the connecting flue pipe) and with chimneys operating under positive pressure conditions and is valid for chimneys serving $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliances for liquid, gaseous and solid fuels.

This part of EN 13384 does not apply to:

- chimneys with different thermal resistance or different cross-section in the various chimney segments. This part does not apply to calculate energy gain;
- chimneys with open fire places, e.g. open fire chimneys or chimney inlets which are normally intended to operate open to the room;
- chimneys which serve different kinds of $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliances regarding natural draught, fan assisted, forced draught or combustion engine. Fan assisted appliances with draught diverter between the fan and the chimney are considered as natural draught appliances;
- chimneys with multiple inlets from more than 5 storeys. (This does not apply to balanced flue chimney.);
- chimneys serving $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliances with open air supply through ventilation openings or air ducts, which are not installed in the same air supply pressure region (e.g. same side of building).

For positive pressure chimneys this part only applies if any $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance which is out of action can be positively isolated to prevent flue gas back flow.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 1443:2003, *Chimneys - General requirements*

EN 13384-1:2015+A1:2019+A1:2019, *Chimneys - Thermal and fluid dynamic calculation methods - Part 1: Chimneys serving one appliance*

EN 15287-1:2007+A1:2010, *Chimneys - Design, installation and commissioning of chimneys - Part 1: Chimneys for non-roomsealed heating appliances*

EN 15287-2:2008, *Chimneys - Design, installation and commissioning of chimneys - Part 2: Chimneys for roomsealed appliances*

prEN 16475-2, *Chimneys - Accessories - Part 2: Chimney fans - Requirements and test methods*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 1443:2003, EN 13384-1:2015+A1:2019+A1:2019, EN 15287-1:2007+A1:2010, EN 15287-2:2008 and the following apply.

3.1

chimney segment

part of a chimney between two consecutive flue gas connections or between the last flue gas connection and the chimney outlet

3.2

collector segment

part of a connecting flue pipe between two consecutive flue gas connections or between the last flue gas connection and the chimney inlet

3.3

flue gas mass flow

\dot{m}

mass of the flue gas leaving the \square_{A_1} combustion \square_{A_1} appliance through the connecting flue pipe per unit of time

Note 1 to entry: In case of a chimney serving more than one \square_{A_1} combustion \square_{A_1} appliance, the air being transported through an appliance which is out of action is also given the term flue gas mass flow.

3.3.1

declared flue gas mass flow

$\dot{m}_{w,j}$

flue gas mass flow given by the manufacturer of the \square_{A_1} combustion \square_{A_1} appliance j with respect to the heat output used in the calculation

3.3.2

calculated flue gas mass flow

$\dot{m}_{wc,j}$

flue gas mass flow calculated with respect to calculated draught and the working conditions of the \square_{A_1} combustion \square_{A_1} appliance j

3.4

calculated flue gas temperature

$T_{wc,j}$

flue gas temperature at the outlet of the \square_{A_1} combustion \square_{A_1} appliance j depending on the calculated flue gas mass flow

3.5

calculated draught of the flue gas of the \square_{A_1} combustion \square_{A_1} appliance

$P_{wc,j}$

draught at the flue gas outlet of the \square_{A_1} combustion \square_{A_1} appliance j depending on the calculated flue gas mass flow

EN 13384-2:2015+A1:2019 (E)

3.6

flue damper

device to close or partially close the flue

3.7

balanced flue chimney

chimney where the point of air entry to the combustion air duct is adjacent to the point of discharge of combustion products from the flue, the inlet and outlet being so positioned that wind effects are substantially balanced

3.8

cascade arrangement

arrangement where two or more appliances situated in the same space are connected by a common connecting flue pipe to the chimney

3.9

multi inlet arrangement

arrangement where two or more appliances are connected to the chimney by individual connecting flue pipes

3.10

air duct

independent duct in a building or a structural part of a flue terminal conveying combustion air to a room-sealed appliance

3.11

pressure equalizing opening

opening or duct that directly connects the air duct with the flue at its base

<https://standards.iteh.ai/catalog/standards/sist/94e9a529-9efd-420f-934a-d50d880e13b1/sist-en-13384-2-2015a1-2019>

4 General symbols and abbreviations

Symbols, terminology and units are given to make the text of this standard understandable. A list of general symbols and abbreviations is given in EN 13384-1 Indices added to symbols for purposes of the calculation method for chimneys serving more than one $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance relate to one chimney segment and/or connection flue pipe section. An example of an indices numbering scheme is given in Figures 1 and 2. Indices numbering shall begin at the lowest, farthest appliance connection. For more than one cascade system/connection, the indices numbering scheme for the calculation formula should be adopted in a similar manner to that for a single cascade scheme. Symbols assigned to a specific section will be indicated by the number of the section after the comma (e. g. $H_{,1}$ is the effective height of a section of a chimney segment between the outlet of the connecting flue pipe of the $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance in the lowest position and the outlet of the connecting flue pipe of the next $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance).

Each symbol and abbreviation is explained at the formula where it is used.

5 Calculation method

5.1 General principles

The calculation is based upon determining the mass flow distribution in the chimney which fulfils the pressure equilibrium condition (Formula (1)) at each flue gas inlet to the chimney (see Figure 1). After such a distribution has been found four requirements shall be verified:

- a) the mass flow requirement (Formulas (4) and (5))
- b) the pressure requirement for minimum draught or maximum positive pressure (Formulas (6) or (6b) and (6c))
- c) the pressure requirement for maximum draught or minimum positive pressure (Formulas (6a) or (6d))
- d) the temperature requirement (Formula (7))

NOTE 1 The calculation is affected by the specific installation design. For recommendations for the installation of appliance and connection flue pipes see Annex A.

NOTE 2 The pressure requirements for maximum draught or minimum positive pressure are only required if there is a limit for the maximum draught for the (negative pressure) $\boxed{A_1}$ combustion $\boxed{A_1}$ appliance or a minimum differential pressure of the (positive pressure) $\boxed{A_1}$ combustion $\boxed{A_1}$ appliance.

In order to verify the criteria two sets of external conditions are used:

- the calculation of the minimum draught and maximum positive pressure (draught) is made with conditions for which the capacity of the chimney is minimal (i.e. high outside temperature); and also
- the calculation of the maximum draught and minimum positive pressure and of the inner wall temperature with conditions for which the inside temperature of the chimney is minimal (i.e. low outside temperature).

(standards.itech.ai)

The validation of the mass flow requirement and pressure requirement shall be done at following working conditions, using the external and ambient air temperatures specified in EN 13384-1.

- All $\boxed{A_1}$ combustion $\boxed{A_1}$ appliances are simultaneously operating at nominal heat output.
- All $\boxed{A_1}$ combustion $\boxed{A_1}$ appliances are simultaneously operating at minimum heat output
- A single $\boxed{A_1}$ combustion $\boxed{A_1}$ appliance operating at nominal heat output and all other appliances out of action (all possible cases)
- A single $\boxed{A_1}$ combustion $\boxed{A_1}$ appliance operating at minimum heat output and all other appliances out of action (all possible cases)
- $\boxed{A_1}$ — For positive pressure chimneys a single $\boxed{A_1}$ combustion $\boxed{A_1}$ appliance operating at minimum nominal heat output and all other appliances operating at maximum nominal heat output (all possible cases) $\boxed{A_1}$

If the control of the installation guarantees that not all appliances will be in operation simultaneously, the validation of the mass flow requirement and pressure requirement may be done with the maximum number of appliances which will be in operation under the most adverse condition.

The validation for the mass flow requirement and pressure requirement for working conditions with $\boxed{A_1}$ combustion $\boxed{A_1}$ appliances at minimum heat output is not required in the following cases:

- the $\boxed{A_1}$ combustion $\boxed{A_1}$ appliances do not have any heat output range
- the $\boxed{A_1}$ combustion $\boxed{A_1}$ appliances have a heat output which is limited to a fixed value as specified on a label on the appliance. In this case the nominal heat output is the given heat output on the label.

EN 13384-2:2015+A1:2019 (E)

- A_1 combustion A_1 appliances heated with solid fuels without fan and appliances with regulated air supply.

The validation of the mass flow requirement for working conditions with appliances at nominal heat output is not required in the following case:

- the A_1 combustion A_1 appliances have a flue gas mass flow at minimum heat output higher than or equal to the flue gas mass flow at nominal heat output.

The temperature requirement shall be validated for the following relevant working condition, using the ambient and external air temperatures as specified in EN 13384-1:

- A_1 combustion A_1 appliances for solid fuels without fan and A_1 combustion A_1 appliances with regulated air supply are in operation at nominal heat output,
- A_1 combustion A_1 appliances with a draught diverter which provide domestic hot water only are out of action. These A_1 combustion A_1 appliances operate with a considerable secondary air (These operate only a short time and therefore it can be assumed that condensation will not cause damage or a lack in safety);
- A_1 combustion A_1 appliances with a fixed output range are in operation at this (nominal) heat output;
- all other A_1 combustion A_1 appliances are in operation at minimum heat output.

When chimneys suitable for operating under wet conditions are located inside a building the check of the temperature requirement is necessary only for the top of the chimney.

The validation of the temperature requirement is not necessary when the chimney serves only domestic gas fired water heaters with instantaneous production and domestic gas fired storage water heaters.

If the chimney system includes a draught regulator, the system is handled as a cascade system.

5.2 Pressure equilibrium condition

5.2.1 Negative pressure chimneys

The following formulas shall be fulfilled for each chimney segment j at all relevant working conditions:

$$|P_{Z,j} - P_{Zc,j}| \leq 0,1, \text{ in Pa} \quad (1)$$

$$P_{Z,j} = -P_L + \sum_{k=j}^N (P_{H,k} - P_{R,k}), \text{ in Pa} \quad (2)$$

$$P_{Zc,j} = P_{Wc,j} + P_{V,j} + P_{Bc,j}, \text{ in Pa} \quad (3)$$

where

$P_{Z,j}$ draught at the flue gas inlet to the chimney segment j , in Pa


$P_{H,k}$ theoretical draught due to chimney effect in chimney segment k , in Pa

$P_{R,k}$ pressure resistance of the chimney segment k , in Pa

$P_{Wc,j}$ calculated draught of the A_1 combustion A_1 appliance, in Pa

$P_{V,j}$ calculated pressure resistance of the connecting flue pipe of chimney segment j , in Pa

- $P_{Bc,j}$ calculated pressure resistance of the air supply for the $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance j, in Pa
 $P_{Ze,j}$ required draught at the flue gas inlet to the chimney segment j, in Pa
 P_L wind velocity pressure, in Pa
 N number of $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliances

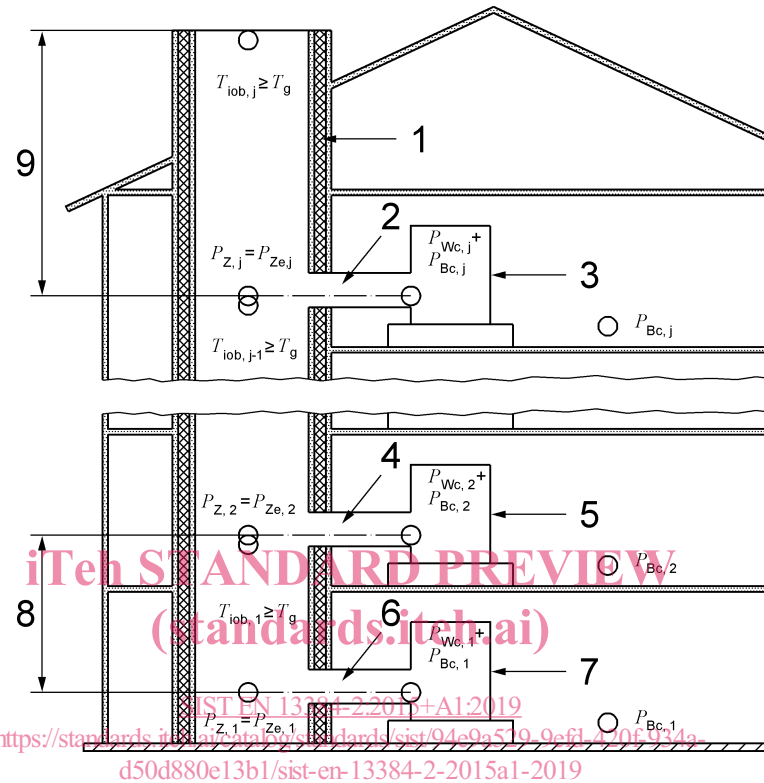

Key

- 1 chimney
- 2 connecting flue pipe j
- 3 $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance j
- 4 connecting flue pipe 2
- 5 $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance 2
- 6 connecting flue pipe 1
- 7 $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance 1
- 8 chimney segment 1
- 9 chimney segment j

Figure 1 — Example of multiple inlet arrangement and numbering pressure values and temperature values of a chimney serving more than one $\langle A_1 \rangle$ combustion $\langle A_1 \rangle$ appliance

5.2.2 Positive pressure chimneys

The following formulas shall be fulfilled for each chimney segment j at all relevant working conditions:

$$|P_{ZOe,j} - P_{ZO,j}| \leq 0,1, \text{ in Pa} \quad (3a)$$

$$P_{ZO,j} = P_L + \sum_{k=j}^N (P_{R,k} - P_{H,k}), \text{ in Pa} \quad (3b)$$