

---

**Signalizacija po nizkonapetostnih električnih napeljavah v frekvenčnem območju od 3 kHz do 148,5 kHz - 4-4. del: Nizkonapetostni ločilni filtri - Impedančni filter**

Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5 kHz Part 4-4: Low voltage decoupling filter - Impedance filter

Signalübertragung auf elektrischen Niederspannungsnetzen im Frequenzbereich 3 kHz bis 148,5 kHz Teil 4-4: Niederspannungs-Entkopplungsfilter - Impedanzfilter

Transmission de signaux sur les réseaux électriques basse tension dans la bande de fréquences de 3 kHz à 148,5 kHz - Partie 4-4: Filtres de découplage basse tension - Filtre d'impédance

<https://standards.iteh.ai/catalog/standards/sist/16b877cd-825a-4042-85f7-6229d60eebaf/osist-pren-50065-4-4-2021>

**Ta slovenski standard je istoveten z: prEN 50065-4-4**

---

**ICS:**

31.160	Električni filtri	Electric filters
33.040.30	Komutacijski in signalizacijski sistem	Switching and signalling systems

**oSIST prEN 50065-4-4:2021****en,fr**

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[oSIST prEN 50065-4-4:2021](#)

<https://standards.iteh.ai/catalog/standards/sist/16b877cd-825a-4042-85f7-6229d60eebaf/osist-pren-50065-4-4-2021>

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

**DRAFT**  
**prEN 50065-4-4**

April 2021

ICS

Will supersede EN 50065-4-4:2003 and all of its amendments and corrigenda (if any)

English Version

## Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5 kHz Part 4-4: Low voltage decoupling filter - Impedance filter

Transmission de signaux sur les réseaux électriques basse tension dans la bande de fréquences de 3 kHz à 148,5 kHz  
- Partie 4-4: Filtres de découplage basse tension - Filtre d'impédance

Signalübertragung auf elektrischen Niederspannungsnetzen im Frequenzbereich 3 kHz bis 148,5 kHz Teil 4-4: Niederspannungs-Entkopplungsfilter - Impedanzfilter

This draft European Standard is submitted to CENELEC members for enquiry.  
Deadline for CENELEC: 2021-07-16.

It has been drawn up by CLC/TC 219.

If this draft becomes a European Standard, CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CENELEC in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

Warning : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

prEN 50065-4-4:2021 (E)

1	<b>Contents</b>	Page
2	<b>European foreword</b> .....	<b>3</b>
3	<b>1 Scope</b> .....	<b>4</b>
4	<b>2 Normative references</b> .....	<b>4</b>
5	<b>3 Terms and definitions</b> .....	<b>5</b>
6	<b>4 Impedance filter electrical characteristics</b> .....	<b>5</b>
7	4.1 General .....	5
8	4.2 Terminations .....	5
9	4.3 Immunity for EMC .....	5
10	4.4 Operating frequency range.....	5
11	4.5 Impedance .....	6
12	4.6 Transfer function .....	6
13	4.7 Safety.....	6
14		

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

<https://standards.iteh.ai/catalog/standards/sist/16b877cd-825a-4042-85f7-6229d60eebaf/osist-pren-50065-4-4-2021>

## 15 European foreword

16 This document (prEN 50065-4-4:2021) has been prepared by WG 12 “Filters” of CLC/TC 205A “Mains  
17 communicating systems”.

18 This document is currently submitted to the Enquiry.

19 The following dates are proposed:

- latest date by which the existence of this document has to be announced at national level (doa) dor + 6 months
- latest date by which this document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) dor + 12 months
- latest date by which the national standards conflicting with this document have to be withdrawn (dow) dor + 36 months (to be confirmed or modified when voting)

20 This document will supersede EN 50065-4-4:2003 and all of its amendments and corrigenda (if any).

21 This document has been prepared under a mandate given to CENELEC by the European Commission  
22 and the European Free Trade Association.

23 EN 50065 consists of the following parts, under the general title: Signalling on low-voltage electrical  
24 installations in the frequency range 3 kHz to 148,5 kHz

25 Part 1 General requirements, frequency bands and electromagnetic disturbances

26 Part 2-1 Immunity requirements for mains communications equipment and systems operating in the  
27 range of frequencies 95 kHz to 148,5 kHz and intended for use in residential, commercial and light  
28 industrial environments

29 Part 2-2 Immunity requirements for mains communications equipment and systems operating in the  
30 range of frequencies 95 kHz to 148,5 kHz and intended for use in industrial environments

31 Part 2-3 Immunity requirements for mains communications equipment and systems operating in the  
32 range of frequencies 3 kHz to 95 kHz and intended for use by electricity suppliers and distributors

33 Part 4-1 Low voltage decoupling filters – Generic specification

34 Part 4-2 Low voltage decoupling filters – Safety requirements

35 Part 4-3 Low voltage decoupling filters – Incoming filter

36 Part 4-4 Low voltage decoupling filters – Impedance filter

37 Part 4-5 Low voltage decoupling filters – Segmentation filter

38 Part 4-6 Low voltage decoupling filters – Phase coupler

39 Part 4-7 Portable low voltage decoupling filters – Safety requirements

40 Part 7 Equipment impedance


## prEN 50065-4-4:2021 (E)

41 **1 Scope**

42 This document applies to impedance filters in a mains communication system, intended for utility  
43 networks or household and similar fixed installation including residential, commercial and light  
44 industrial buildings.

45 These filters are used to set a suitable impedance, in the nominal frequency range of the mains  
46 signalling system, at any point of the low voltage mains network where a low impedance equipment is  
47 connected, as shown in Figure 1, in order to allow reliable operation of the mains signalling system.

48 Impedance filters can be used either in utility or consumer networks. They can also be used in  
49 conjunction with incoming filters and segmentation filters.

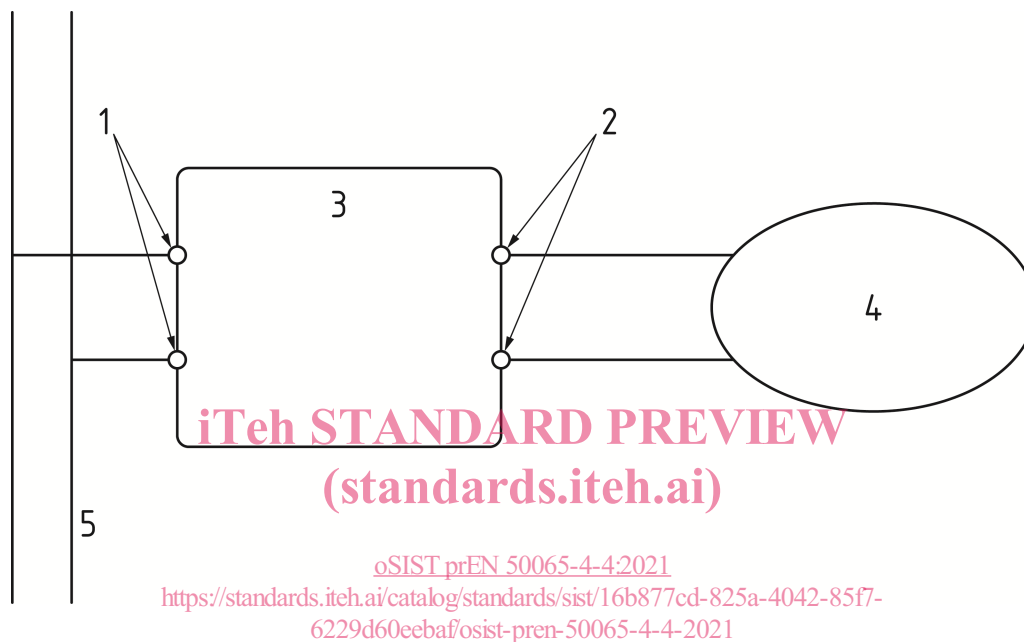

50

51 **Key**

- 1 network terminals
- 2 equipment terminals
- 3 impedance filter
- 4 low impedance equipment
- 5 low voltage network

52

**Figure 1 — The application of impedance filters**

53 **2 Normative references**

54 The following documents are referred to in the text in such a way that some or all of their content  
55 constitutes requirements of this document. For dated references, only the edition cited applies. For  
56 undated references, the latest edition of the referenced document (including any amendments)  
57 applies.

58 EN 50065-2-1, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5*  
59 *kHz - Part 2-1: Immunity requirements for mains communications equipment and systems operating in*  
60 *the range of frequencies 95 kHz to 148,5 kHz and intended for use in residential, commercial and light*  
61 *industrial environments*

62 EN 50065-2-2, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5*  
63 *kHz - Part 2-2: Immunity requirements for mains communications equipment and systems operating in*  
64 *the range of frequencies 95 kHz to 148,5 kHz and intended for use in industrial environments*

65 EN 50065-2-3, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5*  
 66 *kHz - Part 2-3: Immunity requirements for mains communications equipment and systems operating in*  
 67 *the range of frequencies 3 kHz to 95 kHz and intended for use by electricity suppliers and distributors*

68 EN 50065-4-1:2001, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to*  
 69 *148,5 kHz - Part 4-1: Low voltage decoupling filters - Generic specification*

70 EN 50065-4-2, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5*  
 71 *kHz and 1,6 MHz to 30 MHz - Part 4-2: Low voltage decoupling filters - Safety requirements*

72 EN 50065-4-3:2003, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to*  
 73 *148,5 kHz - Part 4-3: Low voltage decoupling filter - Incoming filter*

74 EN 50065-4-7, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5*  
 75 *kHz and 1,6 MHz to 30 MHz - Part 4-7: Portable low voltage decoupling filters - Safety requirements*

### 76 **3 Terms and definitions**

77 No terms and definitions are listed in this document.

78 ISO and IEC maintain terminological databases for use in standardization at the following addresses:

79 — ISO Online browsing platform: available at <https://www.iso.org/obp>

80 — IEC Electropedia: available at <http://www.electropedia.org/>

iTech STANDARD PREVIEW  
(standards.iteh.ai)

### 81 **4 Impedance filter electrical characteristics**

oSIST prEN 50065-4-4:2021

82 **4.1 General** <https://standards.iteh.ai/catalog/standards/sist/16b877cd-825a-4042-85f7-6229d60eebaf/osist-pren-50065-4-4-2021>

83 The filter shall meet the requirements given in EN 50065-4-1.

#### 84 **4.2 Terminations**

85 The impedance filter shall have a network port connected to the mains communication network and an  
 86 equipment port connected to either a low impedance equipment, as shown in Figure 1, or a low  
 87 impedance network. Implementation of impedance filter may not distinguish both ports when designed  
 88 symmetrically.

#### 89 **4.3 Immunity for EMC**

90 The filter shall meet the immunity requirements specified in:

91 — EN 50065-2-1 for consumer side in residential, commercial and light industrial environments

92 — EN 50065-2-2 for consumer side in industrial environments

93 — EN 50065-2-3 for utility side.

#### 94 **4.4 Operating frequency range**

95 The operating frequency range shall be in the band:

96 — 3 kHz to 95 kHz for the utility network,

97 — 95 kHz to 148,5 kHz for the consumer network.