
**Thermal insulating products
for building applications —
Determination of compressive creep**

*Produits isolants thermiques destinés aux applications du bâtiment —
Détermination du fluage en compression*

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO 16534:2020](https://standards.iteh.ai/catalog/standards/sist/87790ff8-edfc-4851-8d56-2ae3f4ecdcc1/iso-16534-2020)

<https://standards.iteh.ai/catalog/standards/sist/87790ff8-edfc-4851-8d56-2ae3f4ecdcc1/iso-16534-2020>



iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 16534:2020

<https://standards.iteh.ai/catalog/standards/sist/87790ff8-edfc-4851-8d56-2ae3f4ecdcc1/iso-16534-2020>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2020

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	iv
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Symbols	3
5 Principle	3
6 Apparatus	3
7 Test specimens	4
7.1 Selection of test specimens	4
7.2 Dimensions of test specimens	4
7.3 Number of test specimens	5
7.4 Preparation of test specimens	5
7.5 Conditioning of test specimens	5
8 Procedure	5
8.1 Test conditions	5
8.2 Stress selection	6
8.3 Test procedure	6
8.4 Duration of test	8
9 Calculation and expression of results	8
10 Accuracy of measurement	8
11 Test report	8
Annex A (normative) Calculation method	10
Annex B (informative) Example of a linear regression analysis	13
Bibliography	16

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 163, *Thermal performance and energy use in the built environment*, Subcommittee SC 1, *Test and measurement methods*, in collaboration with the European Committee for Standardization (CEN) Technical Committee CEN/TC 88, *Thermal insulating materials and products*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

This second edition cancels and replaces the first edition (ISO 16546:2012), which has been technically revised. The main changes compared to the previous edition are as follows:

- modification of [Figure 1](#);
- editorial modifications.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Thermal insulating products for building applications — Determination of compressive creep

1 Scope

This document specifies the equipment and test method for determining the compressive creep of specimens under various conditions of stress.

This document is applicable to thermal insulating products.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 29469, *Thermal insulating products for building applications — Determination of compression behaviour*

ISO 29768, *Thermal insulating products for building applications — Determination of linear dimensions of test specimens*

3 Terms and definitions

For the purposes of this document the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

3.1

thickness

linear dimension measured perpendicular to the planes of length and width

3.2

compressive stress

σ_c

ratio of the compressive force to the initial cross-sectional surface area of the test specimen

3.3

deformation

X

reduction in *thickness* (3.1) of the test specimen

3.4

relative deformation

ε

ratio of the *deformation* (3.3) of the test specimen X , and its *thickness* (3.1) d_s , measured in the direction of loading

3.5 compressive creep

X_{ct}
 increase in *deformation* (3.3) of the test specimen over time whilst under a constant stress, at specified conditions of temperature and humidity


$$X_{ct} = X_t - X_0$$

where

X_t is the deformation at time t ;

X_0 is the initial deformation (after 60 s from the beginning of loading).

Note 1 to entry: An illustration of the different *thicknesses* (3.1) and deformations is given in Figure 1.

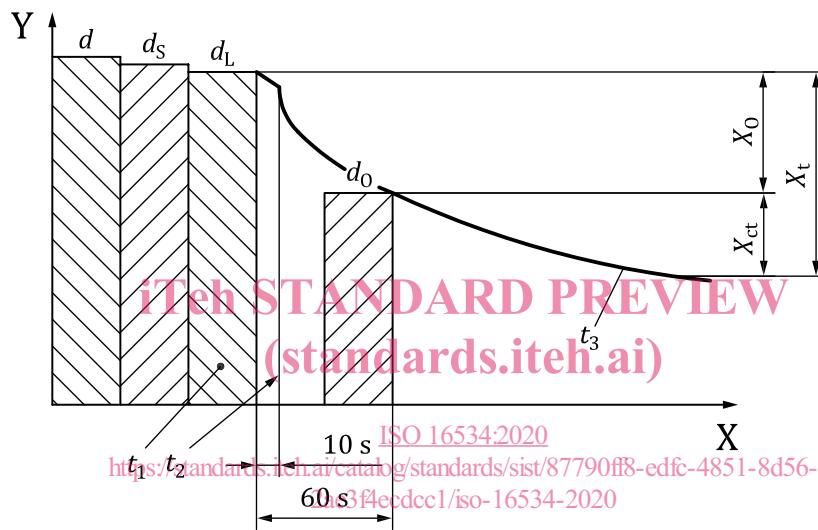

Key

- d original product thickness
- d_s initial thickness of the test specimen
- d_L thickness of the test specimen under the basic compressive stress of the loading device (‘dead weight’)
- d_0 thickness of the test specimen 60 s after the beginning of the loading process
- X_0 the initial deformation (after 60 s from the beginning of loading)
- X_{ct} increase in deformation of the test specimen over time whilst under a constant stress, at specified conditions of temperature and humidity
- X_t total the deformation at selected time t_3
- t_1 time when dead wright is applied
- t_2 time when selected load is uniformly applied
- t_3 deformation at selected time
- Y thickness
- X time

In the illustration, d_L is used as a reference value for deformation measurements. If d_s is used as the reference value, the illustration can be used, omitting the column for d_L (see 3.3).

Figure 1 — Illustration of the different thicknesses and deformations

4 Symbols

Symbol	Description
d	original product thickness
d_S	thickness of the test specimen
d_L	thickness of the test specimen under the basic compressive stress of the loading device ('dead weight')
d_0	thickness of the test specimen 60 s after the beginning of the loading process
d_t	thickness of the test specimen at a given time, t

5 Principle

The compressive creep is determined by measuring the increase in deformation of a test specimen under constant compressive stress and specified conditions of temperature, humidity and time.


6 Apparatus

6.1 Loading device, consisting of two flat plates, one of which shall be movable, arranged so that they compress the test specimen in a vertical direction. The movable plate shall be guided in such a manner as to be self-aligning. The plates shall be capable of being loaded smoothly and without distortion so that, during the test, the static stress does not change by more than +5 %.

6.2 Measuring device (e.g. dial gauge), capable of determining the distance between the two plates, i.e. the deformation of the test specimen, to an accuracy of 0,01 mm.

6.3 Suitable damping measures, to ensure the effects of external vibration are minimized (e.g. a substantial foundation and anchoring of the apparatus support).

Examples of the testing apparatus are given in [Figure 2](#).

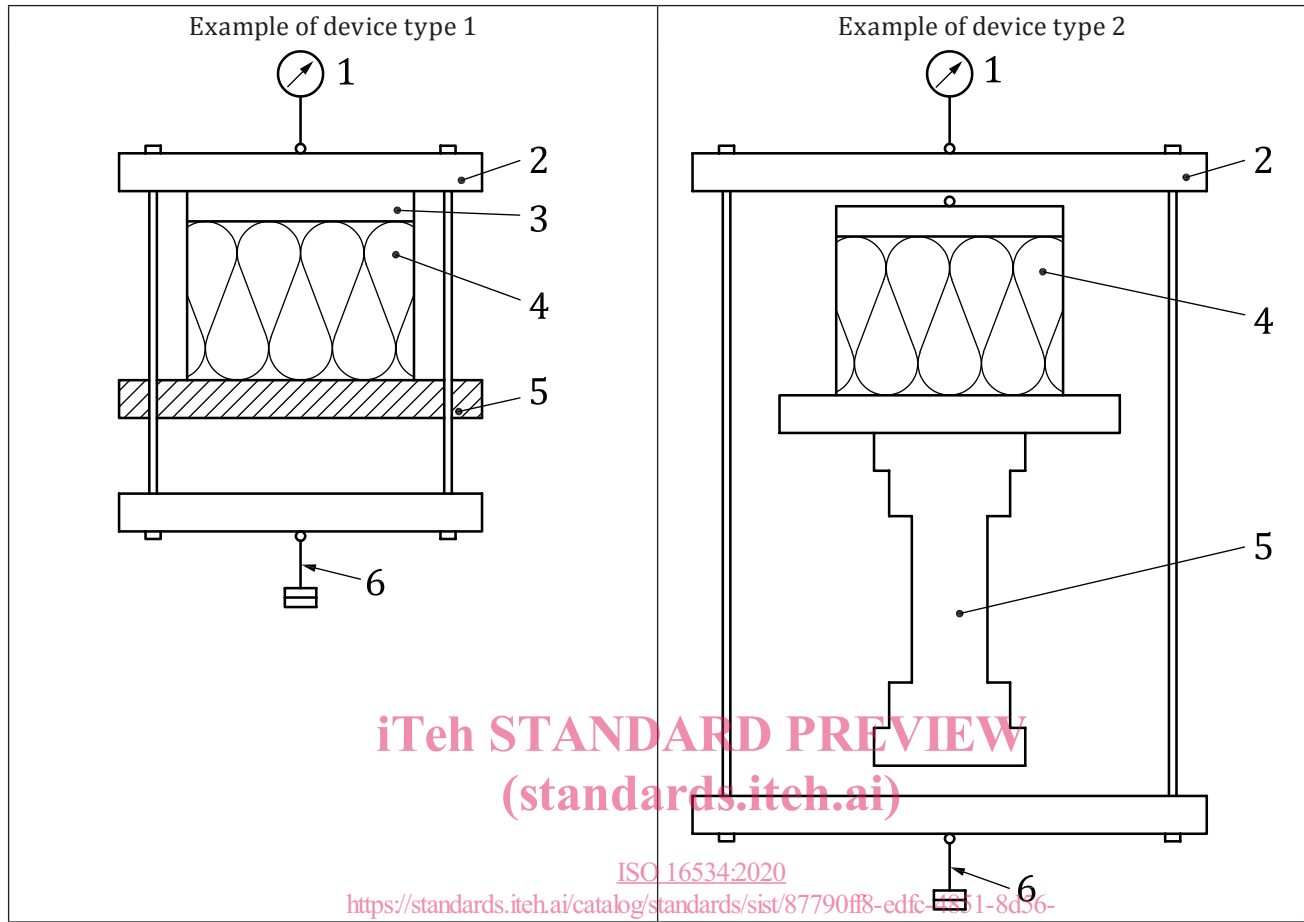

Key

- | | |
|--|----------------------|
| 1 displacement transducer or dial gauge | 4 test specimen |
| 2 loading bridge | 5 support beam |
| 3 load distribution plate (movable, self-aligning) | 6 loading by weights |

Figure 2 — Examples of test apparatus

7 Test specimens

7.1 Selection of test specimens

The test specimens for determining the compressive creep shall be taken from the same sample, with the same preparation as the test specimens used for the compression test as specified in ISO 29469.

The method for selecting the test specimens shall be as specified in the relevant product standard.

NOTE In the absence of a product standard or any other technical specification, the method for selection of the test specimens can be agreed between parties.

7.2 Dimensions of test specimens

The thickness of test specimens shall be equal to the original product thickness. The width of the test specimens shall not be less than their thickness. Products with facings or integral moulded skins which are intended to be retained in use shall be tested with these faces or skins intact.

Test specimens shall not be layered to produce a greater thickness for testing.

The test specimens shall be cut squarely and have sides with the following recommended dimensions:

- 50 mm × 50 mm; or
- 100 mm × 100 mm; or
- 150 mm × 150 mm; or
- 200 mm × 200 mm or
- 300 mm × 300 mm.

The dimensions of test specimens shall be the same as used in the compression test as described in ISO 29469. These are specified in the relevant product standard or agreed between parties.

The linear dimensions shall be determined in accordance with ISO 29768, to an accuracy of 0,5 %.

The upper and lower faces of each test specimen shall be flat and parallel with a tolerance no greater than 0,5 % of its side length, up to a maximum of 0,5 mm.

7.3 Number of test specimens

The number of test specimens shall be as specified in the relevant product standard. If the number is not specified, then at least three specimens shall be used for each compressive stress selected from 8.2.

NOTE In the absence of a product standard or any other technical specification, the number of specimens can be agreed between parties, provided the minimum requirement of three specimens are met.

7.4 Preparation of test specimens

The specimens shall be cut so that the direction of loading applied to the product will correspond to the direction in which the compressive forces are applied to the product in use.

The test specimens shall be cut by methods that do not change the original structure of the product.

If the test specimen is not flat and parallel, it shall be ground flat and parallel or a suitable coating shall be applied to prepare the surface for the test. If a coating is applied, any creep which occurs within the coating shall be taken into account by deducting the creep of the coating.

Special methods of preparation, when needed, can be provided in the relevant product standard.

7.5 Conditioning of test specimens

The test specimens shall be conditioned for at least 24 h at $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \%$ relative humidity (RH). In case of dispute, the time for conditioning (equilibrium of moisture content) shall be as specified in the relevant product standard.

In tropical countries, the local environment can necessitate different conditioning and testing conditions. In such cases, the conditioning shall be performed at $(27 \pm 2) ^\circ\text{C}$ and $(65 \pm 5) \%$ RH and be stated clearly in the test report.

8 Procedure

8.1 Test conditions

The test shall be carried out at $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \%$ RH.

Other conditions can be given in the relevant product standard or can be agreed between parties.

In tropical countries, the local environment may necessitate different conditioning and testing conditions. In such cases, the testing shall be performed at (27 ± 2) °C and (65 ± 5) % RH and be stated clearly in the test report.

8.2 Stress selection

The test shall be carried out at three or more different stresses.

To verify one defined level of stress only this level shall be used.

The alternative stresses for the creep test, σ_c , shall be based on the compressive strength, σ_m , or on the compressive stress, σ_{10} , at 10 % strain measured in accordance with ISO 29469, and shall be calculated as follows:

- $\sigma_c = 0,15 \times \sigma_m$ or $\sigma_c = 0,15 \times \sigma_{10}$
- $\sigma_c = 0,20 \times \sigma_m$ or $\sigma_c = 0,20 \times \sigma_{10}$
- $\sigma_c = 0,25 \times \sigma_m$ or $\sigma_c = 0,25 \times \sigma_{10}$
- $\sigma_c = 0,30 \times \sigma_m$ or $\sigma_c = 0,30 \times \sigma_{10}$
- $\sigma_c = 0,35 \times \sigma_m$ or $\sigma_c = 0,35 \times \sigma_{10}$

If appropriate, other values of σ_c may be chosen.

8.3 Test procedure

iTeh STANDARD PREVIEW
(standards.iteh.ai)

If the thickness of a test specimen, d_s , is to be determined without using the loading device, it shall be measured to an accuracy of 0,1 mm, in accordance with ISO 29768.

Place the test specimen carefully in the test apparatus, under the 'dead weight' of the loading device. The thickness under this load, d_L , is the reference value for the deformation measurements. Determine d_L to the nearest 0,01 mm.

The stress imposed by the 'dead weight' shall be less than 10 % of the minimum stress selected for the test.

If the thickness of the test specimen, d_s , is determined using the loading device, the specimen should be preloaded by applying a pressure of (250 ± 10) Pa and the thickness measured to an accuracy of 0,01 mm. This value shall then be used as the reference value for the deformation measurements.

If a significant deformation occurs under the pressure of 250 Pa, then a load corresponding to 50 Pa may be used, assuming that such load is specified in the relevant product standard. In this case the thickness, d_s , should be determined under the same load.

Apply the selected stress uniformly to the test specimen within (10 ± 5) s.

Determine the initial deformation, X_0 , to the nearest 0,01 mm (60 ± 5) s after loading has started.


Determine the deformation, X_t , to the nearest 0,01 mm at the following times after loading:

1 min, 1 h, 5 h, and then at the following intervals after loading has started: (1, 2, 4, 7, 9, 11, 14, 18, 24, 32, 42, 53, 65 and 80) days, and once between 90 days and 100 days.

NOTE These times, expressed in hours, are equidistant time increments in a logarithmic time scale.

If the test is continued after 90 days (see 8.4), readings shall be made at equidistant time increments (logarithmic scale). An example for appropriate reading time increments is given in [Figure 3](#) and [Table 1](#).

When the product to be tested incorporates a facing which is difficult to remove or if a coating has been applied for testing purposes, the compressive creep may be measured by the relative movement of the flat plates of the loading device. Alternatively, it may be measured from the relative movement of reference points placed on the edges of the material, if the intention is to assess the material itself.

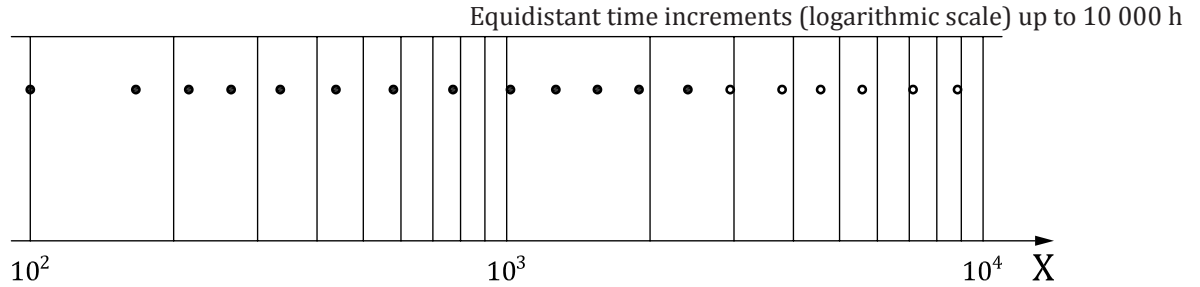

Key

- readings for the required test duration of 90 days (see 8.3)
 - readings for a test duration longer than 90 days (see 8.4)
- X time, *t*, in h

Figure 3 — Reading time: examples for time intervals for deformation measurement

Table 1 — Reading times: examples for time intervals for deformation measurement

Week	Day	Time	Duration in h	Day of the week
1 st	0	10:00	0 (loading)	Monday
1 st	0	10:01	0,017	Monday
1 st	0	11:00	1,0	Monday
1 st	0	15:00	5,0	Monday
1 st	1	10:00	24	Tuesday
1 st	2	10:00	48	Wednesday
1 st	4	14:00	100	Friday
1 st	7	10:10	168	Monday
2 nd	9	10:00	216	Wednesday
2 nd	11	10:00	264	Friday
2 nd	14	10:00	336	Monday
2 nd	18	10:00	432	Friday
3 rd	24	10:00	576	Thursday
4 th	32	10:00	768	Friday
6 th	42	10:00	1 008	Monday
7 th	53	10:00	1 272	Friday
9 th	65	10:00	1 560	Wednesday
11 th	80	10:00	1 920	Thursday
14 th	100	10:00	2 400	Wednesday
17 th	123	10:00	2 952	Friday
22 nd	156	10:00	3 744	Wednesday
27 th	190	10:00	4 560	Tuesday
33 rd	231	10:00	5 544	Monday
42 nd	295	10:00	7 080	Tuesday
52 nd	365	10:00	8 760	Tuesday