
**Construction and installation of
ductile iron pipeline system**

iTeh Standards
(<https://standards.itih.ai>)
Document Preview

[ISO 21051:2020](https://standards.itih.ai/catalog/standards/iso/538d0512-9439-468c-8a94-b510df06f23e/iso-21051-2020)

<https://standards.itih.ai/catalog/standards/iso/538d0512-9439-468c-8a94-b510df06f23e/iso-21051-2020>



iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[ISO 21051:2020](https://standards.iteh.ai/catalog/standards/iso/538d0512-9439-468c-8a94-b510df06f23e/iso-21051-2020)

<https://standards.iteh.ai/catalog/standards/iso/538d0512-9439-468c-8a94-b510df06f23e/iso-21051-2020>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2020

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Occupational safety and health requirements	2
5 Materials in contact with water intended for human consumption	2
6 Input control, transport, handling and storage of pipeline components and inspection	3
6.1 Input control	3
6.2 Transport, handling and storage and inspection of pipeline components	3
6.2.1 Transport	3
6.2.2 Handling	3
6.2.3 Storage	5
6.2.4 Inspection	9
7 Coating and lining repairs	9
7.1 General	9
7.2 Repair external coating	9
7.2.1 General	9
7.2.2 Repair procedure	9
7.3 Repair cement mortar lining	10
7.3.1 General	10
7.3.2 Repair procedure cement mortar lining	10
8 Cutting of pipes and ovality correction	10
8.1 Cutting of pipes	10
8.1.1 General	10
8.1.2 Pipe cutting tools	11
8.1.3 Chamfering of cut edge	11
8.1.4 Repair of damaged lining and coating	11
8.2 Ovality correction	11
9 Site preparation and pipe trenches	14
9.1 Trench width	14
9.2 Trench excavation and minimum depth of cover	14
9.2.1 General	14
9.2.2 Minimum depth of cover	14
9.2.3 Regulations	14
10 Pipeline protection	15
10.1 General	15
10.2 Site applied polyethylene sleeving	15
11 Laying of pipes	15
11.1 Precautions at site before laying	15
11.1.1 General	15
11.1.2 Preparation before pipe laying and jointing	15
11.2 Construction of pipe trenches	16
11.2.1 General	16
11.2.2 Bedding	16
11.2.3 Trench types	17
11.2.4 Soil types	19
11.3 Safety, protection of property and structures	20
12 Push-in joints, jointing and anchoring	20
12.1 Preparations before jointing	20
12.2 Push-in joints	20

12.2.1	General.....	20
12.2.2	Push-in joint assembly for the pipes.....	21
12.2.3	Jointing of push-on fittings.....	27
12.2.4	Jointing of fittings by jointing tackle (assembler).....	27
12.2.5	Jointing of fittings by winch method.....	28
12.2.6	Maximum joint deflection and laying length.....	28
12.2.7	Inspection of the joint.....	29
12.2.8	Dismantling of Joint.....	30
12.3	Mechanical joints.....	30
12.3.1	General.....	30
12.3.2	Mechanical joint assembly for pipes.....	31
12.4	Flanged Joints.....	33
12.4.1	General.....	33
12.4.2	Flange bolting tightening sequence.....	33
12.4.3	Maximum bolt tightening torque.....	34
13	Functional features and installation of valves.....	35
13.1	Installation of valves.....	35
13.1.1	General.....	35
13.1.2	Air valves.....	35
13.1.3	Scour valves or drain valves.....	36
13.1.4	Isolation valves.....	36
13.1.5	Hydrants.....	37
13.1.6	Surge limiting equipment.....	37
14	Restrained joints and thrust blocks.....	37
15	Cleaning, hydraulic testing and commissioning of pipeline and pipeline components.....	37
15.1	Cleaning.....	37
15.2	Hydraulic testing.....	38
16	Flushing and disinfection.....	38
17	Service connections.....	38
17.1	General.....	38
17.2	Conventional type service connection.....	39
17.3	External seal type connection.....	39
17.4	Saddle for ductile iron pipes for distribution network.....	40
18	Supporting pipes.....	41
18.1	General.....	41
18.2	Support for above ground installation.....	41
18.3	Maximum span for river crossing.....	41
18.4	Laying of ductile iron (DI) pipes in hilly terrain.....	42
18.4.1	General.....	42
18.4.2	Pipe line anchoring on slope.....	42
18.4.3	Basic precaution during trenching and bed preparation for pipes on slope.....	44
18.4.4	Additional precautions during laying in a hilly and rocky terrain.....	45
18.4.5	Precaution in snow bound areas.....	46
19	Railroad and highway crossings.....	47
Annex A (normative) Site applied polyethylene sleeving.....		48
Bibliography.....		57

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 5, *Ferrous metal pipes and metallic fittings*, Subcommittee SC 2, *Cast iron pipes, fittings and their joints*.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

<https://standards.iteh.ai/catalog/standards/iso/538d0512-9439-468c-8a94-b510df06f23e/iso-21051-2020>

Construction and installation of ductile iron pipeline system

1 Scope

This document specifies the recommended practices and requirements for the installation of buried and above-ground ductile iron pipeline system conforming to ISO 2531, ISO 7186 and ISO 16631.

The recommended practices in this document are intended to provide the practical advices based on the best methods of construction and installation of ductile iron pipeline system including pipes, fittings, valves and accessories.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 2531:2009, *Ductile iron pipes, fittings, accessories and their joints for water applications*

ISO 4179:2005, *Ductile iron pipes and fittings for pressure and non-pressure pipelines — Cement mortar lining*

ISO 8179-1:2017, *Ductile iron pipes, fittings, accessories and their joints — External zinc-based coating — Part 1: Metallic zinc with finishing layer*

ISO 8180, *Ductile iron pipes — polyethylene sleeving for site application*

ISO 10802, *Ductile iron pipelines — Hydrostatic testing after installation*

3 Terms and definitions

ISO 21051:2020

<https://standards.iteh.ai/catalog/standards/iso/538d0512-9439-468c-8a94-b510df06f23e/iso-21051-2020>

For the purposes of this document, the terms and definitions given in ISO 2531 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

3.1

system test pressure

STP

hydrostatic pressure applied to newly laid pipeline in order to ensure its integrity and leak tightness, based on project requirements of working pressure and the surge pressure

Note 1 to entry: The system test pressure ([Clause 14](#)) shall never exceed the maximum allowable site test pressure of each component of the pipeline i.e. pipes, valves ([3.8](#)), fittings and other accessories.

3.2

gravity system

system where flow and/or pressure are caused by the force of gravity.

Note 1 to entry: There are two kinds of such systems:

- pressurized gravity system, where the pipeline operates full;
- non-pressurized gravity system, where the pipeline operates partially full.

ISO 21051:2020(E)

Note 2 to entry: See [13.1.6](#).

3.3

local main

water main which connects *principal main(s)* ([3.4](#)) with *service pipes* ([3.6](#))

Note 1 to entry: See [13.1.4](#).

3.4

principal main

water main serving as a principal distributor within the supply area, normally without direct consumer connections

Note 1 to entry: See [13.1.4](#).

3.5

pumped or gravity system

system where the *gravity system* ([3.2](#)) and the pumped system are used, either separately or in combination, to provide the flow and/or pressure

3.6

service pipe

water pipe which supplies water from the *local main* ([3.3](#)) to the consumer

3.7

trunk main

water main which interconnects source(s), treatment works, reservoir(s) and/or supply areas, normally without direct consumer connection(s)

Note 1 to entry: See [13.1.4](#).

3.8

valve

component isolating or controlling flow and pressure

EXAMPLE Isolating valves, control valve, air release valve, non-return valve, hydrant.

Note 1 to entry: See [Clause 13](#).

4 Occupational safety and health requirements

During the execution of the works, it is presupposed that local/national regulations on occupational safety and health are followed.

5 Materials in contact with water intended for human consumption

When used under the conditions for which they are designed, in permanent or in temporary contact with water intended for human consumption, ductile iron pipes, fittings and their joints shall not have detrimental effects on the properties of that water for its intended use.

Ductile iron pipeline systems, including pipes, fittings, accessories and joints, consist of various materials. When used for conveying water intended for human consumption, it is presupposed that the materials in contact with the water meet the relevant requirements of the national standards or regulations in the country of use with respect to effect on water quality.

6 Input control, transport, handling and storage of pipeline components and inspection

6.1 Input control

Immediately after the uploading of the pipes at site, pipeline components, including fittings and accessories, should be checked for the markings, suitability for the use in the defined project and should be inspected for the following:

- deformations or dent;
- cracks;
- damage to the pipe ends;
- damage to the external coating and internal lining.

Items requiring repair should be identified and stored separately.

6.2 Transport, handling and storage and inspection of pipeline components

6.2.1 Transport

The following precautions shall be taken during transport and handling of pipe and pipeline components:

- suitable support for the pipes should be provided, which should be resistant and durable, with timbers under the lower layers of the pipes as well as between the other layers;
- pipes should be secured at the sides and at the ends to prevent any longitudinal movement, to avoid damage in the event of a lorry or truck suddenly braking;
- no part of the pipes should be unsupported with provision of the wooden props;
- pipes should be kept in a balanced condition with two parallel rows of good quality timbers fastened to the floor;
- slings or rubber protected hooks should be used for the loading and unloading of the pipes.

6.2.2 Handling

6.2.2.1 General

Sufficient care shall be taken during handling of the pipe to avoid damage to the pipes, pipe lining and coating. During the loading and unloading operation, no one shall stand below the pipe or pipe bundles or in the area around the crane.

[6.2.2.2](#) and [6.2.2.3](#) shall be followed for the handling of the pipes.

6.2.2.2 Pipes in bundled condition


Pipes shall be lifted by a suitable method, for example, using slings or by use of forklift (see [Figure 1](#)).

Steel strips are used to bundle the pipes. The straps should only be cut with suitable tools such as tin snips or side cutters. Use of cold chisels, crowbars, pickaxes or the similar material may cause damage to the external coating of the pipes and also means a greater risk of accidents. Before the straps are cut, it shall be ensured that:

- a) the bundle of pipes is standing on the non-sloping ground which is levelled to the maximum possible extent and is able to carry the weight of the bundle;

- b) the pipes are secured against rolling and slipping;
- c) no one is standing beside the bundle of pipes or on the top of it.

After the bundling, the lifting of bundles shall be done from bottom by suitable tools and not by hooking to the steel strips.

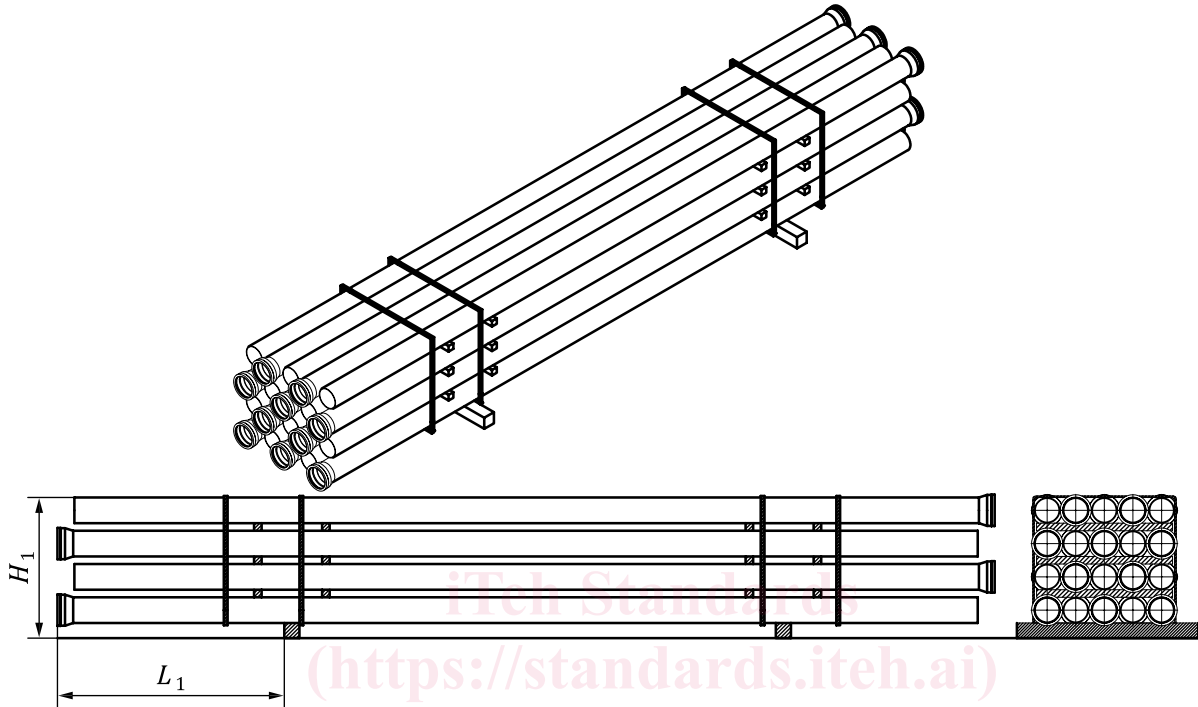

Key

H_1 height ≤ 3 m

L_1 support location from pipe end $\leq 1,5$ m


ISO 21051:2020

<https://standards.iteh.ai/catalog/standards/iso/538d0512-9439-468c-8a94-b510df06f23e/iso-21051-2020>

Figure 1 — Pipes in bundled condition

6.2.2.3 Pipes in loose condition

For pipe in loose condition, the pipes shall be lifted by use of appropriately shaped hooks or by use of padded slings (see [Figure 2](#)) coated with rubber or a similar material to avoid damage to the lining and coating. Sufficient care shall be taken to avoid rolling of the pipes, which may cause damage to the pipe lining and coating.

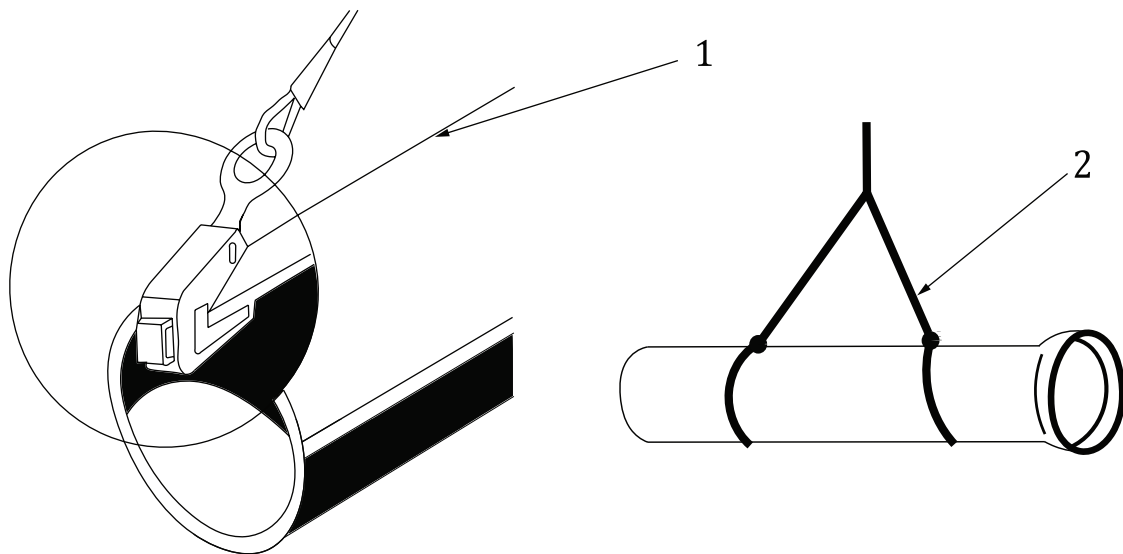

Key

- 1 padded slings to be used
- 2 pipe sling should be protected against sliding

Figure 2 — Lifting of pipes in loose condition

6.2.3 Storage

6.2.3.1 General

Storage of pipes at site should be done considering the local national regulation and all the safety norms.

The following precautions should be taken into account, while storing the ductile iron pipes:

- pipes should be stored so that they do not come in contact with harmful substances like solids, liquids, gases;
- they are therefore also not to be stored directly on the ground, but on appropriate materials;
- pipes should be protected suitably so that they are not internally contaminated with soil, mud, dirt, water or the like by use of suitable method like end caps;
- support and stack heights should be chosen so that damage and permanent deformation or damage to the external protection does not occur.

Manufacturer's recommendations should be followed for the storage of pipes. However, in general the suggested methods of storage are described in [6.2.3.2](#) to [6.2.3.5](#).

6.2.3.2 Storage of non-bundled pipes — Parallel stacking

For storage of non-bundled pipes, the parallel stacking method should be used, using wooden battens between rows. The following precautions should be taken for the storage of pipes:

- stacking area should have a foundation so as to have smooth movement of vehicles and easy access to the top layer;
- pipes should be stacked on wooden battens positioned suitably from each end of the pipe;
- the socket of the pipes in each successive layer should be reversed and the battens should be of sufficient thickness to avoid metal to metal contact ([Figure 3](#));

- an adequate number of blocks should be wedged under the outer of pipes of each layer, so as to ensure stability;
- pipes should be protected suitably so that they are not internally contaminated with soil, mud, dirt, water or the like by use of suitable method like end caps.

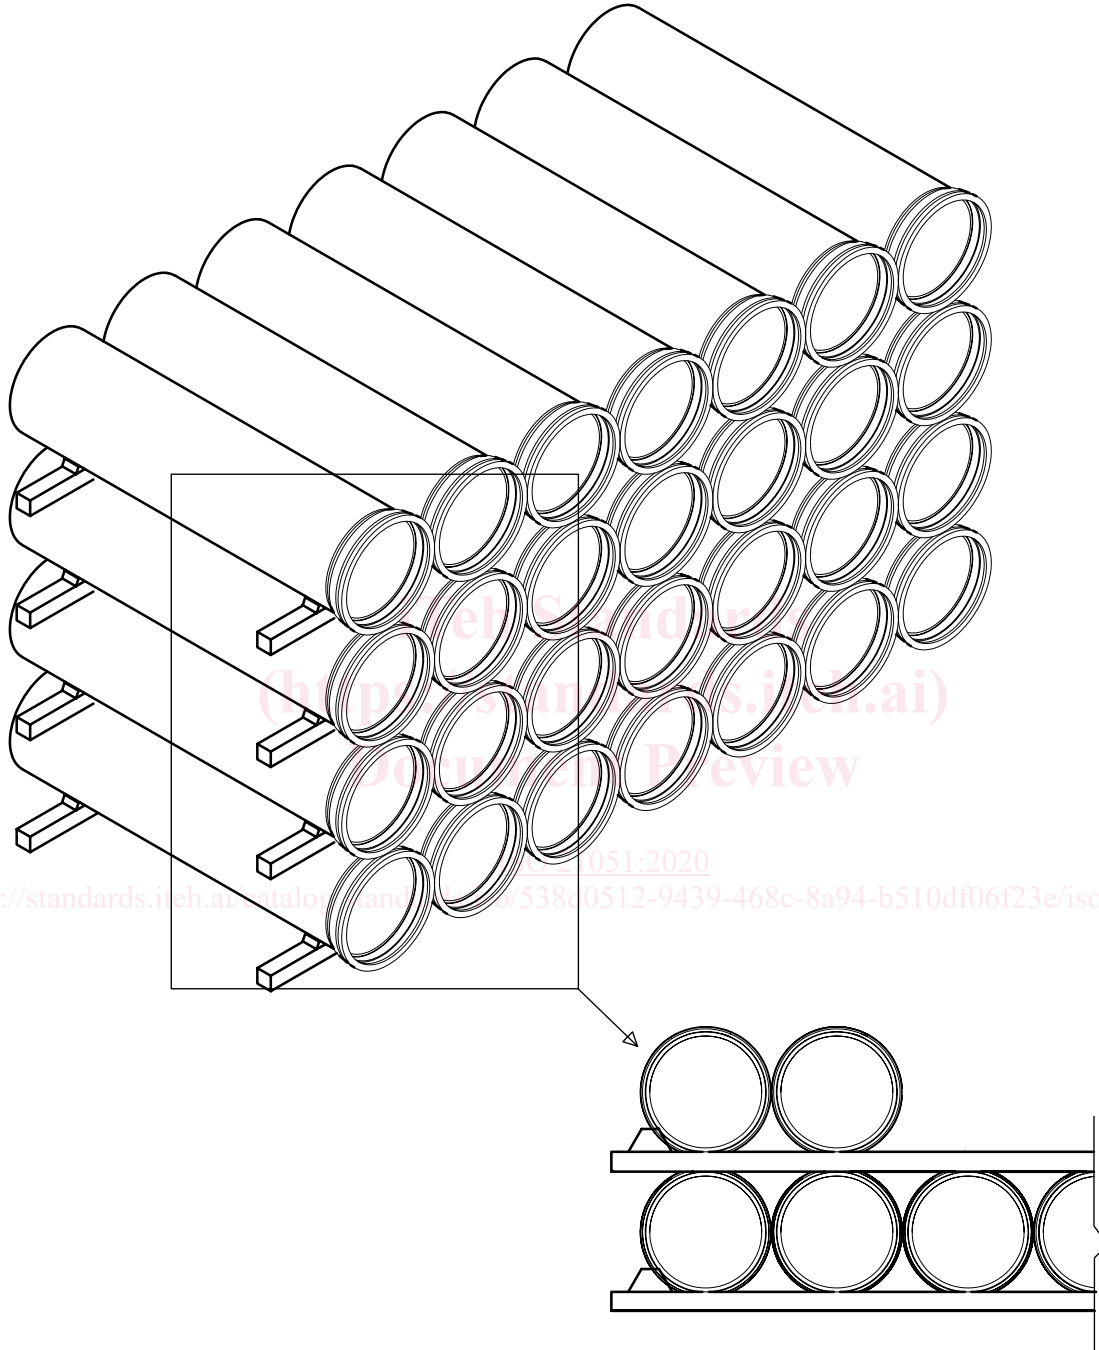
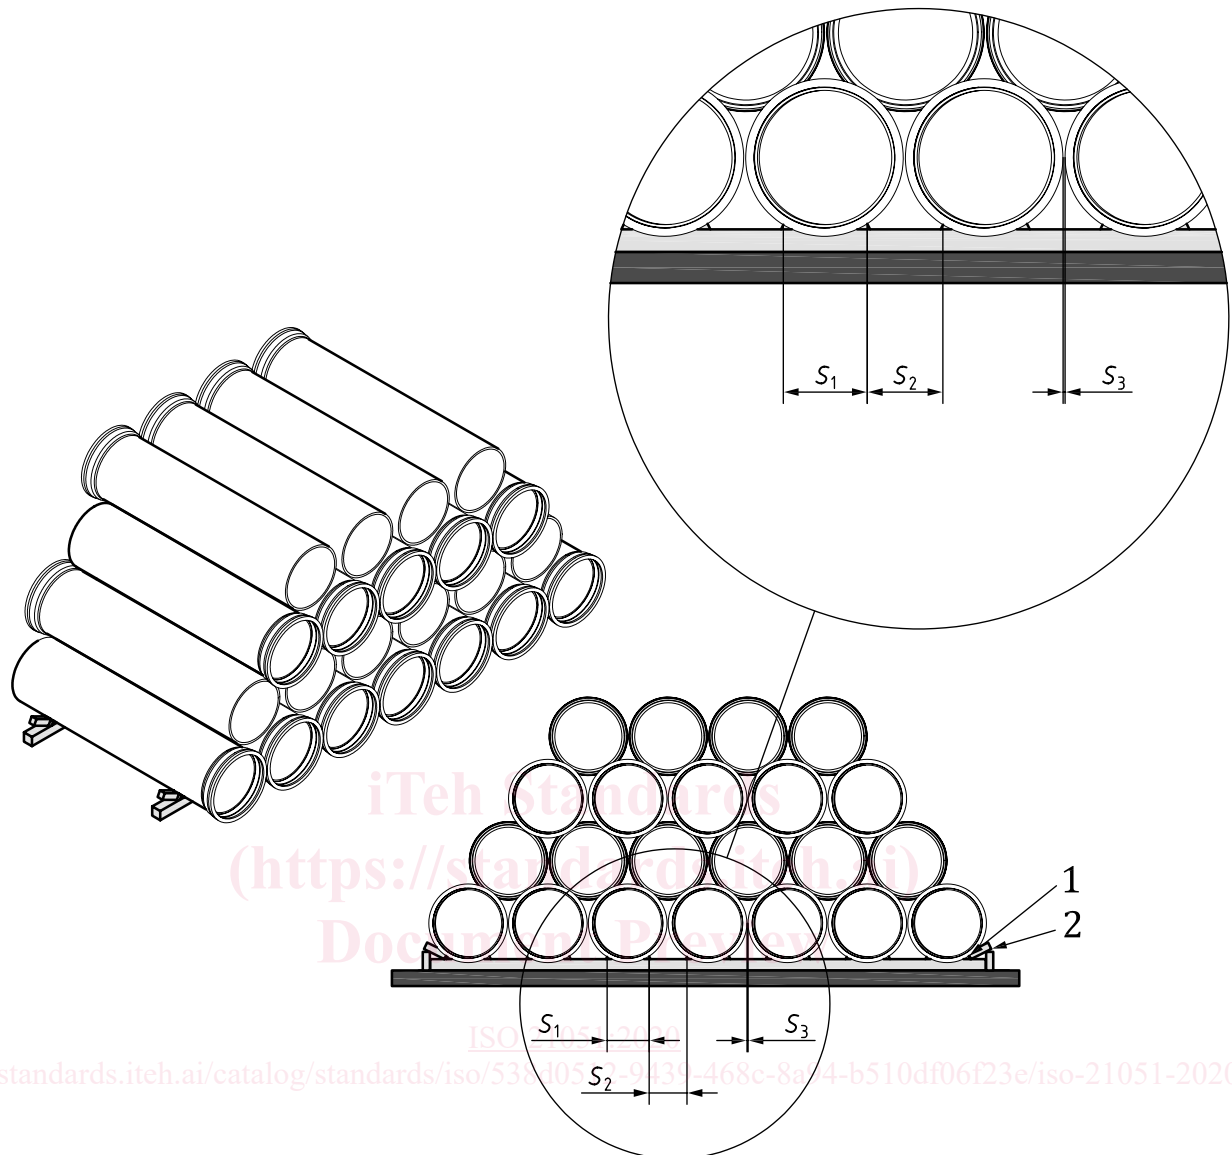


Figure 3 — Parallel stacking of pipes

6.2.3.3 Storage of non-bundled pipes — Pyramid stacking

This method of storing (see [Figure 4](#)) is suggested from the safety point of view and cost of materials used for storing. This method of storage requires end lifting of pipes with hooks and a number of pipes can be lifted using multiple hooks.

**Key**

- 1 triangle wedge
- 2 stopper
- S_1 spacing of triangular wedges of each individual pipe
- S_2 spacing between triangular wedges of adjacent pipe at bottom
- S_3 spacing between two adjacent pipes at socket face position (to ensure proper socket segregation)

Figure 4 — Pyramid stacking of pipes

The bottom layer is laid on two timbers, arranged in parallel, one being 1 m from the socket end and the other 1 m from the spigot end. The pipes are also parallel with one another. The pipes at the two ends are secured at the sockets and spigots with large wooden wedges nailed to the timbers. Strong stopper shall be used at both ends of the bottom layer to avoid stock collapse. Dimensions of S_1 , S_2 and S_3 shall be decided to ensure proper socket segregation of pipes in the same tier.

The upper layers consist of pipes laid alternatively, socket to spigot, with the sockets in one tier overhanging the spigots of the pipes in the tier below. All the sockets of one tier overhang the spigots of the tier below by approximately 10 cm, thus avoiding the deformation of the spigots.

6.2.3.4 Storage of non-bundled pipes — Square stacking

In this method, in the bottom layer, the tier of first layer is similar to pyramid stacking, but the sockets should be alternatively turned to one side and then to the other side. In addition, the sockets should overhang the spigots of adjacent pipes by the whole socket length, plus 5 cm. In the upper layers, each tier consists of parallel pipes, alternating as in the bottom layer. The pipes in one tier are placed perpendicular to the pipes in the tier below. Further, the spigots of the pipes are naturally wedged in by the sockets of the pipes in the tier immediately below. This method keeps packing material to be minimum, but due to the stack formation, implies individual lifting of pipes by their ends.

The maximum number of layers for each size and type of pipes shall be decided based on the consideration of no deformation in the spigot due to the load above. It is suggested to follow manufacturer’s recommendations. However, suggested number of layers for stacking in different methods of stacking is given in [Table 1](#):

Table 1 — Stacking of pipes - Suggested maximum number of layers

Serial No.	Nominal pipe size (DN)	Class of pipe	Number of layers in parallel stacking	Number of layers in pyramid stacking	Number of layers in square stacking
1	80	C40	30	50	30
2	100	C40	27	38	27
3	125	C40	22	30	22
4	150	C40	22	26	22
5	200	C40	18	20	18
6	250	C40	16	16	16
7	300	C40	14	13	14
8	350	C30	12	12	12
9	400	C30	11	11	11
10	450	C30	9	10	9
11	500	C30	8	9	8
12	600	C30	7	8	7
13	700	C25	5	7	5
14	800	C25	4	6	4
15	900	C25	4	5	4
16	1 000	C25	3	4	3
17	1 100	C25	3	3	3
18	1 200	C25	2	3	2
19	1 400	C25	2	3	2
20	1 500	C25	2	2	2
21	1 600	C25	1	2	1
22	1 800	C25	1	2	1
23	2 000 to 2 600	C25	1	2	1

NOTE For other classes, a separate calculation is necessary to arrive at the safe number of layers for stacking.

6.2.3.5 Storage of gaskets

Gaskets shall be stored in cool, dry place without being subjected to any deformation. Gaskets should be protected from the direct sunlight. Care shall be taken to ensure that they are not damaged and do not get dirty. The shelf life of the gaskets should be as per the manufacturer’s recommendations. The expired gaskets should not be used in the pipe installation.