
**Restrained joint systems for ductile
iron pipelines — Calculation rules for
lengths to be restrained**

*Systèmes d'assemblages verrouillés pour canalisations en fonte
ductile — Règles de calcul pour les longueurs à verrouiller*

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO 21052:2021](https://standards.iteh.ai/catalog/standards/sist/164f854f-efae-4e6c-a53d-a4a9794bbbe1/iso-21052-2021)

[https://standards.iteh.ai/catalog/standards/sist/164f854f-efae-4e6c-a53d-
a4a9794bbbe1/iso-21052-2021](https://standards.iteh.ai/catalog/standards/sist/164f854f-efae-4e6c-a53d-a4a9794bbbe1/iso-21052-2021)



iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 21052:2021

<https://standards.iteh.ai/catalog/standards/sist/164f854f-efae-4e6c-a53d-a4a9794bbbe1/iso-21052-2021>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2021

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	v
1 Scope	1
2 Normative references	1
3 Terms, definitions and symbols	1
3.1 Terms and definitions.....	1
3.2 Symbols.....	3
4 Thrust restraint principles, calculation rules and general specification	4
4.1 Thrust forces.....	4
4.2 Calculation rules and general specification.....	4
4.3 Standard jointing systems offer no longitudinal restraint.....	5
4.4 Restrained joint systems.....	5
4.5 Length to be restrained.....	5
4.6 Restrained design method.....	5
4.7 Gravity thrust blocks.....	6
5 Thrust force	6
5.1 Internal hydrostatic pressure in straight pipes.....	6
5.2 Internal hydrostatic pressure in bends.....	6
5.3 Internal hydrostatic pressure in other configurations.....	7
6 Restrained joints	8
6.1 Principle.....	8
6.2 Conservative design.....	8
6.3 Required prevailing site conditions.....	8
7 Unit frictional force, F_s	8
7.1 Static frictional force.....	8
7.2 Values of soil cohesion.....	9
8 Polyethylene encasement and PU coating and other extruded organic coatings	10
9 Unit bearing resistances, R_s	10
9.1 Lateral resistance, passive soil pressure.....	10
9.2 Design value of passive soil pressure.....	10
9.3 Empirical values of passive soil pressure.....	11
10 Application to common situations	14
10.1 Horizontal bends.....	14
10.2 Vertical down bends.....	15
10.3 Vertical up bends.....	15
10.4 Tees.....	16
10.5 Reducers.....	17
10.6 Dead ends.....	17
10.7 Encroaching restrained lengths.....	17
10.8 Equal angle vertical offset (θ).....	18
10.9 Combined horizontal equal angle bends (θ).....	19
10.10 Combined horizontal unequal angle bends.....	20
10.11 Combined vertical equal angle offsets (θ).....	21
10.11.1 Pipeline under obstruction.....	21
10.11.2 Pipeline over obstruction.....	22
11 Restrained lengths	22
12 Installation and laying instruction	22
12.1 Select backfill considerations.....	22
12.1.1 Backfill material versus native soil support characteristics.....	22
12.1.2 Swamps or marshes.....	22
12.2 Combining thrust blocks/anchor blocks and restrained joints.....	22

12.3	Pipe in a casing.....	23
12.3.1	Restrained lengths inside casing.....	23
12.3.2	Balancing the thrust force with restraining lengths outside the casing.....	23
12.4	Future excavations.....	23
Annex A	(informative) Dimensions and unit weights of pipes filled with water for preferred class.....	24
Annex B	(informative) Soil classification chart.....	25
Bibliography	26

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO 21052:2021](https://standards.iteh.ai/catalog/standards/sist/164f854f-efae-4e6c-a53d-a4a9794bbbe1/iso-21052-2021)

<https://standards.iteh.ai/catalog/standards/sist/164f854f-efae-4e6c-a53d-a4a9794bbbe1/iso-21052-2021>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see www.iso.org/iso/foreword.html (standards.iteh.ai)

This document was prepared by Technical Committee ISO/TC 5, *Ferrous metal pipes and metallic fittings*, Subcommittee SC 2, *Cast iron pipes, fittings and their joints*.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 21052:2021

<https://standards.iteh.ai/catalog/standards/sist/164f854f-efae-4e6c-a53d-a4a9794bbbe1/iso-21052-2021>

Restrained joint systems for ductile iron pipelines — Calculation rules for lengths to be restrained

1 Scope

This document specifies a computation method used to determine the length of the ductile iron pipes to be restrained, when used for conveying raw water, drinking water, sewerage under pressure.

This computation method takes into account all common pipeline route changes, including changes in the diameter of the pipeline itself and dead ends at the extremity of the pipeline, the outside diameter of the pipe, the system test pressure (to estimate the thrust), depth of cover, the characteristics of the soil surrounding the pipe and trench backfilling methods for a worldwide usage. The characteristics of the restrained joint are not covered by this document but can also be considered to determine the restraining length using any appropriate method.

The computation method defined in this document is applicable to all types of restrained joint systems, with their operating pressure ratings of ductile iron pipelines complying with ISO 2531, ISO 7186 and ISO 16631.

NOTE 1 ISO 10804 deals with actual design of the joint for various operating pressures of the pipeline.

NOTE 2 National standards or established calculation methods can be used instead of this ISO standard.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 2531, *Ductile iron pipes, fittings, accessories and their joints for water applications*

ISO 7186, *Ductile iron products for sewerage applications*

ISO 10804, *Restrained joint systems for ductile iron pipelines — Design rules and type testing*

ISO 16631, *Ductile iron pipes, fittings, accessories and their joints compatible with plastic (PVC or PE) piping systems, for water applications and for plastic pipeline connections, repair and replacement*

3 Terms, definitions and symbols

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 2531, ISO 10804 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

— ISO Online browsing platform: available at <https://www.iso.org/obp>

— IEC Electropedia: available at <http://www.electropedia.org/>

3.1.1

mechanical flexible joint

flexible joint in which sealing is obtained by applying pressure to the gasket by mechanical means

3.1.2

push-in flexible joint

flexible joint assembled by pushing the spigot through the gasket into the socket of the mating component

3.1.3

restrained joint

joint in which a means is provided to prevent longitudinal separation of the assembled joint

3.1.4

maximum design pressure

MDP

P_{MD}

maximum operating pressure of the system or of the pressure zone fixed by the designer considering future developments and including surge

Note 1 to entry: It is the maximum pressure considering the design pressure and surge together, where:

- MDP is designated $MDPa$, P_{MDa} , fixed allowance for surge (secondary distribution networks);
- MDP is designated $MDPc$, P_{MDc} , surge is calculated (pumping & water mains).

[SOURCE: ISO 10802:2020, 3.6]

3.1.5

system test pressure

STP

P_{ST}

pressure to which a pipeline or a pipeline section is subjected for testing purposes

Note 1 to entry:

- $PST = 1,5 \times PD$ (when $PMD \leq 10$ bar), or
- $PST = PD + 5$ (when $PMD > 10$ bar)

where P_D is the design pressure.

Note 2 to entry: 1 bar is equivalent to 0,1 MPa.

[SOURCE: ISO 10802:2020, 3.7, modified — The original note 2 to entry has been replaced by a new one.]

3.1.6

thrust force

unbalanced hydrostatic force developed at the locations of a pipeline, changing diameter or direction

3.1.7

bearing resistance

passive pressure that is generated as the pipeline attempts to separate and move into the soil

3.1.8

frictional resistance

resisting force resulting from the interaction of the pipeline with the soil encountered on the project site and the pipeline laying conditions

3.1.9

passive soil pressure

maximum pressure that the soil imparts on a structure at the prescribed depth

Note 1 to entry: The passive soil pressure is dependent upon the compaction of the soil.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 21052:2021

<https://standards.iteh.ai/catalog/standards/sist/164f854f-efae-4e6c-a53d-a4a9794bbbe1/iso-21052-2021>

3.1.10**restrained length**

minimum length to be restrained in order to balance *thrust forces* (3.1.6) and prevent disassembly or separation of the pipeline

3.2 Symbols

A	cross-sectional area of pipe, in m^2
A_p	surface area of the pipe bearing on the soil, in m^2/m
C	pipe-soil cohesion, equals $f_c C_s$, in kN/m^2 ;
C_s	soil cohesion, in kN/m^2 (see Table 2)
D_e	outside diameter of pipe spigot, in m (see Annex A)
f_c	ratio of pipe-soil cohesion to soil cohesion (see Table 2)
F_f	unit frictional resistance, in kN/m
F_s	unit frictional force assuming 1/2 the pipe circumference bears against the soil, in kN/m
$(F_s)_b$	unit frictional force assuming the entire pipe circumference contacts the soil, in kN/m
f_φ	ratio of pipe-soil friction angle to soil friction angle (see Table 2)
h	thrust block height, in m
H	depth of cover to top of pipe, in m
H_c	depth of cover to pipe centreline, in m
K_n	trench condition modifier (see Table 2)
L	minimum required restrained pipe length, in m
N_φ	$= \tan^2 (45^\circ + \varphi/2)$
P	system test pressure, in kN/m^2
P_p	passive soil pressure, in kN/m^2
R_s	unit bearing resistance, in kN/m
T	resultant thrust force, in kN
γ	backfill soil density, in kN/m^3 (see Table 2)
W	unit normal force on pipe = $2 W_e + W_p + W_w$, in kN/m
W_e	earth prism load = $\gamma H D_e$, in kN/m
W_p	unit weight of pipe, in kN/m (see Annex A)
W_w	unit weight of water, kN/m (see Annex A)
θ	bend angle, in degrees
δ	pipe-soil friction angle, equals $f_\varphi \varphi$, in degrees;

- φ soil internal friction angle, in degrees (see [Table 2](#))
- S_f safety factor (see [4.2](#))

4 Thrust restraint principles, calculation rules and general specification

4.1 Thrust forces

When underground or above-ground pipelines are in operation, unbalanced hydrostatic or hydrodynamic forces are developed at many locations under the internal pressure of the fluid in the pipeline, this is known as thrust forces. Unless the pipe joints in these areas are restrained against longitudinal movement, joint separation can result. These thrust forces are developed at locations where the pipeline changes either in diameter or in direction. Such locations include horizontal and vertical bends, tees, wyes, reducers, offsets, pipe bifurcations and valves.

At these locations the thrust forces are resisted with thrust blocks at the focus of the thrust force, or by installing a group of restrained joint pipes, in such a way that the unbalanced force is transmitted to the surrounding soil or pedestals (above-ground installation, without overstressing the pipeline wall and without subjecting the pipeline to joint separation).

The present standard studies and provides formulae which enable to balance thrust forces with the adequate quantity of restrained joint pipes.

Proper care shall be taken by the designer when chambers are installed within the restrained length of the pipeline.

The manufacturer’s recommendations for selecting the type of restrained joint shall also be taken into account.

4.2 Calculation rules and general specification

The following parameters shall be taken into account: the cross-sectional area of the pipe ([Table A.1](#)), the pipeline changes generating the thrust force ([Clause 5](#)), the outside diameter of the pipe ([Table A.1](#)), the depth of cover of the pipe (see [Figure 6](#)), the characteristics of the soil surrounding the pipe and the trench backfilling methods ([Clauses 7](#) and [9](#)), the pipeline external coating system (bituminous, epoxy and acrylic paints or polyethylene encased pipe, PU and other extruded coatings - [Clause 8](#)).

The system test pressure (STP) of the pipeline is calculated from the maximum design pressure (MDP) and shall be used to estimate the thrust forces ([Clause 5](#)); and a safety factor of 2 is recommended.

For each pipeline changes and their combination, a specific formula is provided to calculate the length of pipes to be restrained. The list of common situations is provided in [Table 1](#) together with the subclause number:

Table 1 — Type of common situation

Description	Subclause number
Horizontal bends	10.1
Vertical down bends	10.2
Vertical up bends	10.3
Tees	10.4
Reducers	10.5
Dead ends	10.6
Encroaching restrained lengths	10.7
Equal angle vertical offset (θ)	10.8

Table 1 (continued)

Description	Subclause number
Combined horizontal equal angle bends (θ)	10.9
Combined horizontal unequal angle bends	10.10
Combined vertical equal angle offsets (θ)	10.11
Pipeline under obstruction	10.11.1
Pipeline over obstruction	10.11.2

4.3 Standard jointing systems offer no longitudinal restraint


Ductile iron pipes and fittings are most often joined with push-in or mechanical flexible joints (Figure 1). Neither of these joints provide significant restraint against longitudinal separation other than the friction, between the gasket and the plain end of the pipe or fitting. Tests have shown that this frictional resistance of these joints are unpredictable. Thus, these joints should be considered as offering no longitudinal restraint for design purposes.

4.4 Restrained joint systems

The primary objective of the restrained joint system is to design a system to transmit the unbalanced forces to the surrounding soil without overstressing the pipeline wall and without subjecting the pipeline to joint separation. In order to accomplish the transfer of the unbalanced forces, the friction and passive resistance have been relied upon.

4.5 Length to be restrained

The length of the pipe, with restrained joints on each side of the focus of a thrust force, is calculated using the sum of the components of the unbalanced forces in the direction of the corresponding leg. The objective of the thrust restraint design using a restrained joint system is to extend the side of the fitting with inseparable joints so that the fitting can transmit the unbalanced forces to the surrounding soil.

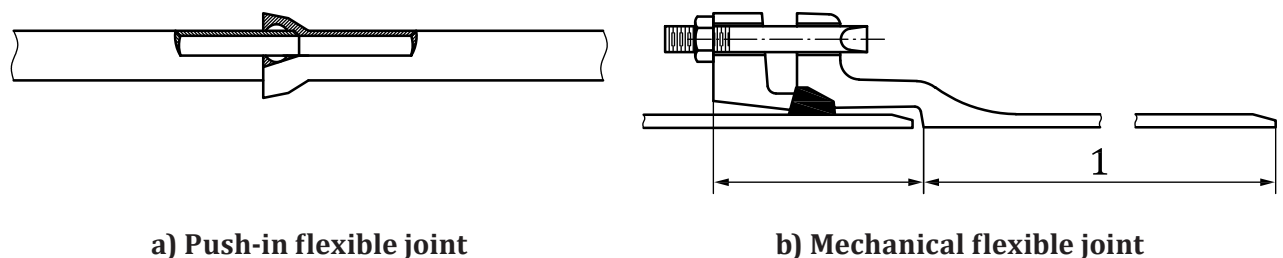

Key

1 nominal laying length

Figure 1 — Push-in and mechanical flexible joints

4.6 Restrained design method

This document shows the method to calculate the quantum of thrust forces for the most common situations and the approaches to the design of restrained joint systems for balancing these forces. The suggested design approaches are conservatively based on accepted principles of soil mechanics.

4.7 Gravity thrust blocks

The design of gravity thrust blocks to counter the thrust forces in pipeline systems is not covered by this document. Thrust blocks/anchor blocks should not interfere with the angular deflection and axial movement of restrained joints as prescribed by the manufacturer.

5 Thrust force

5.1 Internal hydrostatic pressure in straight pipes

The internal hydrostatic pressure acts perpendicularly on any plane with a force equal to the pressure (P) times the area (A) of the plane. All components of these forces acting radially within a pipe are balanced by circumferential tension in the wall of the pipe. Axial components acting on a plane perpendicular to the pipe through a straight section of the pipe are balanced internally by the force acting on each side of the plane (Figure 2).

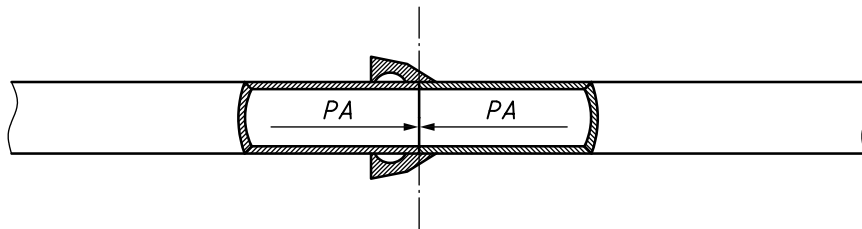


Figure 2 — Internally balanced force
(standards.iteh.ai)

5.2 Internal hydrostatic pressure in bends

In the case of a bend as shown in Figure 3, the forces PA acting axially along each side of the bend are not balanced. The vector sum of these forces is shown as T . This is the thrust force. In order to prevent separation of the joints, a reaction equal to and in the opposite direction of T , shall be established.

$$T = 2PA \sin \frac{\theta}{2} \quad (1)$$

where

- T is the resultant thrust force, in kN;
- P is the system test pressure, in kN/m²;
- A is the cross-sectional area of pipe, in m²;
- θ is the bend angle, in degrees.