



SLOVENSKI STANDARD
SIST HD 60364-8-1:2019/AC:2019
01-september-2019

Nizkonapetostne električne inštalacije - 8-1. del: Energijska učinkovitost - Popravek AC

Low-voltage electrical installations - Part 8-1: Functional aspects - Energy efficiency

Errichten von Niederspannungsanlagen - Teil 8-1: Funktionale Aspekte - Energieeffizienz

Installations électriques à basse tension - Partie 8-1: Fonctionnalité - Efficacité énergétique

ITeH STANDARD PREVIEW
(standards.iteh.ai)

Ta slovenski standard je istoveten z: HD 60364-8-1:2019/AC:2019-06

SIST HD 60364-8-1:2019/AC:2019
<https://standards.iteh.ai/catalog/standards/sist/91dc521f-ead4-4451-8e38-08d5f38040d8/sist-hd-60364-8-1-2019-ac-2019>

ICS:

27.015	Energijska učinkovitost. Ohranjanje energije na splošno	Energy efficiency. Energy conservation in general
91.140.50	Sistemi za oskrbo z elektriko	Electricity supply systems

SIST HD 60364-8-1:2019/AC:2019 **en**

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST HD 60364-8-1:2019/AC:2019

<https://standards.iteh.ai/catalog/standards/sist/91dc521f-ead4-4451-8e38-08d5f38040d8/sist-hd-60364-8-1-2019-ac-2019>

HARMONIZATION DOCUMENT
DOCUMENT D'HARMONISATION
HARMONISIERUNGSDOKUMENT

HD 60364-8-1:2019/AC:2019-06

June 2019

ICS 13.020.01; 27.015; 91.140.50

English Version

**Low-voltage electrical installations - Part 8-1: Functional aspects
- Energy efficiency
(IEC 60364-8-1:2019/COR1:2019)**

Installations électriques à basse tension - Partie 8-1:
Fonctionnalité - Efficacité énergétique
(IEC 60364-8-1:2019/COR1:2019)

Errichten von Niederspannungsanlagen - Teil 8-1:
Funktionale Aspekte - Energieeffizienz
(IEC 60364-8-1:2019/COR1:2019)

This corrigendum becomes effective on 14 June 2019 for incorporation in the English language version of the HD.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST HD 60364-8-1:2019/AC:2019](https://standards.iteh.ai/catalog/standards/sist/91dc521f-ead4-4451-8e38-08d5f38040d8/sist-hd-60364-8-1-2019-ac-2019)
<https://standards.iteh.ai/catalog/standards/sist/91dc521f-ead4-4451-8e38-08d5f38040d8/sist-hd-60364-8-1-2019-ac-2019>



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Endorsement notice

The text of the corrigendum IEC 60364-8-1:2019/COR1:2019 was approved by CENELEC as HD 60364-8-1:2019/AC:2019-06 without any modification.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST HD 60364-8-1:2019/AC:2019](https://standards.iteh.ai/catalog/standards/sist/91dc521f-ead4-4451-8e38-08d5f38040d8/sist-hd-60364-8-1-2019-ac-2019)

<https://standards.iteh.ai/catalog/standards/sist/91dc521f-ead4-4451-8e38-08d5f38040d8/sist-hd-60364-8-1-2019-ac-2019>

INTERNATIONAL ELECTROTECHNICAL COMMISSION

IEC 60364-8-1
Edition 2.0 2019-02LOW-VOLTAGE ELECTRICAL INSTALLATIONS –
Part 8-1: Functional aspects – Energy efficiency

CORRIGENDUM 1

2 Normative references

Replace the reference to IEC 61557-12:2007 with the following new reference:

IEC 61557-12, *Electrical safety in low voltage distribution systems up to 1 000 V AC and 1 500 V DC – Equipment for testing, measuring or monitoring of protective measures – Part 12: Power metering and monitoring devices (PMD)*

(standards.iteh.ai)

4.1.3 Design principles

Replace the first dashed list item with the following new item:
– load energy profile (active and reactive energy);

8.3.1.2 Requirements on accuracy and measuring range

Table 1

In the first row, second column, replace "IEC 62052-22" with "IEC 62053-22". In the second and third rows, third column, replace "PMD-1", "PMD-2" and "PMD-3" with "PMD-I", "PMD-II" and "PMD-III" respectively, as shown:

Measurement application	Applicable IEC product standards	Device name according to standards	Usual device name	Complementary explanations
Billing (Contractual)	or IEC 62053-21 or IEC 62053-22	Electricity metering equipment	Revenue meter, electricity meter, utility meter	Energy metering for billing applications (e.g. utility invoicing a landlord or a mall owner, sub-billing to tenants)
Energy usage analysis	IEC 61557-12 ^a	Power metering and monitoring device (PMD-I or PMD-II or PMD-III)	Power meter, energy meter	Energy cost and usage analysis (for cost allocation or sub-billing within a company or for energy efficiency purposes)
Power monitoring	IEC 61557-12 ^b	Power metering and monitoring device (PMD-II or PMD-III)	Power meter, energy meter	Demand side power quality analysis and energy cost and usage analysis


Energy estimation		Indicator or sensor	Energy estimator	Devices for giving information needed to correctly operate the energy management system, for example running time of equipment, number of operation, basic measurement
<p>^a Devices used for power quality monitoring, when they provide active energy measurement function, can be used for energy usage analysis.</p> <p>^b Devices used for power quality monitoring in accordance with IEC 62586-1 can be used for power monitoring especially where comparable measurements are needed.</p> <p>NOTE Other information such as occupancy, number of operations, manufacturing figures, is provided by different instruments and are covered by other standards.</p>				

8.3.1.3 Measurement

Replace, in the 3 dashed list items, in the third paragraph, "PMD-1", "PMD-2" and "PMD-3" with "PMD-I", "PMD-II" and "PMD-III" respectively.

Figure 3

Replace Figure 3, including the Key, with the following new Figure 3 and Key:

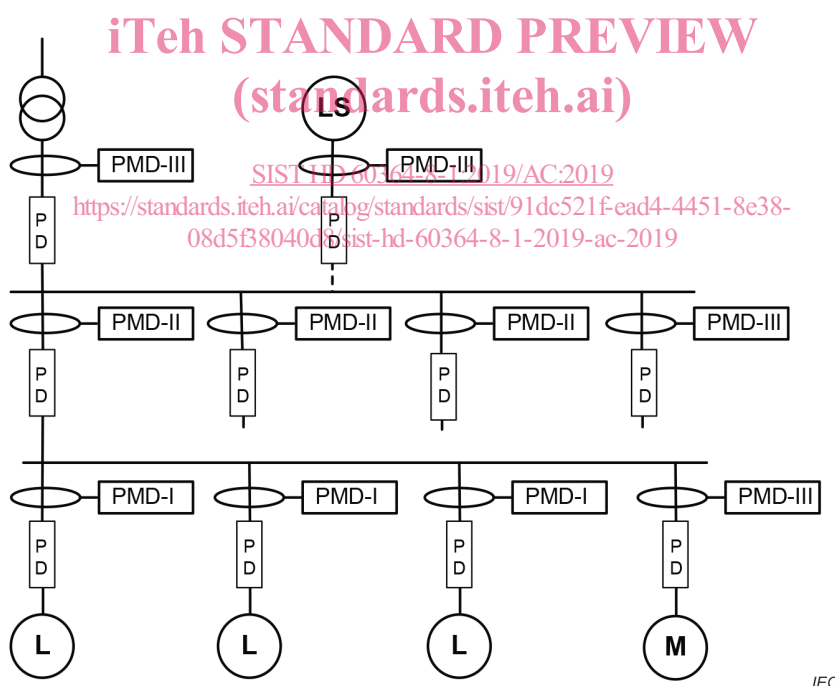

Key

Symbol	Function
PMD	power metering and monitoring device
PMD-I	PMD including at least: E_a
PMD-II	PMD including at least: P , Q , S , E_a , E_r , f , I , U and/or V , PF ,
PMD-III	PMD including at least: P , Q , S , E_a , E_r , E_{ap} , f , I , I_N , U and/or V , PF , THD_U and/or THD_V and/or $THD-R_U$ and/or $THD-R_V$, THD_I and/or $THD-R_I$
P	total active power
E_a	total active energy
Q	total reactive power
S	total apparent power

	E_r	total reactive energy
	E_{ap}	total apparent energy
	f	frequency
	I	line current
	I_N	neutral current
	U	line to line voltage
	V	line to neutral voltage
	PF	power factor
	THD_U	total harmonic distortion voltage related to fundamental
	$THD-R_U$	total harmonic distortion voltage related to RMS value
	THD_I	total harmonic current related to fundamental
	$THD-R_I$	total harmonic current related to RMS value
PD		protective device with isolation function
M		motor
L		load
LS		local power supply (e.g. PV, wind turbine, generator) (if present)

Figure 3 – Example of measurement equipment selection in an installation

9.1 Methodology **iTeh STANDARD PREVIEW** (standards.iteh.ai)

Figure 4

Replace Figure 4 with the following new Figure 4:

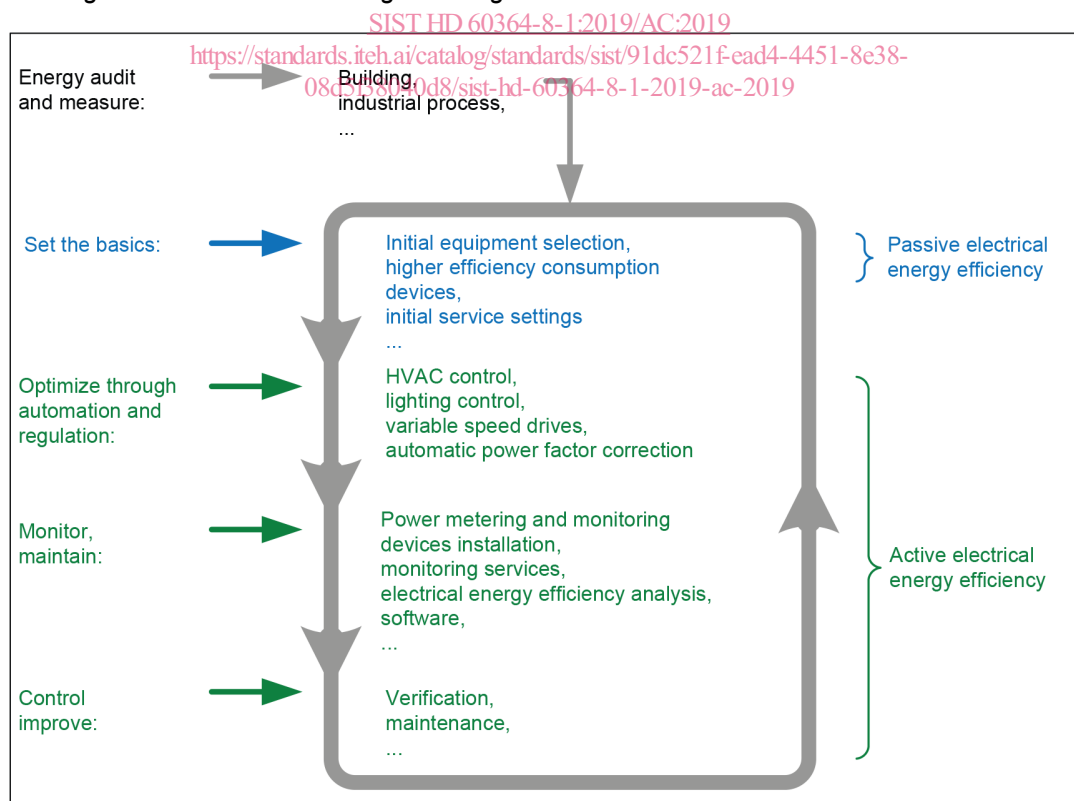


Figure 4 – Iterative process for electrical energy efficiency management

B.3.2.2.1 Parameter II01: determination of energy consumption**Table B.3**

In the first column, last row, replace "> 90 %" with "≥ 90 %" as shown:

Table B.3 – Determination of energy consumption: coverage

K_1	Points for industrial building	Points for commercial building	Points for infrastructure
< 50 %	0	0	0
≥ 50 % and < 65 %	1	1	1
≥ 65 % and < 75 %	2	2	2
≥ 75 % and < 83 %	4	4	4
≥ 83 % and < 90 %	6	5	6
≥ 90 %	7	6	7

B.3.2.2.2 Parameter II02: consumption and location of the main substation**Table B.4**

In the first column, last row, replace "> 90 %" with "≥ 90 %" as shown:

Table B.4 – Main substation: consumption

% of consumption vs total consumption	Points for industrial building	Points for commercial building	Points for infrastructure
< 50 %	0	0	0
≥ 50 % and < 70 %	2	1	2
≥ 70 % and < 83 %	4	2	4
≥ 83 % and < 90 %	5	3	5
≥ 90 %	6	4	6

B.3.2.2.3 Parameter II03: voltage drop**Table B.6**

In the first column, last row, replace "< 1 %" with "≤ 1 %" as shown:

Table B.6 – Voltage drop

K_{VD}	Points for industrial building	Points for commercial building	Points for infrastructure
> 5 %	0	0	0
≤ 5 % and > 3 %	1	1	1
≤ 3 % and > 2 %	2	2	2
≤ 2 % and > 1,5 %	4	4	4
≤ 1,5 % and > 1 %	5	5	5
≤ 1 %	6	6	6

B.3.2.2.5 Parameter II05: efficiency of fixed installed current using equipment**Table B.8**

In the first column, first row, replace "< 1,2" with "≥ 1,2" as shown: