
**Test method to measure the efficiency
of air filtration media against
spherical nanomaterials —**

**Part 1:
Size range from 20 nm to 500 nm**

*Méthode d'essai pour mesurer l'efficacité des médias de filtration
d'air par rapport aux nanomatériaux sphériques —
Partie 1: Spectre granulométrique de 20 nm à 500 nm*

ISO 21083-1:2018

<https://standards.iteh.ai/catalog/standards/sist/b7f545f0-03e5-4791-bd67-f9380dcd670e/iso-21083-1-2018>



iTeh STANDARD PREVIEW (standards.iteh.ai)

ISO 21083-1:2018

<https://standards.iteh.ai/catalog/standards/sist/b7f545f0-03e5-4791-bd67-f9380dcd670e/iso-21083-1-2018>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2018

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

Page

Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms, definitions, symbols and abbreviated terms	1
3.1 Terms and definitions	1
3.2 Symbols and abbreviated terms	2
4 Principle	3
5 Test materials	4
5.1 General	4
5.2 Liquid phase aerosol	4
5.2.1 DEHS test aerosol	4
5.2.2 Liquid phase aerosol generation	5
6 Test setup	6
6.1 General	6
6.2 Specification of setup	8
6.2.1 Aerosol generation system	8
6.2.2 Tubing	8
6.2.3 Dryer	8
6.2.4 DEMC	9
6.2.5 Equilibrium charge distribution and neutralization of aerosol particles	11
6.2.6 Neutralization of aerosol particles	11
6.2.7 Make-up air line	12
6.2.8 Test filter medium mounting assembly	13
6.2.9 CPC	14
6.2.10 Final filter	16
6.3 Detailed setup for test using DEHS particles	16
6.4 Determination of the filter medium velocity	17
7 Qualification of the test rig and apparatus	17
7.1 CPC tests	17
7.1.1 CPC — Air flow rate stability test	17
7.1.2 CPC — Zero test	18
7.1.3 CPC — Overload test	18
7.1.4 Counting accuracy calibration	18
7.2 DEMC tests	21
7.3 Qualification of aerosol neutralization	21
7.3.1 General	21
7.3.2 Qualification of neutralization by checking the multiple charge fraction on the particles passing through the neutralizer	21
7.3.3 Qualification of the aerosol neutralizer using corona discharge balanced output	21
7.3.4 Qualification of neutralization according to ISO/TS 19713-1	22
7.4 System leak checks	22
7.4.1 Air leakage tests	22
7.4.2 Visual detection by cold smoke	22
7.4.3 Pressurization of the test system	22
7.4.4 Use of high efficiency filter media	22
7.5 Uniformity of the test aerosol concentration	22
8 Test procedure	23
8.1 Determination of the correlation ratio/zero efficiency test	23
8.2 Protocol of filtration efficiency measurement	24

8.2.1	Preparatory checks	24
8.2.2	Equipment preparation	24
8.2.3	Aerosol generator	24
8.2.4	Aerosol generator — Neutralizer	25
8.2.5	Filter medium neutralization	26
8.2.6	Filter medium neutralization according to ISO 29461-1	26
8.2.7	Air flow measurement	28
8.2.8	Measurement of the pressure drop	29
8.2.9	Zero count test	29
8.2.10	Air leakage test	29
8.2.11	Loading effect test	29
8.2.12	Reported values	29
8.2.13	Measurement of filtration efficiency — DEHS particles	29
8.3	Test evaluation	31
8.4	Measurement protocol for one sample — Summary	31
8.4.1	Using one CPC to measure the upstream and downstream particle concentrations	31
8.4.2	Using two CPCs to measure the upstream and downstream particle concentrations	32
9	Maintenance items	33
10	Measurement uncertainties	34
11	Reporting results	35
11.1	General	35
11.2	Required reporting elements	35
11.2.1	General	35
11.2.2	Report summary	35
11.2.3	Report Details	36
Annex A (informative)	Instruments specifications	40
Annex B (informative)	Statistical analysis for precision of an experiment (according to ISO 5725-2)	44
Annex C (informative)	Safe use of IPA	49
Annex D (informative)	Safe handling of radioactive devices	50
Bibliography		51

ITeH STANDARD PREVIEW
(standards.iteh.ai)

ISO 21083-1:2018

<https://standards.iteh.ai/catalog/standards/sist/b7f545f0-03e5-4791-bd67-89689d46791c/iso-21083-1-2018>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see www.iso.org/iso/foreword.html.

This document was prepared by the European Committee for Standardization (CEN) Technical Committee CEN/TC 195, *Air filters for general cleaning*, in collaboration with ISO Technical Committee TC 142, *Cleaning equipment for air and other gases*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

A list of all parts in the ISO 21083 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

Nano-objects are discrete piece of material with one, two or three external dimensions in the nanoscale (see ISO/TS 80004-2) and are building blocks of nanomaterials. Nanoparticles, referring to particles with at least one dimension below 100 nm, generally have a higher mobility than larger particles. Because of their higher mobility and larger specific surface area, available for surface chemical reactions, they can pose a more serious health risk than larger particles. Thus, particulate air pollution with large concentrations of nanoparticles can result in an increased adverse effect on human health and an increased mortality (see Reference [17]).

With the increased focus on nanomaterials and nanoparticles, the filtration of airborne nanoparticles is also subject to growing attention. Aerosol filtration can be used in diverse applications, such as air pollution control, emission reduction, respiratory protection for human and processing of hazardous materials. The filter efficiency can be determined by measuring the testing particle concentrations upstream and downstream of the filter. The particle concentration may be based on mass, surface area or number. Among these, the number concentration is the most sensitive parameter for nanoparticle measurement. State-of-the-art instruments enable accurate measurement of the particle number concentration in air and therefore precise fractional filtration efficiency. Understanding filtration efficiency for nanoparticles is crucial in schemes to remove nanoparticles, and thus, in a wider context, improve the general quality of the environment, including the working environment.

A large number of standards for testing air filters exist such as the ISO 29463 series and the ISO 16890 series. The test particle range in the ISO 29463 series is between 0,04 µm and 0,8 µm, and the focus is on measurement of the minimum efficiency at the most penetrating particle size (MPPS). The test particle range in the ISO 16890 series is between 0,3 µm and 10 µm. The ISO 21083 series aims to standardize the methods of determining the efficiencies of filter media, of all classes, used in most common air filtration products and it focuses on filtration efficiency of airborne nanoparticles, especially for particle size down to single-digit nanometres.

ISO 21083-1:2018

<https://standards.iteh.ai/catalog/standards/sist/b7f545f0-03e5-4791-bd67-f9380dcd670e/iso-21083-1-2018>

Test method to measure the efficiency of air filtration media against spherical nanomaterials —

Part 1: Size range from 20 nm to 500 nm

1 Scope

This document specifies the testing instruments and procedure for determining the fractional filtration efficiencies of flat sheet filter medium against airborne nanoparticles in the range of 20 nm to 500 nm. The testing methods in this document are limited to spherical or nearly-spherical particles to avoid uncertainties due to the particle shape.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 5167 (all parts), *Measurement of fluid flow by means of pressure differential devices inserted in circular cross-section conduits running full*

ISO 5725-2, *Accuracy (trueness and precision) of measurement methods and results — Part 2: Basic method for the determination of repeatability and reproducibility of a standard measurement method*

ISO 15900, *Determination of particle size distribution — Differential electrical mobility analysis for aerosol particles*

ISO 27891, *Aerosol particle number concentration — Calibration of condensation particle counters*

ISO 29463-1, *High efficiency filters and filter media for removing particles from air — Part 1: Classification, performance, testing and marking*

ISO 29464, *Cleaning of air and other gases — Terminology*

3 Terms, definitions, symbols and abbreviated terms

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 5725-2, ISO 15900, ISO 27891 and ISO 29464 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <http://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

3.2 Symbols and abbreviated terms

3.2.1 Symbols

Symbol	Definition
A	Source strength of the radioactive source
A_0	Original source strength of the radioactive source
A_f	Effective filtration surface area
C_{up}	Particle concentration upstream of the filter medium
$C_{up,i}$	Concentration of particles with the i_{th} monodisperse size upstream of the filter medium
C_{down}	Particle concentration downstream of the filter medium
$C_{down,i}$	Concentration of particles with the i_{th} monodisperse size downstream of the filter medium
C_{ni}	Concentration of particles after the second DEMC for the particles with i charge(s)
d_d	Diameter of the initial droplet including the solvent
d_p	Diameter of the testing particle after complete evaporation of the solvent
E	Filtration efficiency of the test filter medium
E_i	Filtration efficiency of the test filter medium against the particles with the i_{th} monodisperse size
e	Charge of an electron
ϕ_v	Volume fraction of DEHS in the solution
$t_{0,5}$	Half-life of the radioactive source
N_{up}	Total count of particles upstream of the filter medium in a certain user-defined time interval
$N_{up,i}$	Counts of particles with the i_{th} monodisperse size upstream of the filter medium in a certain user-defined time interval
N_{down}	Total count of particles downstream of the filter medium in a certain user-defined time interval
$N_{down,i}$	Counts of particles with the i_{th} monodisperse size downstream of the filter medium in a certain user-defined time interval
N_{ni}	Total count of particles after the second DEMC for the particles with i charge(s)
n_p	Number of elementary charges
P	Fractional penetration of the test filter medium
P_i	Fractional penetration of particles with the i_{th} monodisperse size for the test filter medium
P_m	Penetration with the filter medium, before applying the correlation ratio
$P_{m,i}$	Measured penetration against particles with the i_{th} monodisperse size when the filter medium is installed in the filter medium holder, before applying the correlation ratio
q	Flow rate through the filter medium
q_e	Air flow rate through the electrometer
R	Correlation ratio
R_i	Correlation ratio for the i_{th} monodisperse particle size, obtained as the penetration without the filter media
R_{es}	Resistance of resistor
t	Time
v_f	Filter medium velocity
V	Voltage
x	Volume of the sampled air
α	Angle for the transition section in the filter medium holder
Δp	Pressure drop across the filter medium
E_0	Initial particulate efficiency of media sample
ΔE_c	Difference in particulate efficiency between E_0 and conditioned efficiency of the media sample
λ	Radioactive decay constant equal to $0,693/t_{0,5}$

3.2.2 Abbreviated terms

AC	Alternating current
CAS	Chemical abstracts service
CL	Concentration limit
CPC	Condensation particle counter
DEHS	Di(2-ethylhexyl) sebacate
DEMC	Differential electrical mobility classifier
DMAS	Differential mobility analysing system
HEPA	High efficiency particulate air
Kr	Krypton
IPA	Isopropyl alcohol
MPPS	Most penetrating particle size
Po	Polonium
PSL	Polystyrene latex
RH	Relative humidity
SRM	Standard reference material

iTech STANDARD PREVIEW
(standards.itech.ai)
ISO 21083-1:2018
<https://standards.itech.ai/catalog/standards/sist/b7f545f0-03e5-4791-bd67-f9380dcd670e/iso-21083-1-2018>

4 Principle

The filtration efficiency of the filter medium is determined by measuring the particle number concentrations upstream and downstream of the filter medium. The fractional penetration, P , represents the fraction of aerosol particles which can go through the filter medium, defined as:

$$P = C_{\text{down}} / C_{\text{up}} \quad (1)$$

where C_{down} and C_{up} are the particle concentrations downstream and upstream of the filter medium, respectively. Another way is to measure the particle counts upstream and downstream of the filter medium for a certain same user-defined time interval and sampling volume rate. Then the penetration is the ratio between the downstream count N_{down} and upstream count N_{up} :

$$P = N_{\text{down}} / N_{\text{up}} \quad (2)$$

The filter medium efficiency, E , is the fraction of aerosol particles removed by the filter medium:

$$E = 1 - P \quad (3)$$

The filter medium efficiency is dependent on the challenge particle size. If the test is performed with a number of monodisperse particles with different sizes, the expression for the penetration of particles with the i_{th} monodisperse size P_i can be written as:

$$P_i = C_{down,i} / C_{up,i} \quad (4)$$

where $C_{up,i}$ and $C_{down,i}$ are the concentrations of particles with the i_{th} monodisperse size upstream and downstream of the filter medium, respectively. If the measurement is performed with the particle number count, P_i can be written as:

$$P_i = N_{down,i} / N_{up,i} \quad (5)$$

where $N_{up,i}$ and $N_{down,i}$ are the counts of particles with the i_{th} monodisperse size upstream and downstream of the filter medium in the same user-defined time interval and sampling volume rate, respectively. Correspondingly, the filtration efficiency E_i of the test filter medium against the particles with the i_{th} monodisperse size is:

$$E_i = 1 - P_i \quad (6)$$

iTeh STANDARD PREVIEW

The test aerosol from the aerosol generator is conditioned (e.g. evaporation of the solvent) and then neutralized. The particles are mixed homogeneously with filtered test air if necessary to achieve desired concentration and flow rate, before they are used to challenge the test filter medium.

A specimen of the sheet filter medium is fixed in a test filter assembly and subject to the test air flow corresponding to the prescribed filter medium velocity. Partial flow, which is the flow that the CPC operates with, of the test aerosol is sampled upstream and downstream of the filter medium, and the fractional penetration is determined from the upstream and downstream number concentrations or total numbers in user-defined time intervals. Furthermore, the measurement of the pressure drop across the filter medium is made at the prescribed filter medium velocity.

Additional equipment is required to measure the absolute pressure, temperature and RH of the test air. It is also needed to measure and control the air volume flow rate.

5 Test materials

5.1 General

Any aerosol used to test the filtration performance according to this test method shall only be introduced to the test section as long as needed to test the filtration performance properties of the test filter medium without changing the filtration performance properties of the subject filter medium due to loading, charge neutralization or other physical or chemical reaction.

5.2 Liquid phase aerosol

5.2.1 DEHS test aerosol

Test liquid aerosol of DEHS, as an example, is widely used in the testing of filters. DEHS aerosols are spherical in shape. Experiments conducted by comparing DEHS droplets and solid silver nanoparticles in the range of 20 nm to 30 nm demonstrated similar filtration efficiencies with the differences below 8 %^[19].

DEHS/DES/DOS – formula:

$$\text{C}_{26}\text{H}_{50}\text{O}_4 \text{ or } \text{CH}_3(\text{CH}_2)_3\text{CH}(\text{C}_2\text{H}_5)\text{CH}_2\text{OOC}(\text{CH}_2)_8\text{COOCH}_2\text{CH}(\text{C}_2\text{H}_5)(\text{CH}_2)_3\text{CH}_3$$
DEHS properties:

Density	912 kg/m ³
Melting point	225 K
Boiling point	529 K
Flash point	>473 K
Vapour pressure	$1,9 \times 10^{-6}$ Pa at 273 K
Refractive index	1,450 at $600 \cdot 10^{-9}$ m wavelength
Dynamic viscosity	0,022 Pa·s to 0,024 Pa·s
CAS number	122-62-3


5.2.2 Liquid phase aerosol generation**5.2.2.1 Principles and specifications**

The test aerosol shall consist of pure DEHS in a suitable solvent (for example IPA), or other liquid phase test aerosols in accordance with the producer's specification.

[Figure 1](#) gives an example of a system for generating the aerosol. Into more details, compressed air expands through an orifice to form a high-velocity jet. The liquid is drawn into the atomizing section through a vertical passage and is then atomized by the jet. Large droplets are removed by impaction on the wall opposite the jet and excess liquid is drained at the bottom of the atomizer assembly block. Fine spray leaves the atomizer through a fitting at the top.

Any other generator capable of producing droplets with a minimum concentration of about 1 000 particles per cubic centimetre in the particle size range of 20 nm to 500 nm can be used. The specifications of different atomizers, as examples, are presented in [Annex A, Table A.1](#).

Before testing, regulation of the upstream concentration, to reach a steady state and to have a concentration in the range that the particle counter can measure, shall be carried out.

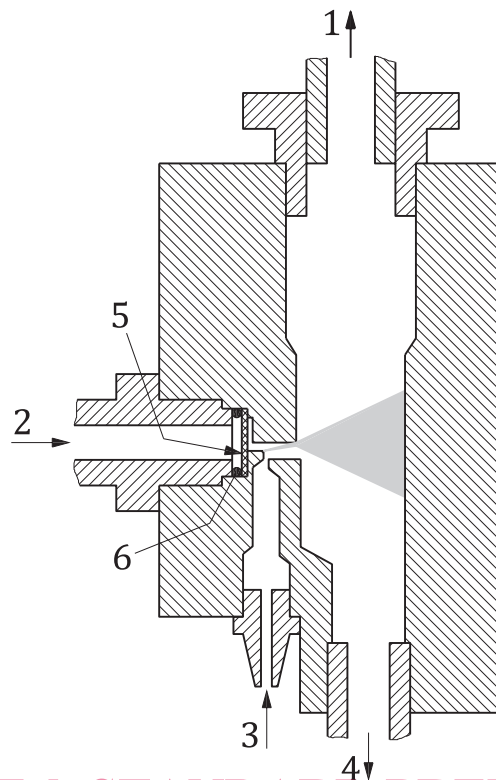

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Key

- 1 aerosol out
- 2 compressed air in
- 3 liquid in
- 4 excess liquid to closed reservoir
- 5 hole
- 6 O-ring

ISO 21083-1:2018

<https://standards.iteh.ai/catalog/standards/sist/b7f545f0-03e5-4791-bd67-f9380dcd670e/iso-21083-1-2018>

Figure 1 — Schematic of the atomizer assembly block


5.2.2.2 Atomizer maintenance

The atomizer shall be kept clean and free of rust. Even though most of the atomizer parts are made of stainless steel, solutes such as sodium chloride will eventually corrode them. In that case, it is recommended to clean and dry the atomizer assembly.

6 Test setup


6.1 General

The test setup is shown in [Figure 2](#) for monodisperse challenge particles and in [Figure 3](#) for polydisperse challenge particles. When the challenge particles are monodisperse the setup consists of the three sections: the one that produces the aerosol particles (which contains the aerosol generator), the particle classification section (which contains the DEMC) and the particle measuring section (which contains the CPC). When the challenging particles are polydisperse, the particle classification shall be performed after sampling the aerosol from the upstream or downstream section.

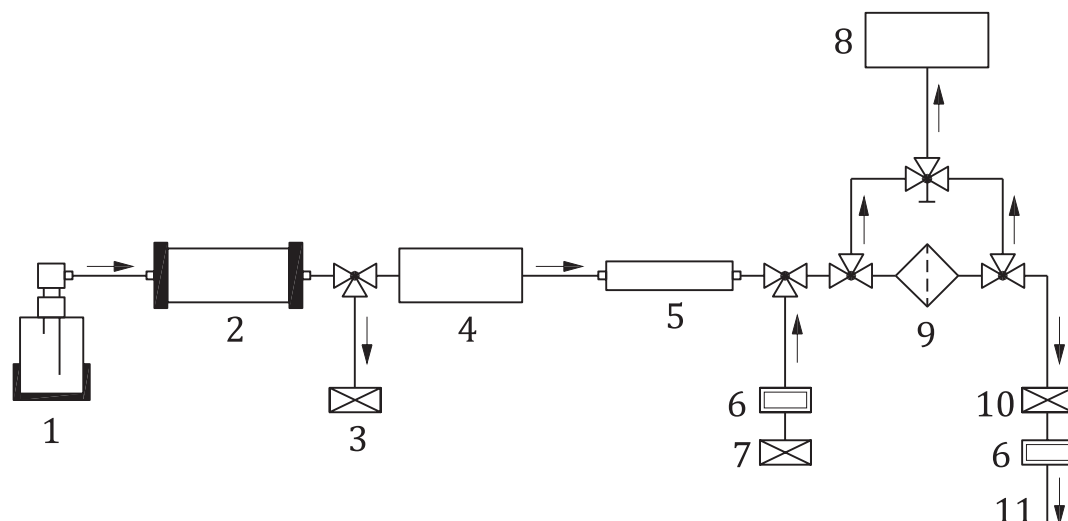**Key**

- | | |
|--------------------------------|------------------------------------|
| 1 atomizer | 7 make-up air with HEPA filter |
| 2 diffusion dryer | 8 CPC |
| 3 excess flow with HEPA filter | 9 filter medium holder |
| 4 DEMC | 10 HEPA filter on the exhaust line |
| 5 neutralizer | 11 vacuum |
| 6 flow controller | |

Figure 2 — Test setup for monodisperse challenge particles

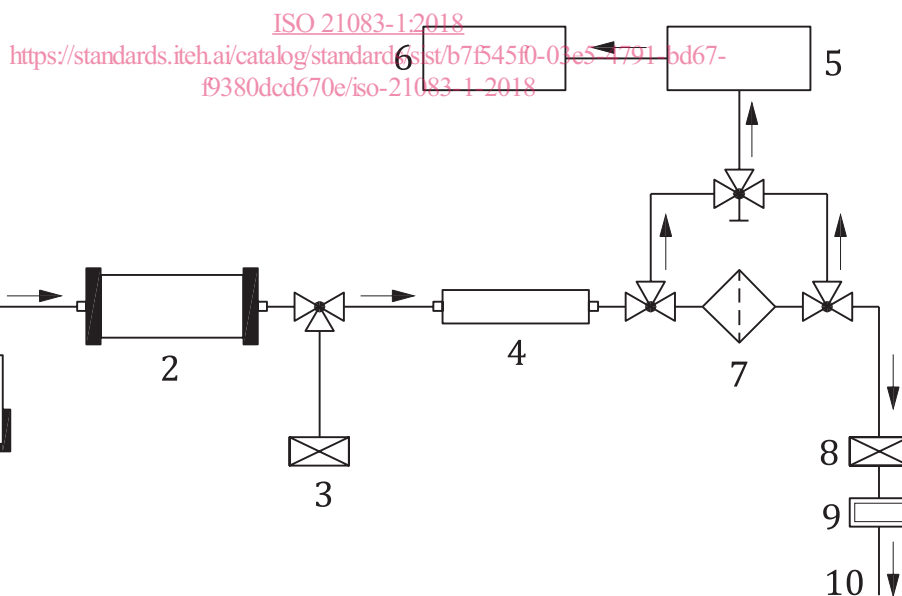**Key**

- | | |
|---|-----------------------------------|
| 1 atomizer | 6 CPC |
| 2 diffusion dryer | 7 filter medium holder |
| 3 flow compensation through HEPA filter | 8 HEPA filter on the exhaust line |
| 4 neutralizer | 9 flow controller |
| 5 DEMC | 10 vacuum |

Figure 3 — Test setup using polydisperse particles to obtain size resolved fractional filtration efficiency

6.2 Specification of setup

6.2.1 Aerosol generation system

The aerosol generation system is described in [5.2.2](#).


6.2.2 Tubing

Tubes shall be made of electrically conductive material (stainless steel, carbon embedded silicon tubing, etc.) in order to minimize particle losses due to electrostatic deposition. Furthermore, the tubing length shall be minimized so as to minimize particle losses due to diffusion. The upstream and downstream sample lines shall be nominally identical in geometry and material.

6.2.3 Dryer

6.2.3.1 Principles

In the case of generated aerosol from atomization, the particles coming out of the atomizer may have solvent attached and the solvent shall be evaporated. One approach is to pass the aerosol through a diffusion dryer. The dryer in this document refers to a device which can reduce the vapour pressure of the solvent in the test aerosol flow coming from the atomization process. The diffusion dryer consists of a porous tube for air flow passing through a bed of adsorptive materials, e.g. silica gel. The solvent vapour in the air has high diffusivity and can be adsorbed by the material in the diffusion dryer. For example, silica gel can adsorb IPA which may be used as the solvent for DEHS in the atomizer (see Reference [26]). A diffusion dryer is shown in [Figure 4](#).

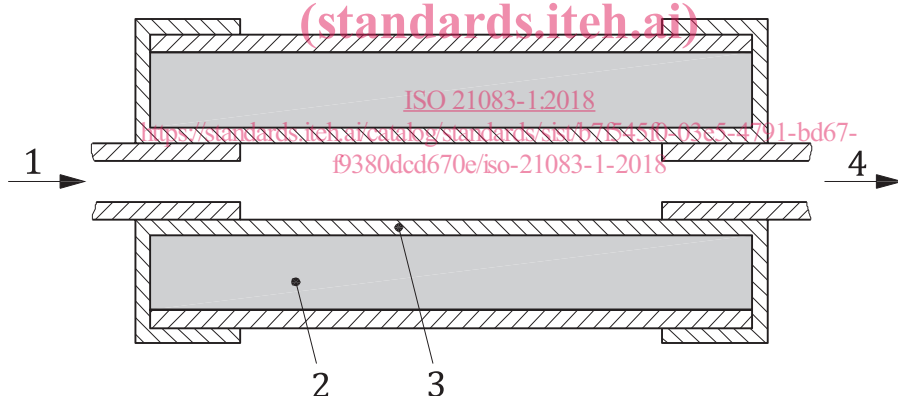

Key

- 1 aerosol in
- 2 annular space filled with an adsorptive material to reduce the vapour pressure of the solvent, for example silica gel
- 3 inner tube made of wire screen
- 4 aerosol flow with reduced amount of the solvent vapour

Figure 4 — Diffusion dryer

6.2.3.2 Maintenance

In order to ensure a partial pressure reduction for the solvent, the adsorptive material shall not be saturated. If silica gel is used, it shall be regenerated periodically until it loses its function after extensive use and regeneration cycles.

6.2.4 DEMC

6.2.4.1 Principles and specifications

The DMAS consists primarily of a bipolar charger to neutralize the charges on particles, a controller to control flows and high-voltage, a DEMC (see [Figure 5](#)) which separates particles based on their electrical mobilities, a particle detector, interconnecting plumbing, a computer and suitable software. The DEMC shall be able to classify particles in the size range of 20 nm to 500 nm and fulfil the qualification procedure described in [7.2](#). In case of the unipolar charger based instrument, the manufacturer shall be contacted for suitable size range, in order to avoid errors due to multiple charge effect. The losses of the smallest particles due to diffusion within the challenge range shall be considered as well.

NOTE For more information, see ISO 15900.

DEMC principles are as follows.

Particles are introduced at the circumference of a hollow tube. A radial electric field is maintained across the outer walls of this tube and a central electrode. As the charged particles flow through the tube, they are attracted towards the central electrode due to the electric field. These are removed through openings in the central electrode.

Small particles require weak electric fields to move them towards the central electrode. Larger particles require stronger fields. By adjusting the electric field, particles of a known size are attracted towards the opening in the central rod and are removed for measurements. Thus particles with a narrow range of sizes can be extracted for each voltage setting. The narrowness is mainly determined by the geometry and uniformity of air flow in the device. By stepping through a range of voltages, or electric field strength, the number of particles in different sizes in the sample can be measured and the particle size distribution of the sample determined.

Alternately, since the DEMC separates particles according to their electrical mobilities, if one knows the number of charges on a particle, it can be used to separate monodisperse particles from a polydisperse aerosol. In this measurement method, test particles are first generated and then sent through a neutralizer. Afterwards, the test particles have the Boltzmann equilibrium charge distribution. In this case the singly charged particles represent the largest fraction of the charged particles (see the details in [7.3.2](#)). In addition the size distribution can be controlled so that the target monodisperse particle size is on the right side of the mode of particle size distribution (see the details in [8.2.13](#)). Under these carefully controlled conditions it is possible to use a DEMC to classify monodisperse particles in the range of 20 nm to 500 nm. (See ISO 15900 for more details.)

A DEMC suitable for the prescribed methods in this document shall be able to separate and provide monodisperse particles in the size range from 20 nm to 500 nm with a geometric standard deviation less than 1,10. In general, the ratio of the sheath flow rate to the aerosol flow rate into the DEMC determines the sizing resolution of the DEMC. A higher ratio provides more accurate sizing and avoids excessive diffusional broadening of the particle size distribution so that better monodispersity of the aerosol exiting the DEMC is achieved (see Reference [\[11\]](#)). In practice, a sheath flow to aerosol flow ratio of at least 5 is shown to give acceptable sizing resolution in the size range of interest for the filtration measurement purpose (see Reference [\[18\]](#)). Prescribing specifications for suitable devices are beyond the scope of this document.

NOTE For more information on DEMC principles see ISO 15900.