



SLOVENSKI STANDARD

SIST EN 1491:2022

01-september-2022

Nadomešča:
SIST EN 1491:2000

Ventili v stavbah - Ekspanzijski ventili - Preskusi in zahteve

Building valves - Expansion valves - Tests and requirements

Gebäudearmaturen - Sicherheitsventile für Expansionswasser - Prüfungen und Anforderungen

Robinetterie de bâtiment - Soupapes d'expansion - Essais et exigences

Ta slovenski standard je istoveten z: **EN 1491:2022**

ICS:

23.060.01	Ventili na splošno	Valves in general
91.140.60	Sistemi za oskrbo z vodo	Water supply systems

SIST EN 1491:2022

en,fr,de

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 1491

July 2022

ICS 91.140.60

Supersedes EN 1491:2000

English Version

**Building valves - Expansion valves - Tests and
requirements**

Robinetterie de bâtiment - Soupapes d'expansion -
Essais et exigences

Gebäudearmaturen - Sicherheitsventile für
Expansionswasser - Prüfungen und Anforderungen

This European Standard was approved by CEN on 13 June 2022.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

SIST EN 1491:2022

<https://standards.iteh.ai/catalog/standards/sist/3f5c67f7-6e98-45c1-b7ee-cfa3e938baef/sist-en-1491-2022>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents

Page

European foreword.....	4
Introduction	5
1 Scope	6
2 Normative references	6
3 Terms and definitions	7
4 Materials and surface finishes.....	8
4.1 General.....	8
4.2 Materials.....	9
4.3 Detection of residual stress.....	9
4.3.1 General.....	9
4.3.2 Test.....	9
4.3.3 Test method (Procedure).....	9
4.3.4 Requirements	10
4.4 Corrosion resistance test.....	10
4.4.1 General.....	10
4.4.2 Test method	10
4.4.3 Requirements	10
4.5 Coating adherence test.....	10
4.5.1 General.....	10
4.5.2 Test method	10
4.5.3 Requirements	11
4.6 Compatibility with the products used for shock disinfection of the networks.....	11
4.6.1 General.....	11
4.6.2 Test method	11
4.6.3 Requirements	11
5 Design, dimensional and pressure requirements	12
5.1 General guidance.....	12
5.2 Dimensional characteristics.....	12
5.2.1 Nominal outlet diameter	12
5.2.2 End connections.....	12
5.3 Expansion valve outlet connection to air break to drain.....	12
5.4 Expansion valve discharge connection to drain service	12
5.5 Connections.....	12
5.6 Pressures.....	13
5.6.1 General.....	13
5.6.2 Nominal set pressure (P_{nr})	13
5.6.3 Water tightness pressure (P_e)	13
5.6.4 Opening pressure (P_o).....	13
5.6.5 Rating pressure (P_{dn}).....	13
5.6.6 Closing pressure (P_f).....	13
5.6.7 Initial opening pressure (P_{dc}).....	13
6 Apparatus.....	13
6.1 General.....	13
6.2 Tolerances of parameters and accuracy of measure instruments	14

6.2.1	Tolerances on set parameters	14
6.2.2	Accuracy of measuring instruments	14
6.2.3	Test media	14
7	Hydraulic tests and requirements	14
7.1	Cold water pressure tests	14
7.1.1	General	14
7.1.2	Water tightness pressure (P_e) test	14
7.1.3	Repeat tests	15
7.2	Endurance test	15
7.2.1	Procedure	15
7.2.2	Requirement	16
7.3	Easing gear (manual control device)	16
7.3.1	Operation of the easing gear	16
7.3.2	Easing gear endurance test	16
8	Mechanical tests and requirements	16
8.1	Mechanical strength	16
8.1.1	Pressure test of the body of the expansion valve	16
8.1.2	Bending moment test of the body of the expansion valve	17
8.2	Mechanical strength of the easing gear	18
8.2.1	Procedure	18
8.2.2	Requirement	18
8.3	Torsional strength of the expansion valve's body	18
8.3.1	General	18
8.3.2	Procedure	18
8.3.3	Requirement	19
8.4	Torque test of the captive rotating nuts/tail pieces	19
8.4.1	General	19
8.4.2	Procedure	19
8.4.3	Requirement	19
9	Classification	19
10	Designation	20
11	Marking	20
12	Technical documents and presentation at delivery	21
Annex A (informative)	Classification of water heaters according to heating method	22
A.1	Indirect heating	22
A.2	Classification of water heaters according to heating method	22
A.2.1	Indirect heating	22
A.2.2	Direct heating	23
Bibliography	24

EN 1491:2022 (E)**European foreword**

This document (EN 1491:2022) has been prepared by Technical Committee CEN/TC 164 “Water supply”, the secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2023, and conflicting national standards shall be withdrawn at the latest by January 2023.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 1491:2000.

In comparison with the previous edition, the following technical modifications have been made:

- chapter on materials was completely revised;
- testing with disinfectant was introduced;
- torque test was added;
- testing of the expansion valve was changed and optimized;
- coating test procedure was revised;
- normative references were updated;
- editorial changes have been made throughout the entire document.

Any feedback and questions on this document should be directed to the users’ national standards body. A complete listing of these bodies can be found on the CEN website.

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Introduction

With regard to potential adverse effect on the quality of water intended for human consumption, caused by the product covered by this document:

- 1) This document provides no information as to whether the product may be used without restriction in any of the Member States of the EU or EFTA.
- 2) It should be noted that, whilst awaiting the adoption of verifiable European criteria, existing national regulations concerning the use and or the characteristics of this product remain in force.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1491:2022

<https://standards.iteh.ai/catalog/standards/sist/3f5c67f7-6e98-45c1-b7ee-cfa3e938baef/sist-en-1491-2022>

1 Scope

This document specifies dimensions, materials and performance requirements (including methods of test) for expansion valves, of nominal sizes from DN 15 to DN 32, having working pressures¹⁾ from 0,1 MPa (1 bar) to 1,0 MPa (10 bar).

Expansion valves are intended for fitting to the cold potable water supply of storage water heaters, having a maximum distribution temperature of 95 °C, for all energy sources.

Expansion valves do not control the temperature and alone do not constitute the protection required for storage water heaters. Expansion valves limit pressure, in the water heaters to what they are fitted, that is produced by thermal expansion of the water.

NOTE The use of the device specified in this document does not override the need to use controls (e.g. thermostats and cut-outs) which act directly on the power sources of water heaters (for more information see Annex A).

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 806 (all parts), *Specifications for installations inside buildings conveying water for human consumption*

EN 1254-2, *Copper and copper alloys - Plumbing fittings - Part 2: Compression fittings for use with copper tubes*

EN 1717, *Protection against pollution of potable water in water installations and general requirements of devices to prevent pollution by backflow*

EN 10226-1, *Pipe threads where pressure tight joints are made on the threads - Part 1: Taper external threads and parallel internal threads - Dimensions, tolerances and designation*

EN ISO 6509 (all parts), *Corrosion of metals and alloys - Determination of dezincification resistance of brass (ISO 6509)*

EN ISO 228-1, *Pipe threads where pressure-tight joints are not made on the threads - Part 1: Dimensions, tolerances and designation (ISO 228-1)*

EN ISO 9227, *Corrosion tests in artificial atmospheres - Salt spray tests (ISO 9227)*

ISO 6957, *Copper alloys — Ammonia test for stress corrosion resistance*

¹ All pressures are gauge unless otherwise stated.

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <https://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

expansion valve

valve that limits the pressure of the water in the water heater to a predetermined value by discharging water to drain

air break to drain


device that prevents discharged water from returning to the expansion valve and thus to the water heater

nominal set pressure

 P_{nr}

pressure of the expansion valve which is set on production

Note 1 to entry: The “nominal set pressure” (P_{nr}) is often called “set pressure”.

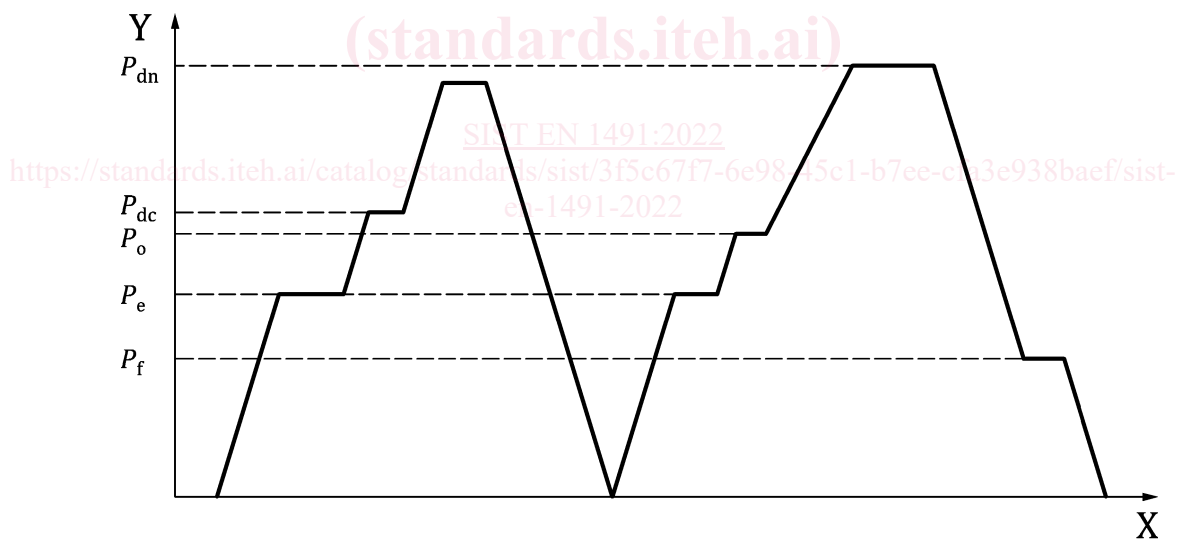

Y pressure

X time

Figure 1 — Pressures

water tightness pressure

 P_e

pressure up to which the expansion valve is closed

Note 1 to entry: See Figure 1.

EN 1491:2022 (E)**3.5
initial opening pressure**

P_{dc}
pressure at which the expansion valve opens for the first time, as indicated by the first droplet of water at the outlet of the expansion valve, after a period of storage

Note 1 to entry: See Figure 1.

**3.6
opening pressure**

P_o
pressure at which the expansion valves opens as indicated by the appearance of water at the outlet of the expansion valve

Note 1 to entry: See Figure 1.

**3.7
rating pressure**

P_{dn}
pressure at which the discharged flow is above the limit

Note 1 to entry: See Figure 1 and Table 2.

**3.8
closing pressure**

P_f
pressure at which the expansion valve closes after having reached the rating pressure

Note 1 to entry: See Figure 1.

4 Materials and surface finishes**4.1 General**

The selection of materials is the responsibility of the manufacturer, provided they satisfy the following requirements:

- a) materials and coatings shall not contaminate the potable water;
- b) in a technical document, the manufacturer shall state the nature of the materials and coatings used;
- c) materials with insufficient corrosion resistance (e.g. cast iron, aluminium) shall have additional protection;
- d) the materials used shall be suitable for the temperatures specified in the tests in this document;
- e) the materials, and in particular copper alloys, for which recommendations or international standards exist, shall comply with the relevant recommendations or international standards.

4.2 Materials

All materials coming into contact with water intended for human consumption shall present no health risk nor cause any change to the water in terms of quality, appearance, smell or taste.

NOTE It is pointed out that while awaiting the adoption of verifiable European criteria for testing materials in contact with water intended for human consumption, existing national regulations concerning the use and/or the characteristics of these products remain in force.

Copper-zinc alloys containing more than 10 % zinc are subject to dezincification when submitted to water capable of dezincification. In the countries where the use of products made of dezincification resistant materials is required, the materials used shall guarantee a dezincification depth less than 200 µm in any direction. For this purpose, materials shall be tested in accordance with EN ISO 6509 (all parts) and the product shall be marked in compliance with the indications according to Clause 11.

4.3 Detection of residual stress

4.3.1 General

This test shall be performed for bodies made out of brass materials and with female threads according to EN 10226-1 and compression ends according to EN 1254-2.

4.3.2 Test

This test is based on ISO 6957. Its purpose is to verify the resistance to cracking under stress corrosion in ammonia medium (as described in 4.3.3, b).

The test entails exposing test specimens consisting of the assembled expansion valve in an atmosphere loaded with ammonia vapour.

4.3.3 Test method (Procedure)

The paragraph below details ISO 6957.

Test solution:

- a) Use solutions of analysis quality and of distilled water.
- b) Solution of ammonia at 20 % (in weight).
- c) The pH of the test solution shall be adjusted to 9,5 by using hydrochloric acid.
- d) The test temperature shall be $(23 \pm 2) ^\circ\text{C}$ with a measurement uncertainty of $\pm 1 \text{ K}$.

Test specimen:

- e) The test specimen consists of three samples of a single assembled product. The test specimen shall be inserted into the test enclosure under no stress.

Instructions:

- f) Rinse the test specimens with a clean non-chlorinated solvent (for example, ethanol).
- g) Let it dry in the air.
- h) Insert the test specimens into the test enclosure along with the ammonia solution. The volume of the container made of glass (e.g. desiccator) shall be minimum $(10 \pm 1) \text{ l}$.