

DRAFT INTERNATIONAL STANDARD

ISO/DIS 11298-4

ISO/TC 138/SC 8

Secretariat: JISC

Voting begins on:
2019-06-12

Voting terminates on:
2019-09-04

Plastics piping systems for renovation of underground water supply networks —

Part 4: Lining with cured-in-place pipes

*Systèmes de canalisation en plastique pour la rénovation des réseaux enterrés d'alimentation en eau —
Partie 4: Tubage continu par tubes polymérisés sur place*

ICS: 23.040.20; 23.040.45; 93.025

iTeh STANDARD PREVIEW
(standards.iteh.ai)
Full standard:
<https://standards.iteh.ai/catalog/standards/sist/caf8bee-6bcb-435b-908a-46c8e534bf4/iso-dis-11298-4>

THIS DOCUMENT IS A DRAFT CIRCULATED FOR COMMENT AND APPROVAL. IT IS THEREFORE SUBJECT TO CHANGE AND MAY NOT BE REFERRED TO AS AN INTERNATIONAL STANDARD UNTIL PUBLISHED AS SUCH.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

This document is circulated as received from the committee secretariat.

ISO/CEN PARALLEL PROCESSING



Reference number
ISO/DIS 11298-4:2019(E)

© ISO 2019

iTeh STANDARD PREVIEW
(standards.iteh.ai)
Full standard:
<https://standards.iteh.ai/catalog/standards/sist/caf8bee-6bcb-435b-908a-46c8e534bf4/iso-dis-11298-4>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2019

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms and definitions	2
3.1 General terms.....	2
3.2 Techniques.....	4
3.3 Characteristics.....	4
3.4 Materials.....	5
3.5 Product stages.....	5
3.6 Service conditions.....	5
4 Symbols and abbreviated terms	5
4.1 Symbols.....	5
4.2 Abbreviated terms.....	7
5 Pipes at the “M” stage	7
5.1 Materials.....	7
5.2 General characteristics.....	9
5.3 Material characteristics.....	9
5.4 Geometric characteristics.....	9
5.5 Mechanical characteristics.....	9
5.6 Physical characteristics.....	9
5.7 Jointing.....	9
5.8 Marking.....	9
6 Fittings at the “M” stage	10
7 Ancillary components	10
8 Fitness for purpose of the installed lining system at the “I” stage	10
8.1 Materials.....	10
8.2 General characteristics.....	10
8.3 Material characteristics.....	11
8.4 Geometric characteristics.....	11
8.4.1 General.....	11
8.4.2 CIPP wall structure.....	11
8.4.3 Wall thickness.....	11
8.5 Mechanical characteristics.....	11
8.5.1 Reference conditions for testing.....	11
8.5.2 Test requirements.....	12
8.6 Physical characteristics.....	15
8.7 Additional characteristics.....	15
8.7.1 Leak tightness of liner terminations.....	15
8.8 Sampling.....	16
9 Installation practice	16
9.1 Preparatory work.....	16
9.2 Storage, handling and transport of pipe components.....	16
9.3 Equipment.....	16
9.4 Installation.....	17
9.4.1 Environmental precautions.....	17
9.4.2 Installation procedures.....	17
9.4.3 Simulated installations.....	18
9.5 Process-related inspection and testing.....	18
9.6 Lining termination.....	18
9.7 Reconnections to existing pipeline system.....	18

9.8	Final inspection and testing.....	18
9.9	Documentation.....	18
Annex A (informative) CIPP components and their functions.....		19
Annex B (normative) Cured-in-place pipes — Determination of short-term flexural properties.....		20
Annex C (normative) Cured-in-place pipes — Determination of long-term flexural modulus under dry or wet conditions.....		29
Annex D (normative) Cured-in-place pipes — Determination of long-term flexural strength under dry or wet conditions.....		34
Bibliography.....		37

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Full standard:
<https://standards.iteh.ai/catalog/standards/sist/caf8bee-6bcb-435b-908a-46c8e534bf4/iso-dis-11298-4>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 08, *Rehabilitation of pipeline systems*.

A list of all parts in the ISO 11298 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

This document is a part of a system standard for plastics piping systems of various materials used for renovation of existing pipelines in a specified application area. System standards for renovation dealing with the following applications are either available or in preparation:

- ISO 11296, *Plastics piping systems for renovation of underground non-pressure drainage and sewerage networks*;
- ISO 11297, *Plastics piping systems for renovation of underground drainage and sewerage networks under pressure*;
- ISO 11298, *Plastics piping systems for renovation of underground water supply networks* (this document);
- ISO 11299, *Plastics piping systems for renovation of underground gas supply networks*.

These system standards are distinguished from those for conventionally installed plastics piping systems because they set requirements for certain characteristics in the “as-installed” condition, after site processing. This is in addition to specifying requirements for plastics piping system components “as manufactured”.

Each of the system standards comprises a

- *Part 1: General*

and all applicable renovation technique family-related parts, which for water supply networks include or potentially include the following:

- *Part 2: Lining with continuous pipes*;
- *Part 3: Lining with close-fit pipes*;
- *Part 4: Lining with cured-in-place pipes (this document)*;
- *Part 5: Lining with discrete pipes*;
- *Part 6: Lining with adhesive-backed hoses*;
- *Part 10: Lining with sprayed polymeric materials*;
- *Part 11: Lining with inserted hoses*.

The requirements for any given renovation technique family are given in Part 1 applied in conjunction with the other relevant part. For example, both ISO 11298-1 and this document together specify the requirements relating to lining with cured-in-place pipes. For complementary information, see ISO 11295. Not all technique families are applicable to every area of application and this is reflected in the part numbers included in each System Standard.

A consistent structure of clause headings has been adopted for all parts to facilitate direct comparisons across renovation technique families.

[Figure 1](#) shows the common structure and the relationship between ISO 11298 and the system standards for other application areas.

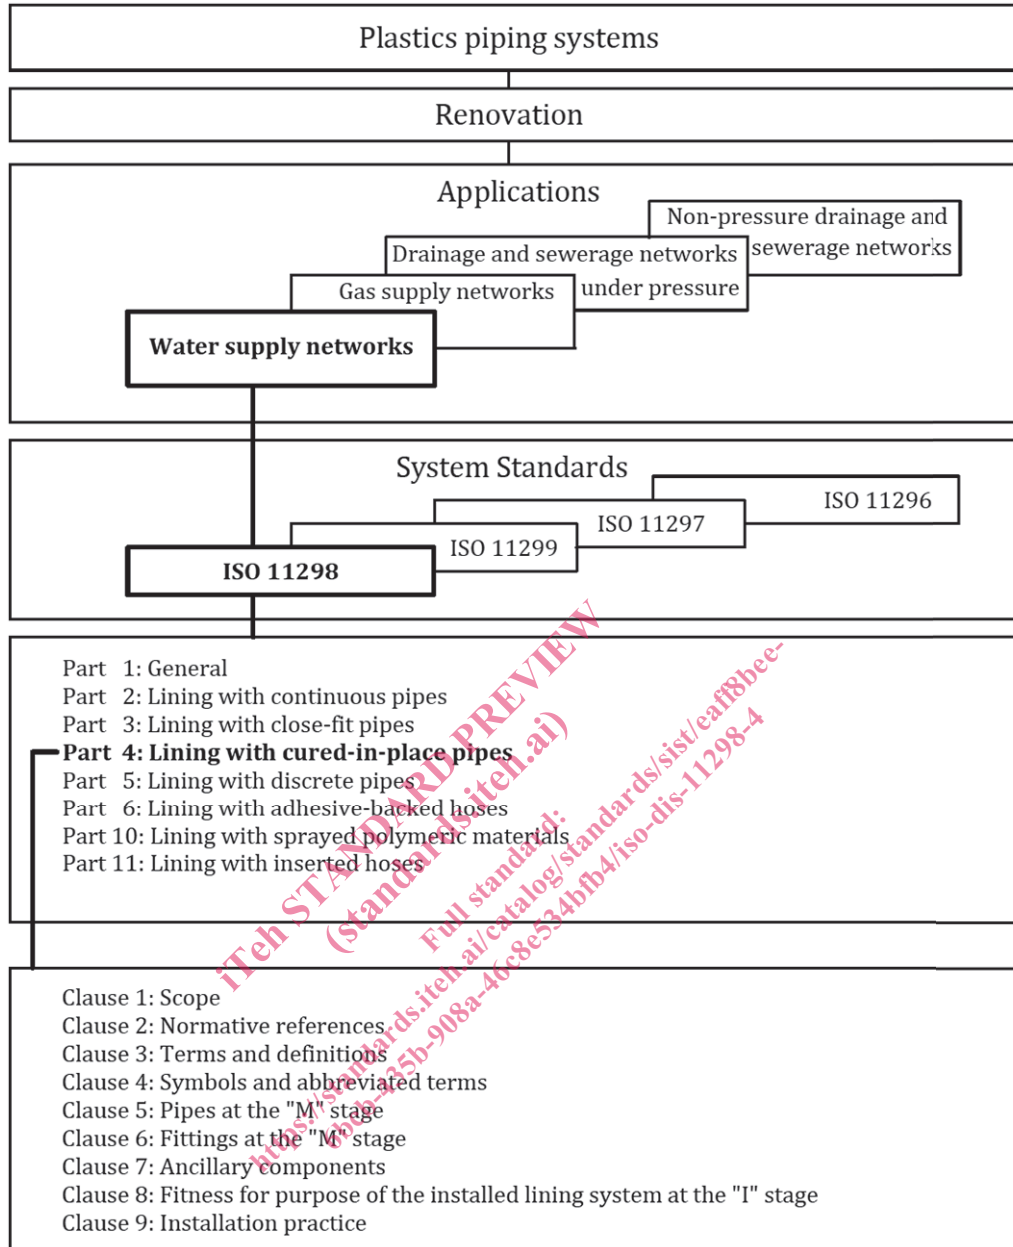


Figure 1 — Format of the renovation system standards

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Full standard:
<https://standards.iteh.ai/catalog/standards/sist/caf8bee-6bcb-435b-908a-46c8e534fb4/iso-dis-11298-4>

Plastics piping systems for renovation of underground water supply networks —

Part 4: Lining with cured-in-place pipes

1 Scope

This document, in conjunction with ISO 11298-1, specifies requirements and test methods for cured-in-place pipes and fittings used for the renovation of water supply networks which transport water intended for human consumption, including raw water intake pipelines.

It applies to independent (fully structural, class A) and interactive (semi structural, class B) pressure pipe liners, as defined in ISO 11295, which do not rely on adhesion to the existing pipeline. It applies to the use of various thermosetting resin systems, in combination with compatible fibrous carrier materials, reinforcement, and other process-related plastics components (see 5.1).

It does not include requirements or test methods for resistance to cyclic loading or the pressure rating of CIPP liners where passing through bends, which are outside the scope of this document.

It is applicable to cured-in-place pipe lining systems intended to be used at a service temperature of up to 25 °C.

NOTE For applications operating at service temperatures greater than 25 °C guidance on re-rating factors can be supplied by the system supplier.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 75-2, *Plastics — Determination of temperature of deflection under load — Part 2: Plastics and ebonite*

ISO 178:2010+A1:2013, *Plastics — Determination of flexural properties*

ISO 899-2:2003, *Plastics — Determination of creep behaviour — Part 2: Flexural creep by three-point loading*

ISO 3126, *Plastics piping systems — Plastics components — Determination of dimensions*

ISO 7432, *Glass-reinforced thermosetting plastics (GRP) pipes and fittings — Test methods to prove the design of locked socket-and-spigot joints, including double-socket joints, with elastomeric seals*

ISO 7509, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Determination of time to failure under sustained internal pressure*

ISO 7684, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Determination of the creep factor under dry conditions*

ISO 7685, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Determination of initial specific ring stiffness*

ISO 8513, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Test methods for the determination of the initial longitudinal tensile strength*

ISO/DIS 11298-4:2019(E)

ISO 8521:2009, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes — Test methods for the determination of the apparent initial circumferential tensile strength*

ISO 8533, *Plastics piping systems for pressure and non-pressure drainage and sewerage — Glass-reinforced thermosetting plastics (GRP) systems based on unsaturated polyester (UP) resin — Test methods to prove the design of cemented or wrapped joints*

ISO 10639:2017, *Plastics piping systems for pressure and non-pressure water supply — Glass-reinforced thermosetting plastics (GRP) systems based on unsaturated polyester (UP) resin*

ISO 10468, *Glass-reinforced thermosetting plastics (GRP) pipes — Determination of the ring creep properties under wet or dry conditions*

ISO 10928, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes and fittings — Methods for regression analysis and their use*

ISO 10952, *Plastics piping systems — Glass-reinforced thermosetting plastics (GRP) pipes and fittings — Determination of the resistance to chemical attack for the inside of a section in a deflected condition*

ISO 11295:2017, *Classification and information on design and applications of plastics piping systems used for renovation and replacement*

ISO 11298-1:2018, *Plastics piping systems for renovation of underground water supply networks — Part 1: General*

ISO 13002, *Carbon fibre — Designation system for filament yarns*

ISO 14125:1998+A1:2011, *Fibre-reinforced plastic composites — Determination of flexural properties*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 11298-1 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

3.1 General terms

3.1.1

carrier material

porous component of the lining tube, which carries the liquid resin system during insertion into the pipe being renovated and forms part of the installed lining system once the resin has been cured

3.1.2

CIPP product

cured-in-place pipe product

cured-in-place pipe of a particular design, produced from a lining tube of specified materials, with a wall structure which is uniquely defined for each diameter/wall thickness combination, and which is impregnated with a specific resin system and installed by a specific process

3.1.3

CIPP unit

specific cured-in-place pipe produced from a continuous lining tube, which has been impregnated in one process and installed as a single length

3.1.4**close fit**

situation of the outside of the installed liner relative to the inside of the existing pipeline, which can either be an interference fit or include a small annular gap resulting from shrinkage and tolerances only

3.1.5**composite**

combination of cured resin system, carrier material and/or reinforcement, excluding any internal or external membranes

3.1.6**curing**

process of resin polymerization, which may be initiated or accelerated by the use of heat or exposure to light

3.1.7**design thickness**

required wall thickness of the composite, excluding any abrasion layer, as determined by structural design

3.1.8**first break**

elastic limit or first major discontinuity of the stress-strain curve associated with local failure of the resin matrix or reinforcing fibres

3.1.9**lining tube**

flexible tube, consisting of carrier material, resin system and any membranes and/or reinforcement, as combined prior to insertion in the pipe to be lined

3.1.10**nominal CIPP wall thickness**

one of a range of discrete lining tube wall thicknesses dictated by the sum of the thicknesses of the individual layers of materials used for tube construction at the "M" stage

3.1.11**permanent membrane**

internal or external membrane designed to retain its integrity through the processes of lining tube insertion and resin system cure, and to provide functions for the operational life of the CIPP liner

3.1.12**preliner**

permanent or semi-permanent external membrane which is installed separately, before insertion of the resin-impregnated lining tube

3.1.13**reinforcement**

fibres incorporated in the liner, which enhance the dimensional stability of the liner and/or the structural properties of the cured composite

Note 1 to entry: The reinforcement can be incorporated in the carrier material, constitute the carrier material, or can be a separate layer.

3.1.14**resin system**

thermosetting resin including the curing agent(s) and any fillers or other additives, in specified proportions

3.1.15**semi-permanent membrane**

internal or external membrane designed to retain its integrity through the processes of lining tube insertion and resin system cure, but not relied on to retain its integrity at the "I" stage

3.1.16

service temperature

maximum sustained temperature at which a system is expected to operate

Note 1 to entry: Service temperature is expressed in degrees Celsius (°C)

3.1.17

temporary membrane

membrane forming the internal or external surface of the pipe at the "M" stage, with functions at the "M" stage only, removed during or after installation

3.1.18

total thickness

thickness of CIPP at the "I" stage comprising the composite and any semi-permanent and permanent membranes

3.1.19

type testing

testing performed to prove that the material, product, joint or assembly is capable of conforming to the requirements given in the relevant standard

3.2 Techniques

3.2.1

inversion

process of turning a flexible tube or hose inside out by the use of fluid (water or air) pressure

3.2.2

inverted-in-place insertion

method whereby the impregnated lining tube is introduced by inversion to achieve simultaneous insertion and inflation

3.2.3

winched-in-place insertion

method whereby the flat impregnated lining tube is first pulled into the pipe to be lined and then inflated to bring it up to size

Note 1 to entry: With some techniques inflation is achieved by inversion through the pulled-in lining tube of a separate impregnated tube or dry hose, which is either withdrawn after resin cure or left in place as a permanent internal membrane.

3.3 Characteristics

3.3.1

projected failure pressure at 50 years

p_{50}
value at 50 years derived from the pressure regression line obtained from long-term pressure tests performed in accordance with ISO 7509 and analysed in accordance with ISO 10928

[SOURCE: ISO 10639:2017, 3.12.10]

3.3.2

minimum failure pressure at 50 years

$p_{50,min}$
95% lower confidence level (LCL) of the failure pressure at 50 years

[SOURCE: ISO 10639:2017, 3.12.7]