



Designation: ~~C1581-04~~ Designation: **C 1581/C 1581M – 09**

# Standard Test Method for Determining Age at Cracking and Induced Tensile Stress Characteristics of Mortar and Concrete under Restrained Shrinkage<sup>1</sup>

This standard is issued under the fixed designation C 1581/C 1581M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope\*

1.1 This test method covers the laboratory determination of the age at cracking and induced tensile stress characteristics of mortar or concrete specimens under restrained shrinkage. The procedure can be used to determine the effects of variations in the proportions and material properties of mortar or concrete on cracking due to both drying shrinkage and deformations caused by autogenous shrinkage and heat of hydration.

1.2 This test method is not intended for expansive materials.

~~1.3 The values stated in inch-pound units are to be regarded as standard. The values shown in parenthesis are in SI units and are given for information only.~~

1.3 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and to determine the applicability of regulatory limitations prior to use. (Warning—Warning—Fresh hydraulic cementitious mixtures are caustic and may cause chemical burns to skin and tissue upon prolonged exposure.<sup>2</sup>)*

## 2. Referenced Documents

### 2.1 ASTM Standards:<sup>3</sup>

C 33 Specification for Concrete Aggregates

C 138/C 138M Test Method for Density (Unit Weight), Yield, and Air Content (Gravimetric) of Concrete

C 143/C 143M Test Method for Slump of Hydraulic-Cement Mortar/Concrete

C 150 Specification for Portland Cement

~~http://~~ C 171 Specification for Sheet Materials for Curing Concrete <https://standards.iteh.ai/document/ASTM-C1581-C1581M-09>

C 192/C 192M Practice for Making and Curing Concrete Test Specimens in the Laboratory

€ C 387 Specification for Packaged, Dry, Combined Materials for Mortar and Concrete

C 595 Specification for Blended Hydraulic Cements

C 1157 Performance Specification for Hydraulic Cement

C 1437 Test Method for Flow of Hydraulic Cement Mortar

F441

F 441/F 441M Specification for Chlorinated Poly(Vinyl Chloride) (CPVC) Plastic Pipe, Schedules 40 and 80

### 2.2 ASME Standards:<sup>4</sup>

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee C09 on Concrete and Concrete Aggregates and is the direct responsibility of Subcommittee C09.68 on Volume Change.

~~Current edition approved July 1, 2004. Published August 2004.~~

Current edition approved June 15, 2009. Published July 2009. Originally approved in 2004. Last previous edition approved in 2004 as C 1581 – 04.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

<sup>3</sup> Section on Safety Precautions, *Manual of Aggregate and Concrete Testing*, *Annual Book of ASTM Standards*, Vol. 04.02.

<sup>3</sup> Available from American Society of Mechanical Engineers, 22 Law Drive, Fairfield, NJ 07007-2900.

<sup>3</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

<sup>4</sup> The boldface numbers in parenthesis refer to the list of references at the end of this test method

<sup>4</sup> Available from American Society of Mechanical Engineers (ASME), ASME International Headquarters, Three Park Ave., New York, NY 10016-5990, <http://www.asme.org>.

\*A Summary of Changes section appears at the end of this standard.

## B 46.1 Surface Texture (Surface Roughness, Waviness and Lay)

### 3. Summary of Test Method

3.1 A sample of freshly mixed mortar or concrete is compacted in a circular mold around an instrumented steel ring. The compressive strain developed in the steel ring caused by the restrained shrinkage of the mortar or concrete specimen is measured from the time of casting (1-6)<sup>5</sup>. Cracking of the test specimen is indicated by a sudden decrease in the steel ring strain. The age at cracking and the rate of tensile stress development in the test specimen are indicators of the material's resistance to cracking under restrained shrinkage.

### 4. Significance and Use

4.1 This test method is for relative comparison of materials and is not intended to determine the age at cracking of mortar or concrete in any specific type of structure, configuration, or exposure.

4.2 This test method is applicable to mixtures with aggregates of ~~0.5-in. (13-mm)~~ 13-mm [0.5-in.] maximum nominal size or less.

4.3 This test method is useful for determining the relative likelihood of early-age cracking of different cementitious mixtures and for aiding in the selection of cement-based materials that are less likely to crack under restrained shrinkage. Actual cracking tendency in service depends on many variables including type of structure, degree of restraint, rate of property development, construction and curing methods, and environmental conditions.

4.4 This test method can be used to determine the relative effects of material variations on induced tensile stresses and cracking potential. These variations can include, but are not limited to, aggregate source, aggregate gradation, cement type, cement content, water content, supplementary cementing materials, or chemical admixtures.

4.5 For materials that have not cracked during the test, the rate of tensile stress development at the time the test is terminated provides a basis for comparison of the materials.

### 5. Apparatus

5.1 *Steel ring*—~~Structural steel pipe with a wall thickness of 0.50 ± 0.05 in. (13 ± 0.12 mm), an outside diameter of 13.0 ± 0.12 in. (330 ± 3.3 mm) and a height of 6.0 ± 0.25 in. (152 ± 6 mm) (see~~ Structural steel pipe with a wall thickness of 13 ± 1 mm [0.50 ± 0.05 in.], an outside diameter of 330 ± 3 mm [13.0 ± 0.12 in.] and a height of 150 ± 6 mm [6.0 ± 0.25 in.] (see Fig. 1). Machine the inner and outer faces to produce smooth surfaces with a texture of 63 microinches (1.6 micrometres) ~~1.6 micrometres [63 microinches]~~ or finer, as defined in ASME B 46.1.

5.2 *Strain gages*—As a minimum, use two electrical resistance strain gages to monitor the strain development in the steel ring. Each strain gage shall be wired in a quarter-bridge configuration (that is, one leg of a full Wheatstone bridge). See Note 1 for additional information.

5.3 *Data acquisition system*—The data acquisition system shall be compatible with the strain instrumentation and automatically record each strain gage independently. The resolution of the system shall be ~~±0.0000005 in./in. (m/m), m/m [in./in.]~~. The system shall be capable of recording strain data at intervals not to exceed 30 minutes.

NOTE 1—Use of a precision resistor, to balance the leg of the bridge, a strain conditioner input module, to complete the other half of the bridge, and a 16-channel interface board has been found to adequately provide the required resolution of the system.

5.4 *Base*—Epoxy-coated plywood or other non-absorptive and non-reactive surface.

5.5 *Outer ring*—Use one of the following alternative materials as the outer ring.

5.5.1 *PVC pipe*—Schedule 80-18 PVC pipe, in accordance with Specification F 441, with a ~~16.0 ± 0.12-in. (406 ± 3-mm) inside diameter and 6.0 ± 0.25-in. (152 ± 6-mm) height (see~~ Schedule 80-18 PVC pipe, in accordance with Specification F 441/F 441M, with a 405 ± 3-mm [16.0 ± 0.12-in.] inside diameter and 150 ± 6-mm [6.0 ± 0.25-in.] height (see Fig. 1).

5.5.2 *Steel outer ring*—~~0.125-in. (3-mm) thick steel sheeting formed to obtain a 16.0 ± 0.12-in. (406 ± 3-mm) inside diameter and 6.0 ± 0.25-in. (152 ± 6-mm) height.~~ 3-mm [0.125-in.] thick steel sheeting formed to obtain a 405 ± 3-mm [16.0 ± 0.12-in.] inside diameter and 150 ± 6-mm [6.0 ± 0.25-in.] height.

5.5.3 *Other materials*—Other suitable non-absorptive and non-reactive materials formed to obtain a ~~16.0 ± 0.12-in. (406 ± 3-mm) [16.0 ± 3-mm] 0.12-in.] inside diameter and 6.0 ± 0.25-in. (152 ± 6-mm) [6.0 ± 6-mm] 0.25-in.] height.~~

5.6 *Testing environment*—Store the specimens in an environmentally controlled room with constant air temperature of ~~73 ± 2.0~~ ± 3.5 °F (23.0 ± 2.0 °C) [73.5 ± 2.0 °C] 3.5 °F and relative humidity of 50 ± 4 %.

### 6. Materials and Mixing

#### 6.1 Materials:

6.1.1 *Cement*—Cement shall conform to Specifications C 150, C 595, or C 1157.

6.1.2 *Aggregates*—Aggregates shall conform to Specification C 33. The maximum nominal size of the coarse aggregate shall be ~~0.5-in. (13-mm)~~ 13-mm [0.5-in.] or less.

<sup>5</sup> The boldface numbers in parenthesis refer to the list of references at the end of this test method

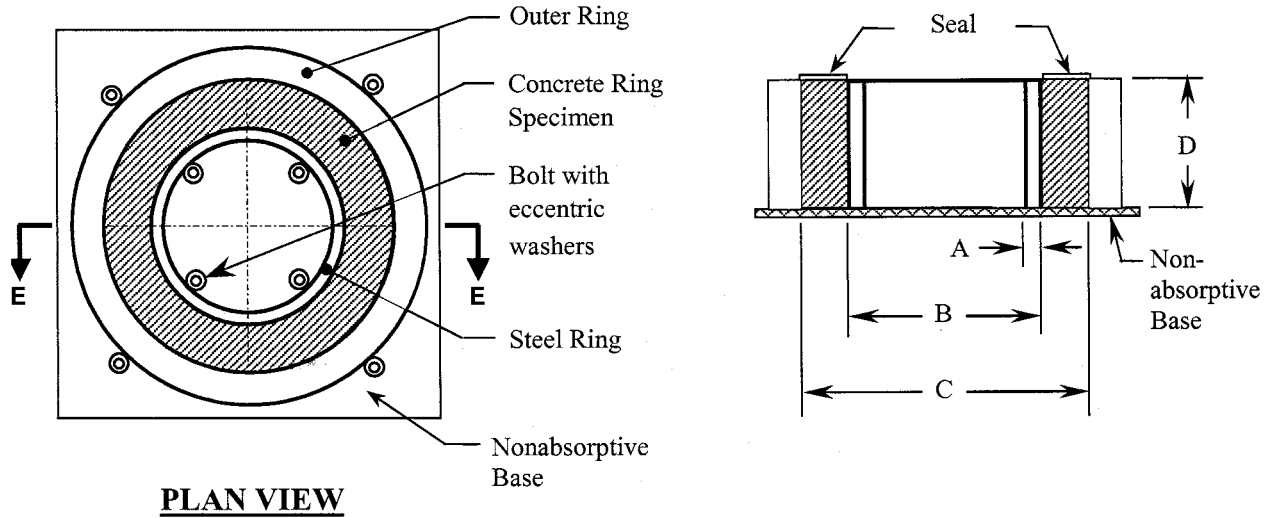
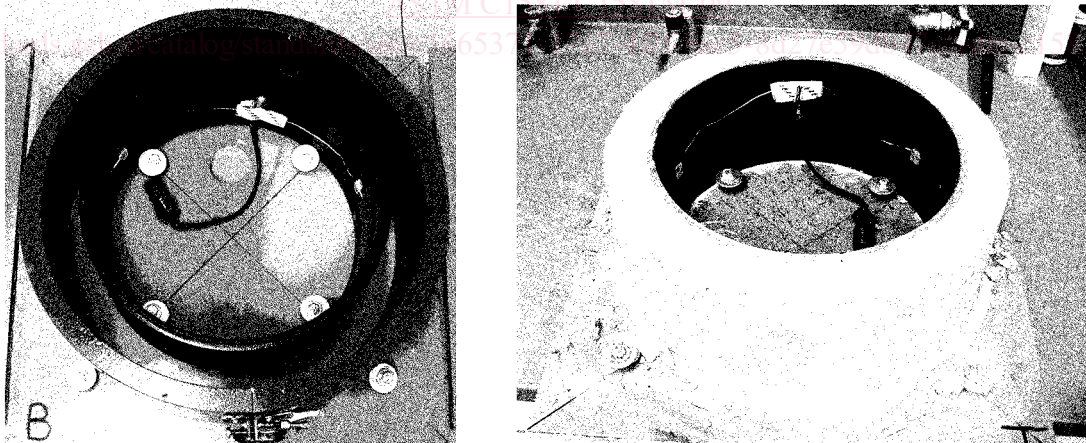


Figure Dimensions	SI Units	Inch-Pound Units
A	13 ± 1 mm	0.50 ± 0.05 in.
B	330 ± 3 mm	13.0 ± 0.12 in.
C	405 ± 3 mm	16.0 ± 0.12 in.
D	150 ± 6 mm	6.0 ± 0.25 in.

Notes:

1. Not to scale.
2. Bolts with eccentric washers for securing steel ring and outer ring to the base during casting of the test specimen (8 required).



**FIG. 1** Test specimen dimensions (top), specimen mold (bottom left), and specimen (bottom right).

6.2 *Mixing:*

6.2.1 *Concrete mixtures*—Machine mix the concrete as prescribed in Practice C 192/C 192M.

6.2.2 *Mortar mixtures*—Mix the mortar as prescribed in Specification C 387.

**7. Properties of Fresh Mixtures**

7.1 *Concrete mixtures*—Samples of freshly mixed concrete shall be tested in accordance with the following methods: