



SLOVENSKI STANDARD
oSIST prEN ISO 29768:2021
01-julij-2021

Toplotnoizolacijski proizvodi za uporabo v gradbeništvu - Ugotavljanje linearnih dimenzij preskušancev (ISO/DIS 29768:2021)

Thermal insulating products for building applications - Determination of linear dimensions of test specimens (ISO/DIS 29768:2021)

Wärmedämmstoffe für das Bauwesen - Bestimmung der linearen Maße von Probekörpern (ISO/DIS 29768:2021)

Produits isolants thermiques destinés aux applications du bâtiment - Détermination des dimensions linéaires des éprouvettes d'essai (ISO/DIS 29768:2021)

<https://standards.iteh.ai/catalog/standards/sist/3b68fcaa-efc5-41ba-aadc-99871ef113/osist-pr-en-iso-29768-2021>

Ta slovenski standard je istoveten z: prEN ISO 29768

ICS:

91.100.60	Materiali za toplotno in zvočno izolacijo	Thermal and sound insulating materials
-----------	---	--

oSIST prEN ISO 29768:2021

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[oSIST prEN ISO 29768:2021](#)

<https://standards.iteh.ai/catalog/standards/sist/3b68fcaa-efc5-41ba-aadc-a99ff4cfd1f3/osist-pren-iso-29768-2021>

DRAFT INTERNATIONAL STANDARD

ISO/DIS 29768

ISO/TC 163/SC 1

Secretariat: DIN

Voting begins on:
2021-05-13Voting terminates on:
2021-08-05

Thermal insulating products for building applications — Determination of linear dimensions of test specimens

Produits isolants thermiques destinés aux applications du bâtiment — Détermination des dimensions linéaires des éprouvettes d'essai

ICS: 91.100.60

iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN ISO 29768:2021](https://standards.iteh.ai/catalog/standards/sist/3b68fcaa-efc5-41ba-aadc-a99ff4cfd1f3/osist-pren-iso-29768-2021)<https://standards.iteh.ai/catalog/standards/sist/3b68fcaa-efc5-41ba-aadc-a99ff4cfd1f3/osist-pren-iso-29768-2021>

THIS DOCUMENT IS A DRAFT CIRCULATED FOR COMMENT AND APPROVAL. IT IS THEREFORE SUBJECT TO CHANGE AND MAY NOT BE REFERRED TO AS AN INTERNATIONAL STANDARD UNTIL PUBLISHED AS SUCH.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

This document is circulated as received from the committee secretariat.

ISO/CEN PARALLEL PROCESSING



Reference number
ISO/DIS 29768:2021(E)

© ISO 2021

iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN ISO 29768:2021
https://standards.iteh.ai/catalog/standards/sist/3b68fcaa-efc5-41ba-aadc-a99ff4cfd1f3/osist-pren-iso-29768-2021](https://standards.iteh.ai/catalog/standards/sist/3b68fcaa-efc5-41ba-aadc-a99ff4cfd1f3/osist-pren-iso-29768-2021)



COPYRIGHT PROTECTED DOCUMENT

© ISO 2021

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
Introduction.....	Fehler! Textmarke nicht definiert.
1 Scope	1
2 Terms and definitions	1
3 Principle.....	1
4 Apparatus.....	1
5 Test specimens.....	2
6 Procedure	3
7 Calculation and expression of results	4
8 Accuracy of measurement.....	4
9 Test report.....	5
Bibliography.....	6

iTeh STANDARD PREVIEW
(standards.iteh.ai)

<https://standards.iteh.ai/catalog/standards/sist/3b68fcaa-efc5-41ba-aadc-a99ff4cfd1f3/osist-pren-iso-29768-2021>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee Committee ISO/TC 163, *Thermal performance and energy use in the built environment*, Subcommittee SC 1, *Test and measurement methods*, in collaboration with the European Committee for Standardization (CEN) Technical Committee CEN/TC 88, *Thermal insulating materials and products*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

This second edition cancels and replaces the first edition (ISO 29768:2008) and the standard EN 12085:2013, which has been technically revised. The main changes compared to the previous edition are as follows:

Clause 5 test specimen;

Clause 6.1 test conditions to reflect the conditions for tropical countries and

Clause 9 test report

The standard also includes the ISO 1923 as published by ISO TC 61 SC 10. The standard is identical to the technical content of EN 12085.

Thermal insulating products for building applications — Determination of linear dimensions of test specimens

1 Scope

This International Standard specifies the characteristics and choice of measuring equipment and the procedure for determining the linear dimensions of test specimens that are taken from thermal insulating products. The procedures for measuring the dimensions of full-size products are specified in ISO 29465 and ISO 29466.

2 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

2.1

linear dimension

distance between two points, between two parallel lines or between two parallel planes, defined by corners, edges or surfaces of the test specimen

2.2

test specimen

single item or part of an item used for a test

3 Principle

The linear dimensions of a test specimen are measured using an apparatus giving the required degree of accuracy.

4 Apparatus

Any test equipment which provides the same result with at least the same accuracy may be used.

4.1 Flat surface, larger than the largest dimensions of the test specimen.


4.2 Dial gauge, permitting reading to at least 0,05 mm.

The measuring surface shall be of such a size that the total resultant measuring pressure ≤ 1 kPa.

NOTE The measuring pressure of the dial gauge can be reduced by removing the spring. The dial gauge, or any other electrical or optical measuring instrument having at least the same accuracy, can be fixed to a device to adapt the testing equipment to the size of the test specimen.

4.3 Micrometer, permitting readings to at least 0,05 mm.

A micrometer shall be used only if it incorporates a device that indicates the onset of the force applied by the micrometer when it contacts the test specimen surface. An example of such a device is an electrical circuit, consisting of a flexible wire, battery, lamp and an aluminium plate exerting a pressure of $(50 \pm 1,5)$ Pa on the test specimen, as shown in Figure 1.

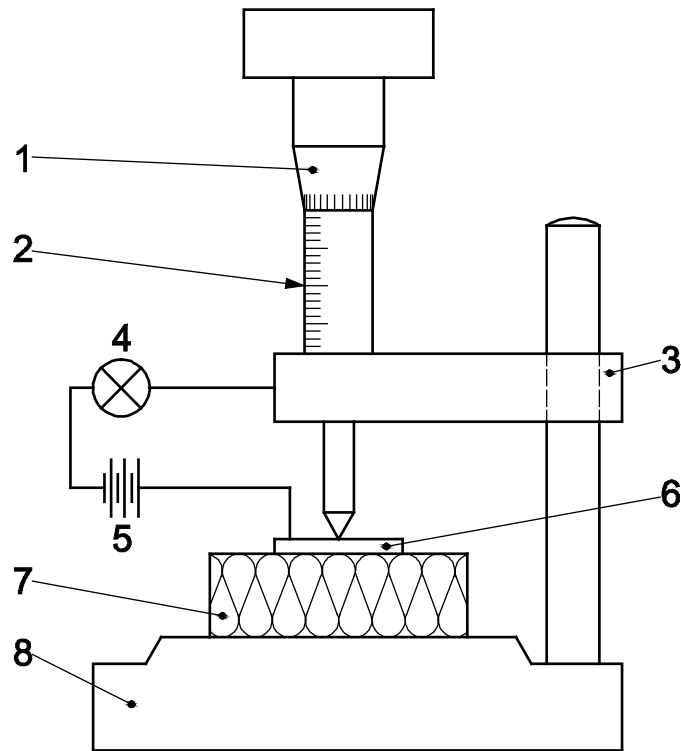

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Key

- 1 screw micrometer
- 2 millimetre scale
- 3 adjustable support
- 4 lamp
- 5 battery
- 6 aluminium plate, 10 cm²
- 7 test specimen
- 8 base plate

oSIST prEN ISO 29768:2021
<https://standards.iteh.ai/catalog/standards/sist/3b68fcaa-efc5-41ba-aadc-a99ff4cfd1f3/osist-pren-iso-29768-2021>

Figure 1 — Example of a suitable micrometer

4.4 Sliding caliper, permitting readings to at least 0,1 mm.

The sliding caliper shall be used only if it does not cause any deformation of the test specimen.

4.5 Metal rule or metal tape, graduated in millimetres and permitting reading to at least 0,5 mm.

5 Test specimens

The number, dimensions and conditioning of test specimens shall be as defined in the relevant test method standard or the product standard or any other international specification.

In tropical countries, different conditioning and testing conditions can be relevant. In this case, the conditions shall be 27 °C and 65 % RH and be stated clearly in the test report.

NOTE In the absence of a product standard or any other technical specification, the method for selection of the test specimens can be agreed between parties.

6 Procedure

6.1 Test conditions

The test conditions shall be as defined in the relevant test method standard or in the relevant product standard or any other international specification.

In tropical countries, different conditioning and testing conditions can be relevant. In this case, the conditions shall be 27 °C and 65 % RH and be stated clearly in the test report.

6.2 Choice of measuring equipment

The choice of measuring equipment shall be in accordance with the required accuracy of the measured value as given in the relevant test method standard or the product standard or any other international specification. Where no such standard or specification exists, the required accuracy shall be agreed between parties, but it shall correspond to the dimensions being measured.

If the required accuracy of the dimension is expressed in millimetres, the choice of the equipment shall be as shown in Table 1.

Table 1 — Required accuracy expressed in millimetres

Required accuracy mm	Measuring equipment	Readings to the nearest mm	Resolution mm
0,1	dial gauge digital indicator or micrometer ^a	0,05	0,1
0,2	sliding caliper ^b	0,1	0,2
1,0	metal tape or rule ^c	0,5	1,0
<p>^a A dial gauge shall be used only if the result is unaffected by dial gauge pressure up to 1 kPa.</p> <p>^b A dial gauge or a micrometer may also be used, but then it is not necessary for the instrument accuracy to be better than that of a sliding caliper.</p> <p>^c A sliding caliper or even a dial gauge or micrometer may be used, but then it is not necessary for the instrument accuracy to be better than that of the metal tape or rule.</p>			

Table 2 shall be used to provide the means for the selection of the equipment used where the accuracy is expressed in percentage terms. The choice depends on both the required accuracy and on the test specimen's dimensions.

Table 2 — Required accuracy expressed in percent

Required accuracy %	Measuring equipment/range of dimensions		
	20 mm to < 50 mm	50 mm to ≤ 100 mm	> 100 mm
0,5 to < 1	dial gauge or micrometer ^a	sliding caliper ^b	metal tape or rule ^c
1 to < 2	sliding caliper ^b	sliding caliper ^b	metal tape or rule ^c
≤ 2	sliding caliper ^b	metal tape or rule ^c	metal tape or rule ^c
<p>^a A dial gauge shall be used only if the result is unaffected by dial gauge pressure up to 1 kPa.</p> <p>^b A dial gauge or a micrometer may also be used, but then it is not necessary for the instrument accuracy to be better than that of a sliding caliper.</p> <p>^c A sliding caliper or even a dial gauge or micrometer may be used, but then it is not necessary for the instrument accuracy to be better than that of the metal tape or rule.</p>			

ISO/DIS 29768:2021(E)

6.3 Number and location of measurements

The number of the measuring locations shall depend on the size and the shape of the test specimen but shall be at least two. The locations shall be as widely separated as possible, in order to give a good mean value.

If the median of three readings at each position is taken, the mean shall be calculated from the two or more median values.

6.4 Measurement with dial gauge

The measurement shall be made with the test specimen placed on a flat surface.

The measurements shall be made with and without the test specimen. The difference between the two measurements gives one reading.

All readings shall be made to the nearest 0,05 mm. The mean value calculated shall be rounded to the nearest 0,1 mm.

6.5 Measurement with micrometer

The measurement shall be made with the test specimen placed on a flat surface. The micrometer shall be fixed to an adjustable support (see Figure 1). The measuring point of the micrometer shall be screwed down continuously until it just touches the test specimen, as indicated by the surface contact device.

The measurements shall be made with and without the test specimen. The difference between the two measurements gives one reading.

All readings shall be made to the nearest 0,05 mm. The mean value calculated shall be rounded to the nearest 0,1 mm.

6.6 Measurement with a sliding caliper

The caliper shall be progressively preset to smaller measurements and presented to the test specimen until the setting is reached when the caliper measuring faces just touch the surface of the test specimen without causing any deformation.

All readings shall be made to the nearest 0,1 mm. The mean value calculated shall be rounded to the nearest 0,2 mm.

6.7 Measurement with metal rule or metal tape

The test specimen shall not be distorted or damaged by the application of the metal rule or metal tape.

All readings shall be made to the nearest 0,5 mm. The mean value calculated shall be rounded to the nearest 1 mm.

7 Calculation and expression of results

The calculation of results shall be as defined in Clause 6.

8 Accuracy of measurement

NOTE It has not been possible to include a statement of the accuracy of measurement in this edition of this International Standard, but it is intended to include such a statement when this International Standard is next revised.