
Sistemi za avtomatizacijo in regulacijo stavb - Izvedba regulacije

Building automation and control systems - Control applications

Systeme der Gebäudeautomation - Steuerungsanwendung

Systèmes d'automatisation et de régulation des bâtiments - Applications de régulation

Ta slovenski standard je istoveten z: EN 17609:2022

<https://standards.iteh.ai/catalog/standards/sist/41e015f4-91c6-447a-9aaa-1fb8fcd340ed/sist-en-17609-2022>

ICS:

35.240.67	Uporabniške rešitve IT v gradbeništvu	IT applications in building and construction industry
91.140.01	Napeljave v stavbah na splošno	Installations in buildings in general

SIST EN 17609:2022**en,fr,de**

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 17609

July 2022

ICS 35.240.67; 91.140.01

English Version

Building automation and control systems - Control
applications

Systèmes d'automatisation et de régulation des
bâtiments - Applications de régulation

Systeme der Gebäudeautomation -
Steuerungsanwendung

This European Standard was approved by CEN on 13 June 2022.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and United Kingdom.

SIST EN 17609:2022

<https://standards.iteh.ai/catalog/standards/sist/41e015f4-91c6-447a-9aaa-1fb8fcd340ed/sist-en-17609-2022>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents	Page
European foreword	3
Introduction	4
1 Scope.....	10
2 Normative references.....	10
3 Terms and definitions.....	10
4 Abbreviations.....	12
5 Functional specifications having an impact on energy performance, comfort, and operational requirements of buildings.....	14
5.1 Heating control.....	14
5.2 Domestic hot water supply control.....	39
5.3 Cooling control.....	45
5.4 Ventilation and air conditioning control.....	66
5.5 Lighting control	81
5.6 Blind control.....	86
6 Functional elements	90
6.1 Sensor Functions.....	90
6.2 Actuator Functions.....	99
6.3 Display and User Operation Functions	103
6.4 Control Functions.....	110
Bibliography	157

European foreword

This document (EN 17609:2022) has been prepared by Technical Committee CEN/TC 247 “Building Automation, Controls and Building Management” the secretariat of which is held by SNV.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2023, and conflicting national standards shall be withdrawn at the latest by January 2023.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

Any feedback and questions on this document should be directed to the users’ national standards body. A complete listing of these bodies can be found on the CEN website.

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and the United Kingdom.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 17609:2022

<https://standards.iteh.ai/catalog/standards/sist/41e015f4-91c6-447a-9aaa-1fb8fcd340ed/sist-en-17609-2022>

Introduction

Buildings are built and operated serving a specific purpose, e.g. as an office workspace, a manufacturing floor, or a data centre. In each case, the usage of the space requires specific environmental conditions, e.g. temperature, light level or air quality, which is provided.

Increasing the efficient usage of energy to provide these environmental conditions is a key aspect of building design addressed in EN ISO 52120-1, *Energy Performance of Buildings — Energy performance of buildings — Part 1: Impact of Building Automation, Controls and Building Management*.

Energy efficiency requirements cannot be fulfilled by optimizing the primary systems of a building alone. A holistic view on the building and especially on the room control systems for lighting, solar protection and HVAC is the basis for optimizing the energy efficiency of buildings. This requires integration of the room and building controls and management systems from the design phase through installation and commissioning to the building operation.

The planning process for the technical infrastructure of a building and its spaces includes several steps starting with a rough set of requirements. With each step in the planning process the design becomes more detailed. First basic design choices or decisions allow for a budget estimate. These first design choices may be documented as depicted in Figure 1.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 17609:2022

<https://standards.iteh.ai/catalog/standards/sist/41e015f4-91c6-447a-9aaa-1fb8fcd340ed/sist-en-17609-2022>

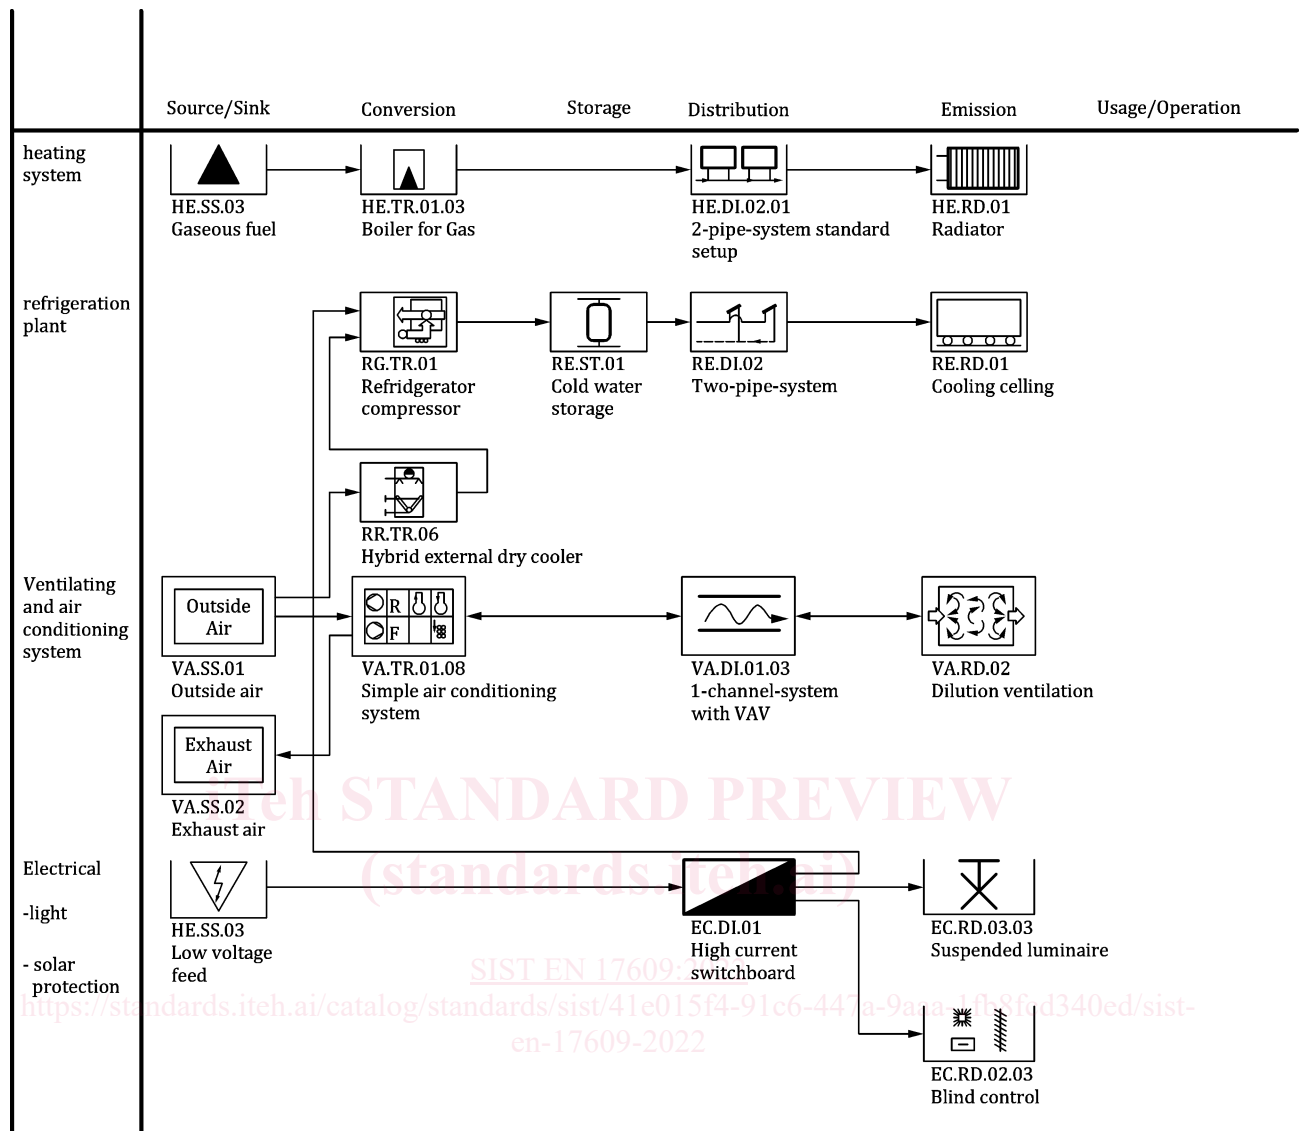


Figure 1 — Example for documentation of design choices for technical infrastructure of a building (Source: SN 502411:2016 / SIA 411:2016)

Figure 1 shows the equipment required for the different technical building disciplines (heating, cooling, ventilation, lighting, solar protection) in the space including energy related interconnections between the equipment of the respective disciplines. The schema depicts source/sink, conversion, storage, distribution, and emission elements and their interconnections in a simple manner. This is a high-level view on the mechanical and electrical equipment. It does not yet include the automation requirements associated with the equipment.

In a further planning step, the control functions (BAC functions) associated with the technical infrastructure equipment of a building are added as depicted in Figure 2.

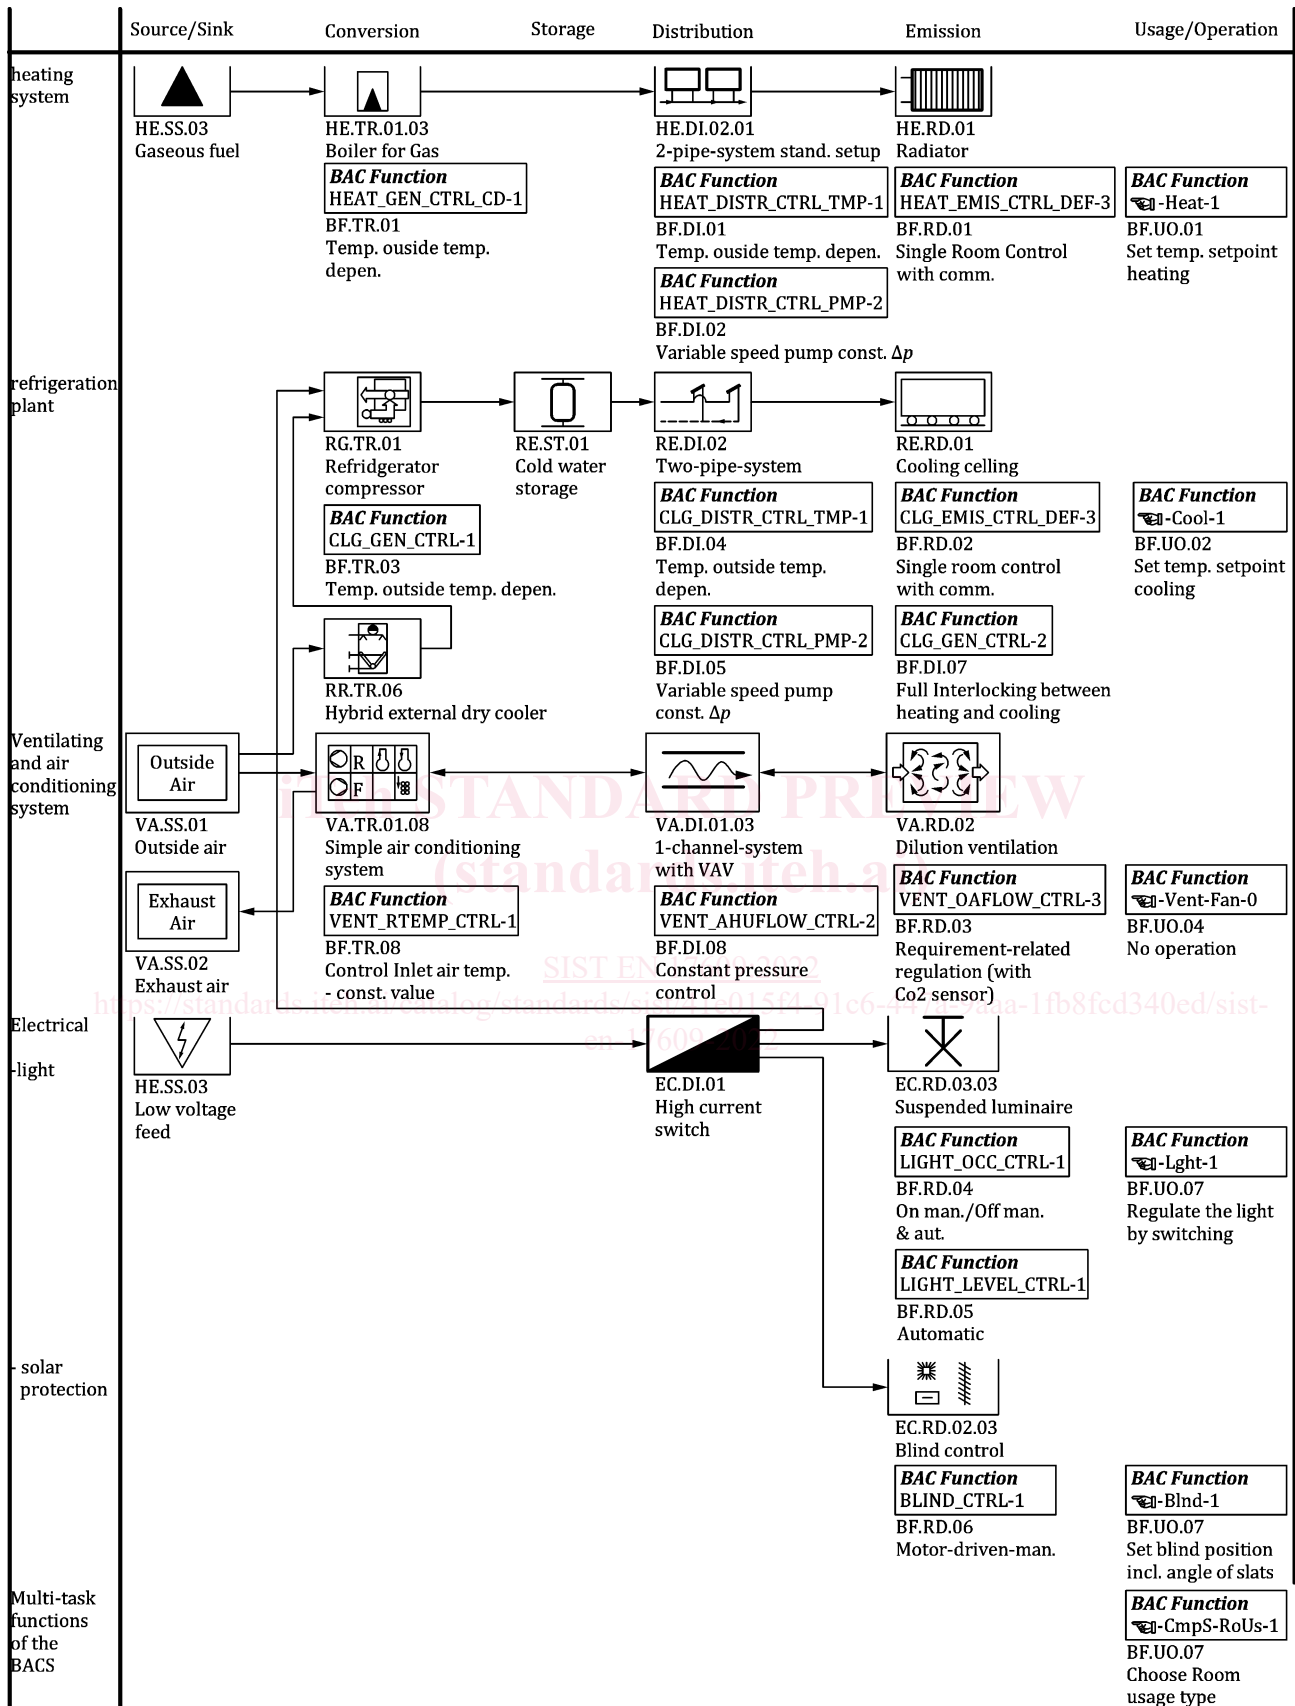


Figure 2 — Example for documentation of design choices for technical infrastructure and associated control functions of a building (Source: SN 502411:2016 / SIA 411:2016)

The column “usage/operation” contains control functions required for user interaction with the technical building infrastructure in the space and/or for super-ordinated (e.g. building-wide) functions and requirements.

Whereas the control functions are determined by the technical building equipment and the user operation interface in general, the sophistication of these control functions is determined by the desired level of energy efficiency of a building or comfort and operational requirements. Hence, both views, the desired level of energy efficiency of a building and the comfort and operational requirements, are considered and documented such that this documentation serves as a requirement specification for building control applications (heating, cooling, ventilation, lighting, solar protection) in a space.

In Figure 2, BAC functions have been added to the equipment. The labels refer to BAC functions listed in EN ISO 52120-1:2022, Table 5. These BAC functions are not specified in detail in EN ISO 52120-1.

Clause 5 of this document provides a method to transfer energy performance, comfort, and operational requirements as defined in EN ISO 52120-1:2022 into a more detailed specification of building automation functions.

Refer to EN ISO 52120-1:2022, Table 5, for a list of functions contributing to achieve the desired level of energy performance. Whereas EN ISO 52120-1:2022 only provides a very brief description of the functionality, Clause 5 contains a more detailed description.

NOTE Application of automated control improves the energy performance of buildings. Clause 5 of this document covers automated control applications only. Any manual or non-automated control listed in EN ISO 52120-1:2022, Table 5, is not covered in this document.

For the purpose of clarity, each subclause in Clause 5 contains a reference in square brackets to the corresponding entry in Table 5 of EN ISO 52120-1:2022 directly after the sub-clause heading.

The more detailed description includes information about mandatory and optional inputs as well as mandatory and optional outputs for the control function. The control function is not described in detail but rather is a “black box” as the actual implementation may be project or manufacturer specific.

Figure 3 provides an informative schematic view with the function (box), mandatory (blue) and optional (grey) inputs and mandatory (blue) and optional (grey) outputs. The informative schematic drawing also shows if inputs may be controlled, e.g. by manual operation or by a schedule and if output values are associated e.g. with an alarm or a trend.

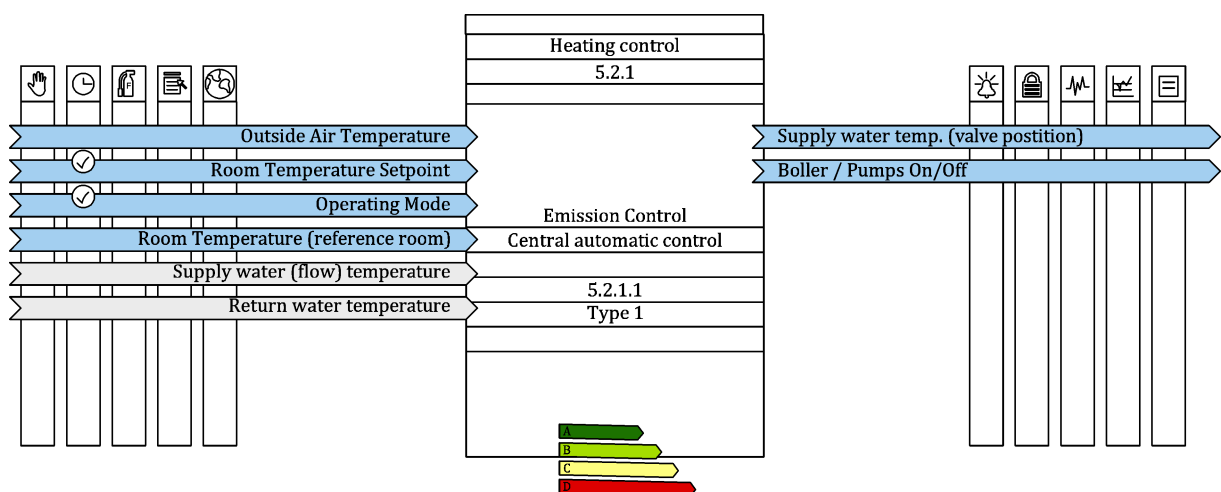


Figure 3 — Informative depiction of control application scheme for Heating control – Emission control – Type 1: Central automatic control

EN 17609:2022 (E)

Clause 5 contains in each sub-clause a brief description of the control function itself, the target of the function, different operating modes, where applicable, and a description of the inputs and outputs of the function. Optionally, parameters and implementation equipment may be described.

For some of these functions more than one version is described, covering different technological implementations.

Building control functions may be associated with a specific zone, a room, a building segment, or the whole building.

The result of applying Clause 5 is a collection of building automation control function blocks. This does not yet depict how these blocks work in detail or how they are linked to each other. A more detailed control scheme description can be provided using the function blocks described in Clause 6.

Clause 6 of this document provides function blocks, which can be used to describe building control functions in more detail independent of a specific building control system or vendor.

Applications can be described by a combination of sensor input, actuator output, user interaction, and control and monitoring functions. Certain functions in a room (e.g. presence detection) may be shared by two or more applications. A common set of function blocks covering sensor input, actuator output, user interaction, and control functions for the different applications in a room serves as the basis for describing room automation, controls and management systems.

Using a typical example, Figure 4 shows the relationship between sensor, display/operation, control and actuator functions. Information exchanged between functions is provided from outputs to inputs. Physical inputs and outputs associated with Sensor and Actuator functions are not depicted in the figure. As some functions may require parameters these are also depicted in each function block.

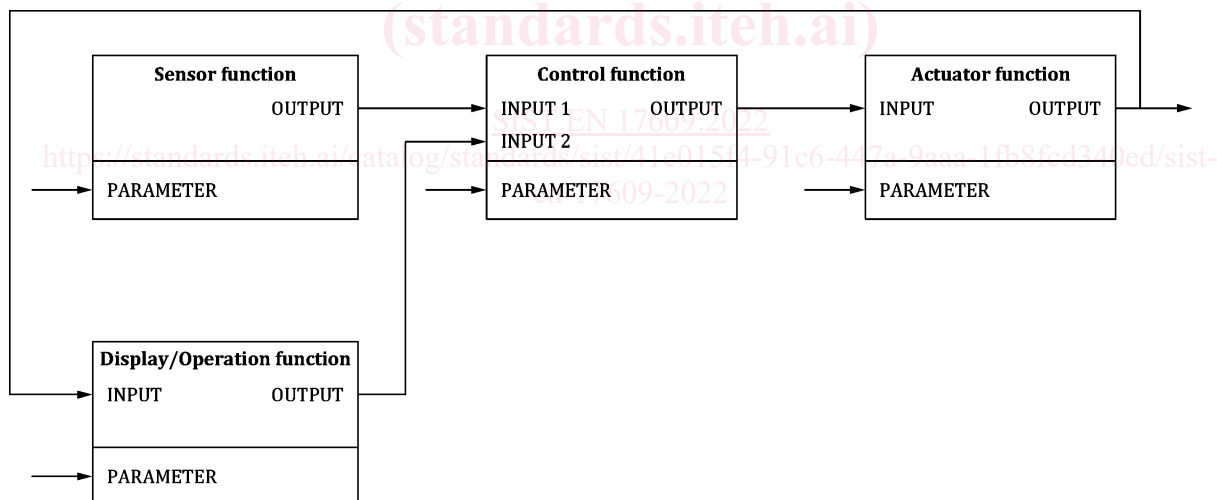


Figure 4 — Relationship between Automation functions (typical example)

A sensor function typically includes a physical input (e.g. a temperature sensor, not depicted in Figure 4) and provides a logical output (OUTPUT of the Sensor function block in Figure 4) for use by other functions.

A display and operation function includes physical inputs or outputs depending on its functionality and provides logical inputs for display purposes and logical outputs for use by other functions (Display and Operation function block in Figure 4).

Control functionality as depicted in Figure 4 is assigned to specific control functions with one or more logical inputs (INPUT 1 and INPUT 2 of the Control function block in Figure 4) and at least one logical output (OUTPUT of the Control function block in Figure 4). Control functions are not directly associated with physical inputs or outputs.

Actuator functionality is assigned to specific actuator functions. An actuator function typically includes a physical output (controlling e.g. a valve) and provides a logical input (INPUT of the Actuator function in Figure 4) and logical output. This logical output could be used as a feedback status information.

The generalized description format used in Clause 6 for functions includes a brief description of the function, of the physical input(s), of the logical input(s) expected from other functions, of the logical output(s) provided to other functions, and of the physical output(s). In addition, parameters are listed that are required to more precisely define the function for a specific project.

The description of the functions blocks follows this uniform scheme:

- Short description of the function;
- Physical Input(s);
- Logical Input(s);
- Logical Output(s);
- Physical Output(s);
- Parameters (optional).

The list of functions may be extended where necessary.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 17609:2022

<https://standards.iteh.ai/catalog/standards/sist/41e015f4-91c6-447a-9aaa-1fb8fcd340ed/sist-en-17609-2022>

1 Scope

This document specifies control applications and function blocks focusing on but not limited to lighting, solar protection and HVAC applications.

It describes how energy performance, comfort, and operational requirements of buildings are translated into functional specifications for integrated plant and room control.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN ISO 52120-1:2022, *Energy performance of buildings — Contribution of building automation, controls and building management — Part 1: General framework and procedures (ISO 52120-1:2021)*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN ISO 52120-1 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <https://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

3.1 building part

one or more rooms horizontally and/or vertically positioned with a joint perimeter typically determined by walls or floors

Note 1 to entry: A horizontal building part may be a floor. A vertical building part may be a building wing or side, e.g. North side or West wing. A building part may be a part of another building part (e.g. West wing – floor 2) and contains at least one room.

3.2 display function

presentation of information coming from an actuator, control, monitoring or sensor function in a visible format understandable by a human user

Note 1 to entry: Information may be displayed in text form (e.g. 18 °C, 100 %) or in a graphical form (e.g. light blue for cool, bar graph).

3.3 energy efficiency

ratio or other quantitative relationship between an output of performance, service, goods or energy, and an input of energy

EXAMPLE Efficiency conversion energy; energy required/energy used; output/input; theoretical energy used to operate/energy used to operate.

Note 1 to entry: Both input and output need to be clearly specified in quantity and quality. Additionally, they need to be measurable.

[SOURCE: EN ISO 52120-1:2022]

3.4**building automation**

coordinated control of lighting, solar protection, heating/ventilation/air conditioning devices and systems in a building providing the desired comfort level with maximum energy efficiency

Note 1 to entry: Coordinated control may also encompass access control via information links from those devices and systems to other building control devices and systems.

3.5**room automation**

coordinated control of lighting, solar protection, heating/ventilation/air conditioning devices and systems in a room providing the desired comfort level with maximum energy efficiency

Note 1 to entry: Coordinated control may also encompass access control via information links from those devices and systems to other room control devices and systems.

3.6**logical input**

interface of a function receiving data from an output of another function

3.7**logical output**

interface of a function sending data to an input of another function

3.8**operation function**

means for input of information by a human user intended for use by an actuator, control, monitoring or display function

Note 1 to entry: Operation of e.g. a wall switch, touch panel area may be used as input.

3.9**plant**

equipment for generation of hot or cold water and/or conditioned air

3.10**room**

one or more zones with a joint perimeter typically determined by walls or other types of partitions

Note 1 to entry: Typically, a room is a part of a building segment.

3.11**room automation**

control of one or more lighting, solar protection, and/or heating/ventilation/air conditioning in a room providing the desired comfort levels of these separate applications

3.12**smart control**

coordination between all control disciplines providing optimal balance of energy-efficiency, comfort, low life-cycle cost, ease of operation, engineering, and maintenance

Note 1 to entry: The implementation of the coordination may be achieved via logical information exchange and/or simply via physics. In the latter case coordination is relying on the synchronization of different disciplines during the design phase.

EN 17609:2022 (E)

3.13**solar protection**

means for reducing heat losses at night and for controlling the impact of solar radiation on the temperature in a space and/or on the visual comfort of an occupant of a space

Note 1 to entry: The impact of solar radiation on the temperature can lead to an undesired (in summer) or a desired (in winter) temperature rise.

3.14**space**

complete building, building part, room, or zone

3.15**superordinate control**

building control functions situated on a supervisory system overseeing automation functions and aggregating information spanning across a building, a campus, or several locations

3.16**zone**

smallest space determined by the minimum technical infrastructure required to operate that space

Note 1 to entry: The minimum technical infrastructure may be a heating radiator, ventilation outlet, or other mechanical or electrical equipment element.

3.17**technical building management****TBM**

process(es) and services related to operation and management of buildings and technical building system through the interrelationships between the different disciplines and trades

Note 1 to entry: The disciplines and trades comprise all technical building services for the purpose of optimized maintenance and energy consumption.

EXAMPLE Optimization of buildings through interrelationships ranging from heating, ventilation and air conditioning (HVAC) to lighting and day lighting to life safety and security to electric power systems and energy monitoring and metering; to its services, including communications and maintenance and to its management.

[SOURCE: EN ISO 52120-1:2022]

4 Abbreviations

Abbreviation	Description
BAC	Building Automation and Control
BACS	Building Automation and Control System
COP	Coefficient of Performance
DHW	Domestic Hot Water
TBM	Technical Building Management
TABS	Thermally Activated Building Structure

For the purposes of Clause 6, the following abbreviations and acronyms apply:

Abbreviation	Description
PAR	Parameter
T	Temperature

For the purposes of Clause 6, for the data types of input and output information shown in the informative examples, the following abbreviations apply:

Abbreviation	Description
Presence	Presence of persons, comprising the states — present and — absent
Binary	Two-valued state whose meaning depends on the function, e.g. — window open — window closed
Function	Enumeration type for controller function (see also 6.4.21)
Solar	Data structure providing information on position (in percent) and slat tilt (in degrees, optionally for blinds) of the solar protection
Light	Control value or current value of the lighting system (in percent)
Lux	Illuminance (in lux)
Mode	Enumeration type for the energy mode, comprising the states — comfort — pre-comfort — economy — protection
Usage	Enumeration type for various room utilisation types
Pos	Control value or current value of drives, e.g. valves, ventilation dampers or windows (in percent)
Qual	Air quality (e.g. CO ₂ content, in ppm)
Temp	Temperature (in degrees Celsius)
Wind	Wind velocity (in metres per second)
Angle	Angle, e.g. of solar position (in degrees)
Time	Current time and date

NOTE Although the identifiers of the input/output information in the informative function blocks merely serve for unambiguous allocation to the text, the naming follows a systematic pattern, consisting of two codes which allow stating the data type and the use: