



SLOVENSKI STANDARD

SIST EN 1825-2:2002

01-december-2002

© Yj Ub_ 'a Uý cV'È&"XY. :ñVcf 'bUhj bY'j Y]_cgñžj [fUXb'UžXY'cj Ub'Y]b
j nXfÿYj Ub'Y

Grease separators - Part 2: Selection of nominal size, installation, operation and maintenance

Abscheideranlagen für Fette - Teil 2: Wahl der Nenngroße, Einbau, Betrieb und Wartung

ITeH STANDARD PREVIEW

Installations de séparation de graisses - Partie 2: Choix des tailles nominales, installation, service et entretien

[SIST EN 1825-2:2002](https://standards.iteh.ai/catalog/standards/sist/7edcc1e2-556d-43cc-a726-35a1f07050ce/sist-en-1825-2-2002)

Ta slovenski standard je istoveten z: **EN 1825-2:2002**

ICS:

13.060.30 Odpadna voda Sewage water

SIST EN 1825-2:2002 en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 1825-2:2002](#)

<https://standards.iteh.ai/catalog/standards/sist/7cdcc1e2-556d-43cc-a726-33af107050ce/sist-en-1825-2-2002>

EUROPEAN STANDARD

EN 1825-2

NORME EUROPÉENNE

EUROPÄISCHE NORM

February 2002

ICS 13.060.30

English version

**Grease separators - Part 2: Selection of nominal size,
installation, operation and maintenance**Installations de séparation de graisses - Partie 2: Choix des
tailles nominales, installation, service et entretienAbscheideranlagen für Fette - Teil 2: Wahl der Nenngröße,
Einbau, Betrieb und Wartung

This European Standard was approved by CEN on 29 September 2001.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

SIST EN 1825-2:2002

<https://standards.iteh.ai/catalog/standards/sist/7cdcc1e2-556d-43cc-a726-33af107050ce/sist-en-1825-2-2002>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

	page
Foreword.....	3
1 Scope	3
2 Normative references	3
3 Terms and definitions.....	3
4 Application.....	4
5 Nominal size	5
6 Selection of the nominal size.....	5
6.1 General.....	5
6.2 Determination of the specific values	5
6.2.1 Maximum flow rate of wastewater.....	5
6.2.2 Temperature factor f_t	6
6.2.3 Density factor f_d	6
6.2.4 Detergent and rinsing agent factor f_r	7
6.3 Special cases.....	7
6.4 Determination of sludge trap volume.....	7
7 Installation	8
7.1 Limitations	8
7.2 Place of installation.....	8
7.3 Drainage to and from the separator.....	8
7.4 Ventilation.....	8
8 Operation, inspection and maintenance	9
Annex A (normative) Calculation of maximum wastewater flow Q_s	10
A.1 Calculation based on equipment/fittings discharging into the separator	10
A.1.1 General.....	10
A.1.2 Maximum wastewater flow rate Q_s	10
A.2 Method based upon the type of establishment discharging into the separator	11
A.2.1 General.....	11
A.2.2 Maximum wastewater flow rate Q_s	11
Annex B (informative) Densities of greases and oils.....	14
Annex C (informative) Examples of determining nominal size of grease separator	16
C.1 Examples of calculation based on equipment/fittings discharging into the separator.....	16
C.2 Examples of calculation based on the type of establishment discharging into the separator	21
Annex D (informative) Measures to prevent grease accumulating and grease build-up in the pipelines upstream of the grease separator	26
Bibliography	27

Foreword

This document EN 1825-2:2002 has been prepared by Technical Committee CEN/TC 165 "Wastewater engineering", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by August 2002, and conflicting national standards shall be withdrawn at the latest by June 2004.

When pollution control requires the treatment of pollutants other than light liquids, additional measures might be necessary.

It is the second part of a two part standard for grease separators. Part 1 gives principles of design, performance and testing, marking and quality control of grease separators.

Annex A is normative. The annexes B, C and D are informative.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Italy, Ireland, Luxembourg, Malta, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

STANDARD PREVIEW
(standards.iteh.ai)

1 Scope

This European Standard provides guidance on the selection of nominal sizes, installation, operation and maintenance of grease separators manufactured in accordance with prEN 1825-1.

This standard does not apply to wastewater containing light liquids, e.g. grease or oils of mineral origin, and does not include treating stable emulsions of grease or oil in water.

The standard does not cover the use of biological additives (bacteria, enzymes).

2 Normative references

This European Standard incorporates by dated or undated references, provisions from other publications. These normative references are cited at the appropriate places in the text, and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies (including amendments).

prEN 1825-1:2000, *Grease separators — Part 1: Principles of design, performance and testing, marking and quality control*.

EN 12056-2, *Gravity drainage systems inside buildings — Part 2: Sanitary pipework, layout and calculation*.

3 Terms and definitions

For the purposes of this European Standard the terms and definitions given in prEN 1825-1 and EN 12056-2 and the following apply.

EN 1825-2:2002 (E)**3.1****selection of the nominal size**

determination of the appropriate nominal size of the grease separation chamber for a specific case, based on amount and type of influent

4 Application

Grease separators shall be used wherever it is necessary to separate greases and oils of vegetable and animal origin from wastewater, such as in trade or industrial plants/establishments, e.g.

- commercial kitchens and large catering establishments, e.g. in inns, hotels, motorways service stations, canteens;
- grilling, roasting and frying facilities;
- food distribution points (with returnable crockery);
- butcher's shops, with or without slaughtering facilities;
- meat and sausage factories, with or without slaughtering facilities;
- abattoirs;
- poultry slaughterers;
- tripe preparation plants;
- animal rendering plants;
- bone and glue boiling plants;
- soap and stearine factories;
- oil mills;
- vegetable oil refineries;
- margarine factories;
- pickling plants;
- fast-food preparation plants;
- chip and crisp producers;
- peanut roasting plants.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 1825-2:2002](https://standards.iteh.ai/catalog/standards/sist/7cdcc1e2-556d-43cc-a726-33af107050ce/sist-en-1825-2-2002)

<https://standards.iteh.ai/catalog/standards/sist/7cdcc1e2-556d-43cc-a726-33af107050ce/sist-en-1825-2-2002>

Wastewater containing a considerable proportion of grease in a non-separable form (i.e. emulsified) from applications such as dairy, cheese making and fish processing, or from distribution points having only dish washing facilities, or from "wet waste compactors", will only be effectively treated in grease separators under certain conditions. The wastewater may require further treatment.

Applications where the discharged wastewater contains solids that are quick to purify (e.g. the fish industry) do not require a sludge trap, but the grease separator shall be fitted with a strainer or screening device fitted on the inlet side to retain coarse solids. Any retained solids should be removed and the separator thoroughly flushed with clean water before operational intervals to prevent putrefaction.

5 Nominal size

For the preferred nominal sizes (NS) see clause 4 of prEN 1825-1:2000.

Multiple separators of the same nominal size may be connected in parallel with the flow split equally between each separator.

6 Selection of the nominal size

6.1 General

The selection of the nominal sizes shall be based on the nature and quantity of wastewater to be treated taking into account:

- maximum flow rate of wastewater;
- maximum temperature of the wastewater;
- density of grease/oils to be separated;
- influence of cleansing and rinsing agents.

If a grease storage capacity greater than $40 \cdot NS$ in litres is required, e.g. when more than the usual amount of grease is expected, the following options may be used:

- 1) using a larger nominal size separator than calculated or
- 2) creating grease storage capacity outside the separator or
- 3) emptying the separator more frequently than usually.

Where no specific sizing method is offered by a regulatory authority, then the nominal size of the separator shall be determined from the following formula:

$$NS = Q_s f_t f_d f_r \quad (1)$$

where

NS is the calculated nominal size of the separator;

Q_s is the maximum flow rate of wastewater, entering the separator in litres per second;

f_t is the impeding factor for the temperature of influent;

f_d is the density factor for the relevant grease/oil;

f_r is the impeding factor for the influence of cleansing and rinsing agents.

After calculation select the next higher preferred nominal size in accordance with clause 4 of prEN 1825-1:2000.

6.2 Determination of the specific values

6.2.1 Maximum flow rate of wastewater

The maximum flow rate of wastewater Q_s shall be determined by:

EN 1825-2:2002 (E)

- a) measurement, or
- b) calculation based upon catering equipment discharging into the grease separator, or
- c) calculation based upon the type of establishment discharging into the grease separator, or
- d) special calculation for individual cases, if acceptable by the regulatory authority.

Where data is available to determine Q_s by b) or c), and the designer is unsure of the most appropriate option of use, it is recommended that the higher of the flow rates determined from both calculations is used.

6.2.2 Temperature factor f_t

High wastewater temperature reduces the efficiency of grease separators. Temperature factors f_t are given in Table 1.

Table 1 — Temperature factor f_t

Temperature of wastewater at inlet °C	Temperature factor f_t
≤ 60	1,0
always or occasionally > 60	1,3

iTeh STANDARD PREVIEW
(standards.iteh.ai)

6.2.3 Density factor f_d


A density factor $f_d = 1,0$ shall be used for wastewater discharged from kitchens, abattoirs and meat and fish processing plants.

<https://standards.iteh.ai/catalog/standards/sist/7cdcc1e2-556d-43cc-a726-33af107050ce/sist-en-1825-2-2002>

When the nature of grease/oil is well known, the density coefficient may be taken from Figure 1, where f_d is plotted for a range of different grease and oil densities.

For grease/oil densities > 0,94 g/cm³, a density factor of 1,5 shall be used.

Densities of different fats and oils are given in annex B.

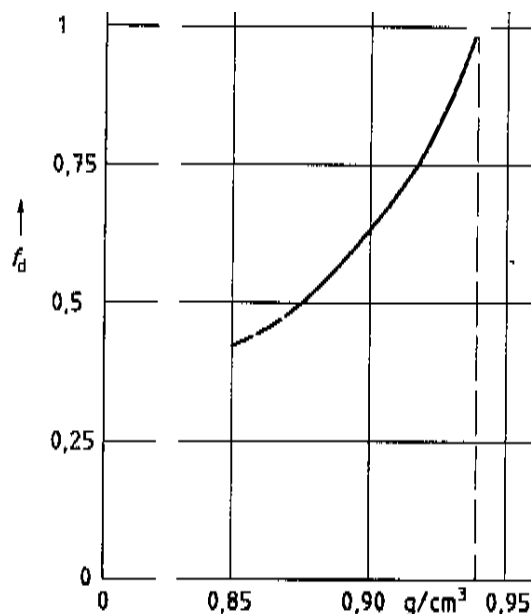

iTeh STANDARD PREVIEW
Figure 1 — Relation between f_d and density
 (standards.itih.ai)

6.2.4 Detergent and rinsing agent factor f_r

SIST EN 1825-2:2002

Detergents, including dishwasher powders and rinsing agents, should carefully be selected and used sparingly. They shall not impair the separating effect as far as possible and not form stable emulsions where they are used upstream of a separator. A detergent and rinsing agent coefficient shall be chosen from Table 2.

Table 2 — Detergent and rinsing agent coefficient f_r

Use of detergent and rinsing agents	Detergent and rinsing agent coefficient f_r
Never used	1,0
Occasionally or always used	1,3
Special cases, e.g. hospitals	$\geq 1,5$

National and local regulations may limit the use of certain detergents, rinsing agents and solvents.

6.3 Special cases

For industrial plants such as abattoirs and wholesale butchers, the grease separator nominal size NS should be selected on the basis of site specific investigation.

6.4 Determination of sludge trap volume

The sludge trap volume shall be at least $100 \cdot NS$ in litres but for abattoirs and similar plants a volume of at least $200 \cdot NS$ in litres is recommended.

EN 1825-2:2002 (E)**7 Installation****7.1 Limitations**

Only wastewater containing organic grease and oils shall be discharged to a grease separator. In particular, the following shall not be discharged to a grease separator:

- wastewater containing faeces ("black" water);
- rainwater;
- wastewater containing light liquids, e.g. grease or oil of mineral origin.

7.2 Place of installation

Grease separators should be installed close to the sources of wastewater but should not be sited in unventilated rooms, roads, car parks or storage areas. To prevent odour and fly nuisance, separators should not be sited close to habitable buildings, especially to opening windows and air intakes. They shall be easily accessible to cleaning vehicles. Specific operational and structural conditions may require the separator to be remotely located from the source of wastewater.

Separators should be installed in such a way to prevent frost damage, and allow all parts requiring regular maintenance to be easily accessible at all times.

Where necessary, manhole covers on separators shall be supported so that the load imposed on the separator does not exceed its design strength.

7.3 Drainage to and from the separator

Where no specific local regulations exist, grease separators shall be connected to the drains and sewers as follows:

The wastewater to the grease separator shall be gravity fed. If the static water level in the grease separator is lower than the flood level (see EN 752-1), then the effluent from the separator shall be discharged to the drainage system using a wastewater lifting plant.

Pipelines upstream of the separator shall be laid at a minimum gradient of 2 % (1 : 50) to prevent an accumulation of grease. Where for structural and/or operational reasons, this is not possible, and/or longer pipe runs are required, appropriate measures shall be taken to prevent grease accumulation or deposition (see annex D).

The transition from vertical to horizontal pipes shall be made by using two 45° bends between which a piece of pipe, at least 250 mm long, shall be placed, or by using equivalent long-radius bend. This shall be followed by a stilling section that has a length, in millimetres, equal to at least 10 times the nominal size of the supply pipe and shall be placed upstream of the separator.

Local regulations may limit the temperature of wastewater at the point of connection to the public sewerage system.

Discharge points, e.g. floor drains, shall have traps, which, where necessary, include sediment buckets which can be removed for cleaning purposes.

The use of sludge traps with an inlet from above, e.g. through a grating, is not permitted.

7.4 Ventilation

Pipelines connected to grease separators (upstream and downstream) shall be adequately ventilated. The discharge pipe to the separator shall be provided with a stack vent and branch ventilating pipes shall be connected to all upstream branch pipes more than 5 m long.

Where the nearest vent is further than 10 m upstream of the grease separator, the supply pipe shall be fitted with an additional vent pipe, terminating as close as possible to the separator.

8 Operation, inspection and maintenance

Grease separators should be inspected, emptied and cleaned regularly. Attention is drawn to the need to comply with national or local regulations for the disposal of waste.

The frequency of inspection, emptying and cleaning should be determined with regard to the grease and sludge storage capacity of the separator and in accordance with operational experience. Unless otherwise specified, separators should be emptied, cleaned and refilled with clean water at least once a month and, preferably, every two weeks.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 1825-2:2002](https://standards.iteh.ai/catalog/standards/sist/7cdcc1e2-556d-43cc-a726-33af107050ce/sist-en-1825-2-2002)

<https://standards.iteh.ai/catalog/standards/sist/7cdcc1e2-556d-43cc-a726-33af107050ce/sist-en-1825-2-2002>