

---

**Informacijska tehnologija - Naprave in infrastruktura podatkovnega centra - 2-4.**  
**del: Pokabljenje za telekomunikacije**

Information technology - Data centre facilities and infrastructures - Part 2-4:  
Telecommunications cabling infrastructure

Informationstechnik - Einrichtungen und Infrastrukturen von Rechenzentren - Teil 2-4:  
Infrastruktur der Telekommunikationsverkabelung

Technologie de l'information - Installation et infrastructures de centres de traitement de  
données - Partie 2-4: Infrastructure du câblage dédié télécommunications

**Ta slovenski standard je istoveten z: EN 50600-2-4:2023**

---

**ICS:**

33.040.01	Telekomunikacijski sistemi na splošno	Telecommunication systems in general
35.110	Omreževanje	Networking

**SIST EN 50600-2-4:2023****en**



EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

**EN 50600-2-4**

March 2023

ICS 35.110; 35.020; 35.160

Supersedes EN 50600-2-4:2015

English Version

**Information technology - Data centre facilities and infrastructures  
- Part 2-4: Telecommunications cabling infrastructure**

Technologies de l'information - Installation et infrastructures  
de centres de traitement de données - Partie 2-4:  
Infrastructure du câblage dédié aux télécommunications

Informationstechnik - Einrichtungen und Infrastrukturen von  
Rechenzentren - Teil 2-4: Infrastruktur der  
Telekommunikationsverkabelung

This European Standard was approved by CENELEC on 2023-03-20. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and the United Kingdom.

SIST EN 50600-2-4:2023

<https://standards.iteh.ai/catalog/standards/sist/52ba3571-fd56-4b55-b276-fabf3796c01c/sist-en-50600-2-4-2023>



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

## Contents

Page

<b>European foreword.....</b>	<b>5</b>
<b>Introduction.....</b>	<b>6</b>
<b>1 Scope.....</b>	<b>9</b>
<b>2 Normative references.....</b>	<b>9</b>
<b>3 Terms, definitions and abbreviations .....</b>	<b>10</b>
3.1 Terms and definitions .....	10
3.2 Abbreviations .....	14
<b>4 Conformance .....</b>	<b>15</b>
<b>5 Telecommunications cabling within the data centre.....</b>	<b>15</b>
5.1 General .....	15
5.2 Requirements for cabling supporting the IT operations in all data centre spaces.....	16
5.3 Requirements for cabling providing distributed building services in all data centre spaces .....	16
5.4 Requirements for cabling for IT and network telecommunications to and within the computer room space.....	17
5.4.1 General .....	17
5.4.2 Point-to-point cabling .....	17
5.4.3 Requirements for fixed cabling .....	19
<b>6 Implementation of cabling in accordance with EN 50173-5.....</b>	<b>20</b>
6.1 General .....	20
6.2 Functional elements.....	20
6.3 Distribution areas and spaces .....	21
6.3.1 General .....	21
6.3.2 Distribution areas.....	23
6.3.3 Building entrance facility.....	24
6.3.4 Entrance rooms .....	25
6.4 Infrastructures supporting the functional elements of EN 50173-5 .....	25
6.4.1 General .....	25
6.4.2 Pathways and pathway systems for telecommunications cabling.....	25
6.4.3 Cabinets, frames and racks for the computer room space.....	26
<b>7 Physical Security.....</b>	<b>27</b>
7.1 General .....	27
7.2 Protection against unauthorized access .....	27
7.2.1 Pathways and spaces.....	27
7.2.2 Entrance room .....	28
7.3 Protection against internal events .....	28

<b>8</b>	<b>Availability classification for the telecommunications cabling infrastructure, infrastructure elements, facilities and spaces .....</b>	<b>28</b>
8.1	General .....	28
8.2	Availability design principles for telecommunications cabling infrastructure .....	29
8.3	Overview about the availability classes for telecommunications cabling .....	30
8.4	Availability Class design requirements and recommendations .....	30
8.4.1	Transmission channel design for the network distribution cabling .....	30
8.4.2	Availability Class 1 .....	31
8.4.3	Availability Class 2 .....	32
8.4.4	Availability Class 3 .....	35
8.4.5	Availability Class 4 .....	38
<b>9</b>	<b>Management and operation of the telecommunications cabling infrastructure .....</b>	<b>40</b>
9.1	General .....	40
9.2	Automated infrastructure management systems .....	40
	<b>Annex A (informative) Design concepts for network distribution cabling .....</b>	<b>41</b>
	<b>Annex B (informative) Energy efficiency considerations for the telecommunications cabling infrastructure .....</b>	<b>50</b>
	<b>Annex C (informative) Summary of requirements .....</b>	<b>51</b>
	<b>Annex D (informative) Examples of telecommunications cabling infrastructures including active equipment .....</b>	<b>53</b>
	<b>Annex E (informative) Availability description .....</b>	<b>56</b>
	<b>Annex F (normative) Availability Classes for cabling infrastructures in colocation data centres ..</b>	<b>57</b>
	<b>Bibliography .....</b>	<b>61</b>

## Figures

Figure 1 — Schematic relationship between the EN 50600 series of documents .....	7
Figure 2 — Schematic relationship between the EN 50600-2-4 and other European cabling design and installation standards .....	8
Figure 3 — Impact of growth in an unstructured point-to-point cabling infrastructure .....	18
Figure 4 — Structured cabling infrastructure: setup and growth .....	19
Figure 5 — Functional elements and cabling subsystems of EN 50173-5 .....	21
Figure 6 — Facilities and spaces relevant for cabling according EN 50173-5 .....	22
Figure 7 — Areas providing accommodation for distributors of EN 50173-5 and connected active equipment .....	23
Figure 8 — Principle of supply and distribution .....	29
Figure 9 — Transmission channels (interconnect and cross-connect) .....	31
Figure 10 — Telecommunication cabling Class 1 using direct attached cords .....	32
Figure 11 — Telecommunication cabling Class 1 .....	32
Figure 12 — Telecommunication cabling Class 2 .....	33
Figure 13 — Managing moves, adds and changes .....	34
Figure 14 — Telecommunication cabling Class 3 with one entrance room .....	36

**EN 50600-2-4:2023 (E)**

Figure 15 — Telecommunication cabling Class 3 with two entrance rooms.....	36
Figure 16 — Telecommunication cabling Class 4.....	39
Figure A.1 — Symbols of network elements .....	41
Figure A.2 — Example of a Class 1 cabling implementation .....	42
Figure A.3 — Example for Class 2 EoR cabling implementation .....	43
Figure A.4 — Example for Class 2 MoR cabling implementation .....	44
Figure A.5 — Example for Class 2 ToR cabling implementation .....	45
Figure A.6 — Example for Class 3 EoR cabling implementation .....	46
Figure A.7 — Example for Class 3 ToR cabling implementation .....	47
Figure A.8 — Example for Class 4 EoR cabling implementation .....	48
Figure A.9 — Example for Class 4 ToR cabling implementation .....	49
Figure D.1 — Example of Availability Class 3 cabling and active equipment with one entrance room .....	53
Figure D.2 — Example of Availability Class 3 cabling and active equipment with two entrance rooms.....	54
Figure D.3 — Example of Availability Class 4 cabling and active equipment.....	54
Figure D.4 — Example of Availability Class 3 cabling and active equipment implemented across multiple floors.....	55
Figure D.5 — Example of Availability Class 3 cabling and active equipment implemented across multiple floors.....	55
Figure F.1 — Telecommunications supply cabling for a single building colocation (AC 3) .....	59
Figure F.2 — Telecommunications supply cabling for a single building colocation (AC 4) .....	59
Figure F.3 — Telecommunications supply cabling for a multi building colocation (AC 4) .....	60
<b>Tables</b>	
Table 1 — Telecommunication cabling Availability Classes per space and overall data centre Availability Class.....	30
Table C.1 — Telecommunications cabling infrastructure requirements per Availability Class .....	51
Table E.1 — Summary of availability classification .....	56

## European foreword

This document (EN 50600-2-4:2023) has been prepared by CLC/TC 215 “Electrotechnical aspects of telecommunication equipment”.

The following dates are fixed:

- latest date by which this document has to be (dop) 2024-03-20  
implemented at national level by publication of  
an identical national standard or by  
endorsement
- latest date by which the national standards (dow) 2026-03-20  
conflicting with this document have to be  
withdrawn

This document supersedes EN 50600-2-4:2015.

The following major modifications have been made compared to EN 50600-2-4:2015:

- a) the document structure has been completely revised;
- b) the availability classes have been revised;
- c) a clause on physical security has been added (Clause 7);
- d) Annex C summarizing the requirements and recommendations of the document has been added;
- e) Annex D with examples for cabling infrastructures including the location of active equipment has been added;
- f) Annex E with an availability description has been added;
- g) Annex F with specific requirements for colocation data centres has been added.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a Standardization Request given to CENELEC by the European Commission and the European Free Trade Association.

Any feedback and questions on this document should be directed to the users' national committee. A complete listing of these bodies can be found on the CENELEC website.

## Introduction

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres are housing and supporting the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres usually provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, energy consumption of data centres has become critical both from an environmental point of view (reduction of carbon footprint) and with respect to economical considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting or network operator facilities);
- b) security level;
- c) physical size;
- d) accommodation (mobile, temporary and permanent constructions).

The needs of data centres also vary in terms of availability of service, the provision of security and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control telecommunications cabling and physical security as well as the operation of the data centre. Effective management and operational information is required to monitor achievement of the defined needs and objectives.

Recognizing the substantial resource consumption, particularly of energy, of larger data centres, it is also important to provide tools for the assessment of that consumption both in terms of overall value and of source mix and to provide Key Performance Indicators (KPIs) to evaluate trends and drive performance improvements.

At the time of publication of this document, the EN 50600 series is designed as a framework of standards, technical specifications and technical reports covering the design, the operation and management, the key performance indicators for energy efficient operation of the data centre as well as a data centre maturity model.

The EN 50600-2 series defines the requirements for the data centre design.

The EN 50600-3 series defines the requirements for the operation and the management of the data centre.

The EN 50600-4 series defines the key performance indicators for the data centre.

The CLC/TS 50600-5 series defines the data centre maturity model requirements and recommendations.

The CLC/TR 50600-99-X Technical Reports cover recommended practices and guidance for specific topics around data centre operation and design.

This series of documents specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation and maintenance of facilities and infrastructures within data centres. These parties include:


- 1) owners, operators, facility managers, ICT managers, project managers, main contractors;
- 2) consulting engineers, architects, building designers and builders, system and installation designers, auditors, test and commissioning agents;
- 3) facility and infrastructure integrators, suppliers of equipment;
- 4) installers, maintainers.

At the time of publication of this document, the EN 50600-2 series comprises the following documents:



- EN 50600-2-1, *Information technology - Data centre facilities and infrastructures - Part 2-1: Building construction*
- CLC/TS 50600-2-10, *Information technology - Data centre facilities and infrastructures - Part 2-10: Earthquake risk and impact analysis*
- EN 50600-2-2, *Information technology - Data centre facilities and infrastructures - Part 2-2: Power supply and distribution*
- EN 50600-2-3, *Information technology - Data centre facilities and infrastructures - Part 2-3: Environmental control*
- EN 50600-2-4, *Information technology - Data centre facilities and infrastructures - Part 2-4: Telecommunications cabling infrastructure*
- EN 50600-2-5, *Information technology - Data centre facilities and infrastructures - Part 2-5: Security systems*

The inter-relationship of the documents within the EN 50600 series is shown in Figure 1.

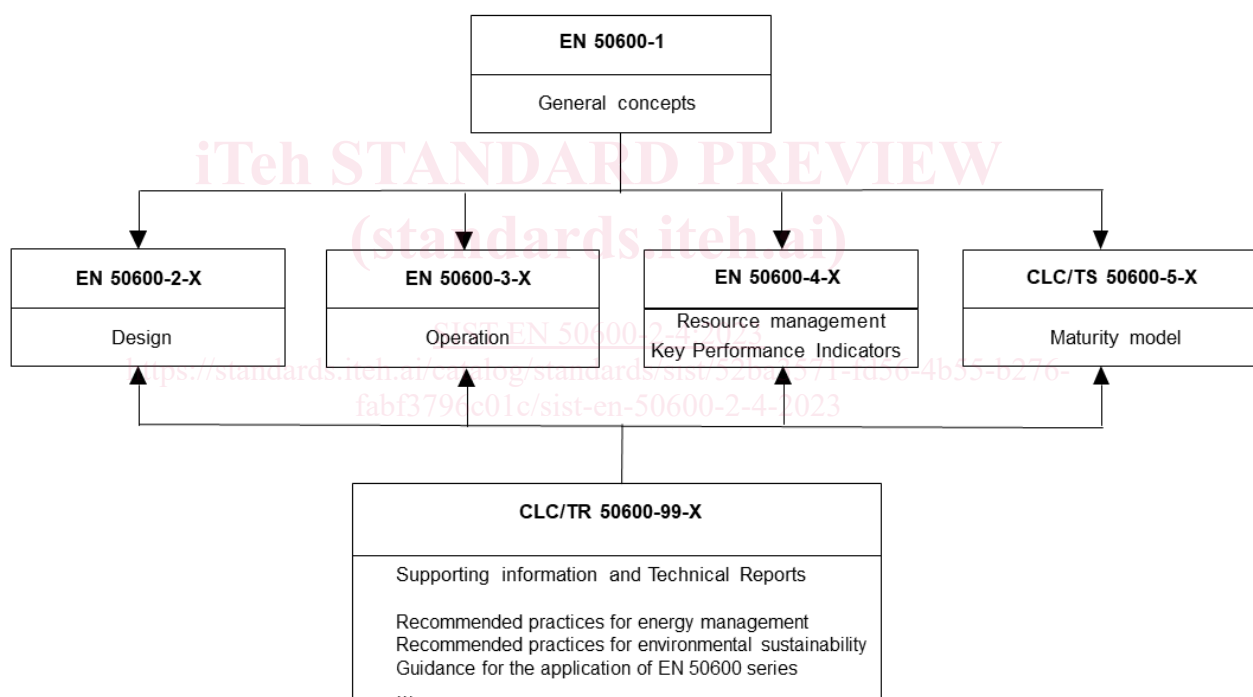

**Figure 1 — Schematic relationship between the EN 50600 series of documents**

EN 50600-2-X documents specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “physical security” and “energy efficiency enablement” selected from EN 50600-1.

EN 50600-3-X documents specify requirements and recommendations for data centre operations, processes and management.

EN 50600-4-X documents specify requirements and recommendations for key performance indicators (KPIs) used to assess and improve the resource usage efficiency and effectiveness, respectively, of a data centre.


This document addresses the specific requirements for the telecommunications cabling infrastructure in data centres used for the purpose of IT networking and building services (in accordance with the requirements of EN 50600-1).

## EN 50600-2-4:2023 (E)

This document is intended for use by and collaboration between architects, building designers and builders, system and installation designers.

This series of documents does not address the selection of information technology and network telecommunications equipment, software and associated configuration issues.

Figure 2 shows the schematic and contextual relationships of the EN 50600-2-4 with other cabling and cabling installation related European standards.

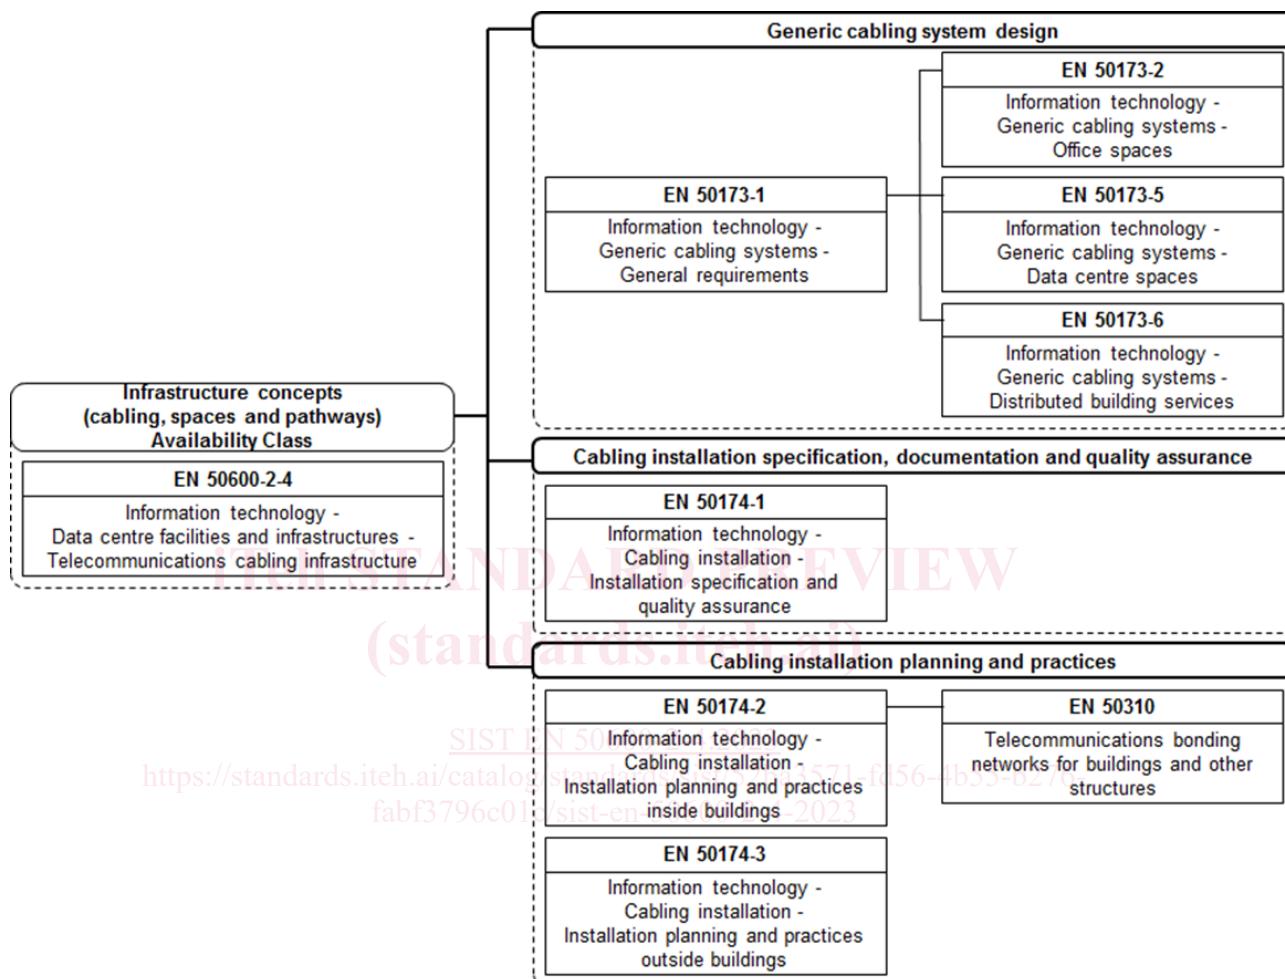

**Figure 2 — Schematic relationship between the EN 50600-2-4 and other European cabling design and installation standards**

The importance of the information technology and network telecommunications cabling infrastructure is similar to that of other infrastructures such as environmental control, power distribution and security systems. As with other utilities, interruptions to service can have a serious impact. Poor quality of service due to lack of planning, use of inappropriate components, incorrect installation, poor administration or inadequate support can threaten an organization's effectiveness.

## 1 Scope

This document specifies design principles for information technology and network telecommunications cabling (e.g. SAN and LAN) in accordance with EN 50173-5, based upon the criteria and classifications for “availability” and “physical security” within EN 50600-1.

This document addresses the telecommunications cabling infrastructures used in data centres. It describes:

- a) for design, the application of generic cabling standards in the EN 50173 series;
- b) for installation specification, planning and practices and quality assurance, the application of standards in the EN 50174 series (and related standards).

In addition, this document specifies requirements and recommendations for the following:

- 1) general information technology cabling to support the IT operation of the data centre;
- 2) telecommunications cabling to monitor and control, as appropriate, power distribution, environmental control and physical security of the data centre;
- 3) other building automation cabling;
- 4) pathways, pathway systems, spaces and enclosures for the telecommunications cabling infrastructures.

Safety and electromagnetic compatibility (EMC) requirements are outside the scope of this document and are covered by other standards and regulations. However, information given in this document can be of assistance in meeting these standards and regulations.

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50173-2, *Information technology - Generic cabling systems - Part 2: Office spaces*

EN 50173-5, *Information technology - Generic cabling systems - Part 5: Data centre spaces*

EN 50173-6, *Information technology - Generic cabling systems - Part 6: Distributed building services*

EN 50174-1:2018,<sup>1</sup> *Information technology — Cabling installation — Part 1: Installation specification and quality assurance*

EN 50174-2:2018, *Information technology - Cabling installation - Part 2: Installation planning and practices inside buildings*

EN 50174-3, *Information technology - Cabling installation - Part 3: Installation planning and practices outside buildings*

EN 50310, *Telecommunications bonding networks for buildings and other structures*

EN 50600-1:2019, *Information technology - Data centre facilities and infrastructures - Part 1: General concepts*

EN 50600-2-1, *Information technology — Data centre facilities and infrastructures — Part 2-1: Building construction*

---

<sup>1</sup> As amended by EN 50174-1:2018/A1:2020.

**EN 50600-2-4:2023 (E)**

EN 50600-2-2, *Information technology - Data centre facilities and infrastructures - Part 2-2: Power supply and distribution*

EN 50600-2-3, *Information technology - Data centre facilities and infrastructures - Part 2-3: Environmental control*

EN 50600-2-5, *Information technology — Data centre facilities and infrastructures — Part 2-5: Security systems*

### **3 Terms, definitions and abbreviations**

#### **3.1 Terms and definitions**

For the purposes of this document, the terms and definitions of EN 50600-1 and the following apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

##### **3.1.1**

##### **application-specific cabling**

structured cabling with a configuration and performance which is considered to provide a specific benefit for a single, or limited number of applications, as compared to generic cabling

##### **3.1.2**

##### **building entrance facility**

facility that provides all necessary mechanical and electrical services for the entry of telecommunications cables into a building and which can enable transition from outdoor to indoor cable

[SOURCE: EN 50173-1:2018, 3.1.18]

##### **3.1.3**

##### **cabinet**

enclosed construction for housing closures and other information technology equipment

##### **3.1.4**

##### **central patching location**

passive cross-connect to connect different functional elements of a data centre

Note 1 to entry: A central patching location can be located in the main distribution area and/or the intermediate distribution area and is therefore a configuration of an MD and/or an ID in accordance with the cabling of EN 50173-5.

##### **3.1.5**

##### **cross-connect**

passive connection between cabling subsystems using a patch cord or jumper

[SOURCE: EN 50173-1:2018, 3.1.35]

##### **3.1.6**

##### **customer space**

part of a cabinet, a cabinet, a cage or a computer room in a colocation data centre that customers can rent to host their IT

**3.1.7****entrance room**

space that houses the external telecommunications provider equipment and that provides the demarcation points for the external telecommunications services

**3.1.8****equipment outlet**

fixed connecting device where the zone distribution cabling terminates and providing the interface to the equipment cabling

[SOURCE: EN 50173-5:2018, 3.1.3]

**3.1.9****equipment distribution area**

area served by LDP(s) and EO(s) of cabling and accommodating the LDP(s), EO(s), servers, storage device and other networking equipment and their connections to the EO(s)

Note 1 to entry: Cabling is in accordance with EN 50173-5.

**3.1.10****external network interface**

termination point providing demarcation of external telecommunications service provision

[SOURCE: EN 50173-1:2018, 3.1.42]

**3.1.11****fixed cabling**

cabling subsystem between closures which has either a peer-to-peer or hierarchical structure and which enables the installation of cross-connects or interconnects at those closures

**3.1.12****floor distributor**

distributor used to connect between the horizontal cable and other cabling subsystems or equipment

**3.1.13****floor distribution area**

area accommodating the FD(s) of cabling and associated transmission equipment

Note 1 to entry: Cabling in accordance with EN 50173-2.

**3.1.14****frame**

open construction, typically wall-mounted, for housing closures and other information technology equipment

[SOURCE: EN 50174-1:2018,<sup>1</sup> 3.1.21]

**3.1.15****generic cabling**

structured telecommunications cabling system, that is capable of supporting a wide range of standardized applications

Note 1 to entry: Application-specific hardware is not a part of generic cabling.

Note 2 to entry: Generic cabling can be installed without prior knowledge of the required applications.

[SOURCE: EN 50173-1:2018, 3.1.46]

## EN 50600-2-4:2023 (E)

**3.1.16****information technology equipment**

equipment designed for the purpose of

- a) receiving data from an external source (such as via network or via a keyboard);
- b) performing processing and storage functions on the received data (such as computation, data transformation or recording, filing, sorting, storage, transfer of data);
- c) providing a data output (either to other equipment or by the reproduction of data or images)

**3.1.17****interconnect**

passive connection to a cabling subsystem without the use of a patch cord or jumper

[SOURCE: EN 50173-1:2018, 3.1.52]

**3.1.18****intermediate distributor**

distributor used to make connections between the main distribution cabling subsystem, intermediate distribution cabling subsystem, network access cabling subsystem and active equipment

[SOURCE: EN 50173-5:2018, 3.1.5]

**3.1.19****intermediate distribution area**

area accommodating the ID(s) of cabling and associated transmission equipment

Note 1 to entry: Intermediate distributions areas (and IDs) are primarily used in larger data centres to enable data centre growth or to provide segmentation for specific applications.

Note 2 to entry: *ps* cabling in accordance with EN 50173-5. <https://standards.iteh.ai/SIST/52ba3571-fd56-4b55-b276-fabf3796c01c/sist-en-50600-2-4-2023>

**3.1.20****IT load**

any active equipment providing data transport services, data processing or data storage inside the data centre

**3.1.21****local distribution point**

connection point in the zone distribution cabling subsystem between a zone distributor and one or more equipment outlets

[SOURCE: EN 50173-5:2018, 3.1.6]

**3.1.22****network telecommunication equipment**

equipment within the data centre that provides data transport services inside or outside the data centre

**3.1.23****main distributor**

distributor used to make connections between the main distribution cabling subsystem, network access cabling subsystem and active equipment

Note 1 to entry: A central patching location located in a main distribution area is a specific configuration of a MD in accordance with the cabling of EN 50173-5.

[SOURCE: EN 50173-5:2018, 3.1.10 – modified: Note 1 to entry added]

**3.1.24****main distribution area**

area accommodating the main distributor(s) of cabling and associated transmission equipment

Note 1 to entry: A main distribution area can be in dedicated “main distributor space” or within the computer room of the data centre.

Note 2 to entry: Cabling in accordance with EN 50173-5.

**3.1.25****meet-me-room**

space in a colocation data centre which enables the interconnection between data centre customer spaces and/or between data centre customer spaces and telecommunications providers

**3.1.26****pathway**

defined route for cables between termination points

[SOURCE: EN 50174-1:2018,<sup>1</sup> 3.1.31]

**3.1.27****pathway system**

cable management system, or other area or volume defined by markings

[SOURCE: EN 50174-1:2018,<sup>1</sup> 3.1.32]

**3.1.28****point-to-point connection**

direct connection of two pieces of IT equipment using a dedicated cable rather than a generic cabling system

**3.1.29****premises entrance facility**

space that provides all necessary mechanical and electrical services for the entry of cables into the premises

[SOURCE: EN 50600-1:2019, 3.1.28]

**3.1.30****rack**

open construction, typically self-supporting and floor-mounted, for housing closures and other information technology equipment

[SOURCE: EN 50174-1:2018,<sup>1</sup> 3.1.34]

**3.1.31****structured cabling**

telecommunications cabling comprising fixed cables between points of distribution at which equipment or other fixed cables can be connected

**3.1.32****telecommunications provider**

either an access provider or a service provider

Note 1 to entry: The term access provider is defined in EN 50174-1:2018,<sup>1</sup> 3.1.2.

Note 2 to entry: The term service provider is defined in EN 50174-1:2018,<sup>1</sup> 3.1.39.