

---

---

**Health and safety in welding and allied  
processes — Equipment for capture  
and separation of welding fume —**

**Part 2:  
Requirements for testing and marking  
of separation efficiency**

*Hygiène et sécurité en soudage et techniques connexes —  
Équipements de captage et de filtration des fumées —*

*Partie 2: Exigences relatives aux essais et marquage de l'efficacité de  
séparation*

ISO 21904-2:2020

<https://standards.iteh.ai/catalog/standards/iso/84096db5-9f4d-4279-a58e-4616ee231a67/iso-21904-2-2020>



iTeh Standards  
(<https://standards.iteh.ai>)  
Document Preview

[ISO 21904-2:2020](https://standards.iteh.ai/catalog/standards/iso/84096db5-9f4d-4279-a58e-4616ee231a67/iso-21904-2-2020)

<https://standards.iteh.ai/catalog/standards/iso/84096db5-9f4d-4279-a58e-4616ee231a67/iso-21904-2-2020>



**COPYRIGHT PROTECTED DOCUMENT**

© ISO 2020

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
CP 401 • Ch. de Blandonnet 8  
CH-1214 Vernier, Geneva  
Phone: +41 22 749 01 11  
Fax: +41 22 749 09 47  
Email: [copyright@iso.org](mailto:copyright@iso.org)  
Website: [www.iso.org](http://www.iso.org)

Published in Switzerland

# Contents

	Page
<b>Foreword</b> .....	<b>iv</b>
<b>Introduction</b> .....	<b>v</b>
<b>1 Scope</b> .....	<b>1</b>
<b>2 Normative references</b> .....	<b>1</b>
<b>3 Terms and definitions</b> .....	<b>1</b>
<b>4 Principle</b> .....	<b>2</b>
<b>5 Apparatus</b> .....	<b>2</b>
<b>6 Test method</b> .....	<b>5</b>
6.1 Selection of test arrangement.....	5
6.2 Test conditions.....	5
6.3 Procedure.....	5
6.3.1 Source emission rate measurement.....	5
6.3.2 Equipment without filter cleaning system.....	5
6.3.3 Equipment with manually initiated filter cleaning system.....	7
6.3.4 Equipment with automatically initiated filter cleaning system.....	7
6.3.5 Equipment with electrostatic precipitators.....	8
6.4 Calculation of the separation efficiency.....	9
<b>7 Accuracy of measurement</b> .....	<b>9</b>
<b>8 Test report</b> .....	<b>9</b>
<b>Annex A (informative) Test cabin</b> .....	<b>11</b>
<b>Annex B (informative) Welding fume source</b> .....	<b>12</b>
<b>Bibliography</b> .....	<b>14</b>

[ISO 21904-2:2020](https://standards.iteh.ai/catalog/standards/iso/84096db5-9f4d-4279-a58e-4616ee231a67/iso-21904-2-2020)

<https://standards.iteh.ai/catalog/standards/iso/84096db5-9f4d-4279-a58e-4616ee231a67/iso-21904-2-2020>

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see [www.iso.org/directives](http://www.iso.org/directives)).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see [www.iso.org/patents](http://www.iso.org/patents)).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see [www.iso.org/iso/foreword.html](http://www.iso.org/iso/foreword.html).

This document was prepared by Technical Committee ISO/TC 44, *Welding and allied processes*, Subcommittee SC 9, *Health and safety*.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at [www.iso.org/members.html](http://www.iso.org/members.html).

Official interpretations of ISO/TC 44 documents, where they exist, are available from this page: <https://committee.iso.org/sites/tc44/home/interpretation.html>.

A list of all parts in the ISO 21904 series can be found on the ISO website.

This first edition cancels and replaces ISO 15012-1.

## Introduction

It is common practice in the fabrication industry to control exposure to welding fume using local exhaust ventilation equipment that, following capture and separation of the fume, returns the extracted air to the workplace or exhausts it to the atmosphere. It is important that such equipment has high separation efficiency so that as little fume as possible is recirculated or exhausted. This document has therefore been developed to specify a test method for determining the efficiency of welding fume separation equipment and the requirements of the test method.

**iTeh Standards**  
**(<https://standards.itih.ai>)**  
**Document Preview**

[ISO 21904-2:2020](https://standards.itih.ai/catalog/standards/iso/84096db5-9f4d-4279-a58e-4616ee231a67/iso-21904-2-2020)

<https://standards.itih.ai/catalog/standards/iso/84096db5-9f4d-4279-a58e-4616ee231a67/iso-21904-2-2020>



# Health and safety in welding and allied processes — Equipment for capture and separation of welding fume —

## Part 2: Requirements for testing and marking of separation efficiency

### 1 Scope

This document specifies a method for testing equipment for the separation of welding fume in order to determine whether its separation efficiency meets specified requirements.

The method specified does not apply to testing of filter cartridges independent of the equipment in which they are intended to be used.

This document applies to equipment that is manufactured after its publication.

NOTE General ventilation systems are excluded from the Scope of ISO 21904-1.

### 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 2602:1980, *Statistical interpretation of test results — Estimation of the mean — Confidence interval*

ISO 15011-1:2009, *Health and safety in welding and allied processes — Laboratory method for sampling fume and gases — Part 1: Determination of fume emission rate during arc welding and collection of fume for analysis*

ISO 21904-1:2020, *Health and safety in welding and allied processes — Equipment for capture and separation of welding fume — Part 1: General requirements*

### 3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 21904-1 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

#### 3.1

##### **free-standing unit**

separation equipment with an integrated fan

#### 3.2

##### **modular system**

separation equipment consisting of a scaleable filter system with the same filter elements and conditions normally connected to a single fan

## 3.3

### welding fume source

source generating welding fume by welding process that charges separation equipment to perform separation efficiency tests

## 3.4

### emission rate

mass of the particles emitted by the welding fume source per time

Note 1 to entry: The emission rate is expressed in milligrams per second.

## 4 Principle

The method is based on the methods specified in EN 1093-6<sup>[10]</sup> and EN 1093-7<sup>[11]</sup>. Under test, the welding fume separation equipment is charged by welding fume generated by a welding process. The welding fume concentrations are measured in the incoming and exhausted air of the separation unit. The welding fume separation equipment under test is operated under defined conditions, according to its intended use.

The emission rate of the welding fume source is measured separately. Therefore, the welding fume generated by the source is sampled on preweighed filters over a period of time.

The air volume flow rate of the welding fume separation equipment and the testing time shall be measured during the separation efficiency test. Emission rate, testing time and air volume flow rate are used subsequently to calculate the concentration of welding fume in the incoming air. Welding parameters should be the same when emission rate and separation efficiency test are performed.

Before separation efficiency measurements are made, all welding fume separation equipment are charged for a period of 30 min using the welding fume source.

For equipment with filters that are not intended to be cleaned, the concentration of welding fume passing through the separation equipment is measured subsequently for a period of 30 min and the measured concentration is used, together with the welding fume concentration calculated from the welding fume emission rate, to determine the separation efficiency.

For equipment with cleanable filters, an additional separation efficiency measurement is performed after a further welding period without measurement and filter cleaning. The average of the two separation efficiencies is calculated.

Two tests are performed and the average, the 95 % one-sided confidence interval and the lower confidence limit value of the separation efficiency are calculated according to ISO 2602. If the resulting lower confidence limit value is less than the required separation efficiency, consideration shall be given to improve the filter unit design.

## 5 Apparatus


**5.1 Welding fume source**, capable of maintaining an emission rate of 10 mg/s  $\pm$  2 mg/s throughout the test period.

The welding fume source shall be fitted with an extraction hood that retains all the welding fume emitted and shall be designed in such a way that it can be connected to the inlet duct of the test cabin, as described in [Figure 1](#), or directly to welding fume separation equipment with a ducted outlet, as described in [Figure 2](#). It shall be possible to determine the welding fume emission rate in situ without disturbing the welding set-up in any way. An example of a suitable welding fume source and parameters required to achieve the required welding fume emission rate are described in [Annex B](#).



**5.2 Test cabin**, consisting of an enclosure for the welding fume separation equipment under test, connected to the welding fume source via an upstream measurement duct.

The cabin is connected to a downstream measurement duct and an air mover (see [Figure 1](#)). The air volume flow rate through the air mover is adjusted to between 95 % and 100 % of the air volume flow rate in the upstream duct, thus ensuring a small positive air pressure in the cabin.

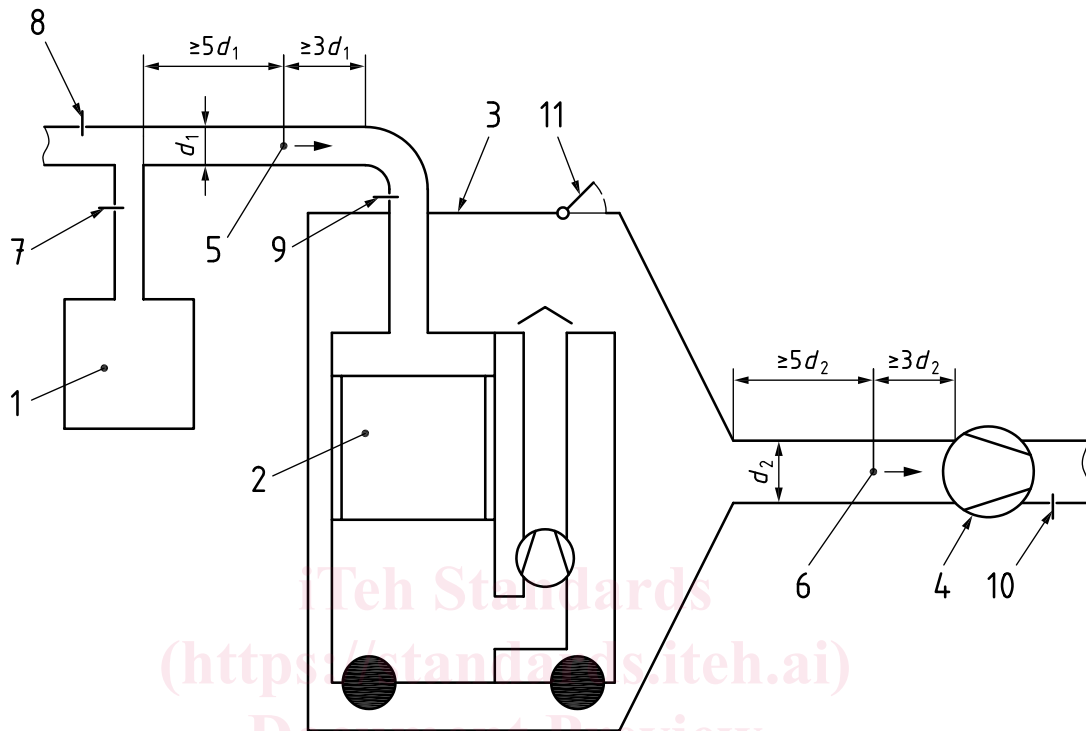

#### Key


- 1 welding fume source (see [Figure B.1](#))
  - 2 welding fume separation equipment
  - 3 test cabin
  - 4 air mover
  - 5 position for measuring the air volume flow rate in the upstream duct,  $q_{V,1}$
  - 6 positions for measuring the air volume flow rate in the downstream duct,  $q_{V,2}$  and isokinetic sampling of welding fume in the downstream duct
  - 7 damper (to control the air volume flow rate passing through the welding fume source in order to avoid shielding gas disturbance)
  - 8 damper (to ensure that all welding fume is captured, even when filter units with a low air volume flow rate are under test)
  - 9 damper (to regulate the total air volume flow rate passing through the separation equipment)
  - 10 damper (to control the air volume flow rate in the downstream duct in order to achieve a slight overpressure in the cabin)
  - 11 gap with a flap (to prevent damage on the cabin in case of high overpressure)
- $d_1$  upstream duct diameter  
 $d_2$  downstream duct diameter

**Figure 1 — Example of test cabin (schematic layout)**

The positions for measuring the air volume flow rate and isokinetic sampling of welding fume in the downstream duct are not the same, but are shown in [Figure 1](#) for convenience. They shall comply with the dimensions marked in [Figure 1](#).

**5.3 Test arrangement for welding fume separation equipment with a ducted outlet**, consisting of a welding fume source connected to the equipment via an upstream measurement duct.

The outlet of the welding fume separation equipment is directly linked to the downstream measurement duct (see [Figure 2](#)).

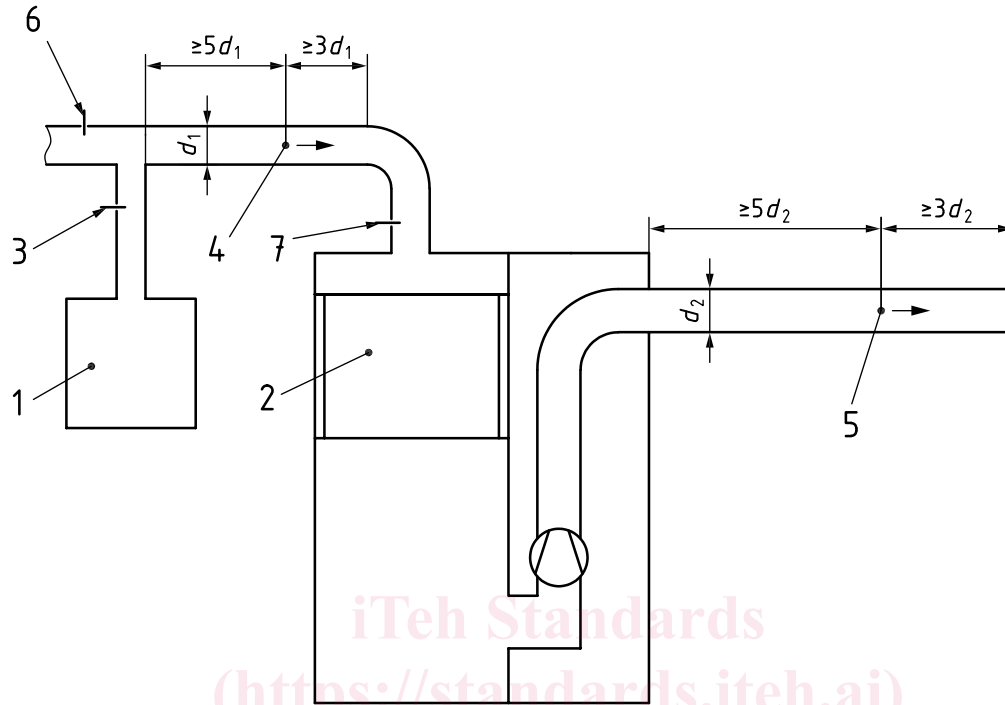

**Key**

- 1 welding fume source
- 2 welding fume separation equipment
- 3 damper (to control the air flow passing through the welding fume source in order to avoid shielding gas disturbance)
- 4 position of equipment for measuring the air volume flow rate in the upstream duct
- 5 position of equipment for measuring the air volume flow rate and the welding fume concentration in the downstream duct
- 6 damper (to ensure that all welding fume is captured, even when filter units with low air volume flow rates are under test)
- 7 damper (to regulate the total air flow passing through the separation equipment)
- $d_1$  upstream duct diameter
- $d_2$  downstream duct diameter

**Figure 2 — Test arrangement for welding fume separation equipment with a ducted outlet (schematic layout)**

**5.4 Air volume flow rate measurement equipment**, capable of measuring rates up to 2 000 m<sup>3</sup>/h continuously, to within an accuracy of ±10 % or better.

The following combination of equipment is suitable.

A flow meter with a calibrated relationship between pressure difference and air volume flow rate, e.g. an orifice plate, together with a digital manometer to measure the pressure difference across it. The digital manometer shall have a logging capability or be connected to a logging system with a logging frequency of 1 min or less.

A device for measuring air volume flow rate with equivalent performance is also suitable.