

---

**Prirobnice in prirobnični spoji - Okrogle prirobnice za cevi, ventile, fitinge in pribor z oznako Class - 3. del: Prirobnice iz bakrovih zlitin**

Flanges and their joints - Circular flanges for pipes, valves, fittings and accessories, Class designated - Part 3: Copper alloy flanges

Flansche und ihre Verbindungen - Runde Flansche für Rohre, Armaturen, Formstücke und Zubehörteile, nach Class bezeichnet - Teil 3: Flansche aus Kupferlegierungen

Brides et leurs assemblages - Brides circulaires pour tubes, appareils de robinetterie, raccords et accessoires, désignées Class - Partie 3 : Brides en alliages de cuivre

<https://standards.iteh.ai/catalog/standards/sist/7511dca8-c833-438c-a1dc-d1ee7e897d8e/osist-pr-en-1759-3-2022>

**Ta slovenski standard je istoveten z: prEN 1759-3**

---

**ICS:**

23.040.60	Prirobnice, oglavki in spojni elementi	Flanges, couplings and joints
77.150.30	Bakreni izdelki	Copper products

**oSIST prEN 1759-3:2022****en,fr,de**

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[oSIST prEN 1759-3:2022](#)

<https://standards.iteh.ai/catalog/standards/sist/7511dca8-c833-438c-a1dc-d1ce7c897d8e/osist-pren-1759-3-2022>

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

**DRAFT**  
**prEN 1759-3**

December 2021

ICS 23.040.60

Will supersede EN 1759-3:2003

English Version

## Flanges and their joints - Circular flanges for pipes, valves, fittings and accessories, Class designated - Part 3: Copper alloy flanges

Brides et leurs assemblages - Brides circulaires pour tubes, appareils de robinetterie, raccords et accessoires, désignées Class - Partie 3 : Brides en alliages de cuivre

Flansche und ihre Verbindungen - Runde Flansche für Rohre, Armaturen, Formstücke und Zubehörteile, nach Class bezeichnet - Teil 3: Flansche aus Kupferlegierungen

This draft European Standard is submitted to CEN members for enquiry. It has been drawn up by the Technical Committee CEN/TC 74.

If this draft becomes a European Standard, CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CEN in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

**Warning** : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

<b>Contents</b>	<b>Page</b>
European foreword .....	4
Introduction .....	5
1 Scope.....	6
2 Normative references.....	8
3 Terms and definitions.....	8
4 Designation .....	9
4.1 General.....	9
4.2 Standard designation .....	9
4.3 Information to be supplied by the equipment manufacturer.....	10
5 General requirements.....	10
5.1 Materials .....	10
5.2 Repairs.....	10
5.3 Bolting.....	11
5.4 Gaskets.....	11
5.5 Pressure/temperature ( <i>p/T</i> ) ratings.....	11
5.5.1 General.....	11
5.5.2 <i>p/T</i> ratings of flanged joints.....	11
5.6 Dimensions.....	12
5.6.1 Flanges.....	12
5.6.2 Bolt holes .....	12
5.7 Flange facings.....	12
5.7.1 Types of facings .....	12
5.7.2 Jointing face finish.....	12
5.7.3 Rims .....	13
5.7.4 Collars and loose flanges.....	13
5.8 Spot facing or back facing .....	13
5.9 Tolerances.....	13
5.10 Marking .....	13
5.10.1 Other than type 21 flanges .....	13
5.10.2 Method of marking.....	14
5.10.3 Omission of markings.....	14
5.10.4 Declaration of compliance.....	14
Annex A (informative) Information to be supplied by the equipment manufacturer .....	29
Annex B (informative) Application and installation .....	30
Annex C (informative) Use of metric bolting in lieu of imperial bolting.....	31
C.1 General.....	31
C.2 Gaskets.....	31
C.3 Comparable nominal bolt sizes.....	31
C.4 Imperial/metric bolt comparisons.....	31
Annex D (informative) Approximate masses of flanges and collars.....	33

<b>Annex ZA (informative) Relationship between this European Standard and the Essential Requirements of EU Directive 2014/68/EU aimed to be covered .....</b>	<b>38</b>
<b>Bibliography .....</b>	<b>40</b>

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[oSIST prEN 1759-3:2022](https://standards.iteh.ai/catalog/standards/sist/7511dca8-c833-438c-a1dc-d1ce7c897d8e/osist-pren-1759-3-2022)

<https://standards.iteh.ai/catalog/standards/sist/7511dca8-c833-438c-a1dc-d1ce7c897d8e/osist-pren-1759-3-2022>

**prEN 1759-3:2021 (E)****European foreword**

This document (prEN 1759-3:2021) has been prepared by Technical Committee CEN/TC 74 “Flanges and their joints”, the secretariat of which is held by DIN.

This document is currently submitted to CEN Enquiry.

This document will supersede EN 1759-3:2003 and EN 1759-3:2003/AC:2004.

The main changes compared to EN 1759-3:2003 and EN 1759-3:2003/AC:2004 are:

- update of Annex ZA.

This document has been prepared under a standardization request given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s)<sup>1</sup>.

For relationship with EU Directive(s), see informative Annex ZA, which is an integral part of this document.

EN 1759 consists of the following parts:

- *Flanges and their joint — Circular flanges for pipes, valves, fittings and accessories, Class designated — Part 1: Steel flanges (draft stage);*
- *Flanges and their joint — Circular flanges for pipes, valves, fittings and accessories, Class designated — Part 3: Copper alloy flanges (draft stage);*
- *Flanges and their joint — Circular flanges for pipes, valves, fittings and accessories, Class designated — Part 4: Aluminium alloy flanges (draft stage).*

The Annexes A, B, C, D and ZA are informative.

---

1 Directive 97/23 EC of the European Parliament and of the Council of 29 May 1997 on the approximation of the Laws of the Member States concerning pressure equipment; OIEC L 181.

## Introduction

This document is related, but not identical, to ISO 7005-3 in respect of flanges having designations Class 150 and Class 300. Outside diameters and mating dimensions are in accordance with ANSI B16.24.

Information on the use of metric bolting in lieu of imperial bolting which can be used with these flanges is given in an informative annex.

The mating dimensions of the flanges of this standard are compatible with Class designated flanges of other materials in accordance with the other parts of EN 1759.

## iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN 1759-3:2022](https://standards.iteh.ai/catalog/standards/sist/7511dca8-c833-438c-a1dc-d1ce7c897d8e/osist-pren-1759-3-2022)

<https://standards.iteh.ai/catalog/standards/sist/7511dca8-c833-438c-a1dc-d1ce7c897d8e/osist-pren-1759-3-2022>

**prEN 1759-3:2021 (E)****1 Scope**

This document specifies requirements for circular copper alloy flanges and copper alloy collars combined with loose steel plate flanges in Class designations Class 150 and Class 300 and nominal sizes from DN 10 to DN 900 (NPS 1/2 to NPS 36) in the types shown in Table 1.

This document also specifies dimensions and tolerances, materials and their associated pressure/temperature ( $p/T$ ) ratings, flange facings and related surface finish, weld repairs and marking together with information on bolting, gaskets, application and installation and approximate flange masses.

The flanges specified, with the exception of integral (type 21) flanges, are for attachment to copper or copper alloy tubes in accordance with EN 12449.

NOTE 1 The size of copper and copper alloy tubes is designated by reference to the outside diameter in millimetres.

NOTE 2 See also Annex B.

NOTE 3 Non-gasketed pipe joints are outside the scope of this document.

**Table 1 — Types of flanges and collars**

Type No.	Description
01	Plate flange in copper alloy for brazing or welding
04	Loose plate flange in steel with a weld-neck collar (type 34) in copper alloy, for welding
05	Blank flange in copper alloy
05C	Blank flange in steel clad with a copper alloy jointing face
07	Loose plate flange in steel with a slip-on collar (type 37) in copper alloy, for soft soldering, brazing or welding
11	Weld-neck flange in copper alloy for welding
12	Hubbed slip-on flange in copper alloy, for soft soldering, brazing or welding
14	Hubbed slip-on flange in copper alloy supplied with tube stops, for soft soldering, brazing or welding
21	Integral flange in copper alloy as part of some other equipment or component
34	Weld-neck collar in copper alloy
37	Slip-on collar in copper alloy





**Type 01**

Plate flange in copper alloy for brazing or welding

**Type 04, 34**


Loose plate flange in steel with a weld-neck collar (type 34) in copper alloy, for welding

**Type 05, 05C**

05 Blank flange in copper alloy  
05C Blank flange in steel clad with a copper alloy jointing face

**Type 07, 37**


Loose plate flange in steel with a slip-on collar (type 37) in copper alloy, for soft soldering, brazing or welding

**Type 11**

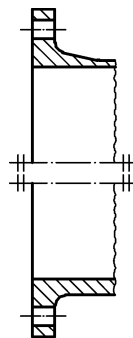
Weld-neck flange in copper alloy, for welding

**Type 12**

Hubbed slip-on flange in copper alloy, for soft soldering, brazing or welding

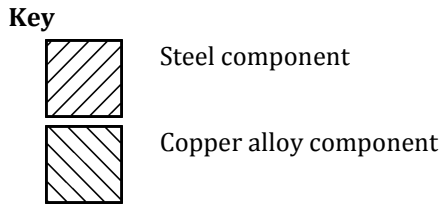
**Type 14**

Hubbed slip-on flange in copper alloy supplied with tube stops, for soft soldering, brazing or welding

**Type 21**

Integral flange in copper alloy as part of some other equipment or component

iTeh STANDARD PREVIEW  
(standards.iteh.ai)

**prEN 1759-3:2021 (E)****Figure 1 — Types of flanges and collars****2 Normative references**

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 1652, *Copper and copper alloys — Plate, sheet, strip and circles for general purposes*

EN 10028-2, *Flat products made of steels for pressure purposes — Part 2: Non-alloy and alloy steels with specified elevated temperature properties*

EN 10222-2, *Steel forgings for pressure purposes — Part 2: Ferritic and martensitic steels with specified elevated temperature properties*

EN 12420, *Copper and copper alloys — Forgings*

EN 12449, *Copper and copper alloys — Seamless round tubes for general purposes*

EN ISO 887, *Plain washers for metric bolts, screws and nuts for general purposes — General plan (ISO 887:2000)*

<https://standards.iteh.ai/catalog/standards/sist/7511dca8-c833-438c-a1dc-d1ce7c897d8e/osist-pren-1759-3-2022>

EN ISO 4287, *Geometrical Product Specification (GPS) — Surface texture: Profile method — Terms, definitions and surface texture parameters (ISO 4287:1997)*

EN ISO 6708:1995, *Pipework components — Definition and selection of DN (nominal size) (ISO 6708:1995)*

**3 Terms and definitions**

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

**3.1****Class**

alphanumeric designation used for reference purposes related to a combination of mechanical and dimensional characteristics of a component of a pipework system. It comprises the word Class followed by a dimensionless whole number

Note 1 to entry: The number following the word Class does not represent a measurable value and should not be used for calculation purposes except where specified in the relevant standard.

Note 2 to entry: The designation Class is not meaningful unless it is related to the relevant component standard number.

Note 3 to entry: It is intended that all components with the same Class and NPS (see below) designations have the same mating dimensions for compatible flange types.

### 3.2

#### DN

see EN ISO 6708:1995

### 3.3

#### NPS

alphanumeric designation of size for components of a pipework system, which is used for reference purposes. It comprises, for the purpose of Class designated flanges according to this document, the letters NPS followed by a dimensionless number which is indirectly related to the physical size of the bore or outside diameter of the end connections

Note 1 to entry: The number following the letters NPS does not represent a measurable value and should not be used for calculation purposes except where specified in the relevant standard. See EN ISO 6708.

## 4 Designation

### 4.1 General

The types of flanges and their reference numbers are given in Table 1 and the range of DN applicable to each flange type and to each Class shall be as given in Table 3.

NOTE 1 Flanges, which are identified and/or marked by NPS additionally or alternatively to DN, are deemed to comply with this document.

NOTE 2 The relationship between DN and NPS is given for reference purposes in Tables 3, 4, 5 and 6.

### 4.2 Standard designation

Flanges and collars in accordance with this standard shall be designated by the following:

- a) designation, e.g. flange or collar;
- b) number of this standard, EN 1759-3;
- c) number of flange type in accordance with Figure 1;
- d) Class designation, Class ..... (the word Class may be omitted);
- e) nominal size, DN ..... (and/or NPS .....);
- f) material number or symbol (see Tables 7 and 8) (for type 05C flanges it is necessary to specify both the material of the flange and the material of the cladding).

EXAMPLE 1 Designation of a plate flange type 01 in Class 150 and DN 600 (NPS 24) and in material symbol CuAl8Fe3:

**Flange EN 1759-3/01/Class 150/DN 600/CW303G**

or

**Flange EN 1759-3/01/150/NPS 24/CW303G**

**prEN 1759-3:2021 (E)**

EXAMPLE 2 Designation of a loose flange type 07 in Class 150 and DN 50 (NPS 2) and in material symbol S235JR:

**Flange EN 1759-3/07/Class 150/DN 50/S235JR**

or

**Flange EN 1759-3/07/150/NPS 6/S235JR**

EXAMPLE 3 Designation of a slip-on collar type 37 in Class 150 and DN 50 (NPS 2) and in material symbol CuZn20Al2As:

**Collar EN 1759-3/37/Class 150/DN 50/CW702R**

or

**Collar EN 1759-3/37/150/NPS 2/CW702R**

EXAMPLE 4 Designation of a blank flange type 05C with clad jointing face, in Class 300 and DN 150 (NPS 6) and in materials symbols, S235JR (for blank flange) and CuNi30Mn1Fe (for cladding):

**Flange EN 1759-3/05C/Class 300/DN 150/S235JR-CW354H**

or

**Flange EN 1759-3/05C/300/NPS 6/S235JR-CW354H**

### 4.3 Information to be supplied by the equipment manufacturer

For information to be supplied by the equipment manufacturer see Annex A.

**iTeh STANDARD PREVIEW**  
(standards.iteh.ai)

## 5 General requirements

### 5.1 Materials

<https://standards.iteh.ai/catalog/standards/sist/7511dca8-c833-438c-a1dc-d1ce7c897d8e/osist-pren-1759-3-2022>

Flanges and collars shall be manufactured from the materials specified in Tables 7 and 8 except for type 21 flanges where the flange manufacturer may use other materials by agreement with the equipment manufacturer.

The flange manufacturer shall provide means of identifying the material of the flange. An equipment manufacturer may require a certificate in accordance with EN 10204 which is suitable for the category of the equipment to which the flange is fitted.

NOTE If a protective coating such as zinc coating or painting is required on steel components, the equipment manufacturer should state this on the enquiry and/or order.

### 5.2 Repairs

5.2.1 Repairs by welding are permitted when there is a proven method and where not otherwise prohibited by the applicable material standard. All welding shall be carried out in accordance with a written procedure.

NOTE For approval of welding procedures, see EN 288-1. For approval of welders, see EN 287-1.

5.2.2 Any filler rod used for weld repairs shall be such as to produce a weld having characteristics at least equal to the parent metal. Flanges shall be heat treated after repair welding when the material standard requires such treatment.

### 5.3 Bolting

Flanges shall be suitable for use with the nominal size and number of bolts specified in Tables 4 and 5 as appropriate.

The bolting material shall be chosen by the equipment manufacturer according to the pressure, temperature, flange material and the selected gasket so that the flanged joint remains tight under the expected operating conditions.

NOTE 1 For information on bolting, see EN 1515-1 and EN 1515-2 and Annexes B and C.

NOTE 2 For flange types 01, 05, 11, 12, 14 and 21, where copper alloy bolting is used, the recommended bolting materials are EN 12420 Alloy Nos. CW306G or CW307G for temperatures up to and including 120 °C.

For flange types 04, 05C and 07, steel bolting should be used and reference should be made to EN 1515-1, EN 1515-2 and Annex C.

### 5.4 Gaskets

The various gasket types, dimensions, design characteristics and material used are not within the scope of this document. Dimensions of gaskets are given in the relevant parts of EN 12560.

### 5.5 Pressure/temperature ( $p/T$ ) ratings

#### 5.5.1 General

The  $p/T$  ratings of the flanges manufactured from the materials specified in Tables 7 and 8 are given in Tables 9, 10 and 11.

The  $p/T$  ratings indicate the relationship between the maximum allowable pressure,  $PS$  and the maximum allowable temperature,  $TS$ .

Linear interpolation is permitted for intermediate temperatures.

NOTE 1 See EN 764 for terminology.

NOTE 2 When type 21 flanges are supplied as part of another component (for example, a valve or pump) in a material other than those listed in Table 7, reference should be made to the relevant product or application standard for the appropriate  $p/T$  ratings.

NOTE 3 The  $p/T$  rating of a flange is not necessarily the  $p/T$  rating of the whole pipework system. Gasket materials can also impose a limitation of the  $p/T$  rating of a flanged joint and the gasket manufacturer should be consulted when selecting the material of the gasket.

#### 5.5.2 $p/T$ ratings of flanged joints

When two flanges in a flanged joint do not have the same  $p/T$  rating at any temperature, then the lower of the two flange  $p/T$  ratings at that temperature shall apply.

NOTE 1 For any  $p/T$  rating, the temperature shown is considered to be the same as that of the contained fluid. Use at a pressure corresponding to a temperature other than that of the contained fluid is the responsibility of the user.

NOTE 2 Application of the  $p/T$  ratings given in this document to flange joints should take into consideration the risks of leakage due to forces and moments developed in the connecting pipework, see Annex B.

NOTE 3 These notes on service considerations are not intended to be exhaustive.