



Designation: D6464-03a Designation: D6464 – 03a (Reapproved 2009)^{ε1}

Standard Specification for Expandable Foam Adhesives for Fastening Gypsum Wallboard to Wood Framing¹

This standard is issued under the fixed designation D6464; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

^{ε1} NOTE—Editorial changes were made throughout in May 2006; November 2009.

1. Scope*

1.1 This specification establishes minimum performance requirements for determining strength, aging, and working properties of expandable foam adhesives intended for bonding back surfaces of gypsum wallboards of all thicknesses to wood framing. Minimum physical and performance requirements are specified for all measured properties of adhesives and adhesive bonds.

1.2 The values stated in inch-pound units are to be regarded as the standard. The SI units given in parentheses are for information only.

1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.3 This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.

2. Referenced Documents

2.1 ASTM Standards:²

C1396/C1396M Specification for Gypsum Board

D905 Test Method for Strength Properties of Adhesive Bonds in Shear by Compression Loading

D907 Terminology of Adhesives

E4 Practices for Force Verification of Testing Machines

E177 Practice for Use of the Terms Precision and Bias in ASTM Test Methods

3. Terminology

3.1 Definitions—Many terms in this specification are defined in Terminology D907.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *expandable foam adhesive, n*—any polymer that expands during delivery or cure to fill the space between substrates.

4. Significance and Use

4.1 This specification applies to expandable foam adhesives used to bond the back surface of gypsum wallboard to Douglas-fir dimensional lumber or other lumber species of equivalent bonding qualities capable of meeting the test requirements.

4.2 The specification establishes the minimum strength requirements of the bond for the selected assembly materials.

4.3 The adhesive is not considered a substitute for mechanical fasteners. Fasteners will be required to restrict expansion of the foam adhesive while it cures. The recommended fastening schedule must appear in the manufacturer's application instructions.

4.4 The tests are suitable for product performance certification and quality control programs, and can be useful to the general public, adhesive manufacturers, distributors, specifiers, architects, contractors, testing laboratories and other businesses and professionals.

4.5 The results do not include all possible conditions, which may occur during final assembly, but indicate a set of performance characteristics for laboratory controlled bonding variables.

¹ This specification is under the jurisdiction of ASTM Committee D14 on Adhesives and is the direct responsibility of Subcommittee D14.70 on Construction Adhesives. Current edition approved Aug. 10, 2003. Published September 2003. Originally approved in 1999. Last previous edition approved in 2003 as D6464-03. DOI: 10.1520/D6464-03AE01.

Current edition approved Nov. 1, 2009. Published December 2009. Originally approved in 1999. Last previous edition approved in 2003 as D6464-03a^{ε1}. DOI: 10.1520/D6464-03a09e01.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For Annual Book of ASTM Standards volume information, refer to the standard's Document Summary page on the ASTM website.

*A Summary of Changes section appears at the end of this standard.

5. Adhesive Physical Property Requirements

5.1 *Open Assembly Time*—These adhesives have a distinct open assembly time and this time must be agreed upon by the user and the manufacturer.

5.2 *Storage Life*—The adhesive shall remain serviceable and meet all the requirements of this specification for not less than six months after delivery, when stored in original unopened containers at temperatures ranging from 40 to 85°F (4 to 30°C).

6. Adhesive Properties and Performance

6.1 The adhesives shall conform to the requirements summarized in Table 1.

7. Materials and Apparatus for Conducting Tests

7.1 *Adhesives*—The adhesive shall be an expandable foam adhesive.

7.2 *Gypsum Wallboard*— $\frac{1}{2}$ in. (12.7 mm) thick, complying with Specification C1396/C1396M; the dimensions are specified in each test.

7.3 *Plywood*— $\frac{3}{4}$ or $\frac{23}{32}$ in. (19.0(19) or 18.3 mm)-thick U.S. Product Standard PS-1-95 grade marked stamped, commercial plywood, Exterior, Group 1 Species, A-A or A-B grade face and back veneers. The test specimen dimensions are specified in each test.

7.4 *Douglas-Fir Lumber*— $\frac{1}{2}$ by $\frac{1}{2}$ by $\frac{3}{2}$ in. (38.0(38) by 38.0(38) by 89.0(89) mm), clear, dry lumber, (moisture content of 8 to 10 %), with the bonding surface free of bark, knots, splits, and pitch.

NOTE 1—The tensile test will use one of the ends of the block as a bonding surface and should be an edge grain face.

7.5 *Tensile Test Fixture*—An assembly of one, 5 by 5 in. (127 by 127 mm)-by-mm by $\frac{1}{2}$ in. (6.35 mm) thick steel plate and two 6 in. long sections of $\frac{1}{2}$ by $\frac{1}{2}$ (38.1 by 38.1 mm) by $\frac{1}{4}$ in. (6.4 mm) thick steel angles (Fig. 1).

7.6 *Garnet Paper*—No. 120 grit, 3/0.

7.7 *Plywood Shim*—4 by $\frac{3}{2}$ in. or 4 by 4 in. (101.6 by 88.9 mm or 101.6 by 101.6 mm) piece of $\frac{3}{4}$ -in. (19-mm) or $\frac{23}{32}$ -in.

TABLE 1 Adhesive Properties and Performance Requirements

Test Method	Section	Property	Condition	Requirements
Rate of shear strength	10.1.4	shear strength	24 h at RT	10 psi (69 kPa) min
Rate of shear strength	10.1.4	shear strength	24 h at STD. COND.	10 psi (69 kPa) min
	10.1.5	shear strength	14 days at RT	40 psi (276 kPa) min
	10.1.5	shear strength	14 days at STD. COND.	40 psi (276 kPa) min
	10.1.6	shear strength	14 days at RT, + cyclic	32 psi (220 kPa) min
	10.1.6	shear strength	14 days at STD. COND., + cyclic	32 psi (220 kPa) min
			lab exposure, + 2 days at RT	
			lab exposure, + 2 days at STD. COND.	
	10.1.7	resistance to static load in shear	(a) 40 lb (178 N) for 24 h at RT	no bond separation
	10.1.7	resistance to static load in shear	(a) 40 lb (178 N) for 24 h at STD. COND.	no bond separation
			(b) 20 lb (89 N) for 24 h at 100°F	no bond separation
			(b) 20 lb (89 N) for 24 h at 100°F (38°C)	no bond separation
Rate of strength development	10.2.2	tensile strength	24 h at RT	15 psi (103 kPa) min
Rate of strength development	10.2.2	tensile strength	24 h at STD. COND.	15 psi (103 kPa) min
	10.2.2	tensile strength	14 days at RT	25 psi (172 kPa) min
	10.2.2	tensile strength	14 days at STD. COND.	25 psi (172 kPa) min
Adhesive open-time determination	10.3	open time	24 h at RT	75 % paper transfer, min
Adhesive open-time determination	10.3	open time	24 h at STD. COND.	75 % paper transfer, min
Substrate wet-out by adhesive				
1. Plywood	10.4.1	wet out	spatula applied	good wetting property
2. Wallboard	10.4.2	wet out	spatula applied	good wetting property
Adhesive aging	10.5	accelerated aging	500 h at 158°F	no cracking or chipping
Adhesive aging	10.5	accelerated aging	500 h at 158°F (70°C)	no cracking or chipping
Freeze-thaw stability †	10.6	low temperature storage	3 cycles of 24 h at 0°F + 24 h at RT	no change in workability; 10 psi (69 kPa) shear strength, min
Freeze thaw stability †	10.6	low temperature storage	3 cycles of 24 h at 0°F + 24 h at STD. COND.	no change in workability; 10 psi (69 kPa) shear strength, min
Suitability of a laminating adhesive for vinyl-covered wallboard	10.7	compatibility	24 h at 100°F	no blistering, vinyl film discoloration, or bond failure
Suitability of a laminating adhesive for vinyl-covered wallboard	10.7	compatibility	24 h at 100°F (38°C)	no blistering, vinyl film discoloration, or bond failure
Suitability for Stain Resistance for Vinyl-covered wallboard	10.8	staining	1 h at RT	no swelling or discoloration
Suitability for Stain Resistance for Vinyl-covered wallboard	10.8	staining	1 h at STD. COND.	no swelling or discoloration
Bridging	10.9	gap-filling	48 h at RT	intact adhesive bond line, report length and paper failure %
Bridging	10.9	gap-filling	48 h at STD. COND.	intact adhesive bond line, report length and paper failure %

† Corrected editorially.



FIG. 1 Tensile Strength Test Specimen Assembly

(18.3-mm)- thick U.S. Product Standard PS-1-95 grade marked stamped, commercial plywood, Exterior, Group 1 Species, A-A or A-B grade face and back veneers.

7.8 *Manila Folder*—Plain manila paper, 11 point weight, (0.011-in. (0.28-mm) thick).

7.9 *Vinyl-Covered Wallboard*—A manufactured product consisting of gypsum wallboard with 2 mil minimum thickness vinyl overlay bonded to the wallboard front face.

7.10 *1-Pt and 1-Gal Non-Reactive Metal Can*.

7.11 *Food Wrap Polyethylene Film*—0.8 mil thickness sheet.

7.12 *Steel Mandrel*—1.0—1 in. (25.4 mm) diameter steel rod or pipe section with smooth and uniform surface.

7.13 *Tension Rod*—A steel rod for connecting the tensile test specimen assembly to the test machine.

7.14 *Testing Machine*—Any suitable testing machine that is capable of operation at a constant rate of motion of the moveable head and has an accuracy of $\pm 1\%$ when calibrated in accordance with Practices E4 requirements.

7.15 *Compression Shear Test Fixture*—A compression-shear apparatus that is similar to, but of a larger scale than the fixture recommended in Test Method D905. A similar fixture is shown in Fig. 2.

7.16 *Wood Screw with Eyelet*—#6 by 1½ in. (38.1 mm) long, ⅜ in. (19.5 mm) inside diameter eyelet.

7.17 *Scaffolding Nails*—6d, double-head, smooth shaft, 0.113—in. (2.870-mm) diameter 2 in. (51 mm) long.

<https://standards.iteh.ai/catalog/standards/sist/27cfb091-e251-4b6f-8129-d38f3e274efb/astm-d6464-03a2009e1>

8. Sampling

8.1 The test adhesive sample size of 1 qt (approximately 1 L) is a minimum amount to complete one full series of testing. The sample is to be handled and stored according to the

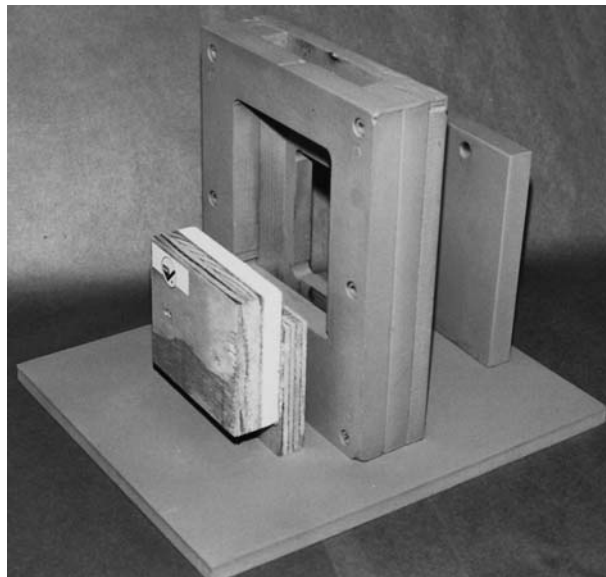


FIG. 2 Shear Strength Test Specimen Assembly

manufacturers recommendations. The sample is to be representative of the final product for which recognition is sought.

9. Conditioning of Materials and Adhesives

9.1 Standard condition will be defined as being $73 \pm 2^\circ\text{F}$ ($23 \pm 1^\circ\text{C}$) and $50 \pm 5\%$ relative humidity.

9.2 Condition the Douglas-fir lumber, plywood, gypsum wallboard, and plain manila file folder for 48 h as described in 9.1. (The Douglas-fir lumber and plywood should not vary by 0.5 % after consecutive weighings.)

10. Test Methods

10.1 *Shear Strength (Rate-of-Shear Strength Development):*

10.1.1 *Preparation of Wallboard-Plywood Laminates*—The gypsum wallboard must be reinforced with plywood. The plywood reinforced gypsum wallboard is referred to as the wallboard-plywood laminate. Each laminate is made by bonding the front surface of a piece of 4 by 3½ by ½ in. (101.6 by 88.9 by 12.7 mm) thick wallboard to a ¾ or 23/32 in. (19.0 or 18.3 mm) thick plywood piece of the same dimensions with a commercially available adhesive. The grain of the wallboard back surface facing paper shall run parallel with the 3½ in. (89.0 mm) direction. Cure the adhesive in accordance with the adhesive manufacturer’s recommendations. Condition the wallboard-plywood laminate to a constant weight in accordance with 9.2.

10.1.2 *Preparation of Test Assembly*—Prepare the test assembly by bonding a 4 by 3½ by ¾ or 23/32 in. (102.0 by 89.0 by 19.0 mm) piece of plywood (7.3) to the previously prepared laminate as follows and shown in Fig. 3.

10.1.2.1 Sand the face of the ¾-in. (19.0 mm) (19-mm) thick plywood smooth with garnet paper and wipe the sanded surface free of dust. Drill two pilot holes through the wallboard-plywood laminate. Use a standard 0.125 in. (3.175 mm) drill bit and locate each pilot hole at ¾-in. (9.5 mm) from the sides and 7/8-in. (22.2 mm) (22-mm) from the overlapped end.

10.1.2.2 Apply the adhesive on the sanded surface with the self-contained delivery system set at the manufacturer’s recommended bead size. The amount of adhesive should be sufficient to cover the entire bond area without gaps in the adhesive.

10.1.2.3 Allow an open time of 30 ± 5 s upon completion of spreading.

10.1.2.4 *Squarely* position the wallboard-plywood laminate on the coated plywood overlapping exactly $2\frac{1}{2} \pm \frac{1}{16}$ in.

(63.5 mm), thus forming the approximate 10 in.² (64.5 cm²) bonded area (see Fig. 3).

10.1.2.5 *Insert four* 10.1.2.5 Insert six wire spacers (No. 20 gage) at least 2 in. (51.0 mm) (51 mm) long into the adhesive bondline joint. Position the spacers so that they are at each end of the test region. With the test specimen positioned horizontally on a firm surface and the wallboard plywood laminate piece on top, install two 6d scaffolding nails into the predrilled pilot holes.

NOTE 2—The pilot hole diameter should be slightly larger than the nail diameter. This is necessary to prevent the laminate from binding against the nail shaft and interfering with the uniform compression at the bond line. Carefully and uniformly set the nails into the lower plywood piece. Drive the nails until the scaffold head initially encounters the wallboard-plywood laminate.

10.1.2.6 After the adhesive has hardened, remove the scaffolding nails. Remove the spacers and cut away the excess adhesive from the bonded edges. Do not disturb the alignment of the bond line.

10.1.3 *Shear Strength—Dynamic Loading Determination*—Following the appropriate conditioning, test the specimen in shear using a compression-shear test fixture as shown in Fig. 2. The bottom edge of the wallboard-plywood laminate shall rest on a self-aligning seat as the test loading is simultaneously applied to the top edge of the plywood. The stress applied must be parallel and uniformly distributed to the joint (shear plane) and must require careful orientation using shims and self-aligning apparatus as necessary. Determine the shear strength at a cross head speed of 0.2 in. (5.1 mm)/min. Observations are made during stress application to ensure the test assembly maintains proper alignment throughout the test. The test fixtures cannot in any way cause stress measurement error(s) such as with binding or friction. Report the maximum shear strength and the average shear strengths for the 24 h, the 14 day, and the cyclic exposure test conditions.

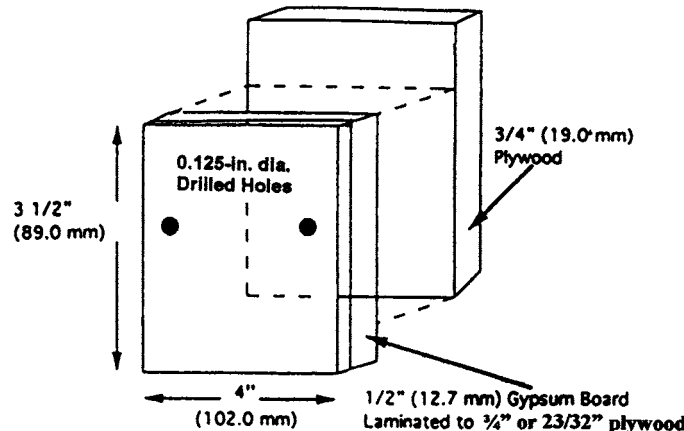


FIG. 3 Predrilled Shear Test Specimen Prior to Assembly