



Designation: E 413 – 87 (Reapproved 1999)

## Classification for Rating Sound Insulation<sup>1</sup>

This standard is issued under the fixed designation E 413; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

*This standard has been approved for use by agencies of the Department of Defense.*

### 1. Scope

1.1 This classification provides methods of calculating single-number acoustical ratings for laboratory and field measurements of sound transmission obtained in one-third octave bands. The method may be applied to laboratory or field measurements of the sound transmission loss of a partition in which case the single-number ratings are called sound transmission class (STC) or field sound transmission class (FSTC), respectively. The method may also be applied to laboratory and field measurements of the sound isolation between two spaces, in which case the single-number ratings are called the noise isolation class (NIC) or normalized noise isolation class (NNIC).

### 2. Referenced Documents

#### 2.1 ASTM Standards:

C 634 Terminology Relating to Environmental Acoustics<sup>2</sup>

E 90 Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions<sup>2</sup>

E 336 Test Method for Measurement of Airborne Sound Insulation in Buildings<sup>2</sup>

E 596 Test Method for Laboratory Measurement of the Noise Reduction of Sound-Isolating Enclosures<sup>2</sup>

#### 2.2 ISO Standard

ISO717 Rating of Sound Insulation for Dwellings<sup>3</sup>

### 3. Terminology

3.1 For definitions of terms used in this classification, see Terminology C 634C 634.

### 4. Significance and Use

4.1 The procedure may be applied to one-third octave band sound transmission losses of test specimens measured in accordance with Test Method E 90E 90 to derive sound transmission class (STC). It can also be applied to (*I*) similar

quantities measured in accordance with Test Method E 336E 336, to derive field sound transmission class (FSTC), noise isolation class (NIC), and normalized noise isolation class (NNIC) and to (2) noise reductions measured in accordance with Method E 596E 596 to derive noise isolation class.

4.2 These single-number ratings correlate in a general way with subjective impressions of sound transmission for speech, radio, television, and similar sources of noise in offices and buildings. This classification method is not appropriate for sound sources with spectra significantly different from those sources listed above. Such sources include machinery, industrial processes, bowling allies, power transformers, musical instruments, many music systems and transportation noises such as motor vehicles, aircraft and trains. For these sources, accurate assessment of sound transmission requires a detailed analysis in frequency bands.

4.3 The single-number ratings obtained can be used to compare the potential sound insulation of partitions or floors tested in laboratory conditions or the actual sound isolation between different suites in buildings. The rating for a partition built and tested in a building may be lower than that obtained for a partition tested in a laboratory because of flanking transmission or construction errors.

NOTE 1—A similar rating procedure, described in ISO 717, provides single figure sound insulation ratings with a frequency range that extends from 100 to 3150 Hz and with no maximum deficiency specified at individual frequencies.

### 5. Procedure

5.1 The reference contour is defined by the array of levels given in Table 1 and shown in Fig. 1.

**TABLE 1 Reference Sound Insulation Contour for Calculation of Single-Number Ratings**

NOTE 1—Reference sound insulation contour for calculation of single-number ratings. This contour has a rating of zero. Other contours may be derived by adding the same integer simultaneously to all values in the table.


Frequency, Hz	125	160	200	250	315	400	500	630
Level, dB	-16	-13	-10	-7	-4	-1	0	1
Frequency, Hz	800	1000	1250	1600	2000	2500	3150	4000
Level, dB	2	3	4	4	4	4	4	4

<sup>1</sup> This classification is under the jurisdiction of ASTM Committee E33 on Environmental Acoustics and is the direct responsibility of Subcommittee E33.03 on Sound Transmission.

Current edition approved Sept. 16, 1987. Approved October 1987. Originally published as E 413 – 70 T. Last previous edition E 413 – 87 (1994) <sup>e1</sup>.

<sup>2</sup> Annual Book of ASTM Standards, Vol 04.06.

<sup>3</sup> Available from American National Standards Institute, 11 W. 42nd St., 13th Floor, New York, NY 10036.

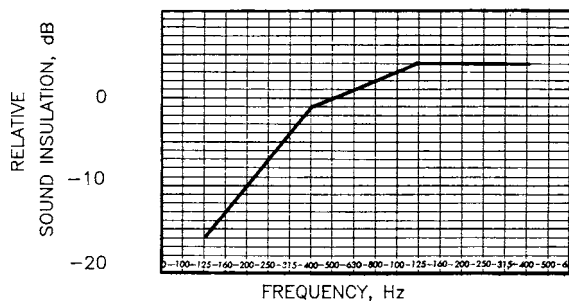

**FIG. 1 Reference Contour for Calculating Sound Transmission Class and Other Ratings**

5.2 Round the data to which the contour is to be fitted to the nearest integer if this is not already specified in the measurement standard.

5.3 Fit the reference contour to the data by increasing simultaneously all the values in Table 1 in 1 dB increments until some of the measured data are less than the shifted reference contour.

5.4 At each frequency calculate the difference between the shifted reference value and the measured data. Only deficiencies, that is, where the measured data are less than the reference contour, are counted in the fitting procedure. Continue to increase the reference contour values until the most stringent of the following conditions is satisfied:

5.4.1 The sum of the deficiencies is less than or equal to 32 dB;

5.4.2 The maximum deficiency at any one frequency does not exceed 8 dB.


5.5 The STC, FSTC, NIC, or NNIC rating is given by the value of the shifted reference contour at 500 Hz.

NOTE 2—This fitting procedure can be done numerically or graphically. One graphical technique involves placing a transparent overlay of the reference contour over a graph of measured data to the same scale,

adjusting initially by trial and error, then making finer adjustments until the criteria are satisfied.

## 6. Presentation of Results

6.1 It is recommended that the data be plotted to the scale sizes recommended in Note 3, along with the shifted reference contour (see Fig. 2). This type of presentation draws attention

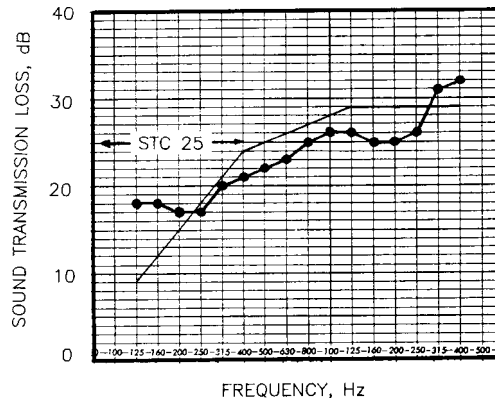

**FIG. 2 Example of Reference Contour Fitted to Transmission Loss Data (STC 25)**

to the frequency regions of the measured data that limit the single-number rating.

NOTE 3—Recommended graph scale sizes are 2 mm/dB for the ordinate and 50 mm per 10 to 1 frequency ratio for the logarithmic abscissa. The ordinate scale should start at 0 dB. If larger or smaller scale sizes are unavoidable, the same aspect ratio of 25 dB per 10 to 1 frequency ratio should be retained.

## 7. Keywords

7.1 architectural acoustics; building design; field sound transmission class (FSTC); noise isolation class (NIC); normalized noise isolation class (NNIC); sound insulation rating; sound transmission class (STC); partitions (buildings)