This document is not an ASTM standard and is intended only to provide the user of an ASTM standard an indication of what changes have been made to the previous version. Because it may not be technically possible to adequately depict all changes accurately, ASTM recommends that users consult prior editions as appropriate. In all cases only the current version of the standard as published by ASTM is to be considered the official document.

Designation: C834-05 Designation: C834 - 10



Standard Specification for Latex Sealants¹

This standard is issued under the fixed designation C834; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the Department of Defense.

1. Scope

1.1 This specification covers one component latex sealants used for sealing joints in building construction.

1.2 A sealant meeting the requirements of this specification shall be classified by the manufacturer to be one of the types and grades defined in Section 4.

1.3 The values stated in SI units are to be regarded as the standard. The inch-pound in parenthesis are provided for information purposes only.

1.4 The following precautionary caveat pertains only to the test method portion, Section 10, of this Specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

NOTE 1-Currently, there is no ISO standard similar to this specification.

2. Referenced Documents

2.1 ASTM Standards:²

C717 Terminology of Building Seals and Sealants

C732 Test Method for Aging Effects of Artificial Weathering on Latex Sealants

C734 Test Method for Low-Temperature Flexibility of Latex Sealants After Artificial Weathering

C736 Test Method for Extension-Recovery and Adhesion of Latex Sealants

C1183 Test Method for Extrusion Rate of Elastomeric Sealants

C1193 Guide for Use of Joint Sealants

C1241 Test Method for Volume Shrinkage of Latex Sealants During Cure

D2202 Test Method for Slump of Sealants

D2203 Test Method for Staining from Sealants

D2377 Test Method for Tack-Free Time of Caulking Compounds and Sealants

https://standards.iteh.ai/catalog/standards/sist/d7935e91-b731-4acc-92c7-0967e4f9689e/astm-c834-10

3. Terminology

3.1 *Definitions*—Definitions of the following terms apply to this specification and are found in Terminology C717: adhesive failure (adhesion loss), cure, joint, latex sealant, sealant, shrinkage (volume), and substrate.

4. Classification of Sealants

4.1 A sealant qualifying under this specification shall be classified by type and grade as follows:

4.1.1 *Type OP*—An opaque sealant containing color pigments or extender pigments, or both, that has no more than 30 % volume shrinkage (see 10.1.3).

4.1.2 Type C-A clear or translucent sealant that has no more than 50 % volume shrinkage (see 10.1.3).

4.1.3 Grade $-18^{\circ}C$ —A sealant that meets the requirements for low temperature flexibility (see 7.1) when tested at $-18^{\circ}C$ (0°F).

4.1.4 Grade $0^{\circ}C$ —A sealant that meets the requirements for low temperature flexibility (see 7.1) when tested at $0^{\circ}C$ (32°F).

4.1.5 Grade NF—A sealant that does not meet the requirements for low temperature flexibility of Grade 0°C (see 4.1.4).

Copyright © ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States.

¹ This specification is under the jurisdiction of ASTM Committee C24 on Building Seals and Sealants and is the direct responsibility of Subcommittee C24.10 on Specifications, Guides and Practices.

Current edition approved May 1, 2005. Published June 2005. Originally approved in 1976. Last previous edition approved in 2000 as C834-00^{e1}. DOI: 10.1520/C0834-05. Current edition approved Jan. 1, 2010. Published February 2010. Originally approved in 1976. Last previous edition approved in 2005 as C834-05. DOI: 10.1520/C0834-10.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For Annual Book of ASTM Standards volume information, refer to the standard's Document Summary page on the ASTM website.

5. Materials and Manufacture

5.1 The sealant shall be composed of latex formulated with appropriate fillers, pigments, and chemical additives to result in conformance to this specification.

5.2 All material and workmanship shall be in accordance with good commercial practice. The producer is permitted a wide latitude in choice of raw materials for making these products. Consequently, there is no implication that the compounds are equivalent in all physical properties.

5.3 The manufacturing process shall be such as will ensure a homogeneous mix, free of defects that would affect serviceability, and provide a consistency suitable for immediate application.

6. General Requirements

6.1 The sealant in the original unopened container shall meet the requirements of this specification for at least 12 months from the date of manufacture when stored at a temperature neither below 5°C (41°F) nor exceeding 26.7°C (80°F).

6.2 After 21 days cure at laboratory conditions controlled at $23 \pm 2^{\circ}$ C ($73 \pm 3.6^{\circ}$ F) and 50 ± 10 % relative humidity, the color of the sealant shall be that color that has been agreed upon between the purchaser and the supplier.


6.3 The sealant is intended for application to clean substrate surfaces only.

7. Physical Properties

7.1 The sealant shall conform to the physical requirements specified in Table 1 according to type and grade.

8. Significance and Use

8.1 This specification covers two types and three grades of latex sealants as described in Section 4 that are formulated for general caulking and sealing operations in building construction. It should be recognized by the user that not all sealants meeting

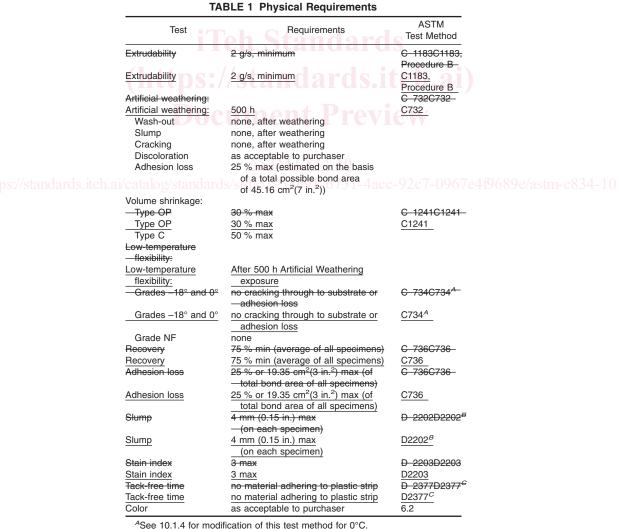

^B See 10.1.6 for modification to this test method.

^C See 10.1.8 for modification to this test method.