



~~Designation: C507-09~~ Designation: C507 - 10

# Standard Specification for Reinforced Concrete Elliptical Culvert, Storm Drain, and Sewer Pipe<sup>1</sup>

This standard is issued under the fixed designation C507; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

*This standard has been approved for use by agencies of the Department of Defense.*

## 1. Scope

1.1 This specification covers reinforced elliptically shaped concrete pipe to be used for the conveyance of sewage, industrial wastes, and storm water, and for the construction of culverts.

1.2 Pipe designed for placement with the major axis horizontal shall be designated as “Horizontal Elliptical Pipe.” Pipe designed for placement with the major axis vertical shall be designated as “Vertical Elliptical Pipe.”

1.3 This specification is the inch-pound companion to Specification C507M; therefore, no SI equivalents are presented in the specification.

NOTE 1—This specification is a manufacturing and purchase specification only, and does not include requirements for bedding, backfill, or the relationship between field load condition and the strength classification of pipe. However, experience has shown that the successful performance of this product depends upon the proper selection of the class of pipe, type of bedding and backfill, and care that the installation conforms to the construction specifications. The owner of the reinforced concrete pipe specified herein is cautioned that he must correlate the field requirements with the class of pipe specified and provide inspection at the construction site.

## 2. Referenced Documents

### 2.1 ASTM Standards:<sup>2</sup>

A36/A36M [Specification for Carbon Structural Steel](#)

A82/A82M [Specification for Steel Wire, Plain, for Concrete Reinforcement](#)

A185/A185M [Specification for Steel Welded Wire Reinforcement, Plain, for Concrete](#)

A496/A496M [Specification for Steel Wire, Deformed, for Concrete Reinforcement](#)

A497/A497M [Specification for Steel Welded Wire Reinforcement, Deformed, for Concrete](#)

A615/A615M [Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement](#)

A706/A706M [Specification for Low-Alloy Steel Deformed and Plain Bars for Concrete Reinforcement](#)

C33 [Specification for Concrete Aggregates](#)

C150 [Specification for Portland Cement](#)

C260 [Specification for Air-Entraining Admixtures for Concrete](#)

C309 [Specification for Liquid Membrane-Forming Compounds for Curing Concrete](#)

C494/C494M [Specification for Chemical Admixtures for Concrete](#)

C497M [Test Methods for Concrete Pipe, Manhole Sections, or Tile \[Metric\]](#)

C595 [Specification for Blended Hydraulic Cements](#)

C618 [Specification for Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete](#)

C822 [Terminology Relating to Concrete Pipe and Related Products](#)

C989 [Specification for Slag Cement for Use in Concrete and Mortars](#)

C1017/C1017M [Specification for Chemical Admixtures for Use in Producing Flowing Concrete](#)

C1116 [Specification for Fiber-Reinforced Concrete and Shotcrete](#)

## 3. Terminology

3.1 *Definitions*—For definitions of terms relating to concrete pipe, see Terminology C822.

<sup>1</sup> This specification is under the jurisdiction of ASTM Committee C13 on Concrete Pipe and is the direct responsibility of Subcommittee C13.02 on Reinforced Sewer and Culvert Pipe.

Current edition approved ~~June~~ Feb. 1, 2009; 2010. Published ~~June~~ 2009; February 2010. Originally approved in 1963. Last previous edition approved in 2008; 2009 as ~~C507-08a~~; C507-09. DOI: 10.1520/C0507-109.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

#### 4. Classification

4.1 Pipe manufactured according to this specification shall be of five classes each for horizontal elliptical and vertical elliptical pipe with identification as follows:

**iTeh Standards**  
**(<https://standards.iteh.ai>)**  
**Document Preview**

[ASTM C507-10](#)

<https://standards.iteh.ai/catalog/standards/sist/02a77d12-01b6-424e-b725-3b2858339cf6/astm-c507-10>

Horizontal Elliptical Pipe  
 Class HE-A  
 Class HE-I  
 Class HE-II  
 Class HE-III  
 Class HE-IV

Vertical Elliptical Pipe  
 Class VE-II  
 Class VE-III  
 Class VE-IV  
 Class VE-V  
 Class VE-VI

4.2 The strength requirements for horizontal elliptical pipe are prescribed in Table 1 and for vertical elliptical pipe are prescribed in Table 2.

### 5. Basis of Acceptance

5.1 Unless otherwise designated by the owner at the time of, or before, placing an order, there are two separate and alternative bases of acceptance. Independent of the method of acceptance, the pipe shall be designed to meet both the 0.01-in. crack and ultimate strength requirements.

5.1.1 *Acceptance on Basis of Plant Load-Bearing Tests, Material Tests, and Inspection of Manufactured Pipe for Visual Defects and Imperfections*—Acceptability of the pipe in all diameters and classes produced in accordance with 7.1 or 7.2 shall be determined by the results of the three-edge-bearing tests as defined in 11.3.1; by such material tests as are required in 6.2, 6.3, 6.5, and 6.6; by an absorption test of the concrete from the wall of the pipe for each mix design that is used on an order, as required in 11.9; and by visual inspection of the finished pipe to determine its conformance with the accepted design and its freedom from defects.

**TABLE 1 Design Requirements for Horizontal Elliptical (HE) Pipe<sup>A</sup>**

NOTE 1—The test load in pounds per linear foot equals D-load × inside span in feet.

NOTE 2—Single cage reinforcement, providing tension steel at the top, bottom, and springline, shall be permitted instead of double cage reinforcement. The area of such reinforcement shall be 112 % of the tabulated inner cage area.

NOTE 3—An inner and outer cage plus quadrant mats shall be permitted instead of double cage reinforcement. The area of such reinforcement shall be in accordance with Fig. 1.

NOTE 4—An inner and outer cage plus a middle cage shall be permitted instead of double cage reinforcement. The area of such reinforcement shall be in accordance with Fig. 2.

| Designated Diameter, Equivalent Round Size, in. | Designated Rise, in. × Span, in. | Minimum Wall Thickness, in. | Reinforcement, in. <sup>2</sup> /linear ft |          |                          |          |                           |          |                           |          |                           |          |
|---|----------------------------------|-----------------------------|--|----------|--------------------------|----------|---------------------------|----------|---------------------------|----------|---------------------------|----------|
|   |                                  |                             | Class HE-A                                 |          | Class HE-I               |          | Class HE-II               |          | Class HE-III              |          | Class HE-IV               |          |
|   |                                  |                             | D-Loads                                    |          |                          |          |                           |          |                           |          |                           |          |
|   |                                  |                             | 0.01 = 600<br>Ult = 900                    |          | 0.01 = 800<br>Ult = 1200 |          | 0.01 = 1000<br>Ult = 1500 |          | 0.01 = 1350<br>Ult = 2000 |          | 0.01 = 2000<br>Ult = 3000 |          |
|   |                                  |                             | In Cage                                    | Out Cage | In Cage                  | Out Cage | In Cage                   | Out Cage | In Cage                   | Out Cage | In Cage                   | Out Cage |
| 18  | 14 × 23                          | 2¾                          | 0.08                                       | ...      | 0.11                     | ...      | 0.14                      | ...      | 0.19                      | ...      | 0.27                      | ...      |
| 24  | 19 × 30                          | 3¼                          | 0.11                                       | ...      | 0.15                     | ...      | 0.19                      | ...      | 0.26                      | ...      | 0.39                      | ...      |
| 27  | 22 × 34                          | 3½                          | 0.14                                       | ...      | 0.18                     | ...      | 0.23                      | ...      | 0.31                      | ...      | 0.46                      | ...      |
| 30  | 24 × 38                          | 3¾                          | 0.10                                       | 0.10     | 0.13                     | 0.13     | 0.17                      | 0.17     | 0.23                      | 0.23     | 0.34                      | 0.34     |
| 33  | 27 × 42                          | 3¾                          | 0.12                                       | 0.12     | 0.17                     | 0.17     | 0.21                      | 0.21     | 0.28                      | 0.28     | 0.41                      | 0.41     |
| 36  | 29 × 45                          | 4½                          | 0.11                                       | 0.11     | 0.15                     | 0.15     | 0.19                      | 0.19     | 0.26                      | 0.26     | 0.39                      | 0.39     |
| 39  | 32 × 49                          | 4¾                          | 0.13                                       | 0.13     | 0.17                     | 0.17     | 0.21                      | 0.21     | 0.29                      | 0.29     | 0.44                      | 0.44     |
| 42  | 34 × 53                          | 5                           | 0.15                                       | 0.15     | 0.20                     | 0.20     | 0.24                      | 0.24     | 0.33                      | 0.33     | 0.50                      | 0.50     |
| 48  | 38 × 60                          | 5½                          | 0.17                                       | 0.17     | 0.23                     | 0.23     | 0.28                      | 0.28     | 0.39                      | 0.39     | ...                       | ...      |
| 54  | 43 × 68                          | 6                           | 0.20                                       | 0.20     | 0.27                     | 0.27     | 0.34                      | 0.34     | 0.45                      | 0.45     | ...                       | ...      |
| 60  | 48 × 76                          | 6½                          | 0.24                                       | 0.24     | 0.32                     | 0.32     | 0.40                      | 0.40     | 0.53                      | 0.53     | ...                       | ...      |
| 66  | 53 × 83                          | 7                           | 0.27                                       | 0.27     | 0.36                     | 0.36     | 0.45                      | 0.45     | 0.61                      | 0.61     | ...                       | ...      |
| 72  | 58 × 91                          | 7½                          | 0.31                                       | 0.31     | 0.41                     | 0.41     | 0.52                      | 0.52     | 0.70                      | 0.70     | ...                       | ...      |
| 78  | 63 × 98                          | 8                           | 0.34                                       | 0.34     | 0.45                     | 0.45     | 0.56                      | 0.56     | 0.78                      | 0.78     | ...                       | ...      |
| 84  | 68 × 106                         | 8½                          | 0.38                                       | 0.38     | 0.50                     | 0.50     | 0.63                      | 0.63     | 0.88                      | 0.88     | ...                       | ...      |
| 90  | 72 × 113                         | 9                           | ...  | ...      | ...                      | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 96  | 77 × 121                         | 9½                          | ...  | ...      | ...                      | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 102   | 82 × 128                         | 9¾                          | ...  | ...      | ...                      | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 108   | 87 × 136                         | 10                          | ...  | ...      | ...                      | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 114   | 92 × 143                         | 10½                         | ...  | ...      | ...                      | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 120   | 97 × 151                         | 11                          | ...  | ...      | ...                      | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 132   | 106 × 166                        | 12                          | ...  | ...      | ...                      | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 144   | 116 × 180                        | 13                          | ...  | ...      | ...                      | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| Concrete strength <sup>B</sup> , psi            |                                  |                             | 4000                                       |          | 4000                     |          | 4000                      |          | 18 to 66 in.<br>4000      |          | 4000                      |          |
|   |                                  |                             |  |          |                          |          |                           |          | 72 to 84 in.<br>5000      |          |                           |          |

<sup>A</sup> For sizes and loads beyond those shown in this table, pipe designs are available that make use of one or a combination of the following: shear steel, multiple cages, or thicker walls in accordance with the provisions of 7.3.

<sup>B</sup> Concrete strength for designs with reinforcement tabulated. For modified or special designs, see 7.3.

**TABLE 2 Design Requirements for Vertical Elliptical Pipe<sup>A</sup>**

NOTE 1—Test load in pounds per linear foot equals D-load × inside span in feet.

NOTE 2—An inner and outer cage plus quadrant mats shall be permitted instead of double cage reinforcement. The area of such reinforcement shall be in accordance with Fig. 3.

NOTE 3—Single cage reinforcement, providing tension steel at the top, bottom, and springline, shall be permitted instead of double cage reinforcement. The area of such reinforcement shall be 112 % of the tabulated inner cage area.

NOTE 4—An inner and outer cage plus a middle cage shall be permitted instead of double cage reinforcement. The area of such reinforcement shall be in accordance with Fig. 4.

| Designated Diameter, Equivalent Round Size, in. | Designated Rise, in. × Span, in. | Minimum Wall Thickness, in. | Reinforcement, in. <sup>2</sup> /linear ft |          |                           |          |                           |          |                           |          |                           |          |
|---|----------------------------------|-----------------------------|--|----------|---------------------------|----------|---------------------------|----------|---------------------------|----------|---------------------------|----------|
|   |                                  |                             | Class VE-II                                |          | Class VE-III              |          | Class VE-IV               |          | Class VE-V                |          | Class VE-VI               |          |
|   |                                  |                             | D-Loads                                    |          |                           |          |                           |          |                           |          |                           |          |
|   |                                  |                             | 0.01 = 1000<br>Ult = 1500                  |          | 0.01 = 1350<br>Ult = 2000 |          | 0.01 = 2000<br>Ult = 3000 |          | 0.01 = 3000<br>Ult = 3750 |          | 0.01 = 4000<br>Ult = 5000 |          |
|   |                                  |                             | In Cage                                    | Out Cage | In Cage                   | Out Cage | In Cage                   | Out Cage | In Cage                   | Out Cage | In Cage                   | Out Cage |
| 36  | 45 × 29                          | 4½                          | 0.08                                       | 0.05     | 0.11                      | 0.07     | 0.16                      | 0.10     | 0.23                      | 0.14     | 0.31                      | 0.19     |
| 39  | 49 × 32                          | 4¾                          | 0.09                                       | 0.05     | 0.12                      | 0.07     | 0.18                      | 0.11     | 0.26                      | 0.16     | 0.35                      | 0.21     |
| 42  | 53 × 34                          | 5                           | 0.10                                       | 0.06     | 0.13                      | 0.08     | 0.20                      | 0.12     | 0.29                      | 0.17     | 0.38                      | 0.23     |
| 48  | 60 × 38                          | 5½                          | 0.11                                       | 0.07     | 0.15                      | 0.09     | 0.22                      | 0.13     | 0.33                      | 0.20     | 0.44                      | 0.26     |
| 54  | 68 × 43                          | 6                           | 0.13                                       | 0.08     | 0.18                      | 0.11     | 0.27                      | 0.16     | 0.40                      | 0.24     | 0.53                      | 0.32     |
| 60  | 76 × 48                          | 6½                          | 0.16                                       | 0.10     | 0.21                      | 0.13     | 0.31                      | 0.19     | 0.47                      | 0.28     | ...                       | ...      |
| 66  | 83 × 53                          | 7                           | 0.18                                       | 0.11     | 0.25                      | 0.15     | 0.36                      | 0.22     | 0.55                      | 0.33     | ...                       | ...      |
| 72  | 91 × 58                          | 7½                          | 0.21                                       | 0.13     | 0.28                      | 0.17     | 0.41                      | 0.25     | ...                       | ...      | ...                       | ...      |
| 78  | 98 × 63                          | 8                           | 0.23                                       | 0.14     | 0.31                      | 0.19     | 0.47                      | 0.28     | ...                       | ...      | ...                       | ...      |
| 84  | 106 × 68                         | 8½                          | 0.26                                       | 0.16     | 0.35                      | 0.21     | 0.53                      | 0.32     | ...                       | ...      | ...                       | ...      |
| 90  | 113 × 72                         | 9                           | ...  | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 96  | 121 × 77                         | 9½                          | ...  | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 102   | 128 × 82                         | 9¾                          | ...  | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 108   | 136 × 87                         | 10                          | ...  | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 114   | 143 × 92                         | 10½                         | ...  | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 120   | 151 × 97                         | 11                          | ...  | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 132   | 166 × 106                        | 12                          | ...  | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| 144   | 180 × 116                        | 13                          | ...  | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      | ...                       | ...      |
| Concrete strength <sup>B</sup> , psi            |                                  |                             | 4000                                       |          | 4000                      |          | 4000                      |          | 5000                      |          | 6000                      |          |

<sup>A</sup> For sizes and loads beyond those shown in this table, pipe designs are available which make use of one or a combination of the following: shear steel, multiple cages, or thicker walls in accordance with the provisions of 7.3.

<sup>B</sup> Concrete strength for designs with reinforcement tabulated. For modified or special designs, see 7.3.

5.1.2 *Acceptance on the Basis of Material Tests and Inspection of Manufactured Pipe for Defects and Imperfections*—Acceptability of the pipe in all diameters and classes produced in accordance with 7.1 or 7.2 shall be determined by the results of such material tests as are required in 6.2, 6.3, 6.5, and 6.6; by crushing tests on concrete cores or cured concrete cylinders; by an absorption test of the concrete from the wall of the pipe for each mix design that is used on an order; and by inspection of the finished pipe, including amount and placement of reinforcement, to determine its conformance with the accepted design and its freedom from defects.

5.1.3 When agreed upon by the owner and the manufacturer, any portion or any combination of the tests itemized in 5.1.1 or 5.1.2 may form the basis of acceptance.

5.2 *Age for Acceptance*—Pipe shall be considered ready for acceptance when they conform to the requirements as indicated by the specified tests.

## 6. Materials

6.1 The aggregate shall be so sized, graded, proportioned, and mixed with such proportions of portland cement, blended hydraulic cement, or portland cement and supplementary cementing materials, or admixtures, if used, or a combination thereof, and water to produce a homogeneous concrete mixture of such quality that the pipe will conform to the test and design requirements of this specification. In no case, however, shall the proportion of portland cement, blended hydraulic cement, or a combination of portland cement and supplementary cementing materials be less than 470 lb/yd<sup>3</sup>.

### 6.2 Cementitious Materials:

6.2.1 *Cement*—Cement shall conform to the requirements of Specification C150, or shall be portland blast-furnace slag cement, or slag modified portland cement, or portland-pozzolan cement conforming to the requirements of Specification C595, except that the pozzolan constituent in the Type IP portland pozzolan cement shall be fly ash.

6.2.2 *Ground Granulated Blast-Furnace Slag (GGBFS)*—GGBFS shall conform to the requirements of Grade 100 or 120 of Specification C989.

6.2.3 *Fly Ash*—Fly ash shall conform to the requirements of Class F or Class C of Specification C618.

6.2.4 *Allowable Combinations of Cementitious Materials*—The combination of cementitious materials used in the concrete shall be one of the following:

- 6.2.4.1 Portland cement only,
- 6.2.4.2 Portland blast furnace slag cement only,
- 6.2.4.3 Slag modified portland cement only,
- 6.2.4.4 Portland pozzolan cement only,
- 6.2.4.5 A combination of portland cement and ground granulated blast-furnace slag,
- 6.2.4.6 A combination of portland cement and fly ash, or
- 6.2.4.7 A combination of portland cement, ground granulated blast-furnace slag (not to exceed 25 % of the total cementitious weight) and fly ash (not to exceed 25 % of the total cementitious weight).

6.3 *Aggregates*—Aggregates shall conform to Specification C33 except that the requirement for gradation shall not apply.

6.4 *Admixtures and Blends*—The following admixtures and blends are allowable:

- 6.4.1 Air-entraining admixture conforming to Specification C260;
- 6.4.2 Chemical admixture conforming to Specification C494/C494M;
- 6.4.3 Chemical admixture for use in producing flowing concrete conforming to Specification C1017/C1017M; and
- 6.4.4 Chemical admixture or blend approved by the owner.


6.5 *Steel Reinforcement*—Reinforcement shall consist of wire conforming to Specification A82/A82M or Specification A496/A496M; or of wire reinforcement conforming to Specification A185/A185M or Specification A497/A497M; or of bars conforming to Specification A36/A36M, Specification A615/A615M Grade 40 or 60, or Specification A706/A706M Grade 60.

6.6 *Synthetic Fibers*—Collated fibrillated virgin polypropylene fibers may be used, at the manufacturer's option, in concrete pipe as a nonstructural manufacturing material. Only Type III synthetic fibers designed and manufactured specifically for use in concrete and conforming to the requirements of Specification C1116 shall be accepted.

## 7. Design

7.1 *Size and Shape*—The standard sizes of elliptical pipe shall be as listed in Table 1 and Table 2. The internal shape for each size pipe shall be defined by the internal dimensions shown in Fig. 5, subject to the permissible variations of 12.1.

7.2 *Design Tables*—The wall thickness, compressive strength of concrete, and the area of circumferential reinforcement shall be as prescribed in Table 1 and Table 2, subject to the provisions of 7.3 and Sections 11 and 12.

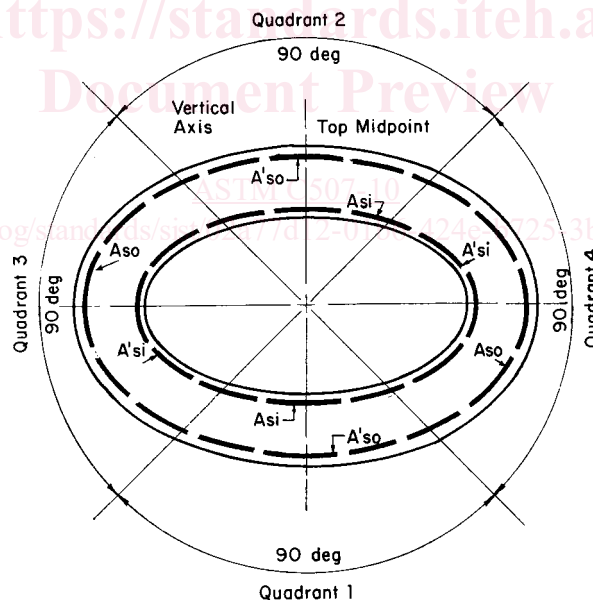


NOTE 1—The total reinforcement area ( $A_{si}$ ) of the inner cage plus the quadrant mat in Quadrants 1 and 2 shall not be less than that specified for the inner cage in Table 1.

NOTE 2—The total reinforcement area ( $A_{so}$ ) of the outer cage plus the quadrant mat in Quadrants 3 and 4 shall not be less than that specified for the outer cage in Table 1.

NOTE 3—The reinforcement area ( $A'_{si}$ ) of the inner cage in Quadrants 3 and 4 shall be not less than 25 % of that specified for the inner cage in Table 1.

NOTE 4—The reinforcement area ( $A'_{so}$ ) of the outer cage in Quadrants 1 and 2 shall be not less than 25 % of that specified for the outer cage in Table 1.


**FIG. 1 Quadrant Reinforcement, Horizontal Elliptical Pipe**

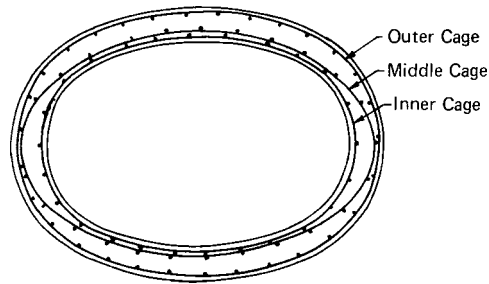

NOTE 1—The total reinforcement area of the inner cage plus the middle cage shall not be less than that specified for the inner cage in Table 1.

NOTE 2—The total reinforcement area of the outer cage plus the middle cage shall not be less than that specified for the outer cage in Table 1.

FIG. 2 Horizontal Elliptical Pipe

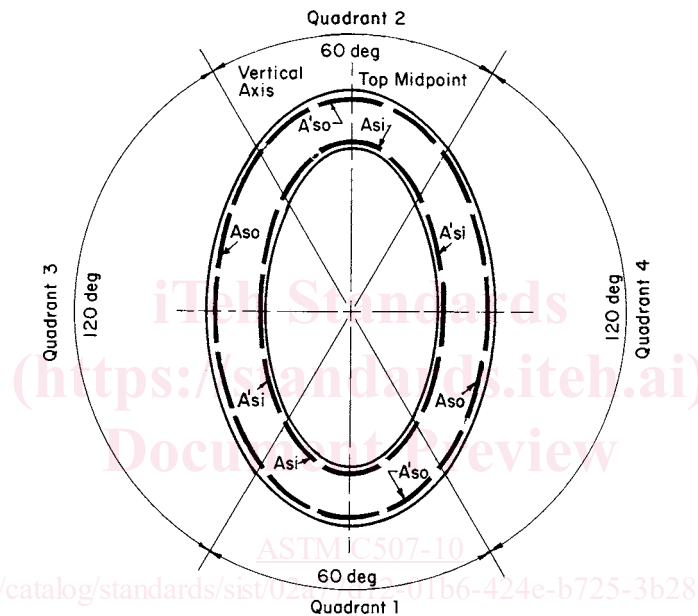

NOTE 1—The total reinforcement area ( $A'si$ ) of the inner cage plus the quadrant mat in Quadrants 1 and 2 shall not be less than that specified for the inner cage in Table 2.

NOTE 2—The total reinforcement area ( $A'so$ ) of the outer cage plus the quadrant mat in Quadrants 3 and 4 shall not be less than that specified for the outer cage in Table 2.

NOTE 3—The reinforcement area ( $A'si'$ ) of the inner cage in Quadrants 3 and 4 shall be not less than 25 % of that specified for the inner cage in Table 2.

NOTE 4—The reinforcement area ( $A'so'$ ) of the outer cage in Quadrants 1 and 2 shall be not less than 25 % of that specified for the outer cage in Table 2.

FIG. 3 Quadrant Reinforcement, Vertical Elliptical Pipe

7.2.1 Footnotes to the tables herein are intended to be amplifications of the tabulated requirements and are to be considered applicable and binding as if they were contained in the body of the specification.

### 7.3 Modified and Special Designs:

7.3.1 If permitted by the owner, the manufacturer may request approval by the owner of modified designs which differ from the designs in this Section 7; or special designs for sizes and loads beyond those shown in Table 1 and Table 2; or special designs for pipe sizes that do not have steel reinforcement areas shown in Table 1 and Table 2.

7.3.2 Such modified and special designs shall be based on rational or empirical evaluations of the ultimate strength and cracking behavior of pipe and shall fully describe to the owner any deviations from the requirements of this section. The descriptions of modified or special designs shall include the wall thickness, the concrete strength, and the area, type, placement, number of layers, and strength of the steel reinforcement.