

TECHNICAL SPECIFICATION

**ISO/IEC TS
22237-4**

First edition
2018-05

Information technology — Data centre facilities and infrastructures —

Part 4: Environmental control

Technologie de l'information — Installation et infrastructures de centres de traitement de données

iTeh STANDARD PREVIEW
Partie 4: Contrôle environnemental
(standards.iteh.ai)

[ISO/IEC TS 22237-4:2018](#)

<https://standards.iteh.ai/catalog/standards/sist/2df34631-ace0-4100-ba98-e93bd1d2e6b2/iso-iec-ts-22237-4-2018>



Reference number
ISO/IEC TS 22237-4:2018(E)

© ISO/IEC 2018

iTeh STANDARD PREVIEW (standards.iteh.ai)

[ISO/IEC TS 22237-4:2018](#)

<https://standards.iteh.ai/catalog/standards/sist/2df34631-ace0-4100-ba98-e93bd1d2e6b2/iso-iec-ts-22237-4-2018>



COPYRIGHT PROTECTED DOCUMENT

© ISO/IEC 2018

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms, definitions and abbreviated terms	1
3.1 Terms and definitions	1
3.2 Abbreviated terms	3
4 Conformance	3
5 Environmental control within data centres	3
5.1 General	3
5.1.1 Functional elements	3
5.1.2 Requirements	4
5.1.3 Recommendations	4
5.2 Environmental control of data centre spaces	5
5.2.1 Building entrance facilities	5
5.2.2 Personnel entrance(s)	5
5.2.3 Docking/loading bay(s)	5
5.2.4 Generator space(s) including fuel storage	5
5.2.5 Transformer space(s)	5
5.2.6 Electrical distribution space(s)	6
5.2.7 Telecommunication spaces(s)	6
5.2.8 Main distributor spaces(s)	6
5.2.9 Computer room space(s) and associated testing space(s)	6
5.2.10 Electrical space(s)	7
5.2.11 Mechanical space(s)	7
5.2.12 Control room space(s)	7
5.2.13 Office space(s)	7
5.2.14 Storage and holding space(s)	7
5.2.15 Accommodation of UPS equipment	7
6 Availability	8
6.1 General	8
6.2 Design options by space	8
6.2.1 General	8
6.2.2 Spaces excluded from the availability classification	9
6.2.3 Main distributor space(s)	9
6.2.4 Computer room space(s) and associated testing space(s)	10
6.2.5 UPS space	11
6.3 Environmental control system capacity planning with respect to expansion	12
6.4 Environmental control system capacity planning with respect to resilience	12
7 Physical security	12
7.1 General	12
7.2 Access	12
8 Energy efficiency enablement	12
8.1 General	12
8.2 Measurement of temperature	12
8.2.1 External temperature	12
8.2.2 Computer room temperature	13
8.3 Measurement of relative humidity	14
8.3.1 External relative humidity	14
8.3.2 Computer room relative humidity	14
8.4 Measurement of air pressure	15

8.5	Coolant flow rates.....	15
8.6	Heat removal.....	15
8.7	Outside air.....	15
8.8	Provision of alarms	15
8.9	Measurement requirements by Granularity Level	15
Annex A (normative) Distribution methodologies for temperature-controlled airin computer room space.....		17
Annex B (informative) Control system concepts		20
Bibliography		21

iTeh STANDARD PREVIEW (standards.iteh.ai)

[ISO/IEC TS 22237-4:2018](#)
<https://standards.iteh.ai/catalog/standards/sist/2df34631-ace0-4100-ba98-e93bd1d2e6b2/iso-iec-ts-22237-4-2018>

Foreword

ISO (the International Organization for Standardization) and IEC (the International Electrotechnical Commission) form the specialized system for worldwide standardization. National bodies that are members of ISO or IEC participate in the development of International Standards through technical committees established by the respective organization to deal with particular fields of technical activity. ISO and IEC technical committees collaborate in fields of mutual interest. Other international organizations, governmental and non-governmental, in liaison with ISO and IEC, also take part in the work. In the field of information technology, ISO and IEC have established a joint technical committee, ISO/IEC JTC 1.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of document should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO and IEC shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see the following URL: www.iso.org/iso/foreword.html.

This document was prepared by ISO/IEC TS 22237-4:2018 ISO/IEC JTC 1, *Information technology, Subcommittie SC 39, Sustainability for and by Information Technology*, <https://standards.iec.ch/ctc/standard/610-4100-4100-ba98-e93bd1d2e6b2/iso-iec-ts-22237-4-2018>

A list of all parts in the ISO/IEC TS 22237 series can be found on the ISO website.

Introduction

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres are housing and supporting the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres need to provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, energy consumption of data centres has become critical both from an environmental point of view (reduction of carbon footprint) and with respect to economical considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting or network operator facilities);
- b) security level;
- c) physical size;
- d) accommodation (mobile, temporary and permanent constructions).

The needs of data centres also vary in terms of availability of service, the provision of security and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control and physical security. Effective management and operational information is required to monitor achievement of the defined needs and objectives.

The ISO/IEC TS 22237 series specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation and maintenance of facilities and infrastructures within data centres. These parties include:

- 1) owners, facility managers, ICT managers, project managers, main contractors;
- 2) architects, building designers and builders, system and installation designers;
- 3) facility and infrastructure integrators, suppliers of equipment;
- 4) installers, maintainers.

At the time of publication of this document, the ISO/IEC TS 22237 series will comprise the following documents:

ISO/IEC TS 22237-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*;

ISO/IEC TS 22237-2, *Information technology — Data centre facilities and infrastructures — Part 2: Building construction*;

ISO/IEC TS 22237-3, *Information technology — Data centre facilities and infrastructures — Part 3: Power distribution*;

ISO/IEC TS 22237-4, *Information technology — Data centre facilities and infrastructures — Part 4: Environmental control*;

ISO/IEC TS 22237-5, *Information technology — Data centre facilities and infrastructures — Part 5: Telecommunications cabling infrastructure*;

ISO/IEC TS 22237-6, *Information technology — Data centre facilities and infrastructures — Part 6: Security systems*;

ISO/IEC TS 22237-7, *Information technology — Data centre facilities and infrastructures — Part 7: Management and operational information*.

The inter-relationship of the specifications within the ISO/IEC TS 22237 series is shown in [Figure 1](#).

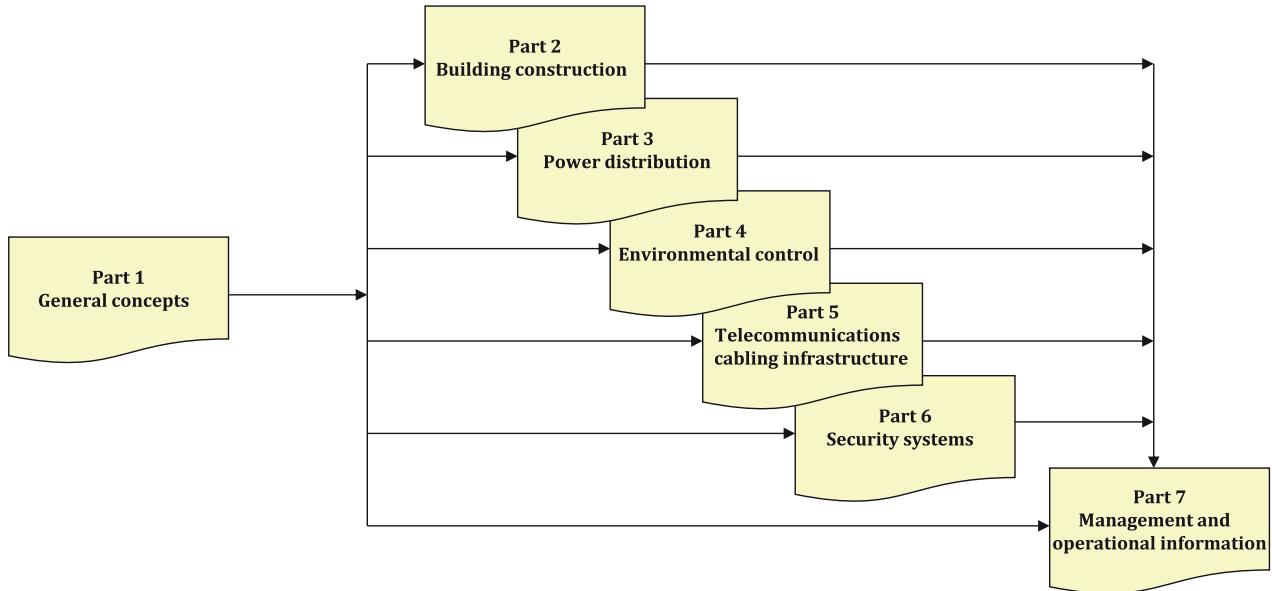


Figure 1 — Schematic relationship between the ISO/IEC TS 22237 series of documents

ISO/IEC TS 22237-2 to ISO/IEC TS 22237-6 specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “physical security” and “energy efficiency enablement” selected from ISO/IEC TS 22237-1.

<https://standards.iteh.ai/catalog/standards/sist/2d/4631-ace0-4100-ba98>

This document addresses the environmental control facilities and infrastructure within data centres together with the interfaces for monitoring the performance of those facilities and infrastructures in line with ISO/IEC TS 22237-7 (in accordance with the requirements of ISO/IEC TS 22237-1).

ISO/IEC TS 22237-7 addresses the operational and management information (in accordance with the requirements of ISO/IEC TS 22237-1).

This document is intended for use by and collaboration between architects, building designers and builders, system and installation designers.

The ISO/IEC TS 22237 series does not address the selection of information technology and network telecommunications equipment, software and associated configuration issues.

iTeh STANDARD PREVIEW

(standards.iteh.ai)

[ISO/IEC TS 22237-4:2018](#)

<https://standards.iteh.ai/catalog/standards/sist/2df34631-ace0-4100-ba98-e93bd1d2e6b2/iso-iec-ts-22237-4-2018>

Information technology — Data centre facilities and infrastructures —

Part 4: Environmental control

1 Scope

This document addresses environmental control within data centres based upon the criteria and classifications for “availability”, “security” and “energy efficiency enablement” within ISO/IEC TS 22237-1.

This document specifies requirements and recommendations for the following:

- a) temperature control;
- b) fluid movement control;
- c) relative humidity control;
- d) particulate control; **Teh STANDARD PREVIEW
(standards.iteh.ai)**
- e) vibration; [ISO/IEC TS 22237-4:2018](https://www.standards.iteh.ai/catalog/standards/sist/2df34631-ace0-4100-ba98-e93bd1d2e6b2/iso-iec-ts-22237-4-2018)
- f) floor layout and equipment locations; [ISO/IEC TS 22237-4:2018](https://www.standards.iteh.ai/catalog/standards/sist/2df34631-ace0-4100-ba98-e93bd1d2e6b2/iso-iec-ts-22237-4-2018)
- g) energy saving practices [ISO/IEC TS 22237-4:2018](https://www.standards.iteh.ai/catalog/standards/sist/2df34631-ace0-4100-ba98-e93bd1d2e6b2/iso-iec-ts-22237-4-2018)
- h) physical security of environmental control systems.

Issues related to electromagnetic environment can be found in ISO/IEC TS 22237-6.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO/IEC TS 22237-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*

ISO/IEC TS 22237-6, *Information technology — Data centre facilities and infrastructures — Part 6: Security systems*

3 Terms, definitions and abbreviated terms

3.1 Terms and definitions

For the purposes of this document, the terms and definitions in ISO/IEC TS 22237-1 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>

— ISO Online browsing platform: available at <https://www.iso.org/obp>

3.1.1

adiabatic cooling

cooling system that uses the evaporative cooling principle to reduce the air temperature

3.1.2

absolute humidity

quantity of water vapour in a given volume of air

Note 1 to entry: Expressed by mass.

3.1.3

access floor

system consisting of completely removable and interchangeable floor panels that are supported on adjustable pedestals connected by stringers to allow the area beneath the floor to be used by building services

Note 1 to entry: Also known as "raised floor".

[SOURCE: ISO/IEC TS 22237-2:2018, 3.1.1]

3.1.4

comfort environmental controls

controls which produce an environment which is appropriate for the effective performance of personnel in a given space

iTeh STANDARD PREVIEW

(standards.iteh.ai)

temperature at which the water vapour in a gas begins to deposit as a liquid or ice, under standardized conditions

[ISO/IEC TS 22237-4:2018](#)

[SOURCE: IEC 60050-212:2010, 212-18-11]
<https://standards.iteh.ai/catalog/standards/sist/2df34631-ace0-4100-ba98-e99bd1d2e6b2/iso-iec-ts-22237-4-2018>

3.1.6

exhaust air temperature

temperature of the air leaving the data centre building or the temperature of the air leaving the heat load

3.1.7

fresh air cooling

cooling system that uses the external air to cool the data centre either directly or indirectly

3.1.8

heat load

thermal power that is produced

3.1.9

information technology equipment

equipment providing data storage, processing and transport services together with equipment dedicated to providing direct connection to core and/or access networks

3.1.10

outdoor air temperature

temperature of the air measured outside of the data centre building

3.1.11

relative humidity

ratio, expressed as a percentage, of the vapour pressure of water vapour in moist air to the saturation vapour pressure with respect to water or ice at the same temperature

[SOURCE: IEC 60050-705:1995, 705-05-09]

3.1.12**return air temperature**

temperature of the air re-entering the environmental control system, e.g. the air handling unit

3.1.13**supply air temperature**

temperature of the air entering the IT equipment

3.1.14**ventilation**

supply of air motion in a space by circulation or by moving air through the space

Note 1 to entry: Ventilation can be produced by any combination of natural or mechanical supply and exhaust.

Note 2 to entry: Such systems can include partial treatment such as heating, relative humidity control, filtering or purification, and, in some cases, evaporative cooling.

3.2 Abbreviated terms

For the purposes of this document, the abbreviated terms given in ISO/IEC TS 22237-1 and the following apply.

UPS Uninterruptible Power Supply

CRAC Computer Room Air Conditioning (Unit)

IT Information Technology
iTeh STANDARD PREVIEW
(standards.iteh.ai)

ITE Information Technology Equipment

[ISO/IEC TS 22237-4:2018](#)

4 Conformance

<https://standards.iteh.ai/catalog/standards/sist/2df34631-ace0-4100-ba98-e93bd1d2e6b2/iso-iec-ts-22237-4-2018>

For a data centre to conform to this document:

- it shall feature an environmental control solution that meets the requirements of [Clauses 4](#) and [5](#);
- it shall feature an approach to physical security in relation to the environmental control solution that meets the requirements of [Clause 6](#);
- it shall feature an energy efficiency enablement solution that meets the requirements of the relevant Granularity Level of [Clause 7](#);
- local regulations, including safety, shall be met.

5 Environmental control within data centres

5.1 General

5.1.1 Functional elements

The environmental control system is one of the most important parts of the data centre infrastructure. Excessive variations of temperature or relative humidity can directly affect the functional capability of the data centre and its infrastructures.

The functional elements of the environmental control system are divided into primary and secondary elements.

Primary elements relate to the mechanical generation of temperature controlled fluids. Secondary elements relate to the distribution of fluids generated by the primary elements. See [Table 1](#) for examples of these elements.

Some environmental systems combine the function of primary and secondary elements.

Table 1 — Examples of primary and secondary functional elements

Area	Fluid	Functional element(s)
Primary	Water	Water supply grid, chiller, pump(s)
	Air	Outside air intake, filter, heat exchanger
Secondary	Water	Pump(s), valve(s), pipe system, liquid cooled enclosures
	Air	Duct system, computer room air conditioning unit

It should be noted that a Class 1 environmental control system does not necessarily contain any of these elements.

5.1.2 Requirements

The approach taken for the design of the environmental control system shall take into account available technology, physical security and data centre availability.

The design of the environmental control system and the selection and installation of functional elements shall take into consideration the effect of vibration on the data centre spaces.

The design of the environmental control system and the selection and installation of functional elements shall take into consideration the effect of friction and/or obstruction in the pathways for temperature controlled fluids. Operational controls shall be provided to ensure no degradation of fluid flow due to changes in the pathways.

[ISO/IEC TS 22237-4:2018](#)

During the design phase the requirement for the number of air changes per unit time and air pressure shall be established.

In all data centre spaces the requirements for filtration shall be considered.

In all spaces where there is a risk of damage to static-sensitive equipment from electro-static discharge the relative humidity shall be maintained in accordance with the instructions of the supplier of the equipment to be accommodated. Where no information exists or where the equipment manufacturer is not specified, a minimum dew point of 5,5 °C shall be maintained.

Where direct fresh air cooling solutions are chosen the requirements analysis and the resulting methodology of monitoring and control is of prime importance. In these circumstances particular consideration shall be given to the control of contaminants.

For guidance on the ventilation requirements of activated gaseous suppression systems see ISO/IEC TS 22237-6.

5.1.3 Recommendations

Opportunities for reductions in energy consumption exist where wider tolerances of temperature and relative humidity can be tolerated in defined data centre spaces. It is recommended to use cooling units with integrated vibration decoupling for all rotating parts (e.g. fan, compressor) or low vibration parts. If the cooling units or other external components with rotating parts are not equipped with integrated vibration decoupling the whole unit should be decoupled.