



SLOVENSKI STANDARD

SIST EN 1806:2001

01-februar-2001

8 ja b] _]! '? YfUa] bYhi `Uj YnUYbcg`c`bYX]a b] _Y!`NU HJj Y]b`dfYg_i gbY'a YfcXY

Chimneys - Clay/ceramic flue blocks for single wall chimneys - Requirements and test methods

Abgasanlagen - Keramik-Formblöcke für einschalige Abgasanlagen - Anforderungen und Prüfmethode

STANDARD PREVIEW

Conduits de fumée - Boisseaux en terre cuite/céramique pour conduits de fumée simple paroi - Exigences et méthodes d'essai

[SIST EN 1806:2001](https://standards.iteh.ai/catalog/standards/sist/8a9e5692-69d7-40b8-ae09-2c3b59466f13/sist-en-1806-2001)

Ta slovenski standard je istoveten z:

EN 1806:2000

ICS:

91.060.40	Dimniki, jaški, kanali	Chimneys, shafts, ducts
91.100.25	S^ æ ã } æ^ æà^} æå å^ \ ã	Ceramic building products

SIST EN 1806:2001

en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1806:2001

<https://standards.iteh.ai/catalog/standards/sist/8a9e5692-69d7-40b8-ac09-2c5b39466f13/sist-en-1806-2001>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 1806

April 2000

ICS 91.060.40; 91.100.25

English version

Chimneys - Clay/ceramic flue blocks for single wall chimneys -
Requirements and test methods

Conduits de fumée - Boisseaux en terre cuite/céramique
pour conduits de fumée simple paroi - Exigences et
méthodes d'essai

Abgasanlagen - Keramik-Formblöcke für einschalige
Abgasanlagen - Anforderungen und Prüfmethode

This European Standard was approved by CEN on 9 December 1999.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

SIST EN 1806:2001

<https://standards.iteh.ai/catalog/standards/sist/8a9e5692-69d7-40b8-ac09-2c5b39466f13/sist-en-1806-2001>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Central Secretariat: rue de Stassart, 36 B-1050 Brussels

Contents

	Page
Foreword	4
1 Scope	5
2 Normative references	5
3 Product shape	6
3.1 General	6
3.2 Straight flue blocks	6
3.3 Form	6
4 Definitions	6
5 Classes of flue block	8
6 Materials	9
6.1 Flue blocks	9
6.2 Insulation	9
7 Tolerances on dimensions	9
7.1 Internal transverse dimensions	9
7.2 Height	10
7.3 Angles	10
7.4 Straightness	10
7.5 Squareness of angles and flatness of walls	10
7.6 Deviation from shape of cross section	10
7.7 Joints	10
7.8 Bonding extension	10
7.9 Tolerance on insulation thickness	10
8 Proof load	10
8.1 Straight flue blocks	10
8.2 Angle blocks	10
8.3 Minimum load for inspection opening sections	11
8.4 Adhesion between outer wall and insulation	11
9 Gastightness (leakage test) and thermal testing	11
9.1 Initial test	11
9.2 Final gastightness (leakage test) after thermal testing	11
10 Acid resistance	12
11 Water absorption and bulk density	12
11.1 General	12
11.2 Water absorption	12
11.3 Bulk density	12
12 Sweeping resistance	12
13 Water and vapour flow resistance	12
14 Thermal resistance	12
15 Fire resistance	12
15.1 Testing at operating conditions	12
15.2 Soot fire test	12

16	Evaluation of conformity	13
16.1	Sampling and testing	13
16.2	Sampling for quality control at the manufacturer's works	13
16.3	Sampling for resubmitted rejected batches	13
16.4	Type tests	13
16.5	Quality assurance	14
17	Test methods	14
17.1	Internal transverse dimensions	14
17.2	Height	14
17.3	Angles	14
17.4	Straightness	14
17.5	Squareness of ends	15
17.6	Deviation from shape of cross-section	16
17.7	Proof load	17
17.8	Thermal testing	19
17.9	Acid resistance	21
17.10	Water absorption	23
17.11	Bulk density	23
17.12	Sweeping resistance	24
17.13	Water and vapour flow test	25
17.14	Fire resistance	27
17.15	Determination of bulk density of insulation	29
17.16	Adhesion test for insulation attached to outer wall of flue blocks	29
18	Designation	30
19	Marking	31
Annex A (Normative)	Sampling procedures for an AQL of 10 % and Inspection Level S2	32
A.1	Acceptability determination	32
A.2	Normal inspection	32
A.3	Normal to reduced inspection	34
A.4	Reduced to normal inspection	35
A.5	Tightened inspection	35
A.6	Tightened to normal inspection	36
A.7	Discontinuation of inspection	36
Annex B (Informative)	Thermal resistance	37
B.1	Method 1	37
B.2	Method 2 - Thermal resistance of flue blocks with or without cavities	38
B.3	Method 3 - Approximate thermal resistance values	41
Annex C (informative)	Prevention of fire spread	42

Foreword

This European Standard has been prepared by Technical Committee CEN/TC 166 "Chimneys", the secretariat of which is held by UNI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by October 2000, and conflicting national standards shall be withdrawn at the latest by April 2001.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1806:2001

<https://standards.iteh.ai/catalog/standards/sist/8a9e5692-69d7-40b8-ac09-2c5b39466f13/sist-en-1806-2001>

1 Scope

This European Standard specifies the requirements for clay/ceramic flue blocks with solid walls or walls with vertical perforations including bonding and non-bonding blocks and their fittings. Non-bonding flue blocks which have insulation in the vertical perforations or attached to the outer walls are also covered by this standard. This standard specifies the performance requirements for factory-made flue blocks. When they are installed, they will form a single-wall chimney which will serve to convey products of combustion from fireplaces or heating appliances to the atmosphere under negative pressure. This standard includes components used for domestic and industrial chimneys which are not structurally independent (free-standing). Testing, marking and inspection requirements are covered by this standard.

2 Normative references

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies

EN 312-4	Particle boards - Specification - Part 4: Requirements for load bearing boards for use in dry conditions
EN 1443	Chimneys - General requirements
EN 10088-1	Stainless steels – Part 1: List of stainless steels
EN 45012:1998	General criteria for certification bodies operating quality system certification
EN ISO 9001:1994	Quality Systems. Model for quality assurance in design development, production, installation and servicing (ISO 9001:1994)
EN ISO 9002:1994	Quality Systems. Model for quality assurance in production, installation and servicing (ISO 9002:1994)
EN ISO 9003:1994	Quality Systems. Model for quality assurance in final inspection and test (ISO 9003:1994)
ISO 2859-1:1989	Sampling procedures for inspection by attributes - Part 1. Sampling plans indexed by acceptable quality level (AQL) for lot-by-lot inspection
EN ISO 7500-1:1999	Metallic materials - Part 1: Verification of static uniaxial testing machines

3 Product shape

3.1 General

Flue blocks may have flues which are either circular, square or rectangular. The joints shall have a locating feature such as a rebate.

3.2 Straight flue blocks

These are flue blocks designed to be used in a vertical section of a chimney having the ends perpendicular to the axis of the flue. When they are designed to be built wholly or partially into a masonry wall and having a bonding extension, they are called "bonding blocks".

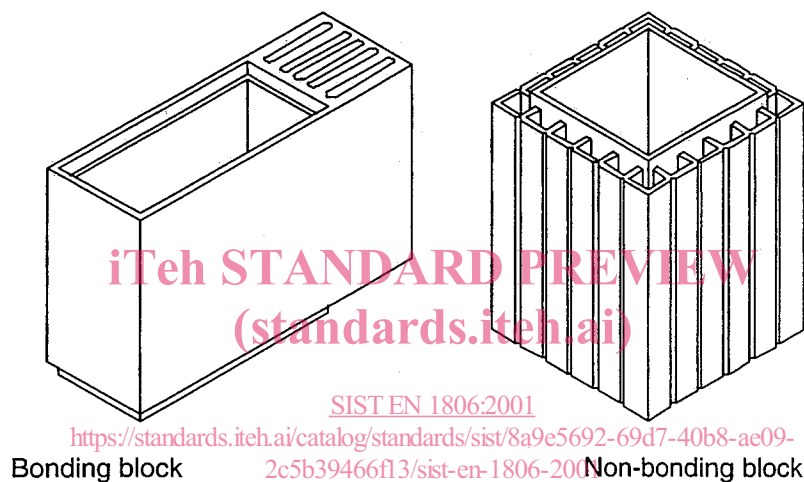


Figure 1: Examples of flue block shape

3.3 Form

Flue blocks covered by this standard shall be manufactured in three forms:

- a) single flue
- b) multi-flue
- c) Flue/ventilation combination

4 Definitions

For the purposes of this standard, the following definitions apply. Other definitions are given in EN 1443.

4.1 nominal size : A numerical designation of size which is a convenient round number equal to or approximately equal to either:

- i) the internal diameter in millimetres of the circular flue passage, or
- ii) the internal width in millimetres of blocks with square section flues, or
- iii) the internal width and breadth in millimetres of the internal transverse dimensions of flue blocks with rectangular flueways.

4.2 nominal height : A numerical designation of the height in millimetres of a standard flue block excluding any projecting spigot, which is a convenient round number.

NOTE : For a bonding block, this is the co-ordinating height which equates to the nominal height of masonry building blocks for walls into which such a flue block is designed to be built.

4.3 angle block : To facilitate a change in angle of the axis of a flue.


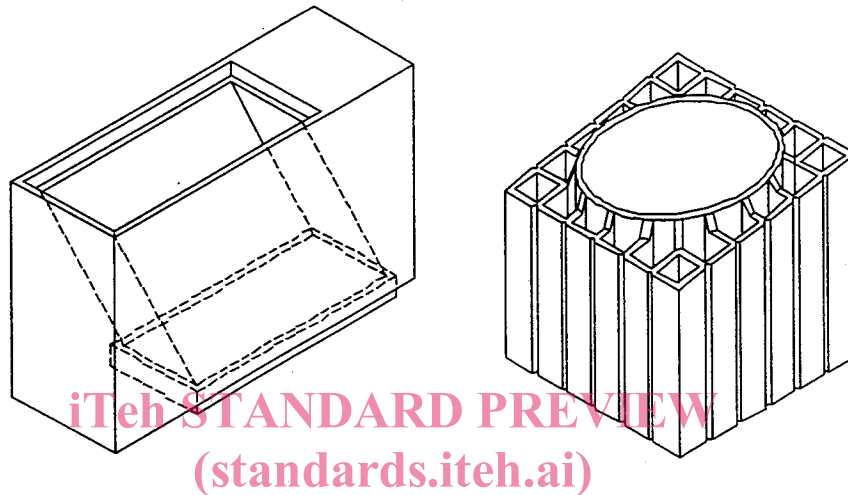


Figure : 2 Examples of angle block

SIST EN 1806:2001

4.4 bonding extension : That part of a flue block which is designed to be bonded into adjacent masonry walls, and forms no part of the chimney.

4.5 transfer block : A flue block which changes the cross-section of the flue from rectangular to circular.

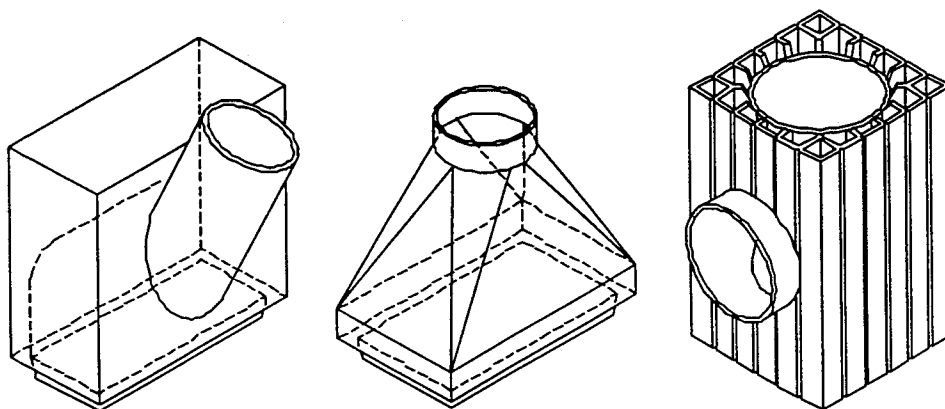

Transfer block

Transfer block

Entry block

Figure 3 : Examples of transfer blocks and entry point block

4.6 flue blocks with insulation in vertical perforations : Flue blocks with perforations within the wall specially designed to house rigid insulation.

4.7 flue blocks with attached insulation : Flue blocks with insulation factory-fitted to the outer walls.

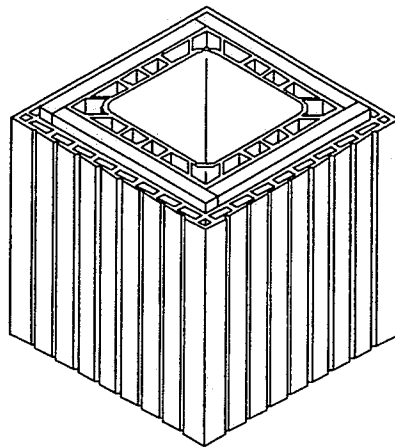


Figure 4a: Example of flue block with insulation in vertical perforation

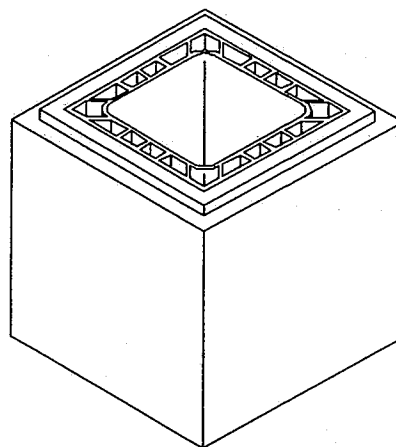


Figure 4b: Example of flue block with insulation attached

4.8 entry block : Block connecting the chimney to the connecting flue pipe or the chimney to the appliance.

5 Classes of flue block

Clay/ceramic flue blocks shall be classified as specified in Table 1.

Table 1: Classes and types of clay/ceramic flue blocks, conditions of use, air test pressures and maximum air permeability rates after thermal testing

Class of flue block	Type of block	Temperature		Negative Pressure	Soot fire resistance	Wet or dry conditions	Test pressure Pa	Maximum air leakage rate $\text{m}^3 \text{s}^{-1} \text{m}^{-2} \times 10^{-3}$
		Working $^{\circ}\text{C}$	Test $^{\circ}\text{C}$					
FB1 N2	Non-bonding	600	1 000	N2	Yes	Dry	20	3
FB1 N1	Non-bonding	600	1 000	N1	Yes	Dry	40	2
FB2 N2	Non-bonding	600	700	N2	No	Dry	20	3
FB2 N1	Non-bonding	600	700	N1	No	Dry	40	2
FB3 N2	Non-bonding	400	500	N2	No	Dry & wet	20	3
FB3 N1	Non-bonding	400	500	N1	No	Dry & wet	40	2
FB4 N2	Non-bonding	300	350	N2	No	Dry & wet	20	3
FB4 N1	Non-bonding	300	350	N1	No	Dry & wet	40	2
FB5 N2	Non-bonding	200	250	N2	No	Dry & wet	20	3
FB5 N1	Non-bonding	200	250	N1	No	Dry & wet	40	2
FB6	Bonding	200	250	N2	No	Dry	20	3

A flue block may be classified in one or more classes provided it complies with the appropriate requirements for each class.

A designated class of flue block is suitable for use on all types of chimney with a nominal working temperature up to a maximum of that designated. The designation for soot fire resistance and corrosion apply throughout the temperature range. All classes of clay/ceramic flue block are suitable for the appropriate pressure application. For clarification of the letters, see clause 17, e.g.

Class FB1 N2 equals T600, N2, S, D, 3 and may also be used for
 T600, N2, O, D, 3
 T400, N2, S, D, 3
 T400, N2, O, D, 3
 T300, N2, O, D, 3
 T200, N2, O, D, 3

Flue block classes for chimneys designed for use with low temperature products of combustion are included in this standard. When they are used with a system chimney, the whole chimney may be tested at the low working temperature for the determination of the minimum distance of combustibles away from the chimney. Flue blocks classified as dry, may be used in wet conditions if back ventilation is provided, see system chimneys with clay/ceramic flue liners or blocks standard clause 8.

6 Materials

6.1 Flue blocks

Flue blocks shall be manufactured from suitable clay/ceramic material which when fired meet the performance requirements given in this standard.

Flue blocks may be unglazed or glazed on the interior and/or exterior. When glazed, they need not be glazed on the jointing surfaces.

6.2 Insulation

6.2.1 Shape

The insulation shall have a permanent shape (e.g. blocks or bonded loose material). It shall not comprise loose material.

6.2.2 Density of insulation

The manufacturer shall declare the density of the insulation and this shall not vary by more than $\pm 10\%$ of the declared value after testing according to 17.15.

6.2.3 Resistance to heat

When tested in accordance with 17.14, the change in the surface temperature after the fourth cycle of heating shall not exceed 10 % of the maximum surface temperature of the first cycle.

7 Tolerances on dimensions

7.1 Internal transverse dimensions

When tested in accordance with 17.1, the internal diameter of flue blocks with circular flues measured on any diameter shall not deviate more than $\pm 3\%$ of the manufacturer's stated nominal internal diameter. For flue blocks with square and rectangular flueways, the tolerances on the internal widths and breadths shall not deviate more than $\pm 3\%$ of the manufacturer's stated nominal internal length of the side. Corners of the flue may be rounded.

7.2 Height

When tested in accordance with 17.2, the height of a flue block shall not deviate more than $\pm 3 \%$ of the manufacturer's stated nominal height subject to a maximum value of 10 mm.

7.3 Angles

When tested in accordance with 17.3, the angle between the axes of the flues of angle or transfer blocks shall not be greater than 45° and shall not deviate more than $\pm 5^\circ$ of the manufacturer's stated nominal value.

7.4 Straightness

When tested in accordance with 17.4, the permissible deviation from straightness of straight flue blocks shall be 1 % of the test length.

7.5 Squareness of angles and flatness of walls

When tested in accordance with 17.5, the permissible deviation from square of the ends of straight flue blocks, shall be not greater than an angle of slope 30 mm/m.

7.6 Deviation from shape of cross section

When tested in accordance with 17.6, the permissible deviation from square of the angles of, and flatness of walls for square or rectangular shape straight flue blocks, shall be not greater than 5 % of the manufacturer's stated nominal internal width or breadth.

7.7 Joints

The design and dimensions of the joints shall be as specified by the manufacturer to provide an adequate joint.

7.8 Bonding extension

Any bonding extension, which may be solid or contain vertical perforations, shall be designed to extend into the adjacent masonry wall by not less than 75 mm (see Figure 1).

7.9 Tolerance on insulation thickness

The thickness of factory-fitted insulation on the outer walls of flue blocks shall not differ from the nominal value by more than the tolerances declared by the flue block manufacturer.

8 Proof load

8.1 Straight flue blocks

When tested in accordance with 17.7, straight flue blocks shall withstand an intensity of loading of 10 MN/m^2 .

8.2 Angle blocks

Where angle blocks are fired in a plant alongside straight flue blocks, using the same materials and firing process, the proof load of these angle blocks is deemed to be that of the straight flue blocks when tested in accordance with 17.7.

If angle blocks are not normally fired alongside straight flue blocks, straight flue blocks or short lengths of straight flue blocks made for test purposes, using the same materials and firing process as for angle blocks, shall be tested for compliance with the requirements of 8.1.

8.3 Minimum load for inspection opening sections

When tested in accordance with 17.5, the minimum load shall be as given in Table 2.

Table 2: Minimum load

Height of chimney [m]	Minimum load [kN]
$\leq 12,5$	25
$> 12,5 \leq 25$	50
$> 25 \leq 50$	100

For chimneys with area greater than $0,04 \text{ m}^2$, the following equation shall be used:

$$F = \chi \cdot H \cdot G$$

where:

- F minimum load (kN)
 χ safety factor = 5
 H height of chimney (m)
 G Weight per metre (kg/m)

[SIST EN 1806:2001](https://standards.iteh.ai/catalog/standards/sist/8a9e5692-69d7-40b8-ac09-2c5b39466f13/sist-en-1806-2001)

<https://standards.iteh.ai/catalog/standards/sist/8a9e5692-69d7-40b8-ac09-2c5b39466f13/sist-en-1806-2001>

8.4 Adhesion between outer wall and insulation

When tested in accordance with 17.16, the force required to separate the outer wall from the insulation shall be greater than 1 500 N.

9 Gastightness (leakage test) and thermal testing

9.1 Initial test

Prior to thermal testing, a test flue constructed in accordance with 17.8 shall have a leakage rate not greater than $2 \text{ m}^3 \text{ s}^{-1} \text{ m}^{-2} \times 10^{-3}$ of internal surface area tested at a differential pressure of $(40 \pm 2) \text{ Pa}$ when tested as described in 17.8.5.

9.2 Final gastightness (leakage test) after thermal testing

When tested in accordance with 17.8.5, flue blocks shall have leakage rate after thermal testing not greater than the values given in Table 1 for the appropriate class of flue block, test temperature and differential pressure.