
Oplaščeni vodniki za nadzemne vode in ustrezen pribor za naznačene izmenične napetosti nad 1 kV, ki ne presegajo 36 kV - 3. del: Vodilo za uporabo

Covered conductors for overhead lines and the related accessories for rated voltages above 1 kV a.c. and not exceeding 36 kV a.c. - Part 3: Guide to use

Kunststoffumhüllte Leiter und zugehörige Armaturen für Freileitungen mit Nennspannungen über 1 kV und nicht mehr als 36 kV Wechselspannung - Teil 3: Leitfaden für die Verwendung

Conducteurs gainés pour lignes aériennes et accessoires associés pour des tensions assignées supérieures à 1 kV en courant alternatif et ne dépassant pas 36 kV en courant alternatif - Partie 3: Guide d'emploi

Ta slovenski standard je istoveten z: prEN 50397-3

ICS:

29.060.20	Kabli	Cables
29.240.20	Daljinovodi	Power transmission and distribution lines

oSIST prEN 50397-3:2021**en**

iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN 50397-3:2021](https://standards.iteh.ai/catalog/standards/sist/48637a63-c51b-4518-89b4-25e1390ee29e/osist-pren-50397-3-2021)

<https://standards.iteh.ai/catalog/standards/sist/48637a63-c51b-4518-89b4-25e1390ee29e/osist-pren-50397-3-2021>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

DRAFT
prEN 50397-3

August 2021

ICS 29.240.20

Will supersede EN 50397-3:2010 and all of its
amendments and corrigenda (if any)

English Version

**Covered conductors for overhead lines and the related
accessories for rated voltages above 1 kV a.c. and not
exceeding 36 kV a.c. - Part 3: Guide to use**

Conducteurs gainés pour lignes aériennes et accessoires
associés pour des tensions assignées supérieures à 1 kV
en courant alternatif et ne dépassant pas 36 kV en courant
alternatif - Partie 3: Guide d'emploi

Kunststoffumhüllte Leiter und zugehörige Armaturen für
Freileitungen mit Nennspannungen über 1 kV und nicht
mehr als 36 kV Wechselspannung - Teil 3: Leitfadens für die
Verwendung

This draft European Standard is submitted to CENELEC members for enquiry.
Deadline for CENELEC: 2021-11-05.

It has been drawn up by CLC/TC 20.

If this draft becomes a European Standard, CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CENELEC in three official versions (English, French, German).

A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

Warning : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

1	Contents	Page
2	European foreword	4
3	Introduction.....	5
4	1 Scope.....	6
5	2 Normative references	6
6	3 Terms and definitions	6
7	4 Covered conductors	7
8	4.1 Recommendations for selection of covered conductors	7
9	4.2 Recommendation for storage and transport	8
10	4.3 Recommendation for installation of covered conductors	11
11	4.4 Other recommendations	14
12	5 Accessories.....	14
13	5.1 General.....	14
14	5.2 Joints	14
15	5.3 Insulators	15
16	5.4 Fittings.....	15
17	5.5 Earthing devices.....	17
18	5.6 Arc protection devices.....	18
19	5.7 Surge arresters	19
20	5.8 Bird protection.....	19
21	5.9 Corona protection.....	19
22	Bibliography.....	20

23 Figures

24	Figure 1 — View from the top.....	9
25	Figure 2 — Keep the drum standing upright, using wedges in the heels of the flanges.....	9
26	Figure 3 — Only drums with protection lagging may be piled flange on flange. Lower layer	
27	to be secured over full drum width	9
28	Figure 4 — Not recommended	10
29	Figure 5 — Drums may be lifted either by crane or fork-lift truck	10
30	Figure 6 — Rolling the drums.....	10
31	Figure 7 — Recommended direction	11
32	Figure 8 — Not recommended direction	11
33	Figure 9 — Unwind this way.....	12
34	Figure 10 — Never unwind this way	13
35	Figure 11 — Example of a joint.....	14
36	Figure 12 — Example of a tie.....	15
37	Figure 13 — Example of a bolted tension clamp.....	16
38	Figure 14 — Example of a helical fitting	16
39	Figure 15 — Example of a wedge type tension clamp	17
40	Figure 16 — Example of a tee off connection.....	17
41	Figure 17 — Example for an earthing device.....	17
42	Figure 18 — Arc phase to phase.....	18
43	Figure 19 — Arc phase to cross arm	18
44	Figure 20 — Example of two types of arc protection devices.....	18
45	Figure 21 — Example of arc protection device for angle constructions.....	19
46	Figure 22 — Example of arc protection device combined with surge arrester	19

prEN 50397-3:2021 (E)**47 European foreword**

48 This document prEN 50397-3:2021 has been prepared by CLC/TC 20 "Electric cables".

49 This document is currently submitted to the Enquiry.

50 The following dates are proposed:

- latest date by which the existence of this document has to be announced at national level (doa) dor + 6 months
- latest date by which this document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) dor + 12 months
- latest date by which the national standards conflicting with this document have to be withdrawn (dow) dor + 36 months (to be confirmed or modified when voting)

51 This document will supersede EN 50397-3:2010 and all of its amendments and corrigenda (if any).

iTeh STANDARD PREVIEW (standards.iteh.ai)

<https://standards.iteh.ai/catalog/standards/sist/48637a63-c51b-4518-89b4-25e1390ee29e/osist-pren-50397-3-2021>

52 Introduction

53 EN 50397 “*Covered conductors for overhead lines and the related accessories for rated voltages above*
54 *1 kV a.c. and not exceeding 36 kV a.c.*” consists of three parts. These are:

55 — Part 1: Covered conductors;

56 — Part 2: Accessories for covered conductors - Tests and acceptance criteria;

57 — Part 3: Guide to use.

58 This Part 3 “Guide to use” assumes that the user will benefit from a single document that gives guidance
59 on all the equipment specified within the other two parts.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[oSIST prEN 50397-3:2021](https://standards.iteh.ai/catalog/standards/sist/48637a63-c51b-4518-89b4-25e1390ee29e/osist-pren-50397-3-2021)

<https://standards.iteh.ai/catalog/standards/sist/48637a63-c51b-4518-89b4-25e1390ee29e/osist-pren-50397-3-2021>

prEN 50397-3:2021 (E)

1 Scope

This part of EN 50397 provides general recommendations for the selection, storage, transportation and installation of the covered conductors and the related accessories specified in EN 50397-1 and EN 50397-2, unless otherwise specified. Safety regulations and environmental regulations as well as rules for installation and mechanical design are not considered in this Guide to use, as they are covered by relevant national regulations and laws. Relevant national regulations are not considered in this guide, but it is advised that they are always consulted as appropriate.

NOTE The term “national regulations” is used throughout this guide. It can include specific safety regulations, rules of installation and other relevant instructions which, depending upon the particular country or district, can exist in a legislative (mandatory) form, or as a non-mandatory code of practice. In addition certain specific utilities can have their own safety practices.

It is assumed that the design of installations, the purchase and installation of covered conductors and of the related accessories specified in this document are entrusted to suitably skilled and competent people. In case of doubt as to the suitability of covered conductors and the related accessories for a particular use, further specific information shall be obtained from the manufacturer.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50397-1:2006, *Covered conductors for overhead lines and the related accessories for rated voltages above 1 kV a.c. and not exceeding 36 kV a.c. - Part 1: Covered conductors*

EN 50397-2, *Covered conductors for overhead lines and the related accessories for rated voltages above 1 kV a.c. and not exceeding 36 kV a.c. - Part 2: Accessories for covered conductors - Tests and acceptance criteria*

EN 50182, *Conductors for overhead lines - Round wire concentric lay stranded conductors*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

— ISO Online browsing platform: available at <https://www.iso.org/obp>

— IEC Electropedia: available at <http://www.electropedia.org/>

3.1**rated tensile strength****RTS**

estimate of the conductor breaking load calculated using the specified tensile properties of the components wires

Note 1 to entry: See EN 50397-1:2006, 4.2.1.

3.2**specified minimum failure load****SMFL**

minimum load, specified by the purchaser or declared by the supplier, at which mechanical failure will not take place

Note 1 to entry: From the probabilistic point of view, the specified minimum failure load corresponds to the value having the probability of e % in the distribution function of the strength of the fitting. The exclusion limit e % is usually taken within 2 % to 5 % with 10 % being the upper limit (see IEC 60826).

3.3**slippage factor****X-value**

ratio between the tensile force on the covering of the conductor when a certain slippage starts to occur and the RTS of the conductor

Note 1 to entry: See EN 50397-1:2006, Annex D.

Note 2 to entry: An X-value of e.g. 100 % means that at a force up to RTS no relative slippage between the covering and the conductor occurs.

4 Covered conductors**4.1 Recommendations for selection of covered conductors****4.1.1 General**

Covered conductors specified in EN 50397-1 are equipped with a polymeric covering as protection against accidental contact with grounded parts or other live covered conductors. Covered conductors are not touch proof, so they shall to be treated as non-protected plain conductors with regard to protection against electric shock.

The use of covered conductors is only permissible in air and mounted on suitable insulators, which are at least specified for the rated voltage of the overhead line.

4.1.2 Power frequency range

Covered conductors are intended to be used in the power frequency range of 49 Hz to 61 Hz.

4.1.3 Current rating

Reference shall be made either to EN 50397-1:2006, Annex A, to EN 50182 or to the manufacturer's specifications to obtain the current ratings of the selected conductor cross sections and the maximum permissible conductor temperature for the covering material as given in EN 50397-1:2006, 4.2.3.

If covered conductors in accordance with EN 50397-1 are exposed to strong solar radiation or high temperature ambient conditions, the current carrying capacity shall be reduced accordingly.

4.1.4 Operating conditions

In addition to the current ratings, due regard shall be given to:

- a) the capability of the covered conductor to withstand the worst anticipated fault conditions of the system;
- b) the earth loop impedance;
- c) the operating characteristics of the connected equipment;
- d) the voltage drop requirements for long distance conditions.

prEN 50397-3:2021 (E)

135 In certain cases longitudinal watertight conductor constructions can be necessary to avoid corrosive effects
136 to the conductor and to obtain a sufficient life time of the overhead line system.

137 4.2 Recommendation for storage and transport

138 4.2.1 General

139 Suitable protection, appropriate to the choice of covered conductors and the installation conditions, shall
140 be provided against mechanical damage.

141 Covered conductors stored at temperatures which are below those recommended for installation shall not
142 be subject to any mechanical stress including shocks, impact, bending and torsion. It is recommended not
143 to store complete reels in conditions, where the maximum permissible conductor temperature as given in
144 EN 50397-1:2006, 4.2.3 is exceeded.

145 4.2.2 Sealing and drumming

146 4.2.2.1 Clearance and lagging

147 In general it is recommended to use lagging or other equivalent protection to avoid damage to the covered
148 conductor. If lagging is used the thickness shall be appropriate.

149 The distance between the outer layer of the covered conductor on the filled drum and the ground or lagging
150 shall be sufficient to avoid damage to the covered conductor. It is recommended to use a clearance of at
151 least 50 mm.

152 4.2.2.2 Barrel diameter

153 The barrel diameter of delivery drums shall not be smaller than $30 \times D$, where D is the outer diameter of
154 the covered conductor.

155 4.2.2.3 Sealing

156 The ends of covered conductors shall be sealed to prevent ingress of moisture during transport and storage.
157 The possibility of damage to moisture seals during transport and storage shall be borne in mind. Where
158 such damage may have occurred, the conductor end shall be inspected and the seal remade.

159 4.2.2.4 Handling

160 When handling drums, suitable precautions shall be taken to avoid damage to the covered conductor and
161 injury to people. Due regard shall be paid to the mass of the drum, the method and direction of rolling and
162 the method of lifting. Drums shall be stored only on even and solid ground.

163 4.2.2.5 Drum condition

164 Drums shall be regularly inspected during storage to assess their physical condition. Care shall be taken
165 to avoid damage to the covered conductor caused by nails and staples used either in drum manufacturing
166 or when applying laggings. Laggings, where applied, shall not be removed from drums until the covered
167 conductor is about to be installed.

168 Care shall be taken to avoid deterioration of the drums. Drums shall be stored so that the drum flanges do
169 not contact products on other drums. See Figure 1.

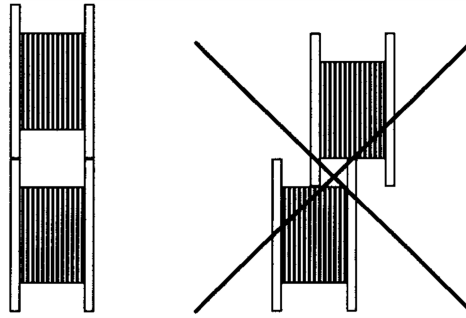


Figure 1 — View from the top

Drums shall be stored with the drum axis horizontal. See Figures 2, 3 and 4.

4.2.3 Transport

4.2.3.1 Carriers

Only suitable carriers shall be used.

4.2.3.2 Drum axis position

Drums shall be transported with the drum axis horizontal and any drum movement shall be avoided.



Figure 2 — Keep the drum standing upright, using wedges in the heels of the flanges




Figure 3 — Only drums with protection lagging may be piled flange on flange. Lower layer to be secured over full drum width