

SLOVENSKI STANDARD

oSIST prEN IEC 62453-309:2021

01-september-2021

Specifikacija vmesnika orodja procesne naprave - 309. del: Integracija komunikacijskih profilov - IEC 61784 CPF 9

Field device tool (DFT) interface specification - Part 309: Communication profile integration - IEC 61784 CPF 9

iTeh STANDARD PREVIEW

Spécification des interfaces des outils des dispositifs de terrain - Partie 309: Intégration des profils de communication - CPF 9 de l'IEC 61784

<https://standards.iteh.ai/catalog/standards/sist/b18fb3afce79/osist-pr-en-iec-62453-309-2021>

Ta slovenski standard je istoveten z: prEN IEC 62453-309:2021

ICS:

25.040.40	Merjenje in krmiljenje industrijskih postopkov	Industrial process measurement and control
35.240.50	Uporabniške rešitve IT v industriji	IT applications in industry

oSIST prEN IEC 62453-309:2021

en,fr,de

iTeh STANDARD PREVIEW **(standards.iteh.ai)**

[oSIST prEN IEC 62453-309:2021](https://standards.iteh.ai/catalog/standards/sist/b4012ebe-7678-44a7-8ac3-b18fb3afce79/osist-pren-iec-62453-309-2021)

<https://standards.iteh.ai/catalog/standards/sist/b4012ebe-7678-44a7-8ac3-b18fb3afce79/osist-pren-iec-62453-309-2021>



65E/785/CDV

COMMITTEE DRAFT FOR VOTE (CDV)

PROJECT NUMBER: IEC 62453-309 ED3	
DATE OF CIRCULATION: 2021-07-09	CLOSING DATE FOR VOTING: 2021-10-01
SUPERSEDES DOCUMENTS: 65E/749/RR	

IEC SC 65E : DEVICES AND INTEGRATION IN ENTERPRISE SYSTEMS	
SECRETARIAT: United States of America	SECRETARY: Mr Donald (Bob) Lattimer
OF INTEREST TO THE FOLLOWING COMMITTEES: SC 65C	PROPOSED HORIZONTAL STANDARD: <input type="checkbox"/> Other TC/SCs are requested to indicate their interest, if any, in this CDV to the secretary.
FUNCTIONS CONCERNED: <input type="checkbox"/> EMC <input type="checkbox"/> ENVIRONMENT <input type="checkbox"/> QUALITY ASSURANCE <input type="checkbox"/> SAFETY	
<input checked="" type="checkbox"/> SUBMITTED FOR CENELEC PARALLEL VOTING <input type="checkbox"/> NOT SUBMITTED FOR CENELEC PARALLEL VOTING https://standards.iteh.ai/catalog/standards/sist/b4012ebe-7678-44a7-8ac3-b18fb3afce79/osist-pr-en-iec-62453-309-2021 Attention IEC-CENELEC parallel voting The attention of IEC National Committees, members of CENELEC, is drawn to the fact that this Committee Draft for Vote (CDV) is submitted for parallel voting. The CENELEC members are invited to vote through the CENELEC online voting system.	

This document is still under study and subject to change. It should not be used for reference purposes.

Recipients of this document are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

TITLE:

Field device tool (DFT) interface specification - Part 309: Communication profile integration - IEC 61784 CPF 9

PROPOSED STABILITY DATE: 2025

NOTE FROM TC/SC OFFICERS:

CONTENTS

CONTENTS.....	2
FOREWORD	5
INTRODUCTION.....	7
1 Scope	8
2 Normative references.....	8
3 Terms, definitions, symbols, abbreviated terms and conventions.....	8
3.1 Terms and definitions	8
3.2 Abbreviated terms	9
3.3 Conventions.....	9
3.3.1 Data type names and references to data types.....	9
3.3.2 Vocabulary for requirements	9
3.3.3 Use of UML.....	9
4 Bus category	9
5 Access to instance and device data	11
5.1 General	11
5.2 Process Channel objects provided by DTM	11
5.3 DTM services to access instance and device data.....	12
6 Protocol-specific behavior.....	12
6.1 Overview	12
6.2 Burst mode subscription	12
6.3 Usage of device addressing information.....	13
6.4 Extended Command Numbers.....	14
6.5 Handling of communication failures and time-outs.....	14
6.6 Handling of Delayed Responses.....	14
6.7 Topologies with mixed HART protocols.....	16
6.7.1 General	16
6.7.2 Behavior of DTMs supporting 'Extended_HART' only.....	16
6.7.3 Behavior of DTMs supporting 'Extended_HART' and 'HART_Basic'.....	16
6.7.4 Behavior of DTMs that require 'Extended_HART' or 'HART_Basic'.....	17
6.8 Nested communication with multiple gateways.....	18
6.9 Communication- and network structures in WirelessHART.....	18
6.9.1 General	18
6.9.2 Network topology.....	19
7 Protocol-specific usage of general data types.....	21
8 Protocol-specific common data types.....	22
9 Network management data types.....	22
9.1 General	22
9.2 Addressing modes.....	22
9.3 Address information.....	23
9.4 Additional address information for 'Extended HART' protocols.....	23
10 Communication data types	25
10.1 General	25
10.2 Protocol-specific Addressing Information	26
10.3 Datatype definitions.....	26
11 Channel parameter data types.....	30

12 Device identification.....	33
12.1 Protocol-specific handling of data type STRING.....	33
12.2 Address Range for Scan.....	33
12.3 Support for Extended Manufacturer and Device Type Code.....	33
12.4 Device type identification data types for protocol 'HART_Basic'.....	33
12.5 Common device type identification data types for 'Extended_HART' protocols.....	37
12.6 Topology scan data types.....	42
12.7 Scan identification data types for protocol 'HART_Basic'.....	43
12.8 Scan identification data types for 'Extended_HART' protocols.....	45
12.9 Device type identification data types – provided by DTM.....	47
Bibliography.....	49
Figure 1 – Part 309 of the IEC 62453 series.....	7
Figure 2 – Burst mode subscription.....	13
Figure 3 – Handling of Delayed Responses (scenario 1).....	15
Figure 4 – Handling of Delayed Responses (scenario 2).....	15
Figure 5 – Behavior of DTMs supporting 'Extended_HART' and 'HART_Basic'.....	17
Figure 6 – Behavior of DTMs requires 'Extended_HART' or 'HART_Basic'.....	18
Figure 7 – Host connected to a WirelessHART gateway device.....	19
Figure 8 – FDT Topology of a WirelessHART network.....	20
Figure 9 – Host connected to HART FSK.....	20
Figure 10 – FDT Topology when directly connected to a WirelessHART adapter device.....	21
Table 1 – Protocol identifiers.....	9
Table 2 – Definition of PhysicalLayer.....	10
Table 3 – Protocol specific usage of general data types.....	22
Table 4 – Relation of ProtocolId and supported features.....	23
Table 5 – Simple address information data types.....	24
Table 6 – Structured address information data types.....	25
Table 7 – Simple communication data types.....	26
Table 8 – Structured communication data types.....	27
Table 9 – Simple channel parameter data types.....	31
Table 10 – Structured channel parameter data types.....	31
Table 11 – Address range for device identification.....	33
Table 12 – Identification data types with protocol-specific mapping for protocol 'HART_Basic'.....	34
Table 13 – Identification data types with semantics for protocol 'HART_Basic'.....	36
Table 14 – Simple identification data types for protocol 'HART_Basic' with protocol independent semantics.....	37
Table 15 – Structured identification data types for protocol 'HART_Basic' with protocol independent semantics.....	37
Table 16 – Identification data types for 'Extended_HART' protocols with protocol-specific mapping.....	38
Table 17 – Identification data types for 'Extended_HART' protocols without protocol independent semantics.....	41

Table 18 – Simple identification data types for ‘Extended_HART’ protocols with protocol independent semantics	42
Table 19 – Structured identification data types for ‘Extended_HART’ protocols with protocol independent semantics	42
Table 20 – Structured device type identification data types	43
Table 21 – Simple scan identification data types for protocol ‘HART_Basic’	43
Table 22 – Structured scan identification data types for protocol ‘HART_Basic’	43
Table 23 – Simple scan identification data types for ‘Extended_HART’ protocols	45
Table 24 – Structured scan identification data types for ‘Extended_HART’ protocols	45
Table 25 – Structured device type identification data types	47

iTeh STANDARD PREVIEW **(standards.iteh.ai)**

[oSIST prEN IEC 62453-309:2021](https://standards.iteh.ai/catalog/standards/sist/b4012ebe-7678-44a7-8ac3-b18fb3afce79/osist-pren-iec-62453-309-2021)

<https://standards.iteh.ai/catalog/standards/sist/b4012ebe-7678-44a7-8ac3-b18fb3afce79/osist-pren-iec-62453-309-2021>

INTERNATIONAL ELECTROTECHNICAL COMMISSION

FIELD DEVICE TOOL (FDT) INTERFACE SPECIFICATION –

Part 309: Communication profile integration –
IEC 61784 CPF 9

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62453-309 has been prepared by subcommittee 65E: Devices and integration in enterprise systems, of IEC technical committee 65: Industrial-process measurement, control and automation.

This third edition cancels and replaces the second edition published in 2016, and constitutes a technical revision. The main changes are clarifications and corrections.

Each part of the IEC 62453-3xy series is intended to be read in conjunction with IEC 62453-2.

The text of this standard is based on the following documents:

CDV	Report on voting
-	-

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 62453 series, under the general title *Field Device Tool (FDT) interface specification*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

iTeh STANDARD PREVIEW

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

<https://standards.iteh.ai/catalog/standards/sist/b4012ebe-7678-44a7-8ac3-6181b3afce79/osist-pren-iec-62453-309-2021>

6181b3afce79/osist-pren-iec-62453-309-2021


INTRODUCTION

This part of IEC 62453 is an interface specification for developers of FDT (Field Device Tool) components for function control and data access within a client/server architecture. The specification is a result of an analysis and design process to develop standard interfaces to facilitate the development of servers and clients by multiple vendors that need to interoperate seamlessly.

With the integration of fieldbuses into control systems, there are a few other tasks which need to be performed. In addition to fieldbus- and device-specific tools, there is a need to integrate these tools into higher-level system-wide planning or engineering tools. In particular, for use in extensive and heterogeneous control systems, typically in the area of the process industry, the unambiguous definition of engineering interfaces that are easy to use for all those involved is of great importance.

A device-specific software component, called DTM (Device Type Manager), is supplied by the field device manufacturer with its device. The DTM is integrated into engineering tools via the FDT interfaces defined in this specification. The approach to integration is in general open for all kind of fieldbuses and thus meets the requirements for integrating different kinds of devices into heterogeneous control systems.

Figure 1 shows how IEC 62453-309 is aligned in the structure of the IEC 62453 series.

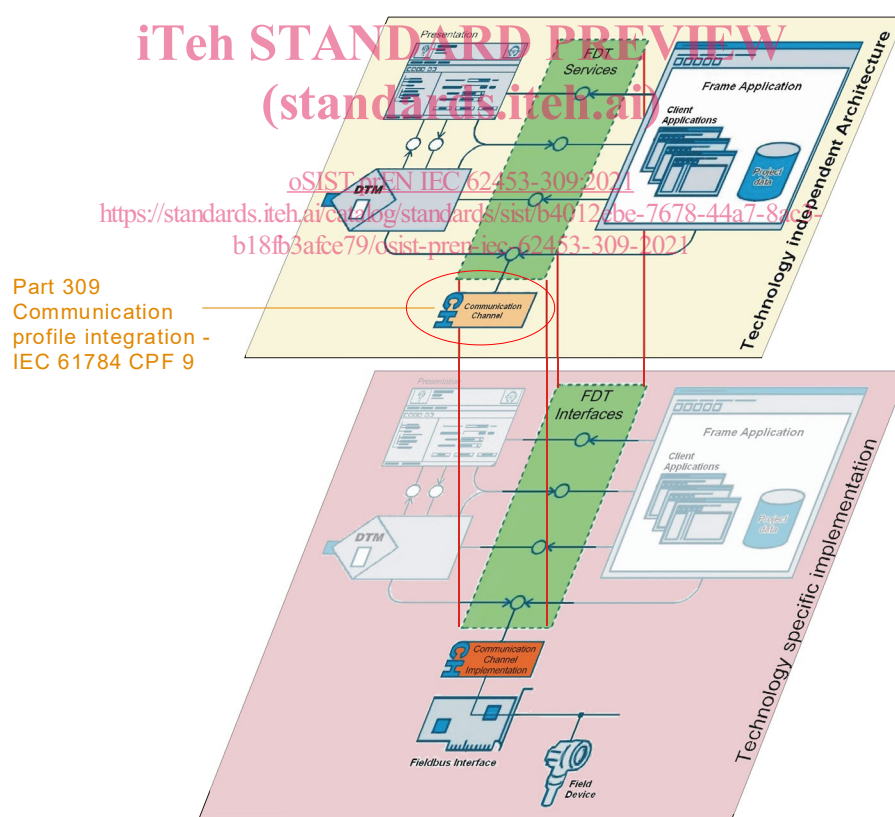

IEC

Figure 1 – Part 309 of the IEC 62453 series

FIELD DEVICE TOOL (FDT) INTERFACE SPECIFICATION –

Part 309: Communication profile integration – IEC 61784 CPF 9

1 Scope

Communication Profile Family 9 (commonly known as HART®¹) defines communication profiles based on IEC 61158-5-20 and IEC 61158-6-20. The basic profile CP 9/1 is defined in IEC 61784-1.

This part of IEC 62453 provides information for integrating the HART® technology into the FDT standard (IEC 62453-2).

This part of the IEC 62453 specifies communication and other services.

This standard neither contains the FDT specification nor modifies it.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

<https://standards.iteh.ai/catalog/standards/sist/b4012ebe-7678-44a7-8ac3-b18fb3af-e79/osist-pr-en-iec-62453-309-2021>

IEC 61158-5-20, *Industrial communication networks – Fieldbus specifications – Part 5-20: Application layer service definition – Type 20 elements*

IEC 61158-6-20, *Industrial communication networks – Fieldbus specifications – Part 6-20: Application layer protocol specification – Type 20 elements*

IEC 61784-1, *Industrial communication networks – Profiles – Part 1: Fieldbus profiles*

IEC 62453-1:–², *Field device tool (FDT) interface specification – Part 1: Overview and guidance*

IEC 62453-2:–², *Field device tool (FDT) interface specification – Part 2: Concepts and detailed description*

3 Terms, definitions, symbols, abbreviated terms and conventions

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 62453-1 and IEC 62453-2, as well as the following apply.

¹ HART® and WirelessHART® are trade names of products supplied by FieldComm Group. This information is given for convenience of users of this document and does not constitute an endorsement by IEC of the product named. Equivalent products may be used if they can be shown to lead to the same results.

² To be published concurrently with this standard.

3.1.1

burst mode

mode in which the field device generates response telegrams without request telegram from the master

3.2 Abbreviated terms

For the purposes of this document, the abbreviations given in IEC 62453-1, IEC 62453-2, as well as the following apply.

BACK	Burst ACKnowledge
C8PSK	Coherent 8-way Phase Shift Keying, HART communication layer as defined in HCF_SPEC-60, Revision 1.0
DR	Delayed Response
EDD	Electronic Device Description
FSK	Frequency Shift Keying, HART communication layer as defined in HCF_SPEC-54, Revision 8.1
HART	Highway Addressable Remote Transducer

3.3 Conventions

3.3.1 Data type names and references to data types

The conventions for naming and referencing of data types are explained in IEC 62453-2:–, Clause A.1.

3.3.2 Vocabulary for requirements

The following expressions are used when specifying requirements.

Usage of “shall” or “mandatory”	No exceptions allowed.
Usage of “should” or “recommended”	Strong recommendation. It may make sense in special exceptional cases to differ from the described behaviour.
Usage of “can” or “optional”	Function or behaviour may be provided, depending on defined conditions.

3.3.3 Use of UML

Figures in this document are using UML notation as defined in IEC 62453-1:–, Annex A.

4 Bus category

IEC 61784 CPF 9 protocol is identified in the protocolId element of structured data type 'fdt:BusCategory' by the following unique identifiers (see Table 1):

Table 1 – Protocol identifiers

Identifier value	ProtocolId	Display String	Description
036D1498-387B-11D4-86E1-00E0987270B9	HART_Basic	'HART'	Support of IEC 61784 CPF 9 protocol over FSK communication with basic functionality (deprecated)
98503B8F-0FFB-4EB7-BB67-F4D6BD16DB8D	HART_FSK	'HART FSK'	Support of HART protocol over FSK communication with complete functionality

Identifier value	ProtocolId	Display String	Description
74D29D22-F752-40EF-A747-ACA72C791155	HART_Wireless	'HART Wireless'	Support of WirelessHART protocol
58001A08-C178-4A59-A76B-9EF9111CB83D	HART_RS485	'HART RS485'	Support of HART protocol over RS485 communication
EF708CB7-A2A1-42AF-890C-15CEB680CC12	HART_Infrared	'HART Infrared'	Support of HART protocol over Infrared communication
D122D172-F0C7-4B03-965B-512CD4C0871E	HART_IP	'HART IP'	Support of HART over IP protocol

The 'HART_Basic' protocol is maintained for backward compatibility only (e.g. for interaction with DTMs according to IEC 62453-309 Ed.1.0). The other protocol identifiers provide a better support for planning of network topologies and for establishment of connections between DTM and respective device. For DTMs complying with this document support for one of the other protocols is mandatory.

Within this document the other protocols (HART_FSK, HART_Wireless, HART_RS485, HART_Infrared, HART_IP) are referenced as 'Extended_HART' protocols. (E.g. for definitions that apply to all protocols except 'HART_Basic'.)

Table 2 defines which PhysicalLayer can be used together with the BusCategory defined in Table 1.

Table 2 – Definition of PhysicalLayer

PhysicalLayer Id value	PhysicalLayer name value	Description
BAB2091A-C0A7-4614-B9DE-FCC2709DCF5D	HART FSK Physical Layer	Support of HART FSK physical layer
B9F1A250-AC94-4487-8F25-A8F3F8F89DC5	WirelessHART Physical Layer	Support of WirelessHART physical layer
036D1591-387B-11D4-86E1-00E0987270B9	HART RS-485 Physical Layer	Support of HART devices using RS-485 communication
AE4119EF-B9FD-429c-B244-134DB182296A	HART Infrared Physical Layer	Support of HART devices using infrared communication
307dd808-c010-11db-90e7-0002b3ecdcb	10BASET	HART Ethernet based Physical Layers
307dd809-c010-11db-90e7-0002b3ecdcb	10BASETXHD	
307dd80a-c010-11db-90e7-0002b3ecdcb	10BASETXFD	
307dd80b-c010-11db-90e7-0002b3ecdcb	10BASEFLHD	
307dd80c-c010-11db-90e7-0002b3ecdcb	10BASEFLFD	
307dd80d-c010-11db-90e7-0002b3ecdcb	10BASEFXHD	
307dd80e-c010-11db-90e7-0002b3ecdcb	10BASEFXFD	
307dd80f-c010-11db-90e7-0002b3ecdcb	100BASETXHD	
307dd810-c010-11db-90e7-0002b3ecdcb	100BASETXFD	
307dd811-c010-11db-90e7-0002b3ecdcb	100BASEFXHD	
307dd812-c010-11db-90e7-0002b3ecdcb	100BASEFXFD	
307dd813-c010-11db-90e7-0002b3ecdcb	100BASELX10	
307dd814-c010-11db-90e7-0002b3ecdcb	100BASEPX10	
307dd815-c010-11db-90e7-0002b3ecdcb	1000BASEXHD	
307dd816-c010-11db-90e7-0002b3ecdcb	1000BASEXFD	
307dd817-c010-11db-90e7-0002b3ecdcb	1000BASELXHD	
307dd818-c010-11db-90e7-0002b3ecdcb	1000BASELXFD	
307dd819-c010-11db-90e7-0002b3ecdcb	1000BASESXHD	

PhysicalLayer Id value	PhysicalLayer name value	Description
307dd81a-c010-11db-90e7-0002b3ecdcbe	1000BASEXFD	
307dd81b-c010-11db-90e7-0002b3ecdcbe	1000BASETHD	
307dd81c-c010-11db-90e7-0002b3ecdcbe	1000BASETFD	
307dd81d-c010-11db-90e7-0002b3ecdcbe	10GigBASEFX	

The significant information for topology planning is the BusCategory. The PhysicalLayer (which is provided in the BusInformation data type) shall be used only for additional information.

The DataLinkLayer property is not applicable for HART and shall be set to null.

5 Access to instance and device data

5.1 General

The HART protocol has semantics defined that allow in a wide range the identification of device variables and device parameters. Most of this semantic information is defined in the standard EDD import libraries.

Clause 5 describes how the semantic information defined with the HART protocol shall be used to export device data, instance data and process data.

5.2 Process Channel objects (provided by DTM)

The minimum set of provided data shall be:

- the first four provided process related values (PV, SV, ...³) – if available – are modeled as channel references. The referenced channel shall include ranges and scaling.

A HART device communicates the process data either via its analogue channels or via digital information (e.g. by request or by burst mode). Analogue channels are always related to a dynamic variable, as specified in [3]³ chapter 8 and therefore the description of an analogue channel has to be accessed using the respective dynamic variable (e.g. the attributes of dynamic variable PV always describe the first analogue channel).

HART distinguishes between three methods to access digital signals:

- 1) Access to analogue value and assigned dynamic variables (Command #3)

IO signals can be assigned to one of the four dynamic variables PV, SV, TV, and QV. Using the command #3 the analogue value and the dynamic variables can be read without specific device knowledge.

- 2) Indexed access to device variables (Command #33)

All device variable values and their units can be read using the related device variable code information in command #33.

- 3) Indexed access to device variable classification and device variable status (Command #9)

Command #9 provides more information than command #33. Beside of the value and unit also a classification and the variable status can be determined.

The command initiator determines by means of the HART specification which commands will be used.

³ Figures in square brackets refer to the bibliography.

5.3 DTM services to access instance and device data

The services InstanceDataInformation and DeviceDataInformation shall provide access to at least all parameters of the Universal and Common Practice commands (as far as the device supports the function).

Furthermore, the Response Byte 0 and the Response Byte 1 for each command shall be exposed.

The services InstanceDataInformation and DeviceDataInformation may also provide access to device specific parameters (e.g. diagnostic information).

6 Protocol-specific behavior

6.1 Overview

There is only one protocol-specific sequence defined for IEC 61784 CPF 9:

- burst mode subscription.

This sequence explains how the sequence “Device initiated data transfer”, defined in IEC 62453-2, is applied in context of burst telegrams as defined by IEC 61784 CPF 9.

Additionally Clause 6 provides information regarding:

- usage of device addressing information,
- support of extended command codes,
- handling of communication failures,
- handling of delayed responses, and
- management of physical topologies.


6.2 Burst mode subscription

A subscription to device initiated data transfer can be requested by sending a transaction request with SubscribeRequest content (see Figure 2). The Communication Channel may detect if the device is already in burst mode.

NOTE In HART 5 this can be detected only when burst frames are received from the device. In HART 6 the burst mode can be detected using command #105.

The Communication Channel answers to a SubscribeRequest with a SubscribeResponse content. If burst frames are received, the device is in burst mode and burstModeDetected value is set to TRUE. This means that Device DTM will start to receive burst messages via the transaction response mechanism. In the case that no burst messages were received, burstModeDetected value is set to FALSE. It is up to Device DTM to set device into burst mode. Then Device DTM may call a transaction request with SubscribeRequest content again in order to receive burst messages.

In order to unsubscribe, the Device DTM sends a transaction request with a UnsubscribeRequest. The Communication Channel answers with a UnsubscribeResponse where burstModeDetected value is set to FALSE. The Device DTM will not receive any more burst information via the transaction response mechanism. The Communication Channel does not switch off the burst mode in the device. The Device DTM may switch burst mode on or off by using normal transaction requests (command #109). This is independent of the subscription.

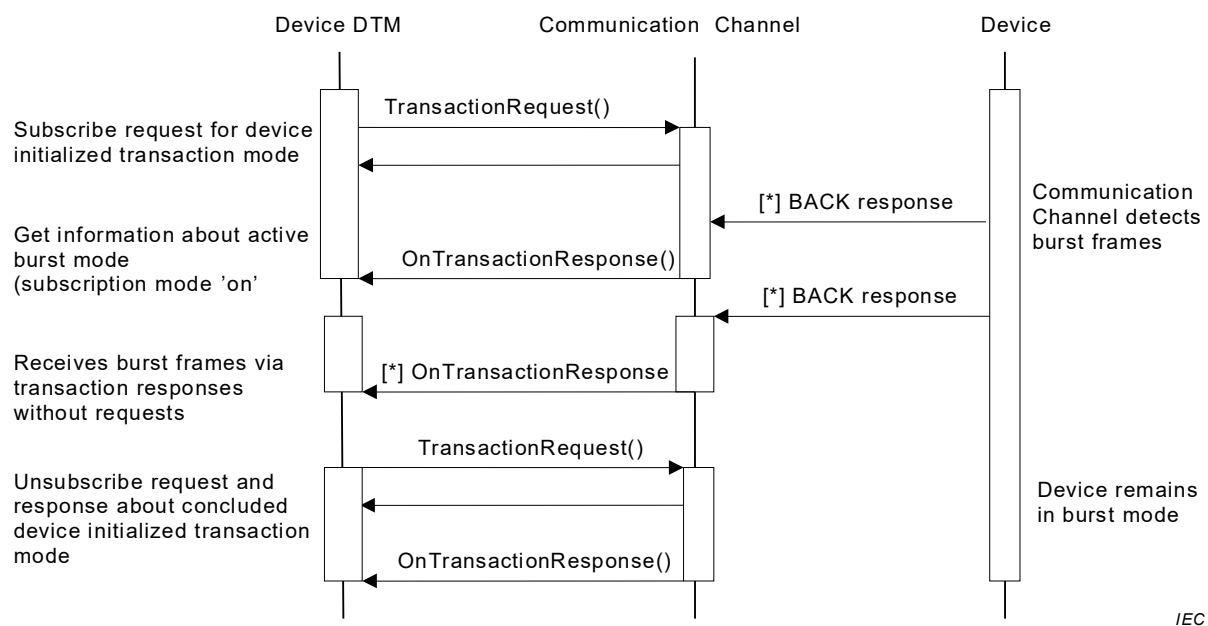

NOTE BACK means Burst ACKnowledge.

Figure 2 – Burst mode subscription

6.3 Usage of device addressing information

HART is a connectionless master/slave protocol. Transaction requests are always addressed using unique device address information (a 5 byte integer), the so called long address.

Device addressing in HART therefore is mainly focused to determine this long address.

There are currently three ways possible to determine the long address.

1) short address

The short address is a number between 0 and 63 (for HART version 5 only 0 to 15). In the context of a direct connection to the device the short address is unique and allows to read the long address using command #0.

2) short tag

With command #11 the long address information can be requested for a device with a specific short tag. Such requests are especially used for installations with a huge amount of connected HART devices. All HART multiplexer devices and other HART communication structures have to support this command.

3) long tag

HART Version 6 introduced the long tag, which at 32 characters has 24 more characters than the short tag, and can thus provide for a larger number of device label options. For devices with HART version less than 6 instead of long tag, message is used. With command #21 the long address information can be requested for a device with a specific long tag.. Command #21 is usually supported by highly modular devices or gateways.

A Device DTM is responsible to provide and store all information that is used for resolving the long address of a connected device. It has therefore to maintain the data for all three address resolving methods. The DTM responsible to connect to the communication hardware has to select the method and provide means for a user to input the address information.

Besides the addressing topic, there are also different approaches for manufacturer and device type identification depending on the supported version of HART. HART versions up to HART 6