

ISO/TC 282/SC 2

Secretariat: SAC

Voting begins on:
2020-08-28

Voting terminates on:
2020-10-23

Water Reuse in Urban Areas — Guidelines for reclaimed water treatment: Design principles of a RO treatment system of municipal wastewater

ITeH STANDARD PREVIEW
(standards.iteh.ai)
Full standard:
<https://standards.iteh.ai/catalog/standards/sist/0d354e33-e1f8-43bd-b35c-56d43860f5ca/iso-fdis-23070>

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.



Reference number
ISO/FDIS 23070:2020(E)

iTeh STANDARD PREVIEW
(standards.iteh.ai)
Full standard:
<https://standards.iteh.ai/catalog/standards/sist/0d354e33-e1f8-43bd-b35c-56d43860f5ca/iso-fdis-23070>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2020

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Abbreviated terms	3
5 Application of RO treatment systems for reclaimed water	3
5.1 Overview	3
5.2 Design consideration	4
5.2.1 Safety consideration	4
5.2.2 Stability consideration	4
5.2.3 Economy consideration	4
5.3 RO system components	4
5.3.1 General	4
5.3.2 Feed water source	5
5.3.3 Pre-treatment unit	5
5.3.4 RO treatment unit	5
5.3.5 Auxiliary equipment	5
5.3.6 Post treatment unit	5
5.3.7 Water quality and performance monitoring system	5
6 Technical considerations of pre-treatments	5
6.1 Quality considerations of feed water	5
6.1.1 General water quality index	5
6.1.2 Silt density index	6
6.1.3 Organic index	6
6.1.4 Biological index	7
6.1.5 Oxidation-reduction potential	7
6.2 Selection of mechanical pre-treatments	7
6.2.1 Clarification	7
6.2.2 Media/Multimedia filtration	7
6.2.3 Activated carbon filtration	7
6.2.4 Microfiltration and ultrafiltration	8
6.2.5 Cartridge filtration	8
6.3 Chemical pre-treatments	8
6.3.1 Antiscalants	8
6.3.2 Chemical oxidizers for disinfection of the feed	8
6.3.3 Reductants	8
6.3.4 Non-oxidizing biocides	8
7 Technical and structural considerations of RO unit	8
7.1 Components	8
7.1.1 RO feed pumps	8
7.1.2 RO membrane modules	9
7.1.3 Pressure vessels	9
7.2 Selection of RO membranes	9
7.2.1 Membrane materials	9
7.2.2 Membrane modules	10
7.3 RO unit configuration	10
8 Operating conditions and maintenance system	11
8.1 Operating conditions	11
8.1.1 Pressure	11
8.1.2 Temperature	11

8.1.3	Feed water flow and permeate flux.....	11
8.1.4	Concentrate flow.....	11
8.1.5	pH.....	12
8.2	RO performance parameters.....	12
8.2.1	Permeate flow rate.....	12
8.2.2	Salt rejection.....	13
8.2.3	Pressure drop.....	13
8.3	Automatic chemical dosing system.....	13
8.3.1	Dosing point.....	13
8.3.2	Dosing method.....	13
8.4	Control and monitor system of RO performance.....	13
8.4.1	Instrumentation.....	13
8.4.2	Control system.....	14
8.4.3	Monitoring system.....	14
8.5	Cleaning system.....	14
8.5.1	Physical cleaning.....	14
8.5.2	Chemical cleaning.....	14
8.6	Integrity testing of RO systems.....	15
8.7	System failure.....	16
9	Post treatment unit.....	17
10	RO concentrate treatment.....	17
11	Emergency response plan.....	17
Annex A (informative) Example of a RO treatment system for reclaimed water.....		19
Annex B (informative) Information of chlorine disinfection for the influent of a RO system.....		20
Annex C (informative) Maturity level of technologies applied to RO concentrate treatment.....		21
Bibliography.....		22

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2. www.iso.org/directives

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received. www.iso.org/patents

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT) see the following URL: Foreword Supplementary information

This document was prepared by Technical Committee ISO/TC 282, *Water reuse*, Subcommittee SC 2, *Water reuse in urban areas*.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

Over the past decade, with an increasing demand of high-quality reclaimed water, reverse osmosis (RO) has been widely applied as an important option for municipal wastewater reclamation. Reverse osmosis (RO) is a water purification technology that uses a semipermeable membrane to remove ions and organic micropollutants from feed water. In reverse osmosis, an applied pressure is used to overcome osmotic pressure, a colligative property that is driven by chemical potential differences of the solvent, a thermodynamic parameter. The automatic operation, small footprint and consistent high permeate quality are the advantages of a RO process, which make it widely recognized. The reclaimed water produced by a RO system could be used as boiler replenishing water, water for industrial production and so on.

Compared with seawater and industrial wastewater, municipal wastewater has its distinctive features. The total dissolved solid (TDS) concentration in seawater is mainly in the range of 30,000 to 45,000 mg/l^[1], while the TDS concentration in secondary effluent of municipal wastewater ranges from 100 to 3,000 mg/l^[2]. Thus, the RO system of municipal wastewater could achieve higher recovery efficiency with much lower operational pressure compared with that of seawater. However, the dissolved organic matter (DOM) concentration in secondary effluent is in the range of 5 to 20 mg/l as dissolve organic carbon (DOC)^[2], which is much higher than that in seawater (<2 mg/l)^[1]. Furthermore, the components of the DOM in secondary effluent are much more complicated than those in seawater. Long-term operation of the RO system for municipal wastewater reclamation could lead to serious organic and biological fouling. Therefore, in order to provide the stable operation, the distinctive features of municipal wastewater should be taken into consideration in the design of the RO unit as well as the pre-treatment unit. The design experience of the RO system for other water sources (e.g., seawater and industrial wastewater) could not be applied directly to municipal wastewater.

This document provides guidelines for the planning and design of a RO treatment system for water reuse applications in urban areas. This document is applicable to practitioners and regulatory authorities who intend to implement principles and decisions on water reuse in a safe, reliable and sustainable manner.

This document addresses a RO treatment system in its entirety (e.g. reclaimed water sources, pre-treatment process, RO treatment process, post treatment process, performance of RO system, operation and maintenance and monitoring, usage of reclaimed water).

Water Reuse in Urban Areas — Guidelines for reclaimed water treatment: Design principles of a RO treatment system of municipal wastewater

1 Scope

This document provides guidelines for the planning and design of a reverse osmosis (RO) desalination system of municipal wastewater. This document is applicable to practitioners and authorities who intend to implement principles and decisions on RO treatment of municipal wastewater in a safe, reliable and sustainable manner. This document addresses RO treatment systems of municipal wastewater in their entirety and is applicable to any RO treatment system component.

This document provides:

- standard terms and definitions;
- a description of the system components of a RO treatment system of municipal wastewater;
- design principles of a RO treatment system of municipal wastewater;
- statements on the feed water quality and technical requirements of a RO treatment system;
- guidance for operation and maintenance of a RO treatment system;
- specific aspects for consideration and emergency response.

Design parameters and regulatory values of a RO treatment system of municipal wastewater are out of the scope of this document.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 20670:2018, *Water reuse — Vocabulary*

3 Terms and definitions

For the purpose of this document, the terms and definitions given in ISO 20670 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

3.1

assimilable organic carbon (AOC)

organic carbon which can be used by microorganisms for assimilation

3.2

biodegradable dissolved organic carbon (BDOC)

organic carbon which can be used by microorganisms for assimilation as well as catabolism

3.3

concentrate

rejected stream exiting a membrane module under a cross-flow mode

[SOURCE: ASTM D6161-10^[3]]

Note 1 to entry: Concentrate stream contains increased concentrations of constituents over the feed stream due to the accumulation of rejected constituents by membranes in the feed stream.

3.4

feed

input solution entering the inlet of a membrane module or system

[SOURCE: ASTM D6161-10^[3]]

3.5

ion exchange

process by which certain anions or cations in water are replaced by other ions by passage through a bed of ion-exchange material

[SOURCE: ISO 6107-1:2004, 46^[4]]

3.6

membrane rejection rate

relative measure of how much of the target constituent that was initially in the feed water is separated from the liquid by the membrane

Note 1 to entry: Rejection is generally expressed by $1 - C_2/C_1$, where C_1 is feed concentration and C_2 is permeate concentration. To make the guideline simple, the word "membrane" is frequently omitted depending on the context.

3.7

microfiltration

pressure driven membrane based separation process designed to remove particles and macromolecules in the approximate range of 0,05 to 2 μm

[SOURCE: ASTM D6161-10^[3]]

3.8

permeate

portion of the feed stream which passes through a membrane

[SOURCE: ASTM D6161-10^[3]]

3.9

pressure drop

pressure change of the influent after the treatment by a RO system

3.10

recovery rate

ratio of the permeate volume to the feed volume

3.11

reverse osmosis

separation process where one component of a solution is removed from another component by flowing the feed stream under pressure across a semipermeable that causes selective movement of solvent against its osmotic pressure difference

[SOURCE: ASTM D6161-10^[3]]

Note 1 to entry: Reverse Osmosis (RO) removes ions based on electro chemical forces, colloids, and organics down to 150 molecular weight. May also be called hyperfiltration.

3.12**silt density index (SDI)**

index for the fouling capacity of water in reverse osmosis systems, measuring the rate at which a 0,45-micrometre filter is plugged when subjected to a constant water pressure of 206,8 kPa (30 psi) [5]

[SOURCE: ASTM D4189-07 (2014) [5]]

3.13**ultrafiltration**

pressure driven process employing semipermeable membrane under hydraulic pressure gradient for the separation components in a solution

[SOURCE: ASTM D6161-10 [3]]

Note 1 to entry: The pores of the membrane are of a size smaller than 0.1 µm, which allows passage of the solvent(s) but will retain non-ionic solutes based primarily on physical size, not chemical potential.

4 Abbreviated terms

AOC assimilable organic carbon

BDOC biodegradable dissolved organic carbon

BOD biochemical oxygen demand

CA cellulose acetate

COD chemical oxygen demand

DOC dissolved organic carbon

DOM dissolved organic matter

MF microfiltration

NPF normalized permeate flow

ORP oxidation-reduction potential

RO reverse osmosis

SDI silt density index

TOC total organic carbon

TSS total suspended solids

UF ultrafiltration

5 Application of RO treatment systems for reclaimed water**5.1 Overview**

Over the past decade, with an increasing demand of high-quality reclaimed water, reverse osmosis (RO) among other technologies has been widely applied as an important option for municipal wastewater reclamation. RO technology can achieve high removal efficiency of microbes, colloidal matter, dissolved solids, organics and inorganics from feed water. The advantages of a RO process are automatic operation and high stability of RO permeate and this makes the RO process widely accepted [6-8].

5.2 Design consideration

Generally, permeate flow rate and permeate quality are used to characterize a RO treatment system under certain feed water quality, recovery rate and operational pressure. Therefore, the main objective of designing a RO treatment system is to meet the specific consideration of permeate flow rate and quality with minimal operational pressure and the considerations about the costs of system components. Furthermore, the cleaning process and maintenance should also be taken into consideration to maintain the stable operation of the system.

5.2.1 Safety consideration

In theory, the reverse osmosis process is driven by pressure. In practice, the pressure is provided by the feed pump of RO process, and a pressure vessel is used to hold the membrane modules and the pressurized feed water. Therefore, the design and operation of a RO system shall meet the safety consideration for a pressurized system.

5.2.2 Stability consideration

Stability represents the ability of a RO system to provide stable permeate flow rate and water quality under certain operational conditions. In practice, because of membrane fouling, scaling or other factors which could increase the resistance, in order to maintain a stable permeate flow rate, the operational pressure keeps increasing. When the operational pressure is too high, it is necessary to clean the RO membranes. As for permeate quality, it might deteriorate because of membrane damage, membrane degradation and membrane fouling. Therefore, the permeate quality shall be diligently monitored.

In order to enhance the stability of a RO system, provision for equalization of effluent flow prior to pre-treatment stage and or RO unit may also be considered. The resultant reduced variability in influent flow rate would also allow for more consistent dosing of chemicals such as antiscalants, reductants and non-oxidizing biocides.

5.2.3 Economy consideration

As for the infrastructure cost of a RO system, it is necessary to meet the considerations of permeate flow rate and quality with a minimal cost of system components. As for the operational cost, it is necessary to maintain the operational stability of the whole system with reasonable operational pressure, cleaning and maintenance.

5.3 RO system components

5.3.1 General

A RO system generally consists of six essential components:

- feed water source;
- pre-treatment;
- RO treatment;
- auxiliary equipment;
- post treatment (optional depending of the reclaimed water usage and quality criteria); and
- monitor ([Figure 1](#)).

Each part of the system should be characterized and managed with appropriate strategies. See [Annex A](#) for the example of a typical RO treatment system for reclaimed water.

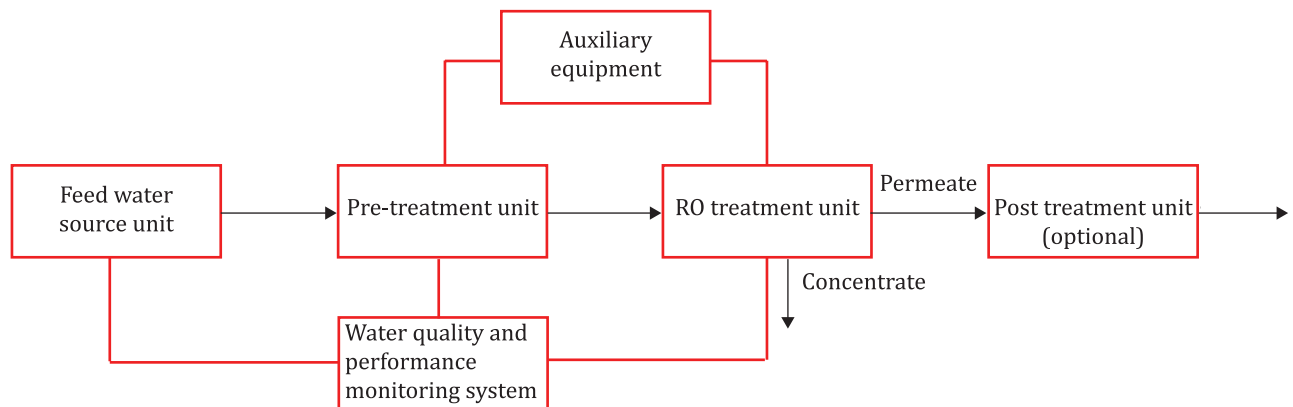


Figure 1 — The essential components of a RO treatment system for reclaimed water

5.3.2 Feed water source

Secondary or tertiary treated municipal wastewater is generally the water source to the RO process stage of the water reclamation plant.

5.3.3 Pre-treatment unit

The pre-treatment unit may include one or more treatment stages as physico-chemical treatment, oxidation (ozone and AOP), media filtration, UF/MF membrane filtration, disinfection.

5.3.4 RO treatment unit

The RO treatment unit generally includes a safety filter, a high-pressure pump, RO equipment and a storage tank for the effluent of RO. It is the key component of the whole RO system.

5.3.5 Auxiliary equipment

The auxiliary equipment may include the dosing and cleaning units. Several kinds of chemicals may be added, including chlorine, cleaning chemicals, antiscalants, reductants and non-oxidizing biocides ([Figure 1](#) and [Figure A.1](#)).

5.3.6 Post treatment unit

According to the specific consideration of the end user, one or more stages shall be needed to attain the desired rejection (e.g. secondary RO, ion exchange, electrodialysis reversal). RO concentrate may require treatment. The post treatment unit will be elaborated on in [Clause 9](#).

5.3.7 Water quality and performance monitoring system

In order to maintain the operational stability and safety of the whole system, a series of monitors should be installed, including temperature meter, pressure gauge, pH meter, flowmeter, conductivity meter, ORP meter and so on.

6 Technical considerations of pre-treatments

6.1 Quality considerations of feed water

6.1.1 General water quality index

General water quality indices of the feed water for a RO system are listed in [Table 1](#).