



SLOVENSKI STANDARD
oSIST prEN ISO 23875:2022
01-januar-2022

Rudarstvo - Sistemi za nadzor kakovosti zraka za ohišje operaterja - Zahteve glede zmogljivosti in preskusne metode (ISO 23875:2021)

Mining - Air quality control systems for operator enclosures - Performance requirements and test methods (ISO 23875:2021)

iTeh STANDARD PREVIEW

Exploitation minière - Systèmes de contrôle de la qualité de l'air des enceintes de l'opérateur - Exigences de performance et méthodes essai (ISO 23875:2021)

[oSIST prEN ISO 23875:2022](https://standards.iteh.ai/catalog/standards/iso/23875-2021/016-4710-94d9-b5aaad5d01e0/osist-pren-iso-23875-2022)

Ta slovenski standard je istoveten z: prEN ISO 23875

ICS:

13.040.30	Kakovost zraka na delovnem mestu	Workplace atmospheres
73.020	Rudarstvo in kamnolomsko izkopavanje	Mining and quarrying

oSIST prEN ISO 23875:2022

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[oSIST prEN ISO 23875:2022](https://standards.iteh.ai/catalog/standards/sist/83726b1e-1016-4710-94d9-b5aaad5d01e0/osist-pren-iso-23875-2022)

<https://standards.iteh.ai/catalog/standards/sist/83726b1e-1016-4710-94d9-b5aaad5d01e0/osist-pren-iso-23875-2022>

INTERNATIONAL STANDARD

**ISO
23875**

First edition
2021-02

Mining — Air quality control systems for operator enclosures — Performance requirements and test methods

**iTeh STANDARD PREVIEW
(standards.iteh.ai)**

[oSIST prEN ISO 23875:2022](https://standards.iteh.ai/catalog/standards/sist/83726b1e-1016-4710-94d9-b5aaad5d01e0/osist-pren-iso-23875-2022)

<https://standards.iteh.ai/catalog/standards/sist/83726b1e-1016-4710-94d9-b5aaad5d01e0/osist-pren-iso-23875-2022>



Reference number
ISO 23875:2021(E)

© ISO 2021

iTeh STANDARD PREVIEW (standards.iteh.ai)

[oSIST prEN ISO 23875:2022
https://standards.iteh.ai/catalog/standards/sist/83726b1e-1016-4710-94d9-b5aaad5d01e0/osist-pren-iso-23875-2022](https://standards.iteh.ai/catalog/standards/sist/83726b1e-1016-4710-94d9-b5aaad5d01e0/osist-pren-iso-23875-2022)



COPYRIGHT PROTECTED DOCUMENT

© ISO 2021

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
3.1 Terms related to air quality.....	2
3.2 Terms related to the operator enclosure design.....	2
3.3 Terms related to measurement.....	3
4 Requirements	4
4.1 Performance requirements.....	4
4.2 Engineering design.....	4
4.2.1 Operator enclosure.....	4
4.2.2 Air quality control system.....	5
4.2.3 Filters and filter housings.....	6
4.3 Monitoring devices.....	7
4.3.1 General.....	7
4.3.2 Carbon dioxide operator notification system for retrofit installations.....	8
4.3.3 Carbon dioxide operator notification system for machine manufacturers.....	8
4.3.4 Additional monitoring capabilities.....	9
5 Performance testing	9
5.1 Requirements.....	9
5.1.1 Test set up.....	9
5.1.2 Test equipment.....	9
5.1.3 Test methods.....	10
5.2 Test report.....	12
6 Operation and maintenance instructions	13
Annex A (informative) CO₂ management	15
Annex B (informative) Recommendations for the operational integration of this document	17
Bibliography	21

ISO 23875:2021(E)

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 82, *Mining*.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

Safety in mining operations is of concern to all involved in owning, developing, managing, and working in mining environments. Routine mining activities can generate airborne particulates which are hazardous to human health. Therefore, it is necessary to develop controls which limit the operator's exposure to airborne particulates while operating equipment from within the operator enclosure. With the rise in the number of countries regulating air quality in mining, construction, and industrial environments, machine manufacturers have become increasingly aware of the need for standard practices in the design and performance of operator enclosures. This document seeks to address the fundamental design requirements that will allow for operator enclosures to perform at a level that provides sustained air quality, reducing concentrations of respirable particulate matter and carbon dioxide that are harmful to human health. The emphasis of this document is in three areas: 1) design, 2) air quality control system performance testing, and 3) maintenance and operation instruction for the operator enclosure.

All operator enclosures, either on new machines or existing machines currently in operation, meeting the requirements of this document are expected to provide consistent air quality performance. The technical aspects of an operator enclosure are universal as are the design and performance testing methods. Therefore, every attempt has been made to make this an inclusive document which addresses the needs of fixed and mobile operator enclosures.

This document was developed to provide for the occupational health and safety of personnel who work inside operator enclosures. It primarily addresses air quality concerns by establishing parameters to determine air quality control system effectiveness. The control of these airborne contaminants is through an effective air quality control system (for both external air and recirculated air), dilution of CO₂, routine testing of the air within the operator enclosure, and effective maintenance throughout the life cycle of the operator enclosure. Extensive research and subsequent publications have produced a substantial body of knowledge around the air quality control systems and are the basis of this document. See Bibliography.

<https://standards.iteh.ai/catalog/standards/sist/83726b1e-1016-4710-94d9-b5a7ad5d11e0/occupancy-com-iso-23875-2022>

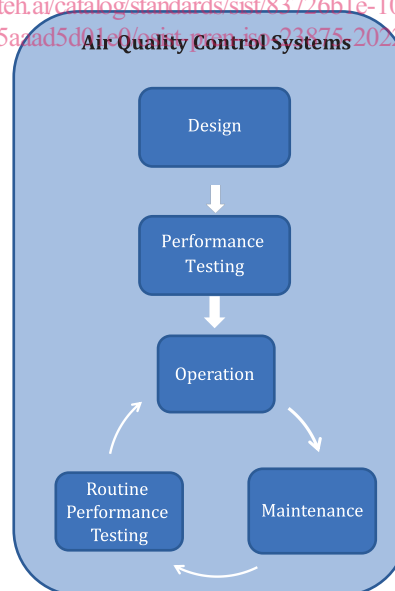


Figure 1 — Air quality control system life cycle

As illustrated in [Figure 1](#), this document presents a life cycle approach to operator enclosure air quality control system design, performance testing, and maintenance.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[oSIST prEN ISO 23875:2022](#)

<https://standards.iteh.ai/catalog/standards/sist/83726b1e-1016-4710-94d9-b5aaad5d01e0/osist-pren-iso-23875-2022>

Mining — Air quality control systems for operator enclosures — Performance requirements and test methods

1 Scope

This document specifies performance and design requirements for air quality control systems for operator enclosures and their monitoring devices. The design specifications are universal in their application and do not contemplate specific mining environments. They are intended to meet identified parameters of both pressurization and respirable particulate and carbon dioxide concentrations. This document also specifies test methods to assess such parameters and provides operational and maintenance instructions. Recommendations are made for operational integration of the air quality control system.

Gases and vapours that can be a hazard in the work environment outside of the operator enclosure are excluded from this document.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 18158, *Workplace air — Terminology*

ISO 29463-1:2017, *High efficiency filters and filter media for removing particles from air — Part 1: Classification, performance, testing and marking*

ISO 29463-2, *High-efficiency filters and filter media for removing particles in air — Part 2: Aerosol production, measuring equipment and particle-counting statistics*

ISO 29463-3, *High-efficiency filters and filter media for removing particles in air — Part 3: Testing flat sheet filter media*

ISO 29463-4:2011, *High-efficiency filters and filter media for removing particles in air — Part 4: Test method for determining leakage of filter elements - Scan method*

ISO 29463-5:2011, *High-efficiency filters and filter media for removing particles in air — Part 5: Test method for filter elements*

ISO/IEC 17000, *Conformity assessment — Vocabulary and general principles*

ISO/IEC 17050-1, *Conformity assessment — Supplier's declaration of conformity — Part 1: General requirements*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO/IEC 17000, ISO 18158, ISO 29463-1 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

ISO 23875:2021(E)

3.1 Terms related to air quality

3.1.1

airborne particle

airborne particulate

fine matter, in solid or liquid form, dispersed in air

[SOURCE: ISO 18158:2016, 2.1.2.3, modified — The preferred term "airborne particulate" has been added.]

3.1.2

hazardous to human health

in such a quantity and/or quality of *airborne particulates* (3.1.1) or CO_2 (3.1.7) or noise, that it has adverse health effects

3.1.3

contaminated environment

area where *airborne particulates* (3.1.1) *hazardous to human health* (3.1.2) are present in the ambient air

3.1.4

breathing zone

air space around the worker's face from where they take their breath

3.1.5

ambient CO_2 level

CO_2 (3.1.7) concentration present in the air outside of the *operator enclosure* (3.2.1), to which people can be exposed

iTeh STANDARD PREVIEW

(standards.iteh.ai)

3.1.6

respirable particulate matter

materials that are deposited in the gas-exchange region of the lungs

oSIST prEN ISO 23875:2022

Note 1 to entry: The median cut-point for respirable particulate matter is $4,0 \mu m$, according to ISO 7708:1995.

94d9-b5aaad5d01e0/osist-pren-iso-23875-2022

3.1.7

CO_2

carbon dioxide emitted as a by-product of human respiration

3.2 Terms related to the operator enclosure design

3.2.1

operator enclosure

structure that completely surrounds the operator, preventing the free passage of *external air* (3.2.7), dust or other substances into the area around the operator

[SOURCE: ISO 10263-4:2009, 3.1, modified – "part of the machine which" has been replaced with "structure that".]

3.2.2

air quality control system

operator enclosure (3.2.1) that includes structural components, *external air* (3.2.7) and recirculation air systems designed to protect an operator from environmental factors such as dust, heat, cold, wind, and *airborne particulates* (3.1.1) *hazardous to human health* (3.1.2)

3.2.3

sustained quality

quality achieved through designs that work together to create an effective *air quality control system* (3.2.2) that allows *operator enclosure* (3.2.1) pressure and effective filtration to be maintained continuously between *planned maintenance intervals* (3.2.4)

3.2.4**planned maintenance interval**

interval when routine maintenance is performed

3.2.5**operator enclosure pressurization**

situation when the *operator enclosure* (3.2.1) *external air* (3.2.7) intake is greater than the operator enclosure leakage

3.2.6**operator enclosure work environment**

space inside the *operator enclosure* (3.2.1)

3.2.7**external air**


controlled air entering the system or opening from outdoors before any air treatment

[SOURCE: ISO 16818:2008, 3.97]

3.3 Terms related to measurement**3.3.1****decay time**

time that it takes for the *airborne particles* (3.1.1) to be removed from the air inside the *operator enclosure work environment* (3.2.6)

Note 1 to entry: See [Figure 2](#).

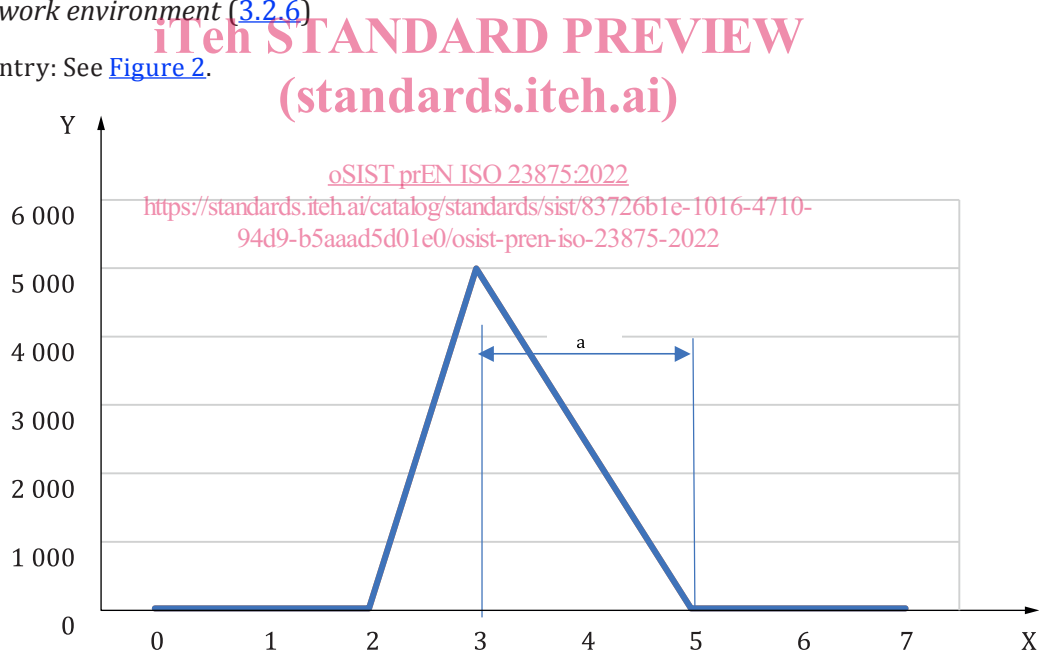

Dust concentration within the operator enclosure starts at $7 \mu\text{g}/\text{m}^3$ and at the 2-minute interval it begins to rise. At the 3-minute interval it peaks at $5\,000 \mu\text{g}/\text{m}^3$, and at the 5-minute interval it returns to $7 \mu\text{g}/\text{m}^3$. In this example, the decay time is two minutes.

Key

X time, min

Y concentration, $\mu\text{g}/\text{m}^3$

a 2 min

Figure 2 — Decay time — Example

ISO 23875:2021(E)

4 Requirements

4.1 Performance requirements

The air quality control system objective is to prevent ingress of respirable particulate matter from the contaminated environment, through means of filtration and operator enclosure pressurization. The air quality control system shall meet the following performance requirements.

- a) The maximum sustained CO₂ shall be the ambient level of CO₂ + 400 ppm, refer to [Annex A](#) for further information.
- b) At the start and the end of the decay test, the maximum respirable particulate matter concentration shall be ≤25 µg/m³.
- c) The respirable particulate decay time shall be of 120 s maximum.
- d) The minimum sustained pressurization, when the machine starting device is in the “on” position (activating the electrical system) shall be ≥ 20 Pa.
- e) The maximum sustained pressurization shall not exceed 200 Pa.

4.2 Engineering design

4.2.1 Operator enclosure

The following requirements shall be met.

- a) The machinery safety standard for the specific machine type shall be consulted when designing or retrofitting an operator enclosure to a machine.
- b) If the operator enclosure is built on the machine, the interface with the machine frame shall be properly sealed to ensure that there are no leakage points created under vibration during machine operations.
- c) Operator ingress, egress, and field of view, and operator enclosure serviceability and maintainability, shall be considered when retrofitting an operator enclosure with an air quality control system.
- d) Operator roll over protective structures (ROPS) and falling-object protective structures (FOPS), or other protective structure systems, shall not be modified without permission from the machine manufacturer.
- e) Consideration should be given to materials used in the enclosure to ensure that they do not accumulate particulate and are easily cleaned. Operator seats should be covered in a smooth, easily cleaned material, for example vinyl.
- f) Weld joints or connections in the engine exhaust system, which are prone to leakage over time, should not be near the external intake air system.
- g) The operator enclosure shall be designed such that all ingress points are sealed so that the system holds pressure. All structural members, such as ROPS and FOPS, weld points, stitch welds, electrical and hydraulic penetrations, windows, etc. shall ensure that the operator enclosure holds pressure sufficiently to meet the minimum pressurization performance requirement, see [4.1 d\)](#), [e\)](#).
- h) Operator enclosures with air quality control system components and plumbing that are built with attachment to two different planes shall have means to relieve the vibration stress, for example by flexible connectors.