## FINAL DRAFT

# INTERNATIONAL STANDARD

ISO/FDIS 11855-3

ISO/TC 205

Secretariat: ANSI

Voting begins on: **2021-05-03** 

Voting terminates on:

2021-06-28

Building environment design — Embedded radiant heating and cooling systems —

Part 3:

Design and dimensioning

Teh ST Conception de l'environnement des bâtiments — Systèmes intégrés de chauffage et de refroidissement par rayonnement — Partie 3: Conception et dimensionnement

ISO/FDIS 11855-3

https://standards.iteh.ai/catalog/standards/sist/817f4773-5073-416d-9f37-ee5c7fa92810/iso-fdis-11855-3

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.

## ISO/CEN PARALLEL PROCESSING



Reference number ISO/FDIS 11855-3:2021(E)

# iTeh STANDARD PREVIEW (standards.iteh.ai)

ISO/FDIS 11855-3

https://standards.iteh.ai/catalog/standards/sist/817f4773-5073-416d-9f37-ee5c7fa92810/iso-fdis-11855-3



## **COPYRIGHT PROTECTED DOCUMENT**

© ISO 2021

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office CP 401 • Ch. de Blandonnet 8 CH-1214 Vernier, Geneva Phone: +41 22 749 01 11 Email: copyright@iso.org Website: www.iso.org

Published in Switzerland

Co	Contents				
Fore	eword		iv		
Intr	oductio	on	v		
1		ne			
_	_				
2		native references			
3		ns and definitions			
4	Syml	bols	1		
5	Radiant panel				
	5.1	Floor heating systems	3		
		5.1.1 Design procedure			
		5.1.2 Heating medium differential temperature	4		
		5.1.3 Characteristic curve	4		
		5.1.4 Field of characteristic curves	4		
		5.1.5 Limit curves	4		
		5.1.6 Downwards thermal insulation	5		
		5.1.7 Procedure for determining the design supply temperature of the heating			
		medium	10		
		5.1.8 Procedure for determining the design heating medium flow rate	13		
	= 0	5.1.9 Peripheral areas			
	5.2	Ceiling heating systems ARD PREVIEW 5.2.1 General	14		
		5.2.1 General	14		
		5.2.2 Limit curvest and artistic hands and selection of the design heating medium flow rate	14		
	5.3	5.2.3 Procedure for determining the design heating medium flow rate	15		
	5.5	F 2.1 Conoral ISO/FDIS 11855-3	15		
		Wall heating systems  5.3.1 General  5.3.2 https://initel.culr.viels.ai/catalog/standards/sist/817f4773-5073-416d-9f37-	15 15		
		5.3.3 Procedure for determining the design heating medium flow rate	15		
	5.4	Floor cooling systems.	16		
	0.1	5.4.1 Design procedure			
		5.4.2 Cooling medium differential temperature			
		5.4.3 Characteristic curve	17		
		5.4.4 Field of characteristic curves			
		5.4.5 Limit curves	17		
		5.4.6 Downwards thermal insulation	17		
		5.4.7 Procedure for determining the supply design temperature of cooling medium	n17		
		5.4.8 Procedure for determining the design cooling medium flow rate	17		
	5.5	Ceiling cooling systems			
	5.6	Wall cooling systems			
Ann	ex A (no	ormative) Thermal insulation for Type A and C	18		
	ingrank		19		

#### Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see <a href="www.iso.org/directives">www.iso.org/directives</a>).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see <a href="https://www.iso.org/patents">www.iso.org/patents</a>).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see <a href="https://www.iso.org/iso/foreword.html">www.iso.org/iso/foreword.html</a>. (standards.iteh.ai)

This document was prepared by Technical Committee ISO/TC 205, *Building environment design*, in collaboration with the European Committee for Standardization (CEN) Technical Committee CEN/TC 228, *Heating systems and water based cooling systems in buildings*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

This second edition cancels and replaces the first edition (ISO 11855-3:2012), which has been technically revised.

The main changes compared to the previous edition are as follows:

- the Scope clause was modified, series-related information has been moved to the Introduction section;
- normative references were modified;
- informative references have been moved to the Bibliography;
- Annex A was added for the calculation of the thermal resistance of the insulating layers.

A list of all parts in the ISO 11855 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at <a href="https://www.iso.org/members.html">www.iso.org/members.html</a>.

### Introduction

The radiant heating and cooling system consists of heat emitting/absorbing, heat supply, distribution, and control systems. The ISO 11855 series deals with the embedded surface heating and cooling system that directly controls heat exchange within the space. It does not include the system equipment itself, such as heat source, distribution system and controller.

The ISO 11855 series addresses an embedded system that is integrated with the building structure. Therefore, the panel system with open air gap, which is not integrated with the building structure, is not covered by this series.

The ISO 11855 series is applicable to water-based embedded surface heating and cooling systems in buildings. The ISO 11855 series is applied to systems using not only water but also other fluids or electricity as a heating or cooling medium. The ISO 11855 series is not applicable for testing of systems. The methods do not apply to heated or chilled ceiling panels or beams.

The object of the ISO 11855 series is to provide criteria to effectively design embedded systems. To do this, it presents comfort criteria for the space served by embedded systems, heat output calculation, dimensioning, dynamic analysis, installation, control method of embedded systems, and input parameters for the energy calculations.

The ISO 11855 series consists of the following parts, under the general title *Building environment design* — *Embedded radiant heating and cooling systems*:

- Part 1: Definitions, symbols, and comfort criteria PREVIEW
- Part 2: Determination of the design heating and cooling capacity
- Part 3: Design and dimensioning
- Part 4: Dimensioning and calculation of the dynamic heating and cooling capacity of Thermo Active Building Systems (TABS)

  ee5c7fa92810/iso-fdis-11855-3
- Part 5: Installation
- Part 6: *Control*
- Part 7: *Input parameters for the energy calculation*

ISO 11855-1 specifies the comfort criteria which should be considered in designing embedded radiant heating and cooling systems, since the main objective of the radiant heating and cooling system is to satisfy thermal comfort of the occupants. ISO 11855-2 provides steady-state calculation methods for determination of the heating and cooling capacity. ISO 11855-3, this document, specifies design and dimensioning methods of radiant heating and cooling systems to ensure the heating and cooling capacity. ISO 11855-4 provides a dimensioning and calculation method to design Thermo Active Building Systems (TABS) for energy saving purposes, since radiant heating and cooling systems can reduce energy consumption and heat source size by using renewable energy. ISO 11855-5 addresses the installation process for the system to operate as intended. ISO 11855-6 shows a proper control method of the radiant heating and cooling systems to ensure the maximum performance which was intended in the design stage when the system is actually being operated in a building. ISO 11855-7 presents a calculation method for input parameters to ISO 52031.

# iTeh STANDARD PREVIEW (standards.iteh.ai)

ISO/FDIS 11855-3 https://standards.iteh.ai/catalog/standards/sist/817f4773-5073-416d-9f37ee5c7fa92810/iso-fdis-11855-3

# Building environment design — Embedded radiant heating and cooling systems —

### Part 3:

# Design and dimensioning

## 1 Scope

This document establishes a system design and dimensioning method to ensure the heating and cooling capacity of the radiant heating and cooling systems.

#### 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 11855-1, Building environment design —Embedded radiant heating and cooling systems — Part 1: Definition, symbols, and comfort criteria

ISO 11855-2:—<sup>1)</sup>, Building environment design CEmbedded radiant heating and cooling systems — Part 2: Determination of the design heating and cooling capacity

ISO 11855-5:—<sup>2)</sup>, Building environment design — Embedded radiant heating and cooling systems — Part 5: Installation ee5c7fa92810/iso-fdis-11855-3

## 3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 11855-1 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <a href="https://www.iso.org/obp">https://www.iso.org/obp</a>
- IEC Electropedia: available at <a href="https://www.electropedia.org/">https://www.electropedia.org/</a>

#### 4 Symbols

For the purposes of this document, the symbols in <u>Table 1</u> apply.

 Symbol
 Unit
 Quantity

  $A_{\rm F}$  m²
 Area of the heating or cooling surface

  $A_{\rm A}$  m²
 Area of the occupied heating or cooling surface

  $A_{\rm R}$  m²
 Area of the peripheral heating or cooling surface

  $C_{\rm Wa}$  J/(kg·K)
 Specific heat of water

Table 1 — Symbols and abbreviated terms

<sup>1)</sup> Second edition under preparation. Stage at the time of publication: ISO/FDIS 11855-2:2021.

<sup>2)</sup> Second edition under preparation. Stage at the time of publication: ISO/FDIS 11855-5:2021

 Table 1 (continued)

Symbol	Unit	Quantity
$K_{\mathrm{H}}$	W/(m <sup>2</sup> ·K)	Equivalent heat transmission coefficient
$l_{\rm p}$	m	Distance between the joists
$l_{W}$	m	Thickness of the joist
$m_{C}$	kg/s	Design cooling medium flow rate
$m_{ m H}$	kg/s	Design heating medium flow rate
$q_{ m des}$	W/m <sup>2</sup>	Design heat flux
$q_{ m des,A}$	W/m <sup>2</sup>	Design heat flux in the occupied area
$q_{ m des,R}$	W/m <sup>2</sup>	Design heat flux in the peripheral area
$q_{ m G}$	W/m <sup>2</sup>	Limit heat flux
$q_{\max}$	W/m <sup>2</sup>	Maximum design heat flux
$Q_{\mathrm{des}}$	W	Design heating/cooling capacity
$Q_{ m N}$	W	Design heating/cooling load
$Q_{\mathrm{N,s}}$	W	Design sensible cooling load
$Q_{ m N,l}$	W	Design latent cooling load
$Q_{ m out}$	W	Heat output of supplementary heating equipment
$R_{ m h,bk}$	(m <sup>2</sup> K)/W	Thermal resistance on the surface of the back side of the wall
R <sub>h,c</sub>	(m <sup>2</sup> K)/W	Thermal resistance on ceiling surface under the floor heated room
$R_{\rm o}$	(m <sup>2</sup> K)/W	Partial inwards thermal resistance of the surface structure
$R_{\rm u}$	(m <sup>2</sup> K)/W	Partial outwards thermal resistance of the surface structure
$R_{\lambda,\mathrm{B}}$	(m <sup>2</sup> ·K)/W	Thermal resistance of surface covering
$R_{\lambda,c}$	(m <sup>2</sup> ·K)/W <sub>https</sub>	Thermal resistance of ceiling slab structure 073-416d-9f37-
$R_{\lambda, \text{ins}}$	(m <sup>2</sup> ·K)/W	Back side thermal resistance of insulating layer
$R_{\lambda,\mathrm{pl}}$	(m <sup>2</sup> ·K)/W	Thermal resistance of plaster layer
$s_{ m ins}$	m	Effective thickness of thermal insulating layer
W	m	Pipe spacing
$h_{C}$	W/(m <sup>2</sup> K)	Heat transfer coefficient at ceiling heating surface
$h_{ m F}$	W/(m <sup>2</sup> K)	Heat transfer coefficient at floor heating surface
$h_{W}$	W/(m <sup>2</sup> K)	Heat transfer coefficient at wall heating surface
$\lambda_{ m ins}$	W/(m·K)	Effective thermal conductivity of the thermal insulation layer
$\lambda_{\mathrm{i}}$	W/(mK)	Thermal conductivity of the thermal insulation layer between the joists
$\lambda_{ m w}$	W/(mK)	Thermal conductivity of the joist
$\theta_{ ext{F,max}}$	°C	Maximum surface temperature
$ heta_{ ext{F,min}}$	°C	Minimum surface temperature
$\theta_{ m i}$	°C	Design indoor temperature
$\theta_{ m R}$	°C	Return temperature of heating or cooling medium
$\theta_{ m V}$	°C	Supply temperature of heating or cooling medium
$ heta_{ extsf{V}, ext{des}}$	°C	Design supply temperature of heating/cooling medium
$\Delta  heta_{ m H}$	K	Heating or cooling medium differential temperature
$\Delta  heta_{ ext{C,des}}$	K	Design cooling medium differential temperature
$\Delta  heta_{ m H,des}$	K	Design heating medium differential temperature
$\Delta  heta_{ ext{H,G}}$	K	Limit of heating/cooling medium differential temperature
$\Delta  heta_{ m V,des}$	K	Design heating/cooling medium differential supply temperature
σ	K	Temperature drop/rise between supply and return medium

### Radiant panel

#### 5.1 Floor heating systems

#### Design procedure 5.1.1

Floor heating system design requires determining heating surface area, type, pipe size, pipe spacing, supply temperature of the heating medium, and design heating medium flow rate. The design steps are as follows.

- Step 1: Calculate the design heating load  $Q_N$ . The design heating load  $Q_N$  shall not include the adjacent heat losses. This step should be conducted in accordance with a standard for heating load calculation, such as EN 12831, based on an index such as operative temperature (OT) (see ISO 11855-1).
- Determine the area of the heating surface  $A_{\rm F}$ , excluding any area covered by immovable objects or objects fixed to the building structure.
- Step 3: Establish a maximum permissible surface temperature in accordance with ISO 11855-1.
- Step 4: Determine the design heat flux  $q_{\rm des}$  according to Formula (1). For floor heating systems including a peripheral area, the design heat flux of peripheral area  $q_{\rm des,R}$  and the design heat flux of occupied area  $q_{\rm des,A}$  shall be calculated respectively on the area of the peripheral heating surface  $A_{\rm R}$ and on the area of the occupied heating surface  $A_A$  complying with Formula (2).

$$q_{\text{des}} = \frac{Q_{\text{N}}}{A_{\text{F}}}$$
 iTeh STANDARD PREVIEW (1)
$$Q_{\text{sec}} = q_{\text{N}} \times A_{\text{sec}} + q_{\text{N}} \times A_{\text{sec}}$$
 (2)

$$Q_{\rm N} = q_{\rm des,R} \times A_{\rm R} + q_{\rm des,A} \times A_{\rm A} \tag{2}$$

- Step 5: For the design of the floor heating systems, determine the room used for design with the maximum design heat flux  $q_{\text{max}=5}q_{\text{des}2810/\text{iso-fdis-}11855-3}$
- Step 6: Determine the floor heating system such as the pipe spacing and the covering type, and design heating medium differential temperature  $\Delta \theta_{\rm H,des}$  based on the maximum design heat flux  $q_{\rm max}$  and the maximum surface temperature  $\theta_{\rm F,max}$  from the field of characteristic curves according to ISO 11855-2 and 5.1.7.
- Step 7: If the design heat flux  $q_{\rm des}$  cannot be obtained by any pipe spacing for the room used for the design, it is recommended to include a peripheral area and/or to provide supplementary heating equipment. In this case, the maximum design heat flux  $q_{\max}$  for the embedded system may now occur in another room. The amount of heat output of supplementary heating equipment  $Q_{\mathrm{out}}$  is determined by Formula (3):

$$Q_{\text{out}} = Q_{\text{N}} - Q_{\text{des}} \tag{3}$$

where design heating capacity  $Q_{\text{des}}$  is calculated by Formula (4):

$$Q_{\rm des} = q_{\rm des} \times A_{\rm F} \tag{4}$$

- Step 8: Determine the backside thermal resistance of insulating layer  $R_{\lambda,ins}$  and the design heating medium flow rate m (see 5.1.6 and 5.1.8).
- Step 9: Estimate the total length of heating circuit.

If intermittent operation is common, the characteristics of the increase of the heat flow and the surface temperature and the time to reach the allowable conditions in rooms just after switching on the system shall be considered.

#### Heating medium differential temperature 5.1.2

Heating medium differential temperature  $\Delta\theta_{\rm H}$  is calculated as follows (refer to ISO 11855-2):

$$\Delta \theta_{\rm H} = \frac{\theta_{\rm V} - \theta_{\rm R}}{\ln \frac{\theta_{\rm V} - \theta_{\rm i}}{\theta_{\rm R} - \theta_{\rm i}}} \tag{5}$$

In this formula, the effect of the temperature drop of the heating medium is taken into account.

#### Characteristic curve 5.1.3

The characteristic curve describes the relationship between the heat flux q and the heating medium differential temperature  $\Delta\theta_{\rm H}$ . For simplicity, the heat flux q is taken to be proportional to the heating medium differential temperature  $\Delta \theta_{\rm H}$ :

$$q = K_{\rm H} \cdot \Delta \theta_{\rm H} \tag{6}$$

where  $K_{\rm H}$  is the equivalent heat transmission coefficient determined in ISO 11855-2 depending on the type of the system.

#### 5.1.4 Field of characteristic curves

The field of characteristic curves of a floor heating system with a specific pipe spacing W shall at least contain the characteristic curves for values of the thermal resistance of surface covering  $R_{\lambda B} = 0$ ,  $R_{\lambda,\mathrm{B}} = 0.05$ ,  $R_{\lambda,\mathrm{B}} = 0.10$  and  $R_{\lambda,\mathrm{B}} = 0.15$  (m<sup>2</sup>K/W), in accordance with ISO 11855-2 (see Figure 1). Values of  $R_{\lambda,\mathrm{B}} > 0.15$  (m<sup>2</sup>K/W) shall not be used if possible ards.iteh.ai


#### 5.1.5 Limit curves

#### ISO/FDIS 11855-3

https://standards.iteh.ai/catalog/standards/sist/817f4773-5073-416d-9f37-The limit curves in the field of characteristic/scurves\_describe\_sin accordance with ISO 11855-2, the relationship between the heating medium differential temperature  $\Delta\theta_{\rm H}$  and the heat flux q in the case where the physiologically agreed limit values of surface temperatures are reached. For design purposes, i.e. the determination of design values of the heat flux and the associated heating medium differential temperature  $\Delta\theta_{H}$ , the limit curves are valid for temperature drop between supply and return medium  $\sigma$  in a range of:

$$0 \text{ K} < \sigma < 5 \text{ K}$$

The limit curves are used to specify the limit of heating medium differential temperature  $\Delta\theta_{\rm H,G}$  and supply temperature (refer to Figure 6).

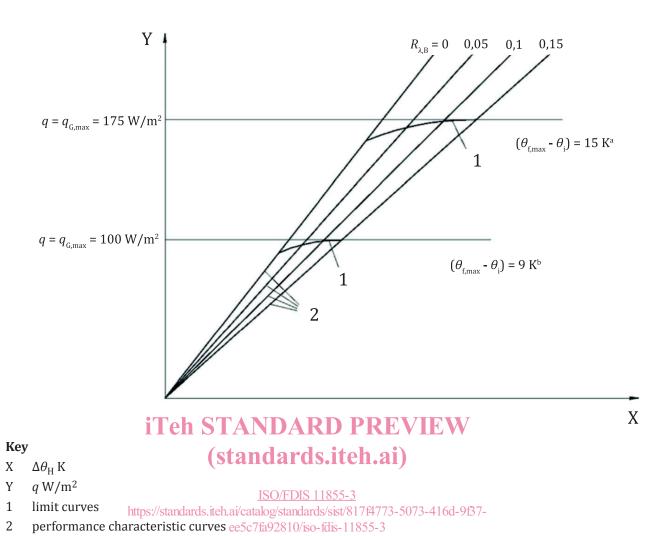

 $Figure \ 1 - Field \ of \ characteristic \ curves, including \ limit \ curves \ for \ floor \ heating, for \ constant \\ pipe \ spacing$ 

This example is for floor heating, indoor temperature = 20 °C and the maximum temperature is 29 °C (occupied areas) and 35 °C (peripheral area). For bathrooms (the indoor temperature is 24 °C), the limit curve for  $(\theta_{E,max} - \theta_i)$  = 9 K also applies.

#### 5.1.6 Downwards thermal insulation

Peripheral area. Occupied area.

In order to limit the heat flow through the floor towards the space below, the required back-side thermal resistance of the insulating layer  $R_{\lambda, \text{ins}}$  shall be specified in the design to be not lower than the value in ISO 11855-5:—, 5.1.2.3.2.

For systems which have a flat insulating layer (types A, B, C, D and G in ISO 11855-2), the back-side thermal resistance of the insulating layer  $R_{\lambda, \text{ins}}$  is calculated by Formula (7) where there is no stud. And the effective thickness of thermal insulating layer  $s_{\text{ins}}$  is identical to the thickness of the thermal insulating panel and the effective thermal conductivity of the thermal insulation layer  $\lambda_{\text{ins}}$  is calculated by Formula (7) where there are studs.

$$R_{\lambda, \text{ins}} = \frac{s_{\text{ins}}}{\lambda_{\text{ins}}} \tag{7}$$