



Designation: ~~F1043-08~~ Designation: F1043 - 10

Standard Specification for Strength and Protective Coatings on Steel Industrial Chain Link Fence Framework¹

This standard is issued under the fixed designation F1043; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

~~1.1 This specification covers the strength and protective coating requirements for industrial steel chain link fence framework. Maximum allowable heights of framework and post spacing are to be based on chain link fence fabric mesh size and gages, and specified wind loads. Post spacings are not to exceed 10 ft. (For additional information, see CLFMI Guide WLG2445~~

1.1 This specification covers the strength and protective coating requirements for industrial steel fence framework. The intended use is for all types of fence, including but not limited to, chain link, expanded metal, wire mesh both welded and woven, PVC and wood. Consult fencing product manufacturer for post spacing requirements. Post spacings for chain link fence are not to exceed 10 ft. (For additional information, see CLFMI Guide WLG2445.)

1.1.1 *Caution Regarding Windload*—If additives to the fence, such as windscreen, inserts, or signage are required, it is advisable to use stronger framework and fittings, to reduce the on-center spacing of posts, or to add back bracing. Factors to consider when determining windload include the type of screening material to be used, area of fence to be covered and local wind conditions.

1.2 Posts and rails may have any cross-sectional shape meeting the requirements herein. The shapes may be formed and welded, cold formed, hot rolled, or extruded.

1.3 The values in inch-pound units are to be regarded as the standard. The values stated in SI units are for information purposes only. ~~Note 1—For aluminum alloy extruded structural pipe and tube please refer to Specification B429/B429M.~~

2. Referenced Documents

2.1 ASTM Standards:²

A90/A90M Test Method for Weight [Mass] of Coating on Iron and Steel Articles with Zinc or Zinc-Alloy Coatings

A123/A123M Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products

A653/A653M Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

~~A875/A875M Specification for Steel Sheet, Zinc-5 % Aluminum Alloy-Coated by the Hot-Dip Process 924/~~
A924M Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process ~~1043-10~~

A1011/A1011M Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength

B6 Specification for Zinc ~~B429/B429M Specification for Aluminum Alloy Extruded Structural Pipe and Tube~~

B750 Specification for GALFAN (Zinc-5 % Aluminum-Mischmetal) Alloy in Ingot Form for Hot-Dip Coatings

D1499 Practice for Filtered Open-Flame Carbon-Arc Exposures of Plastics

D3359 Test Methods for Measuring Adhesion by Tape Test

E8 Test Methods for Tension Testing of Metallic Materials

E376 Practice for Measuring Coating Thickness by Magnetic-Field or Eddy-Current (Electromagnetic) Examination Methods

F552 Terminology Relating to Chain Link Fencing

F934 Specification for Colors for Polymer-Coated Chain Link Fence Materials

F1083 Specification for Pipe, Steel, Hot-Dipped Zinc-Coated (Galvanized) Welded, for Fence Structures

F1553 Guide for Specifying Chain Link Fence

G23 ~~Practice for Operating Light-Exposure Apparatus (Carbon-Arc Type) With and Without Water for Exposure of Nonmetallic Materials (Discontinued 2001)~~

¹ This specification is under the jurisdiction of ASTM Committee F14 on Fences and is the direct responsibility of Subcommittee F14.40 on Chain Link Fence and Wire Accessories.

Current edition approved Aug. Nov. 1, 2008-2010. Published October 2008-December 2010. Originally approved in 1995. Last previous edition approved in 2006-2008 as F1043 - 068. DOI: 10.1520/F1043-108.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For Annual Book of ASTM Standards volume information, refer to the standard's Document Summary page on the ASTM website.

[G26 Practice for Operating Light-Exposure Apparatus \(Xenon-Arc Type\) With and Without Water for Exposure of Nonmetallic Materials \(Discontinued 2001\)](#)–[155 Practice for Operating Xenon Arc Light Apparatus for Exposure of Non-Metallic Materials](#)

2.2 *Other Documents:*

WLG2445 CLFMI Guide for the Selection of Line Post Spacings³

3. Terminology

3.1 *Definitions:*

3.1.1 *posts*—vertical members of the fence.

3.1.1.1 *Discussion*—End, corner, and pull posts are posts at which chain link fabric fencing material terminates. Gateposts are posts to which gates are either attached or latched. Line posts are posts that occur in a line of fence in which the chain link fabric fencing material passes and to which it is held-secured.

3.1.2 *rails*—horizontal members of the fence.

3.1.2.1 *Discussion*—May be top, bottom, intermediate or brace rails.

3.1.3 The dimensional terminology is shown in Fig. 1.

3.1.4 The relationship of measured dimension (used throughout) to trade and industry usage is shown in Table 1.

3.1.5 *open sections*—non-tubular framework sections (such as H-posts, C-posts, and roll-formed top rail, and terminal posts)-rail).

3.1.6 *polymer coatings*—examples of some polymer coatings are acrylic urethane, polyurethane, polyvinyl chloride (PVC), polyester, and polyolefin elastomer.

3.1.7 See Terminology F552 for definitions of other terms.

4. Ordering Information

4.1 Orders for steel fence framework purchased to this specification shall include the following information:

4.1.1 Number of posts and rails by size and length,

4.1.2 Type of outside and inside coating (Section 7) and class of material,

4.1.3 Color, if applicable, in accordance with Specification F934,

4.1.4 ~~Material group (IA, IC, IC-L, II, II-L, III, III-L) (Table 2~~

4.1.4 Material group (IA, IC, IC-L, II, II-L, III, III-L, IV, IV-L) (Tables 2-4),

4.1.5 Certification, if required, and

4.1.6 Exception(s) to this specification, or special requirements, if any.

~~NOTE 2—These 1—These~~ details may be covered in whole or in any part by accompanying the orders with design drawings and notations thereon.

5. Strength Requirements

5.1 It is the intent of this specification to permit the continuance of historically proved practice in the installation of chain link

³ Available from Chain Link Fence Manufacturers Institute, 10015 Old Columbia Road, Suite B-215, Columbia, MD 21046, <http://www.chainlinkinfo.org>.

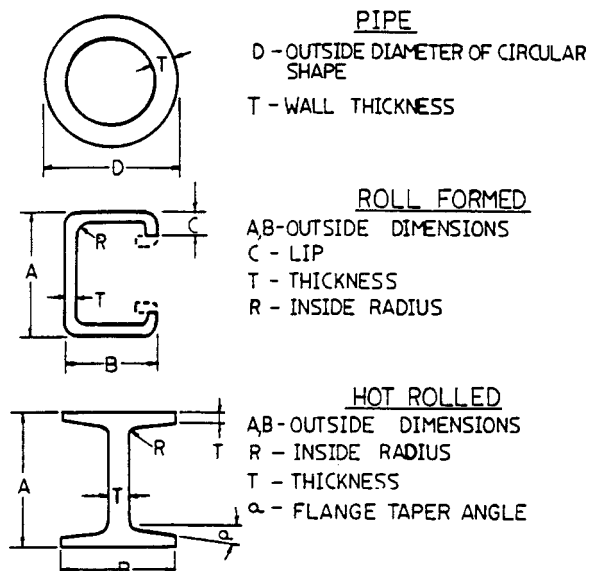


FIG. 1 Definitions of Dimensional Terms

TABLE 1 Pipe Diameter Terminology

Trade Size, in.-(mm)	Actual Outside Diameter	
	in.	mm
1³/₈ (33.40)	1.315	33.40
1³/₈ (33.40)	1.315	33.40
1⁵/₈ (42.16)	1.660	42.16
1⁵/₈ (42.16)	1.660	42.16
1⁷/₈ (48.26)	1.900	48.26
1⁷/₈ (48.26)	1.900	48.26
2³/₈ (60.33)	2.375	60.33
2³/₈ (60.33)	2.375	60.33
2⁷/₈ (73.03)	2.875	73.03
2⁷/₈ (73.03)	2.875	73.03
3¹/₂ (88.90)	3.500	88.90
3¹/₂ (88.90)	3.500	88.90
4 (101.60)	4.000	101.60
4 (101.60)	4.000	101.60
4¹/₂ (114.30)	4.500	114.30
4¹/₂ (114.30)	4.500	114.30
5 (127.00)	5.000	127
5 (127.00)	5.000	127
5⁹/₁₆ (141.30)	5.563	141.3
5⁹/₁₆ (141.30)	5.563	141.3
6³/₈ (168.28)	6.625	168.28
6³/₈ (168.28)	6.625	168.28
8³/₈ (219.08)	8.625	219.08
8³/₈ (219.08)	8.625	219.08

fence systems, and to provide strength requirements for alternative shapes and materials. Two categories are described. Heavy industrial fence represents the most rigid and mechanically durable of the commonly installed framework. Light industrial/commercial fence, as provided herein, exhibits approximately 80 % of the load bearing capability of heavy industrial fence. The summary requirements and options for heavy industrial fence are given in Table 3 and those of light industrial/commercial fence in and those of Light Industrial/Commercial Fence in Table 4.

5.2 *Historical Practice*—Experience has shown that galvanized steel performs satisfactorily as fence posts and rails if furnished to the standard weight (Schedule 40, Regular Grade, 30,000 psi) and nominal sizes listed in Specification F1083. Therefore, fence posts and rails consisting of standard weight (Schedule 40) galvanized steel in the nominal sizes and weight per foot listed in Specification. Therefore, the minimum performance criteria is based on the historical strength of Specification F1083 shall be considered in compliance with this specification. Schedule 40, Regular Grade, 30,000 psi minimum yield.

TABLE 2 Definitions of Fence Framework Materials Design

Material	Description of Material
Group IA Round Steel Pipe	Steel pipe shall be produced to conform to Specification F1083, standard weight (Schedule 40). Weight shall not vary more than 10 % ± from that prescribed.
Group IC/IC-L Round Steel Pipe (Electric Resistance Welded Pipe)	Steel pipe shall be produced in accordance with commercial standards. Minimum yield strength shall be 50 000 psi [344 MPa]. Such products shall include, without seeking to limit to, cold-formed and welded pipe. Weight shall not vary more than 10 % ± from that prescribed.
Group IC/IC-L Round Steel Pipe (Electric Resistance Welded Pipe)	Steel pipe shall be produced in accordance with commercial standards. Minimum yield strength shall be 50 000 psi (344 MPa). Such products shall include, without seeking to limit to, cold-formed and welded pipe. Weight shall not vary more than 10 % ± from that prescribed.
Group II/II-L Roll-Formed Steel Shapes (C-Sections)	Roll formed steel shapes shall be produced to commercial standards. Minimum yield strength shall be 50 000 psi [344 MPa], and 60 000 psi [413 MPa] for the 3.25 in. × 2.50 in. line post sections. The formed lip shall be of the same thickness as the flat elements and shall project no less than 1/3 the width of the flat element being stiffened. Group II products shall be designated such that the strong axis is perpendicular to the line of fence. Weight shall not vary more than 10 % ± from that prescribed.
Group II/II-L Roll-Formed Steel Shapes (C-Sections)	Roll formed steel shapes shall be produced to commercial standards. Minimum yield strength shall be 50 000 psi (344 MPa), and 60 000 psi (413 MPa) for the 3.25 in. × 2.50 in. line post sections. The formed lip shall be of the same thickness as the flat elements and shall project no less than 1/3 the width of the flat element being stiffened. Group II products shall be designated such that the strong axis is perpendicular to the line of fence. Weight shall not vary more than 10 % ± from that prescribed.
Group III/III-L Hot-Rolled Shapes- (H Beams)	Hot-rolled shapes shall meet the specified criteria and exhibit a minimum yield strength of 50 000 psi [344 MPa]. Weight shall not vary more than 10 % ± from that prescribed.
Group III/III-L Hot-Rolled Shapes (H Beams)	Hot-rolled shapes shall meet the specified criteria and exhibit a minimum yield strength of 50 000 psi (344 MPa). Weight shall not vary more than 10 % ± from that prescribed.
Group IV/IV-L Alternate Design	Any suitable design can be delivered, provided it meets the strength and stiffness criteria of Table 3 (Heavy Industrial) or Table 4 (Light Industrial/Commercial) and the producer has supplied, in a form acceptable to the purchaser, data that demonstrates conformance with the specification. At the producer's option the methods in either Section 6 or 6.4 may be used.

TABLE 3 Summary of Requirements for Heavy Industrial Fence Framework

Description	Pipe		Roll-Formed	Hot-Formed	Performance Criteria for Alternative Products
	IA	IC	II	III	
Material	Steel	Steel	Steel	Steel	IV
Reference Specification	F1083 Regular Grade 30 000 psi Intermediate Strength Grade 50 000 psi Available in 5.563 in. O.D. and larger High Strength Grade 83 000 psi A653/A653M, A924/A924M,	A653/A653M, A924/A924M, A1011/A1011M	A1011/A1011M Grade 50; Others		The performance criterion for Alternative Products is as stated in: F1043 Table 2; Group IV/IV-L Alternative Design; 5. Strength Requirements; 6. Strength Calculations; and if requested it is the producers responsibility to provide information for which Group of material this is an Alternative Product. The Alternative Product shall meet or exceed the strength requirements of the referenced Group material.

TABLE 3 *Continued*

Description	Pipe		Roll-Formed	Hot-Formed	Performance Criteria for Alternative Products
	IA	IC	II	III	
Material	Steel	Steel	Steel	Steel	IV
Reference Specification	F1083 Regular Grade 30 000 psi Intermediate Strength Grade 50 000 psi Available in 5.563 in. O.D. and larger High Strength Grade 83 000 psi	A653/A653M, A924/A924M, A1011/A1011M	A1011/A1011M Grade 50, Others		The performance criterion for Alternative Products is as stated in: F1043 Table 2, Group IV/IV-L Alternative Design, 5. Strength Requirements, 6. Strength Calculations, and if requested it is the producers responsibility to provide information for which Group of material this is an Alternative Product. The Alternative Product shall meet or exceed the strength requirements of the referenced Group material.
Minimum Yield Strength, psi [MPa]	30 000 {205} 50 000 {344} For Sizes 5.563 in. O.D. and Larger and 83 000 {572}	50 000 {344} 60 000 {414}	50 000 {344}	50 000 {344}	
Minimum Yield Strength, psi (MPa)	30 000 (205) 50 000 (344) For Sizes 5.563 in. O.D. and Larger and 83 000 (572)	50 000 (344) 60 000 (414)	50 000 (344)	50 000 (344)	
Framework	See Fig. 1 for Definitions of Dimensional Terms				
Rail or Braces	D = 1.660 in. {42 mm} T = 0.140 in. {3.6 mm} 2.27 lb/ft {3.38 kg/m}	D = 1.660 in. {42 mm} T = 0.111 in. {2.8 mm} 1.84 lb/ft {2.74 kg/m}	A = 1.625 in. {41.2 mm} B = 1.25 in. {31.7 mm} C = 0.375 in. {9.5 mm} R = 0.1875 in. {4.76 mm} T = 0.80 in. {2.0 mm} 1.35 lb/ft {2.01 kg/m}		
Rail or Braces	D = 1.660 in. (42 mm) T = 0.140 in. (3.6 mm) 2.27 lb/ft (3.38 kg/m)	D = 1.660 in. (42 mm) T = 0.111 in. (2.8 mm) 1.84 lb/ft (2.74 kg/m)	A = 1.625 in. (41.2 mm) B = 1.25 in. (31.7 mm) C = 0.375 in. (9.5 mm) R = 0.1875 in. (4.76 mm) T = 0.80 in. (2.0 mm) 1.35 lb/ft (2.01 kg/m)		
Line Post	D = 1.900 in. {48 mm} T = 0.145 in. {3.7 mm} 2.72 lb/ft {4.05 kg/m}	D = 1.900 in. {48 mm} T = 0.120 in. {3.0 mm} 2.28 lb/ft {3.39 kg/m}	A = 1.875 in. {47.6 mm} B = 1.625 in. {41.2 mm} C = 0.5625 in. {14.3 mm} R = 0.25 in. {6.4 mm} T = 0.121 in. {3.1 mm} 2.40 lb/ft {3.39 kg/m}		

TABLE 3 *Continued*

Description	Pipe		Roll-Formed	Hot-Formed	Performance Criteria for Alternative Products
	IA	IC	II	III	
Material	Steel	Steel	Steel	Steel	IV
Line Post	D = 1.900 in. (48 mm) T = 0.145 in. (3.7 mm) 2.72 lb/ft (4.05 kg/m)	D = 1.900 in. (48 mm) T = 0.120 in. (3.0 mm) 2.28 lb/ft (3.39 kg/m)	A = 1.875 in. (47.6 mm) B = 1.625 in. (41.2 mm) C = 0.5625 in. (14.3 mm) R = 0.25 in. (6.4 mm) T = 0.121 in. (3.1 mm) 2.40 lb/ft (3.39 kg/m)		
Line or Terminal Post	D = 2.375 in. [60 mm] T = 0.154 in. [3.9 mm] 3.65 lb/ft [5.43 kg/m]	D = 2.375 in. [60 mm] T = 0.130 in. [3.3 mm] 3.12 lb/ft [4.64 kg/m]	A = 2.25 in. [57.2 mm] B = 1.70 in. [43.2 mm] C = 0.75 in. [19.1 mm] R = 0.25 in. [6.4 mm] T = 0.121 in. [3.1 mm] 2.78 lb/ft [4.13 kg/m] (Line Post Only)	A = 2.25 in. [57.2 mm] B = 1.70 in. [43.2 mm] R = 0.25 in. [6.4 mm] a = 10 T = 0.125 in. [3.2 mm] 3.26 lb/ft [4.85 kg/m] (Line Posts Only)	
Line or Terminal Post	D = 2.375 in. (60 mm) T = 0.154 in. (3.9 mm) 3.65 lb/ft (5.43 kg/m)	D = 2.375 in. (60 mm) T = 0.130 in. (3.3 mm) 3.12 lb/ft (4.64 kg/m)	A = 2.25 in. (57.2 mm) B = 1.70 in. (43.2 mm) C = 0.75 in. (19.1 mm) R = 0.25 in. (6.4 mm) T = 0.121 in. (3.1 mm) 2.78 lb/ft (4.13 kg/m) (Line Post Only)	A = 2.25 in. (57.2 mm) B = 1.70 in. (43.2 mm) R = 0.25 in. (6.4 mm) a = 10 T = 0.125 in. (3.2 mm) 3.26 lb/ft (4.85 kg/m) (Line Posts Only)	
Line or Terminal Post	D = 2.875 in. [73 mm] T = 0.203 in. [5.2 mm] 5.79 lb/ft [8.62 kg/m]	D = 2.875 in. [73 mm] T = 0.160 in. [4 mm] 4.64 lb/ft [6.90 kg/m]	A = 3.25 in. [82.6 mm] B = 2.50 in. [64.0 mm] C = 1.00 in. [25.4 mm] R = 0.25 in. [6.4 mm] T = 0.130 in. [3.30 mm] 4.50 lb/ft [6.70 kg/m] (60 000 min yield) (Line Post Only)		
Line or Terminal Post	D = 2.875 in. (73 mm) T = 0.203 in. (5.2 mm) 5.79 lb/ft (8.62 kg/m)	D = 2.875 in. (73 mm) T = 0.160 in. (4 mm) 4.64 lb/ft (6.90 kg/m)	A = 3.25 in. (82.6 mm) B = 2.50 in. (64.0 mm) C = 1.00 in. (25.4 mm) R = 0.25 in. (6.4 mm) T = 0.130 in. (3.30 mm) 4.50 lb/ft (6.70 kg/m) (60 000 min yield) (Line Post Only)		