
**Air intake filter systems for rotary
machinery — Test methods —**

**Part 1:
Static filter elements**

*Systèmes de filtration d'air d'admission pour machines tournantes —
Méthodes d'essai —*

Partie 1: Éléments filtrants pour filtres statiques

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO/PRF 29461-1](https://standards.iteh.ai/catalog/standards/sist/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1)

<https://standards.iteh.ai/catalog/standards/sist/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1>

PROOF / ÉPREUVE



Reference number
ISO 29461-1:2021(E)

iTeh STANDARD PREVIEW (standards.iteh.ai)

[ISO/PRF 29461-1](https://standards.iteh.ai/catalog/standards/sist/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1)

<https://standards.iteh.ai/catalog/standards/sist/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2021

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Symbols and abbreviated terms	2
5 Testing and classification of filter efficiencies	2
6 Determination of the air flow resistance versus the mass of test dust captured	4
7 Conditioning method to determine the minimum fractional test efficiency	5
8 Reporting	5
Annex A (normative) Net area calculation	7
Bibliography	15

iTeh STANDARD PREVIEW (standards.iteh.ai)

[ISO/PRF 29461-1](https://standards.iteh.ai/catalog/standards/sist/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1)

<https://standards.iteh.ai/catalog/standards/sist/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 142, *Cleaning equipment for air and other gases*, in collaboration with the European Committee for Standardization (CEN) Technical Committee CEN/TC 195, *Cleaning equipment for air and other gases*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

This second edition cancels and replaces the first edition (ISO 29461-1:2013), which has been technically revised.

The main changes compared to the previous edition are as follows:

- a new test method, referring to ISO 16890 (all parts) and ISO 29463 (all parts), has been added;
- a classification table has been added;
- previous Annexes A, B, C and D have been deleted; previous Annex E has become [Annex A](#).

A list of all parts in the ISO 29461 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

In rotating machinery applications, the filtering systems, typically a set of filter elements arranged in a suitable manner, are an important part of the whole turbine/compressor system. The development of turbine machinery used for energy production or others has led to more sophisticated equipment; and therefore the importance of good protection of these systems has become more important in the recent years. It is known that particulate contamination can deteriorate a turbine power system quite substantially if not taken care of.

This event is often described as “erosion”, “fouling” and “hot corrosion” where salt and other corrosive particles are known as potential problems. Other particulate matters can also cause significant reduction of efficiency of the systems. It is important to understand that air filter devices in such systems are located in various environmental conditions. The range of climate and particulate contamination is very wide, ranging from deserts to humid rain forests to arctic environments. The requirements on these filter systems are obviously different depending on where they will be operating.

ISO 29461 (all parts) has based the performance of the air intake filter systems not only upon heavy dust collection but also particulate efficiency in a size range that is considered to be the problematic area for these applications. Both ultra-fine and fine particles, as well as larger particles, should be considered when evaluating turbine fouling. In typical outdoor air, ultra-fine and fine particles in the size range from 0,01 μm to 1 μm contribute to > 99 % of the number concentration and to > 90 % of the surface contamination. The majority of the mass normally comes from larger particles (>1,0 μm).

Turbo-machinery filters comprise a wide range of products from filters for very coarse particles to filters for very fine, sub-micron particles. The range of products varies from depth to surface loading systems, which can be regenerated e.g. by pulse cleaning. The filters and the systems have to withstand a wide temperature and humidity range, very low to very high dust concentration and mechanical stress. The shape of products existing today can be of many different types and have different functions such as droplet separators, coalescing products, filter pads, metal filters, inertial filters, filter cells, bag filters, panel-type, cleanable and depth loading filter cartridges and pleated media surface filter elements.

ISO 29461 (all parts) provides a way to compare these products in a similar way and define what criteria are important for air filter intake systems for rotary machinery performance protection. The aim is to compare different filters and filter types with respect to the operating conditions they finally will be used in. For instance, if a filter or a filter system is meant to operate in an extreme, very dusty environment, the real particulate efficiency of such a filter cannot be predicted because the dust loading of the filter plays an important role. A further part of ISO 29461 will address the performance of cleanable and surface loading filters. Filters in turbo-machinery applications can also face very harsh operating conditions such as high air flow rates or water and salt ingress. Further parts of ISO 29461 will address the performance of filters under such harsh conditions.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO/PRF 29461-1](https://standards.iteh.ai/catalog/standards/sist/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1)

<https://standards.iteh.ai/catalog/standards/sist/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1>

Air intake filter systems for rotary machinery — Test methods —

Part 1: Static filter elements

1 Scope

This document specifies methods and procedures for determining the static performance of particulate air filters used in air intake filter systems for rotary machinery such as stationary gas turbines, compressors and other stationary internal combustion engines. It applies to air filters with an efficiency of 85 % or more for the MPPS (EPA and HEPA filters) which are tested according to ISO 29463 (all parts) and filters with a lower efficiency which are tested according to ISO 16890 (all parts). The procedures described in both ISO 16890 (all parts) and ISO 29463 (all parts) are applied and extended by this document to air filters which operate at flow rates within the range 0,24 m³/s (850 m³/h) up to 2,36 m³/s (8 500 m³/h).

Static filter systems normally use multiple stages of coarse, fine and optional EPA or HEPA filter elements to protect the machinery. The scope of this document includes methods for performance testing of individual filter elements. It does not include methods for the direct measurement of the performance of entire systems as installed in service except in cases where they can meet the qualification criteria for the test assembly. Nevertheless, cumulative filter efficiencies of multistage systems of fine filters can be calculated by using the methods described in ISO 16890-1.

This document refers to static (barrier) filter systems but can also be applied to other filter types and systems in appropriate circumstances, for example to evaluate the initial efficiency of cleanable and surface loading filters.

The performance results obtained in accordance with this document cannot be quantitatively applied (by themselves) to predict performance in service with regard to efficiency and lifetime.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 15957, *Test dusts for evaluating air cleaning equipment*

ISO 16890 (all parts), — *Air filters for general ventilation*

ISO 29463 (all parts), — *High efficiency filters and filter media for removing particles from air*

ISO 29464, *Cleaning of air and other gases — Terminology*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 29464 and the following apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

— ISO Online browsing platform: available at <https://www.iso.org/obp>

— IEC Electropedia: available at <http://www.electropedia.org/>

3.1 EPA filter
efficient particulate air filter
filters with performance complying with requirements of filter class ISO T10 to ISO T12 as per this document

Note 1 to entry: EPA filters cannot be and shall not be leak tested.

3.2 initial gravimetric arrestance
 A_{100}
ratio of the mass of a standard test dust retained by the filter to the mass of dust fed after the first 100 g of dust load

Note 1 to entry: This measure is expressed as a weight percentage.

4 Symbols and abbreviated terms

For the application of this document, the following symbols and abbreviated terms apply:

$ePM_{x, \min}$	Minimum efficiency value with $x = 1 \mu\text{m}, 2,5 \mu\text{m}$ or $10 \mu\text{m}$ of the conditioned filter element, % (see ISO 16890-1)
ePM_x	Efficiency with $x = 1 \mu\text{m}, 2,5 \mu\text{m}$ or $10 \mu\text{m}$, % (see ISO 16890-1)
MPPS	Most penetrating particle size

5 Testing and classification of filter efficiencies

Filters with an efficiency of 85 % or more for the MPPS (EPA and HEPA filters) shall be tested according to ISO 29463 (all parts), while filters with a lower efficiency shall be tested according to ISO 16890 (all parts). Filters are classified in groups and classes based on their efficiency as defined in [Table 1](#).

NOTE For the classification of ISO ePM_1 and ISO $ePM_{2,5}$ filters only the $ePM_{x, \min}$ values are used.

HEPA filters (class T13) shall be individually tested and their efficiency determined at MPPS according to ISO 29463-5. Filters shall be individually leak tested according to ISO 29463-4 where, in addition to the reference leak scan method, four alternate methods for leak testing are allowed. For HEPA filters with geometries which do not allow a scan testing, like e.g. cartridges or V-bank filters, the oil thread test method or one of the other suitable (non-scanning) methods described in ISO 29463-4 can be applied. Alternate norms used for leak testing should be clearly identified on the filter and certifications.

In order to extent the volume flow rate and the range of filter geometries (e.g. cylindrical filters), deviations and extensions to the test rig defined by ISO 16890-2 and ISO 29463-5, respectively, are described below.


The test rig consists of several square duct sections with typical 610 mm × 610 mm nominal inner dimensions except for the section where the filter is installed. This section has nominal inner dimensions between 616 mm and 622 mm. The length of this duct section shall be at least 1,1 times the length of the filter, with a minimum length of 1 m as shown in [Figure 1](#) (for more details on the test rig see ISO 16890-2). The filter shall be within the section and shall not protrude out of this section, either upstream or downstream. The test duct may need to have larger dimensions in cases when very large filters or integrated filter-system-element are to be tested. In those cases, other dimensions are allowed as long as the qualification procedures described in ISO 16890-2 are fulfilled. An example of a special (large) filter transition can be seen in [Figures 2](#) and [3](#).

Table 1 — Filter classification

Class	Group	ISO 29463 (all parts)	ISO 16890 (all parts)			
		MPPS efficiency	$ePM_{1, \min}$	$ePM_{2,5, \min}$	ePM_{10}	Initial gravimetric arrestance A_{100}
ISO T1	Coarse					$20 \% < A_{100} < 50 \%$
ISO T2						$\geq 50 \%$
ISO T3						$\geq 70 \%$
ISO T4						$\geq 85 \%$
ISO T5	ePM_{10}				$\geq 50 \%$	
ISO T6	$ePM_{2,5}$			$\geq 50 \%$		
ISO T7	ePM_1		$\geq 50 \%$			
ISO T8			$\geq 70 \%$			
ISO T9			$\geq 85 \%$			
ISO T10	EPA	$\geq 85 \%$				
ISO T11		$\geq 95 \%$				
ISO T12		$\geq 99,5 \%$				
ISO T13	HEPA	$\geq 99,95 \%$				

In case of circular cartridges, the test setup (mounting of the filters in the test duct) shall be as close to the real application as possible. In cases of large cylinders, a mounting plate with an additional hole for the air inlet/outlet can be sufficient (see Figure 4). In terms of much smaller cylinders an additional transition could be inserted in the duct (see Figure 3). This shall however be analysed specifically for each construction, taking into consideration possible jetting effect that can affect the velocity and aerosol concentration in the test duct cross section.


<https://standards.iteh.ai/catalog/standards/sat/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1>

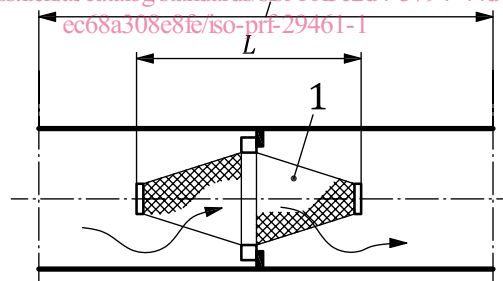

Key


- 1 filter to be tested
- L filter length
- a Duct section length (<1 000 mm and/or $1,1 \times L$).

Figure 1 — Duct section including filter to be tested

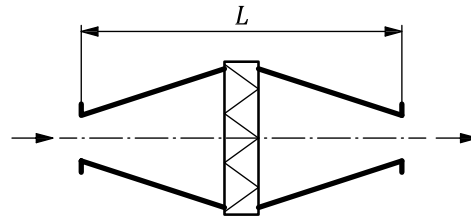

Key
 L filter length

Figure 2 — Example of a filter section with transition for special filter constructions

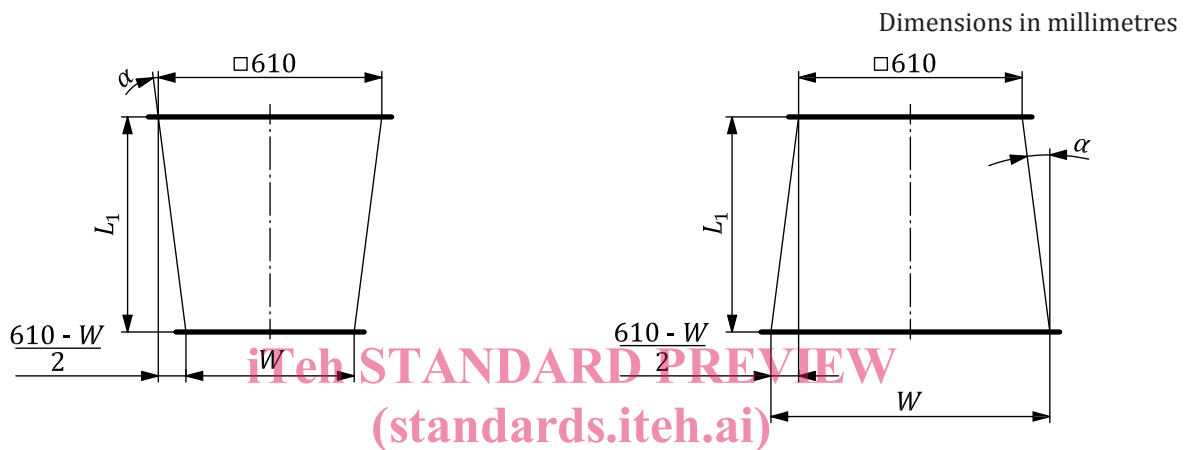

a) Mounting filter smaller than the test duct b) Mounting filter larger than the test duct
 ISO/PRF 29461-1

Key
 L_1 length of the transition duct
 W width of the filter element to be tested
 α angle of maximum 7°
<https://standards.iteh.ai/catalog/standards/sist/10f5c2d4-3794-44d4-a1af-ec68a308e8fe/iso-prf-29461-1>

Figure 3 — Details of transition ducts for mounting filters

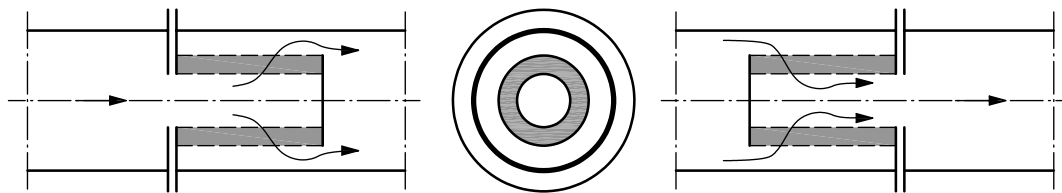


Figure 4 — Examples of mounting circular cartridges in the test duct

6 Determination of the air flow resistance versus the mass of test dust captured

For the determination of the air flow resistance versus the mass of test dust captured, the procedures described in ISO 16890-3 shall be applied. The synthetic loading dust as specified in ISO 15957 as L2 shall be used as a loading dust for reporting results. Filters with particle removal efficiency $ePM_{10} < 50\%$ (ISO coarse according to ISO 16890-1) shall be loaded to a final resistance to air flow of 375 Pa, while filters with a particle removal efficiency $ePM_{10} \geq 50\%$ (fine filter groups ISO ePM_{10} , ISO $ePM_{2,5}$ and ISO ePM_1 according to ISO 16890 (all parts)) and EPA and HEPA filters up to ISO 45H according to ISO 29463-1 shall be loaded to a final resistance to air flow of 625 Pa. As additional data

points, higher values for the final resistance to air flow can be defined between vendor and buyer for information.

The first 100 g dust loading (or 15 Pa increase, whichever comes first) gives the initial gravimetric arrestance; and the additional dust increments should give a smooth curve arrestance versus dust loading up to the final resistance

7 Conditioning method to determine the minimum fractional test efficiency

Certain types of filter media rely on electrostatic effects to achieve high efficiencies at low resistance to airflow. Exposure to some types of challenge, such as combustion particles or other fine particles, can inhibit such electrostatic effects with the result that filter performance suffers. The test procedure described in ISO 16890-4 and ISO 29463-5 provides techniques for identifying this type of behaviour. This procedure is used to determine whether the filter particulate efficiency is dependent on the electrostatic removal mechanism and to provide quantitative information about the importance of the electrostatic removal. Applying these procedures is a mandatory part of the filter testing and classification of filters according to this document.

8 Reporting

The one-page summary section of the performance report according to this document shall include the following information:

- General:
 - a) testing organization including name, location and contact information;
 - b) report number;
 - c) date of the report;
 - d) name of report supervisor;
 - e) test(s) requested by;
 - f) date when and how the tested device (filter) was obtained.
- Manufacturer's data of the tested device:
 - g) manufacturer's name (or name of the marketing organization, if different from the manufacturer);
 - h) brand and model name or number as marked on the tested device (full identification of the tested device); in case of HEPA filters, each filter shall be marked with an individual identifier, which allows to link the filter element to the individual test report;
 - i) description of the physical construction (e.g. pocket filter, number of pockets);
 - j) dimensions (width, height, depth);
 - k) type of medium, if possible or available the following shall be described:
 - identification code (e.g. glass fibre type ABC123, inorganic fibre type 123ABC);
 - net effective filtering area as determined by the testing organization according to [Annex A](#);
 - in case of HEPA filters the MPPS of the filter medium as tested per ISO 29463-3;
 - l) additional information if needed;
 - m) a photo of the actual test device is highly recommended, but not required.