



Designation: F1554 – 07a^{ε1}

Standard Specification for Anchor Bolts, Steel, 36, 55, and 105-ksi Yield Strength¹

This standard is issued under the fixed designation F1554; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

^{ε1} NOTE—Table S1.2 was editorially corrected in October 2011.

1. Scope*

1.1 This specification covers straight and bent, headed and headless, carbon, carbon boron, alloy, or high-strength low-alloy steel anchor bolts (also known as anchor rods). The anchor bolts are furnished in three strength grades, two thread classes, and in the sizes specified in Section 4.

1.2 The anchor bolts are intended for anchoring structural supports to concrete foundations. Such structural supports include building columns, column supports for highway signs, street lighting and traffic signals, steel bearing plates, and similar applications.

1.3 Supplementary requirements are included to provide for Grade 55 weldable steel, permanent manufacturers and grade identification, and impact properties for Grades 55 and 105.

1.4 Zinc coating requirements are included in Section 7 for applications requiring corrosion protection.

1.5 The recommended grade and style of nut and washer are included in 6.6 and 6.7 for each grade.

1.6 This specification does not cover the requirements for mechanical expansion anchors, powder-activated nails or studs, or anchor bolts fabricated from deformed bar.

1.7 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are for information only.

2. Referenced Documents

2.1 *ASTM Standards*:²

[A194/A194M Specification for Carbon and Alloy Steel Nuts for Bolts for High Pressure or High Temperature Service, or Both](#)

¹ This specification is under the jurisdiction of ASTM Committee F16 on Fasteners and is the direct responsibility of Subcommittee F16.02 on Steel Bolts, Nuts, Rivets and Washers.

Current edition approved Dec. 1, 2007. Published January 2008. Originally approved in 1994. Last previous edition approved in 2007 as F1554 – 07. DOI: 10.1520/F1554-07A.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

[A370 Test Methods and Definitions for Mechanical Testing of Steel Products](#)

[A563 Specification for Carbon and Alloy Steel Nuts](#)

[A673/A673M Specification for Sampling Procedure for Impact Testing of Structural Steel](#)

[A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products](#)

[B695 Specification for Coatings of Zinc Mechanically Deposited on Iron and Steel](#)

[D3951 Practice for Commercial Packaging](#)

[F436 Specification for Hardened Steel Washers](#)

[F606 Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, Direct Tension Indicators, and Rivets](#)

[F2329 Specification for Zinc Coating, Hot-Dip, Requirements for Application to Carbon and Alloy Steel Bolts, Screws, Washers, Nuts, and Special Threaded Fasteners](#)

[2.2 Research Council on Structural Connections Standard: Specification for Structural Joints Using ASTM A325 or A490 Bolts](#)

[2.3 ASME Standards](#):⁴

[B 1.1 Unified Screw Threads](#)

[B 1.3 Screw Thread Gaging Systems for Dimensional Acceptability](#)

[B 18.2.2 Square and Hex Nuts](#)

[B 18.18.2M Inspection and Quality Assurance for High Volume Machine Assembly Fasteners](#)

3. Terminology

3.1 *Definitions of Terms Specific to This Standard*:

3.1.1 *anchor bolt*—steel rod or bar, one end of which is intended to be cast in concrete, while the opposite end is threaded and projects from the concrete, for anchoring other material to the concrete. The end cast in concrete may be either straight or provided with an anchor such as a bent hook, forged head, or a tapped or welded attachment to resist forces imposed on the anchor bolt, as required.

³ Available from Research Council on Structural Connections, c/o Industrial Fasteners Institute, 1717 East 9th Street, Cleveland, OH 44114.

⁴ Available from American Society of Mechanical Engineers (ASME), ASME International Headquarters, Three Park Ave., New York, NY 10016-5990, http://www.asme.org.

*A Summary of Changes section appears at the end of this standard

3.1.2 *manufacturer*—manufacturer of the anchor bolt; the party that performs the cutting, bending, and threading operations.

3.1.3 *producer*—manufacturer of the steel rods or bars.

3.1.4 *purchaser*—purchaser of the finished anchor bolt, or his designated agent.

3.1.5 *responsible party*—see Section 18; this may be the manufacturer or supplier.

3.1.6 *supplier*—agent who furnishes the finished anchor bolt and nuts to the purchaser; this may be the manufacturer.

4. Classification

4.1 The anchor bolts are furnished in three grades denoting minimum yield strength and two classes denoting thread class as follows:

Grade	Tensile Strength, ksi (MPa)	Description Yield Strength, min, ksi (MPa)	Size Range, in. (mm)
36 ^A	58–80 (400–558)	36 (248)	¼–4 (6.4–102)
55	75–95 (517–655)	55 (380)	¼–4 (6.4–102)
105	125–150 (862–1034)	105 (724)	¼–3 (6.4–76)
Class			
1A	anchor bolts with Class 1A threads		
2A	anchor bolts with Class 2A threads		

^A When Grade 36 is specified, a weldable Grade 55 may be furnished at the supplier's option.

4.2 Weldable steel for Grade 55 is provided for in Supplementary Requirement SI.

5. Ordering Information

5.1 Orders for anchor bolts should include the following information:

5.1.1 *Quantity (Number of Pieces)*—If the purchaser intends to perform destructive tests on finished anchor bolts, the manufacturer should be advised so that an adequate number are produced, especially for the sizes and types not readily available from stock.

5.1.2 Name of product (steel anchor bolt).

5.1.3 ASTM designation and year of issue.

5.1.4 Grade and class, that is, Grade 36, 55, or 105 and Class 1A or 2A. Weldable Grade 55 may be furnished when Grade 36 is ordered (see 4.1).

5.1.5 Copper, if copper bearing steel is required.

5.1.6 *Size and Dimensions*—Include the diameter and threads (based on nominal thread diameter), bolt length, thread length, and length of hook if a hook is required, or provide a drawing showing the required information.

5.1.7 Zinc coatings in accordance with 7.1. When zinc coatings in accordance with 7.1 are required, specify the zinc coating process to be used, that is, hot dip, mechanically deposited, or no preference (see 7.1). Also, specify the length to be coated as measured from the exposed end.

5.1.8 *Other Coatings*—Specify other protective coatings, if required (see 7.2).

5.1.9 Number of nuts, either the total number or number per bolt.

5.1.10 Number of washers, either the total number or number per bolt, and dimensions if other than standard.

5.1.11 Inspection at place of manufacture, if required (see 15.1).

5.1.12 Color coding, if different from the standard in 19.1.

5.1.13 Test reports, if required (see 17.1).

5.1.14 Supplementary requirements, if required.

5.1.15 Special requirements, if required.

NOTE 1—An example of a typical order follows: 5000 pieces; steel anchor bolts; ASTM designations including issue date; Grade 55; Class 2A; Supplementary Requirement S 1; 1.0-8-in. thread size by 15-in. long, 3.0-in. thread length, 4.0-in. hook; zinc coated by hot dipping 5.0 in. from exposed end; each with one zinc-coated nut and washer; test report required.

6. Materials and Manufacture

6.1 *Process*—Steel for anchor bolts shall be made by the open-hearth, basic-oxygen, or electric-furnace process.

6.2 *Threading*—Threads shall be rolled, cut, or ground at the option of the manufacturer, unless otherwise specified.

6.3 *Heat Treatment:*

6.3.1 When required, the anchor bolts may be heat treated to develop the specified properties. Heat treatment shall be at the option of the manufacturer.

6.3.2 Heat treatment may be performed prior to or after bending or threading.

6.3.3 When heat treatment is required, the anchor bolts shall be heat treated by quenching in a liquid medium from above the transformation temperature and then tempering by reheating to a temperature not less than 800°F (425°C) for Grade 55 and 1100°F (593°C) for Grade 105.

6.4 *Bending:*

6.4.1 When required, hooks, shall be made by cold bending or hot bending. The bent portion shall be free from cracks when examined at 10× magnification after bending.

6.4.2 Hot bending performed on bar stock without heat treatment shall not have the temperature exceed 1300°F (705°C) at any location during hot bending and shall be allowed to air cool after bending.

6.4.3 Hot bending performed on heat-treated bar stock shall not have the temperature come within 100°F (56°C) of the tempering (stress relieve) temperature of the heat-treat process at any location during hot bending and shall be allowed to air cool after bending.

6.4.4 The bending shall not reduce the cross-sectional area below that required in 10.3.

6.5 *Secondary Processing*—If a subcontractor, or party other than the manufacturer or producer, performs heat treatment, coating, welding, machining, or other process affecting the properties or performance of the anchor bolts, the anchor bolts shall be inspected and tested after such processing by the party responsible for supplying the anchor bolts to the purchaser.

6.6 *Recommended Nuts:*

6.6.1 Unless otherwise specified, all nuts used on these anchor bolts shall conform to the requirements of Specifications A194/A194M or A563 and shall be of the grade, surface finish, and style for each grade and size of anchor bolt as follows:

Anchor Bolt Grade and Size, in. (mm)		Specification A563 Plain		Recommended Nut Hot-Dip or Mechanical Zinc Coated in accordance with 7.1	
Grade	Size, in. (mm)	Grade	Style	Grade	Style
36	¼ – 1½ (6.4–38) over 1½ – 4.0 (38–102)	A	Hex	A	Hex
		A	Heavy Hex	A	Hvy Hex
55	¼ – 1½ (6.4–38) over 1½ – 4.0 (38–102)	A	Hex	A	Hvy Hex
		A	Heavy Hex	A	Hvy Hex
105	¼ – 1½ (6.4–38) over 1½ – 3.0 (38–76)	D	Hex	DH	Hvy Hex
		DH	Heavy Hex	DH	Hvy Hex

6.6.2 The requirements for the recommended grade and style of nut may be fulfilled by furnishing a nut of one of the grades or styles listed in Specifications A194/A194M or A563 having a proof load stress equal to or higher than the minimum tensile strength specified for the anchor bolt.

6.7 Recommended Washers:

6.7.1 The washer material and dimensions shall be specified in the inquiry and the order (see Note 2).

6.7.2 Unless the requirement of 6.7.1 is met, washers conforming to the requirements of Specification F436, Type 1 shall be furnished.

6.7.3 When anchor bolts are specified to be zinc coated, the washers shall be zinc coated as specified in 7.1, except that the coating process for the washers need not be the same as that for the anchor bolts and nuts.

NOTE 2—Washers used on anchor bolts, installed in holes with dimensions greater than oversize or short slot as defined by the Research Council on Structural Connections, require design consideration. (For guidance refer to Specification for Structural Joints Using ASTM A325 or A490 Bolts.)

7. Protective Coatings

7.1 Zinc, Hot Dip or Mechanically Deposited—Specification F2329, and mechanically deposited, Specification B695, Class 55.

7.1.1 When zinc-coated anchor bolts with the coating specified in 7.1 are required, the purchaser shall specify the zinc coating process, for example, hot dip, mechanically deposited, or no preference.

7.1.2 When hot-dip is specified, the fasteners shall be zinc coated by the hot-dip process in accordance with the requirements of Specification F2329.

7.1.3 When mechanically deposited is specified, the fasteners shall be zinc coated by the mechanical deposition process in accordance with the requirements of Class 55 of Specification B695.

7.1.4 When no preference is specified, the supplier may furnish either a hot-dip zinc coating in accordance with Specification F2329, or a mechanically deposited zinc coating in accordance with Specification B695, Class 55. Threaded components (bolts and nuts) shall be coated by the same zinc-coating process, and the supplier’s option is limited to one process per item, with no mixed processes in a lot.

7.2 Other Coatings:

7.2.1 Coatings other than the zinc coatings specified in 7.1 shall be as specified by the purchaser on the purchase order.

7.2.2 The complete specification shall be included as part of the purchase order when other coatings are specified.

8. Chemical Composition

8.1 Anchor bolts shall have a chemical composition conforming to the requirements listed in Table 1 for Grade 36 and Table 2 for Grades 55 and 105.

8.2 Grade 55 ordered as weldable shall conform to the requirements specified in Supplementary Requirement S1.

8.3 Anchor bolts made from low-carbon martensitic steel shall not be permitted.

8.4 The application of heats of steel to which bismuth, selenium, tellurium, or lead has been added intentionally shall not be permitted.

8.5 Product analyses may be made by the purchaser from finished anchor bolts representing each heat. The chemical composition thus determined shall conform to the requirements specified in 8.1 through 8.4.

9. Mechanical Properties

9.1 Bars—The bars or rods from which the anchor bolts are made shall conform to the tensile properties listed in Table 3, except when heat treated after bending or threading.

9.2 Anchor Bolts—The finished anchor bolts shall conform to the tensile properties listed in Table 3 for tests on machined specimens and Table 4 for axial tests on full-size threaded anchor bolts.

10. Anchor Bolt Dimensions

10.1 Nominal Size—The nominal anchor bolt diameter shall be the same as the nominal thread diameter.

10.2 Body Diameter:

10.2.1 When threads are rolled, the body diameter shall not be less than the minimum pitch diameter for the thread class, 1A or 2A, designated by the purchaser and specified in

TABLE 1 Chemical Requirements for Grade 36

Element	Diameter, in. (mm)		
	To ¾ (20), incl	Over ¾ to 1½ (20 to 40), incl	Over 1½ to 4 (40 to 100), incl
Carbon, max, %			
Heat	0.26	0.27	0.28
Product	0.29	0.30	0.31
Manganese, %			
Heat	A	0.60–0.90	0.60–0.90
Product	A	0.54–0.98	0.54–0.98
Phosphorus, max, %			
Heat	0.04	0.04	0.04
Product	0.05	0.05	0.05
Sulfur, max, %			
Heat	0.05	0.05	0.05
Product	0.06	0.06	0.06
Copper, min, % (when specified)			
Heat	0.20	0.20	0.20
Product	0.18	0.18	0.18

^A Optional with the manufacturer but shall be compatible with weldable steel.

TABLE 2 Chemical Requirements for Grades 55 and 105

Element	Composition, %	
	Heat Analysis	Product Analysis
Phosphorus, max	0.040	0.048
Sulfur, max	0.050	0.058
Copper, min (when Cu is specified)	0.20	0.18

TABLE 3 Tensile Properties for Bars and Machined Specimens

	Grade		
	36	55	105
Tensile strength, ksi	58–80	75–95	125–150
Tensile strength, MPa	(400–552)	(517–655)	(862–1034)
Yield strength, min, ksi (0.2 % offset)	36	55	105
Yield strength, min, MPa (0.2 % offset)	248	380	724
Elongation in 8 in. (200 mm), min, % ^A	20	18	12
Elongation in 2 in. (50 mm), min, % ^A	23	21	15
Reduction of Area, min, %			
¼ to 2 in. (6.4 to 50 mm), incl	40	30	45
over 2 to 2½ in. (50 to 63 mm), incl	40	22	–45
over 2½ to 3 in. (63 to 76), incl	40	20	45
over 3 to 4 in. (76 to 102 mm), incl	40	18	...

^A Elongation in 8 in. (200 mm) applies to bars. Elongation in 2 in. (50 mm) applies to tests on machined specimens.

ANSI/ASME B 1.1. Class 2A shall be furnished when the thread class is not specified.

10.2.2 The body diameter shall not be less than the minimum major diameter when threads are cut.

10.2.3 The minimum body diameters are listed in **Table 5** based on the requirements specified in 10.2.1 and 10.2.2.

10.3 *Bend Section*—The bend section of bent anchor bolts shall have a cross-sectional area not less than 90 % of the area of straight portions. The area in the bend shall be calculated by the following formula: $A_b = 0.25\pi D \cdot d$

where

A_b = cross-sectional area in the bend,

d = minor (or minimum) diameter at any point, generally in the plane of the bend, and

D = major diameter, at the same cross section as, and at 90 degrees to, the minor diameter.

10.4 Length:

10.4.1 The overall length of straight anchor bolts, or length to the inside of the hook, shall be the specified length $\pm 1/2$ in. (13 mm) for lengths 24 in. (600 mm) or less, and ± 1 in. (25 mm) for longer bolts (see **Fig. 1**).

10.4.2 The length of hooks shall be the specified length, ± 10 % of the specified hook length, or $\pm 1/2$ in. (13 mm), whichever is greater.

10.5 *Bend Angle*—The bend angle of hooks shall not vary from that specified by more than $\pm 5^\circ$.

10.6 *Coated Length*—When only the exposed end of the anchor bolt is required to be zinc coated, the length of zinc coating shall not be less than that specified on the order.

10.7 Other Dimensions:

10.7.1 Tolerances for dimensions other than those given in **10.1** through **10.6** shall be as specified by the purchaser.

10.7.2 When tolerances are not specified, they shall be in accordance with the manufacturer’s documented standard practice.

11. Thread Dimensions

11.1 Uncoated Anchor Bolts:

11.1.1 Unless otherwise specified, uncoated threads shall be Unified Coarse Thread Series as specified in the latest issue of ANSI/ASME B 1.1, and they shall have Class 1A or 2A tolerances, as specified by the purchaser. Class 2A shall be furnished when the class is not specified.

11.1.2 When required, anchor bolts having a nominal diameter greater than 1.0 in. (25.5 mm) may be specified to have threads conforming to the 8-Thread Series (8 UN Series) in ANSI/ASME B 1.1, and they shall have Class 2A tolerances.

11.2 Anchor Bolts Zinc Coated in Accordance With 7.1, Specification F2329, and Specification B695, Class 55:

11.2.1 Unless otherwise specified, anchor bolts hot dip or mechanically zinc coated in accordance with 7.1.1 through 7.1.4 (requiring overtapped nuts, see **Note 3**) shall be the Unified Coarse Thread Series and shall have Class 1A or 2A threads, as specified by the purchaser, before zinc coating. After zinc coating, and due to the zinc buildup, the pitch and major diameters for hot-dip zinc-coated anchor bolts shall not exceed the dimensions listed in **Table 6**.

NOTE 3—Zinc-coated nuts of the grade and style recommended in 6.6.1, when overtapped the diametral allowance for the thread series listed in the table entitled “Thread Dimensions and Overtapping Allowances for Nuts” in Specification A563, will develop the bolt tensile strength required in **Table 4** of this specification.

11.2.2 Thread conformance shall be verified during manufacture. In case of dispute, a calibrated thread ring gage of the same size as the oversize limit specified in 11.2.1 (Class X tolerance, gage tolerance plus) shall be used to verify compliance. Assembly of the gage shall be possible with hand effort, following the application of light machine oil to prevent galling and damage to the gage.

11.3 *Thread Length*—The thread length shall not vary from that specified more than +1.0 in. (25.5 mm), –0.00 in. (0.00 mm).

11.4 *Thread Gaging System*—Thread acceptability shall be in accordance with System 21 or ANSI/ASME B 1.3, unless otherwise specified.

12. Workmanship

12.1 Anchor bolts shall be commercially smooth and free of burrs, laps, seams, cracks, and other injurious manufacturing defects that would make them unsuitable for the intended application.

13. Number of Tests and Retests

13.1 Testing Responsibility:

13.1.1 The anchor bolt manufacturer or supplier, whichever is the responsible party as defined in Section 18, shall be responsible for conducting or ensuring that the required tests have been conducted to determine compliance with all of the requirements of this specification and the purchaser order.

TABLE 4 Axial Tensile Properties for Full-Size Anchor Bolts

Nominal Size, in.	Threads/ in.	Stress Area, ^A in. ²	Anchor Bolt Grade					
			36		55		105	
			Tensile Strength, ^B klf	Yield Strength, ^{BC} min, klf	Tensile Strength, ^B klf	Yield Strength, ^{BC} min, klf	Tensile Strength, ^B klf	Yield Strength, ^{BC} min, klf
Unified Coarse Thread Series (UNC)								
1/4	20 UNC	0.0318	1.89–2.54	1.15	2.4–3.0	1.75	3.98–4.27	3.34
3/8	16 UNC	0.0775	4.5–6.2	2.8	5.8–7.36	4.26	9.7–11.6	8.14
1/2	13 UNC	0.1419	8.2–11.4	5.1	10.6–13.5	7.8	17.7–21.3	14.9
5/8	11 UNC	0.226	13.1–18.1	8.1	17.0–21.5	12.4	28.2–33.9	23.7
3/4	10 UNC	0.334	19.4–26.7	12.0	25.0–31.7	18.4	41.8–50.1	35.1
7/8	9 UNC	0.462	26.8–37.0	16.6	34.6–43.9	25.4	57.8–69.3	48.5
1	8 UNC	0.606	35.2–48.5	21.8	45.4–57.6	33.3	75.8–90.9	63.6
1 1/8	7 UNC	0.763	44.3–61.0	27.5	57.2–72.5	42.0	95.4–114.4	80.1
1 1/4	7 UNC	0.969	56.2–77.5	34.9	72.7–92.1	53.3	121–145	102
1 1/2	6 UNC	1.405	81.5–112.4	50.6	105.0–133.0	77.3	176–216	148
1 3/4	5 UNC	1.90	110–152	68.4	142–180	104.5	238–285	200
2	4 1/2 UNC	2.50	145–200	90.0	188–238	138	312–375	262
2 1/4	4 1/2 UNC	3.25	188–260	117	244–309	179	406–488	341
2 1/2	4 UNC	4.0	232–320	144	300–380	220	500–600	420
2 3/4	4 UNC	4.93	286–394	177	370–468	271	616–740	518
3	4 UNC	5.97	346–478	215	448–567	328	746–896	627
3 1/4	4 UNC	7.10	412–568	256	532–674	390
3 1/2	4 UNC	8.33	483–666	300	625–791	458
3 3/4	4 UNC	9.66	560–773	348	724–918	531
4	4 UNC	11.08	643–886	399	831–1053	609
8 Thread Series (8 UN)^D								
1 1/8	8 UN	0.790	45.8–63.2	28.4	59.2–75.0	43.4	98.8–118.5	83.0
1 1/4	8 UN	1.000	58.0–80.0	36.0	75.0–95.0	55.0	125–150	105
1 1/2	8 UN	1.492	86.5–119.4	53.7	112–142	82.1	186–224	157
1 3/4	8 UN	2.08	121–166	74.9	156–198	114	260–312	218
2	8 UN	2.77	161–222	99.7	208–263	152	346–416	291
2 1/4	8 UN	3.56	206–285	128	267–338	196	445–534	374
2 1/2	8 UN	4.44	258–355	160	333–422	244	555–666	466
2 3/4	8 UN	5.43	315–434	195	407–516	299	679–815	570
3	8 UN	6.51	378–521	234	488–618	358	814–976	684
3 1/4	8 UN	7.69	446–615	277	577–731	423
3 1/2	8 UN	8.96	520–717	323	672–851	493
3 3/4	8 UN	10.34	600–827	372	776–982	569
4	8 UN	11.81	685–945	425	886–1122	650

^A Stress areas extracted from ANSI/ASME B 1.1.

^B Tensile properties calculated from the tensile requirements given in [Table 3](#).

^C Yield strength measured at 0.2 % offset.

^D Anchor bolts to 1 3/4 in. (44.5 mm) and larger with 8 UN threads and the nuts overlapped to the limits stated in 11.2.1 will not develop the tensile strength in [Table 4](#) when the bolt and nut dimensions approach the minimum material limits of ANSI/ASME B 1.1 and B 18.2.2. See 11.2.1 for thread series that have been qualified for strength when the nuts are overlapped to the limits stated in 11.2.1.

13.1.2 Reports of tension tests, conducted by the steel producer on bar stock used to manufacture the anchor bolts without additional heat treatment, may be used to qualify the finished anchor bolt tensile properties.

13.1.3 The purchaser shall be permitted to perform any of the tests and inspections listed in this specification or the purchaser order.

13.2 Lot Definition:

13.2.1 *Bar Stock Tensile Tests*—For tensile tests conducted by the steel producer on bars to be used for the manufacture of anchor bolts, a lot shall consist of bars from the same heat, having the same diameter, and, if heat treated, heat treated in the same furnace lot.

13.2.2 *All Other Tests*—A lot is a quantity of product of one part number made by the same production process and subsequently submitted for final inspection at one time. The maximum lot size traceable to final inspection shall not be larger than 250 000 pieces.

13.3 Test Frequency:

13.3.1 The number of tests shall be as follows and in [Table 7](#) and [Table 8](#):

Test	Number of Tests
Composition	one per heat, minimum
Tensile tests	
Bar stock	one per lot, min, as defined in 13.2.1
Anchor bolts	in accordance with Table 7 and Table 8 on each lot defined in 13.2.2
Coating weight and thickness	
Dimensions	
Thread conformance	in accordance with Table 7 and Table 8 on each lot defined in 13.2.2
Workmanship	
Overall compliance	


13.3.2 When the identity to a specific heat number (and furnace lot number for heat-treated bars) has not been maintained, the number of tests for all requirements, including tensile, shall be based on the quantity of anchor bolts of a given description as shown in [Table 8](#).

TABLE 5 Minimum Body Diameter


Nominal Size, in.	Threads/ in.	Body Diameter, min, in.		
		Rolled Threads ^A		Cut Threads ^B Classes 1A and 2A
		Class 1A	Class 2A	
Unified Coarse Thread Series (UNC)				
1/4	20 UNC	0.2108	0.2127	0.2367
3/8	16 UNC	0.3266	0.3287	0.3595
1/2	13 UNC	0.4411	0.4435	0.4822
5/8	11 UNC	0.5561	0.5589	0.6052
3/4	10 UNC	0.6744	0.6773	0.7288
7/8	9 UNC	0.7914	0.7946	0.8523
1	8 UNC	0.9067	0.9100	0.9755
1 1/8	7 UNC	1.0191	1.0228	1.0982
1 1/4	7 UNC	1.1439	1.1476	1.2232
1 1/2	6 UNC	1.3772	1.3812	1.4703
1 3/4	5 UNC	1.6040	1.6085	1.7165
2	4 1/2 UNC	1.8385	1.8433	1.9641
2 1/4	4 1/2 UNC	2.0882	2.0931	2.2141
2 1/2	4 UNC	2.3190	2.3241	2.4612
2 3/4	4 UNC	2.5686	2.5739	2.7111
3	4 UNC	2.8183	2.8237	2.9611
3 1/4	4 UNC	3.0680	3.0734	3.2110
3 1/2	4 UNC	3.3177	3.3233	3.4610
3 3/4	4 UNC	3.5674	3.5730	3.7109
4	4 UNC	3.8172	3.8229	3.9609
8 Thread Series (8UN)				
1 1/8	8 UN	...	1.0348	1.1004
1 1/4	8 UN	...	1.1597	1.2254
1 1/2	8 UN	...	1.4093	1.4753
1 3/4	8 UN	...	1.6590	1.7252
2	8 UN	...	1.9087	1.9752
2 1/4	8 UN	...	2.1584	2.2251
2 1/2	8 UN	...	2.4082	2.4751
2 3/4	8 UN	...	2.6580	2.7250
3	8 UN	...	2.9077	2.9749
3 1/4	8 UN	...	3.1575	3.2249
3 1/2	8 UN	...	3.4074	3.4749
3 3/4	8 UN	...	3.6571	3.7248
4	8 UN	...	3.9070	3.9748

^A Minimum body diameter is the same as minimum pitch diameter. Extracted from ANSI/ASME B 1.1.

^B Minimum body diameter is the same as minimum major diameter. Extracted from ANSI/ASME B 1.1 for Class 1A and Footnote 5 for Class 2A.

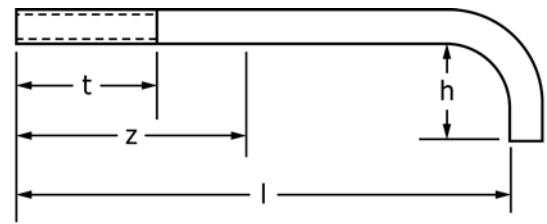

Anchor Bolt with Hook

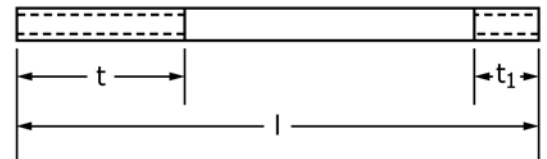

Straight Anchor Bolt

- h = length of hook
- l = length of bolt
- t = length of threads (exposed end)
- t₁ = length of threads (encased end), when required
- z = length of zinc coating, min, when partial zinc coating is required

FIG. 1 Anchor Bolt Dimensions

TABLE 6 Zinc Buildup on Coated Threads and Corresponding Thread Dimensions; Hot-Dip Zinc Coated in Accordance With Specification F2329

Nominal Size, in.	Threads/in.	Diametral Zinc Buildup, in. ^A	Anchor Bolt Diameter, max, in.	
			Major	Pitch
1/4	20	0.016	0.2649	0.2324
3/8	16	0.017	0.3907	0.3501
1/2	13	0.018	0.5165	0.4685
5/8	11	0.020	0.6434	0.5844
3/4	10	0.020	0.7682	0.7032
7/8	9	0.022	0.8951	0.8229
1	8	0.024	1.0220	0.9408
1 1/8	8	0.024	1.1469	1.0657
1 1/4	7	0.024	1.1468	1.0540
1 1/4	8	0.024	1.2719	1.1667
1 1/4	7	0.024	1.2718	1.5740
1 1/2	8	0.027	1.5248	1.4436
1 1/2	6	0.027	1.5246	1.4163
1 3/4	5	0.050	1.7973	1.6674
2	4.5	0.050	2.0471	1.9028
2 1/4	4.5	0.050	2.2971	2.1528
2 1/2	4	0.050	2.5469	2.3845
2 3/4	4	0.050	2.7968	2.6344
3	4	0.050	3.0468	2.8844
3 1/4	4	0.050	3.2967	3.1343
3 1/2	4	0.050	3.5467	3.3843
3 3/4	4	0.050	3.7966	3.6342
4	4	0.050	4.0466	3.8842

^A These values are the same as the overlap requirements for zinc-coated nuts given in Specification A563.

13.3.3 Tensile tests on finished anchor bolts apply only when bar stock tests are not available or applicable or heat treatment is performed after threading or bending.

13.4 *Retests*—If a single nonconforming characteristic is found in final inspection, the lot may be resampled for this characteristic with a sample four times the size of the original final acceptance sample. The acceptance criterion shall then be zero discrepancies in this larger sample.

13.5 Purchaser's Inspection:

13.5.1 If, on receipt of anchor bolts, the purchaser discovers a single nonconforming part, he may sample the lot for such nonconforming characteristic(s) in accordance with 13.3 using an acceptance number of zero.

13.5.2 If the nonconforming characteristic in 13.5.1 is thread dimension and the anchor bolt manufacturer or supplier contests the findings, the final determination of thread acceptability shall be as follows: a full-size axial tension test shall be made on the threaded anchor bolt and nut assembly at the manufacturer's or supplier's expense. The assembly shall develop the tensile load specified in Table 4.

14. Test Methods

14.1 *Chemical Composition*—Chemical analysis shall be conducted in accordance with Test Methods, Practices, and Terminology A751.

14.2 *Tensile Tests:*